
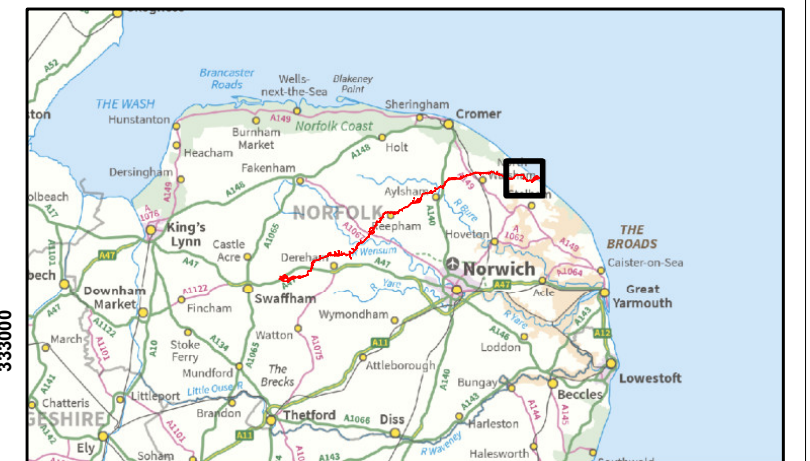


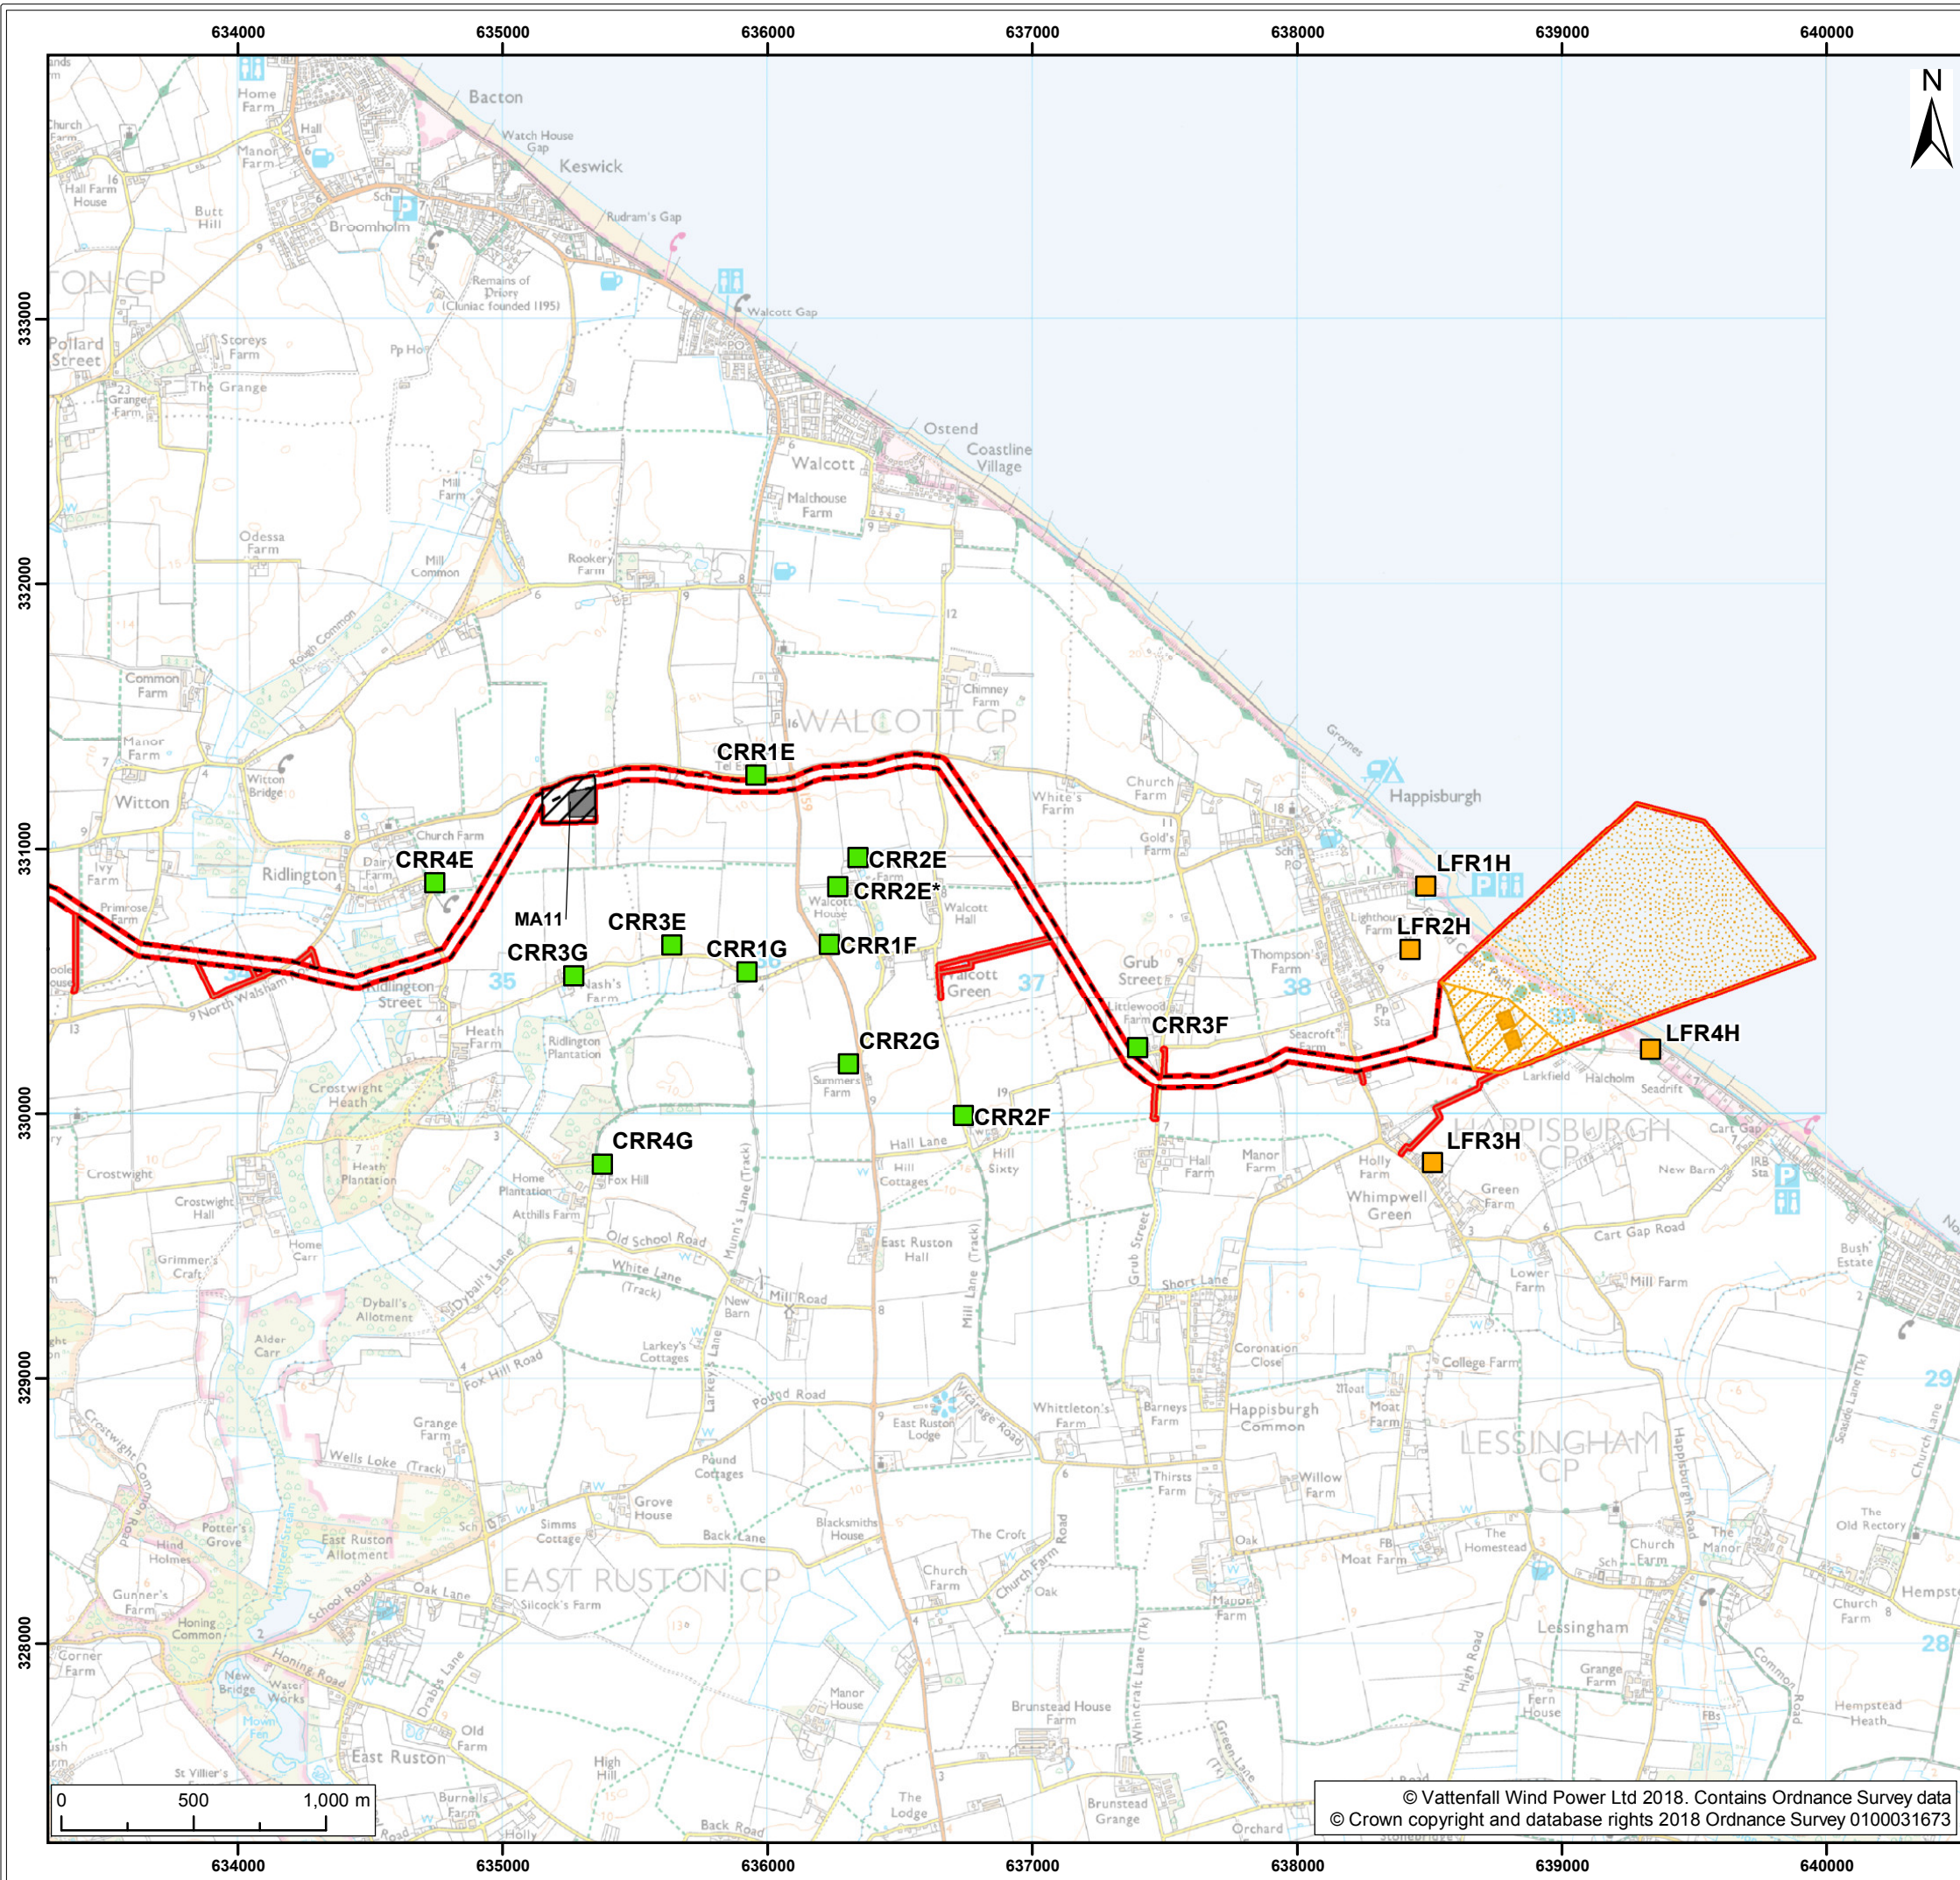

- Legend:
- Norfolk Vanguard onshore red line boundary
 - Landfall**
 - Landfall zone
 - Landfall compound zone
 - Indicative landfall compound
 - Onshore cable route**
 - Onshore cable route
 - Mobilisation zone
 - Indicative mobilisation area compound
 - Access**
 - Construction access
 - Operation access
 - Noise receptor location**
 - Landfall noise receptor location
 - Cable relay station noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement


Title:
Noise receptor locations
(map 1 of 9)

Figure: 25.2	Drawing No: PB4476-005-025-002				
Revision:	Date:	Drawn:	Checked:	Size:	Scale:
04	22/05/2018	NJ	MS	A3	1:25,000
03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700



© Vattenfall Wind Power Ltd 2018. Contains Ordnance Survey data
© Crown copyright and database rights 2018 Ordnance Survey 0100031673

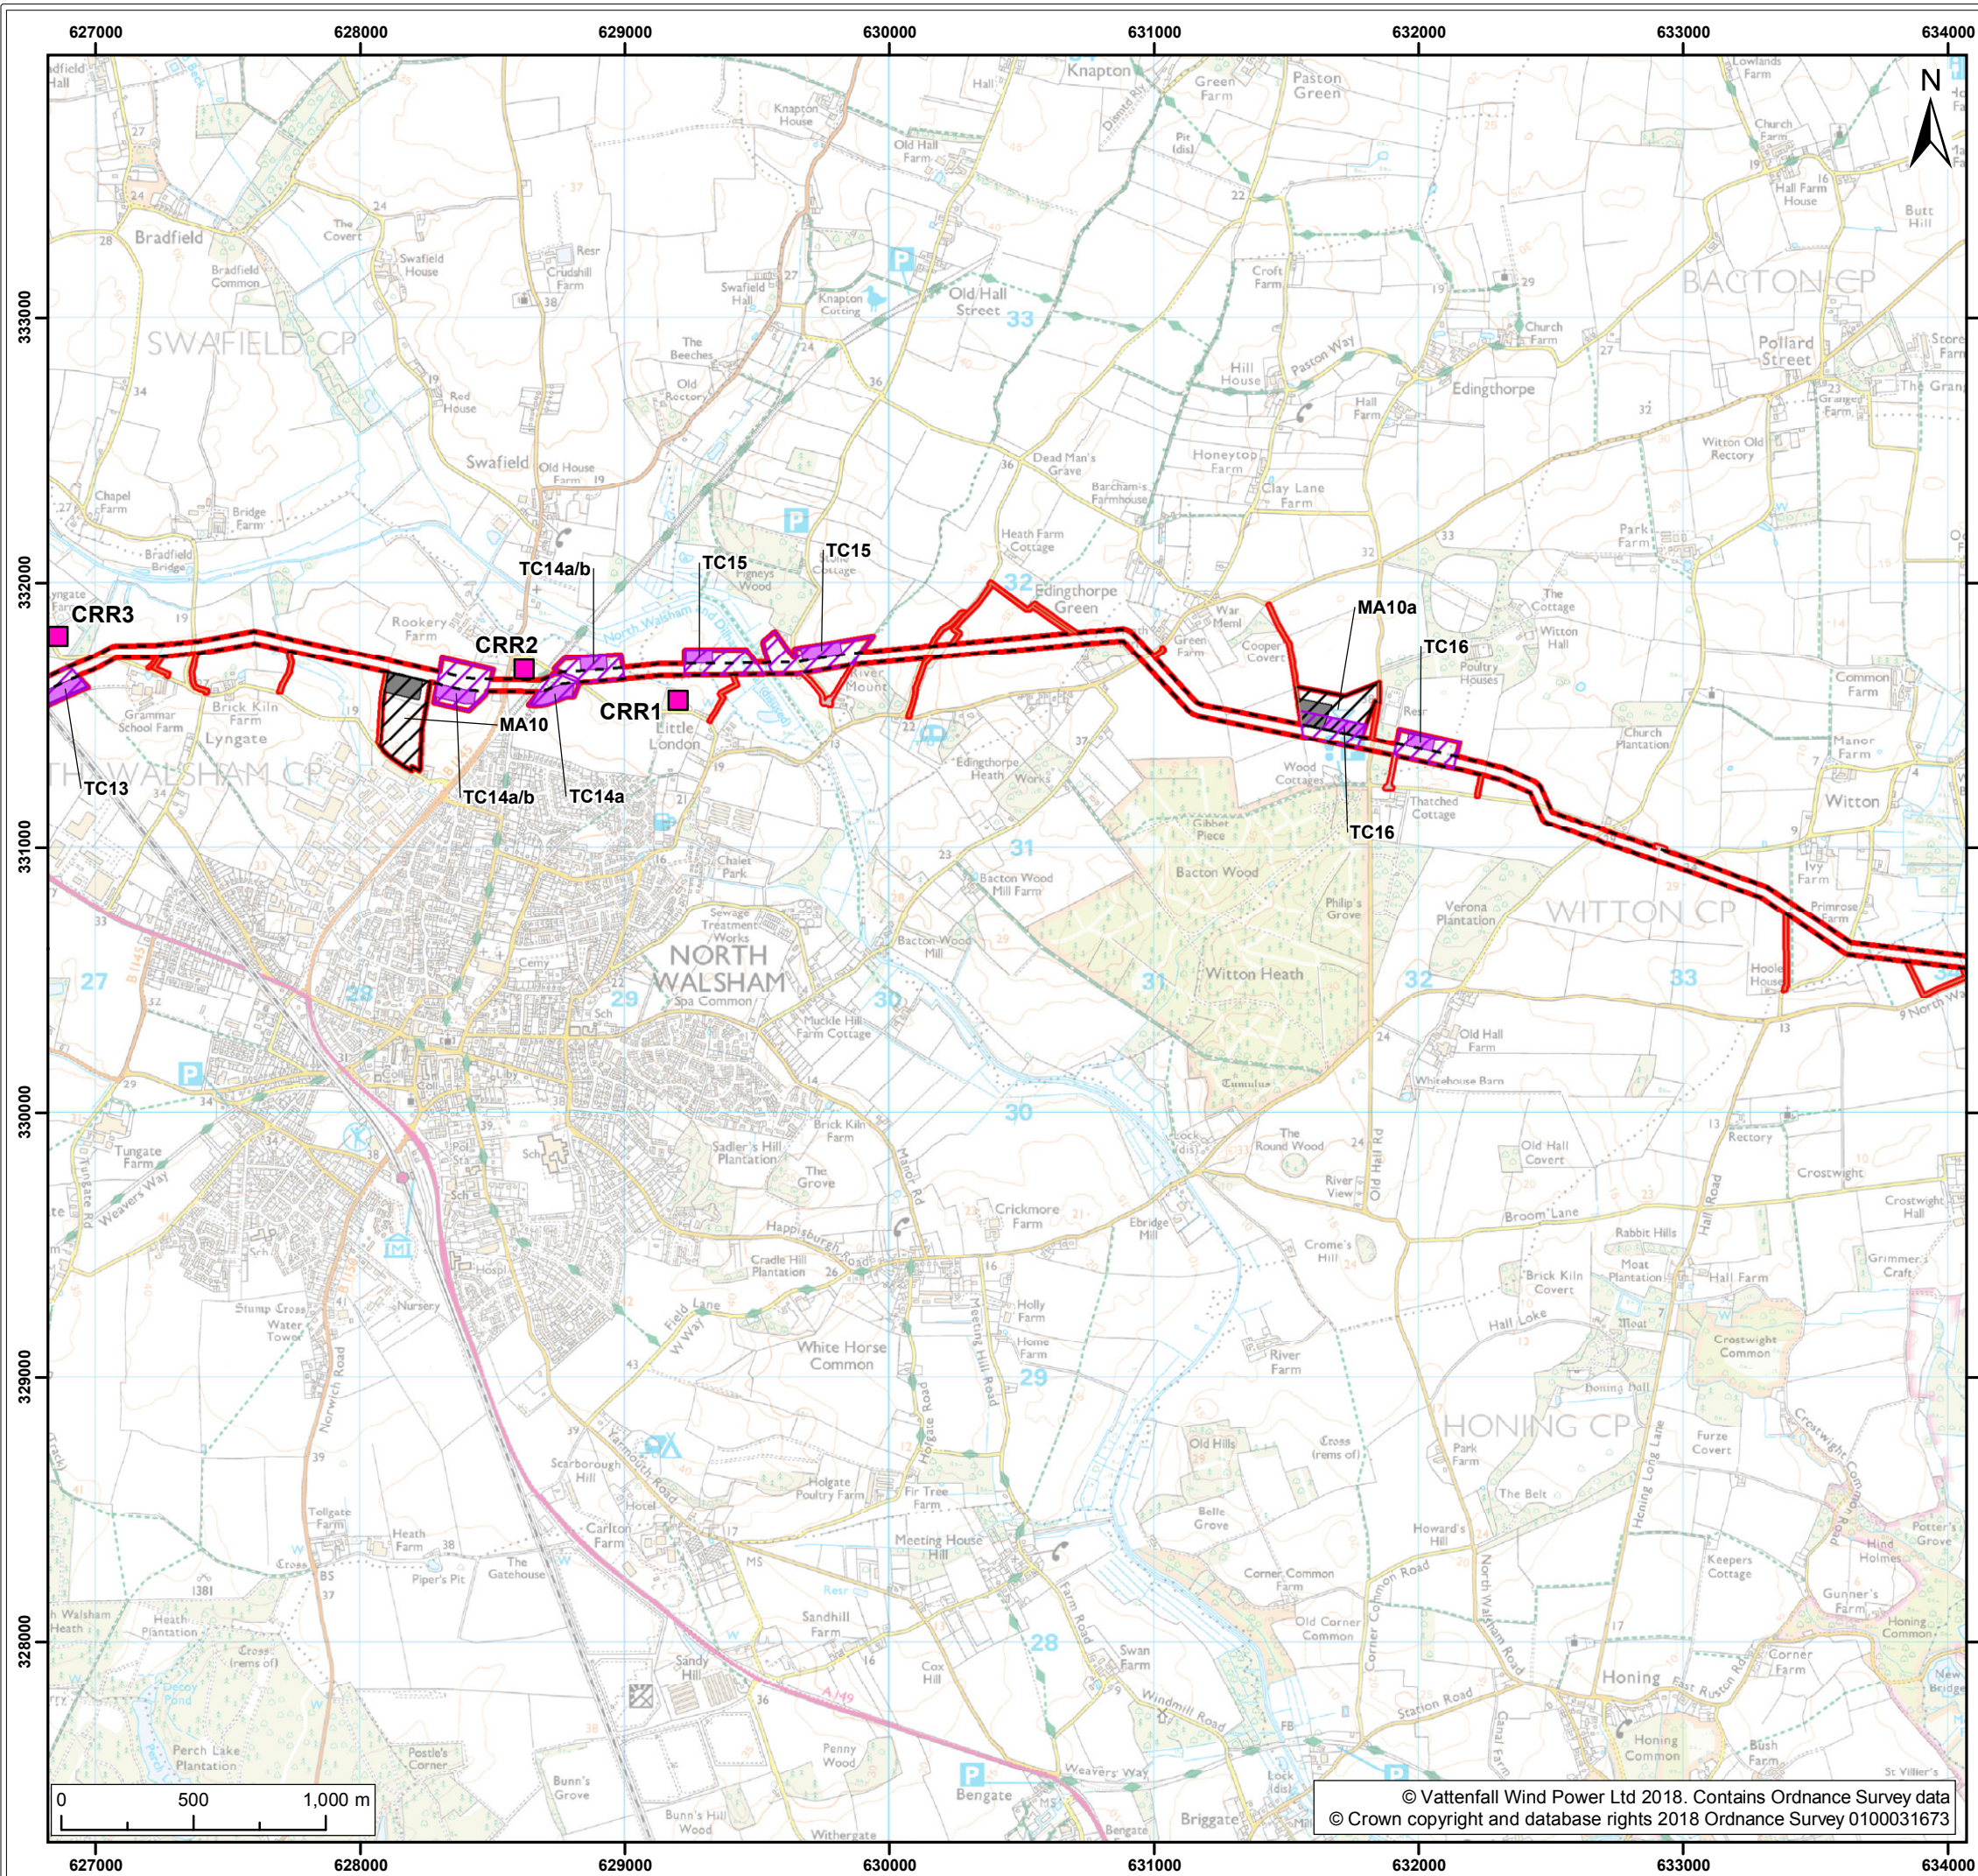

- Legend:
- Norfolk Vanguard onshore red line boundary
 - Onshore cable route
 - Trenchless crossing zone (e.g. HDD)
 - Indicative trenchless crossing compound
 - Mobilisation zone
 - Indicative mobilisation area compound
 - Access
 - Construction access
 - Operation access
 - Noise receptor location
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location


Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:
Noise receptor locations (map 2 of 9)

000

Figure:	25.2	Drawing No: PB4476-005-025-002				
Revision:	Date:	Drawn:	Checked:	Size:	Scale:	
04	22/05/2018	NJ	MS	A3	1:25,000	
03	26/04/2018	AB	MS	A3	1:25,000	

Co-ordinate system: British National Grid EPSG: 27700

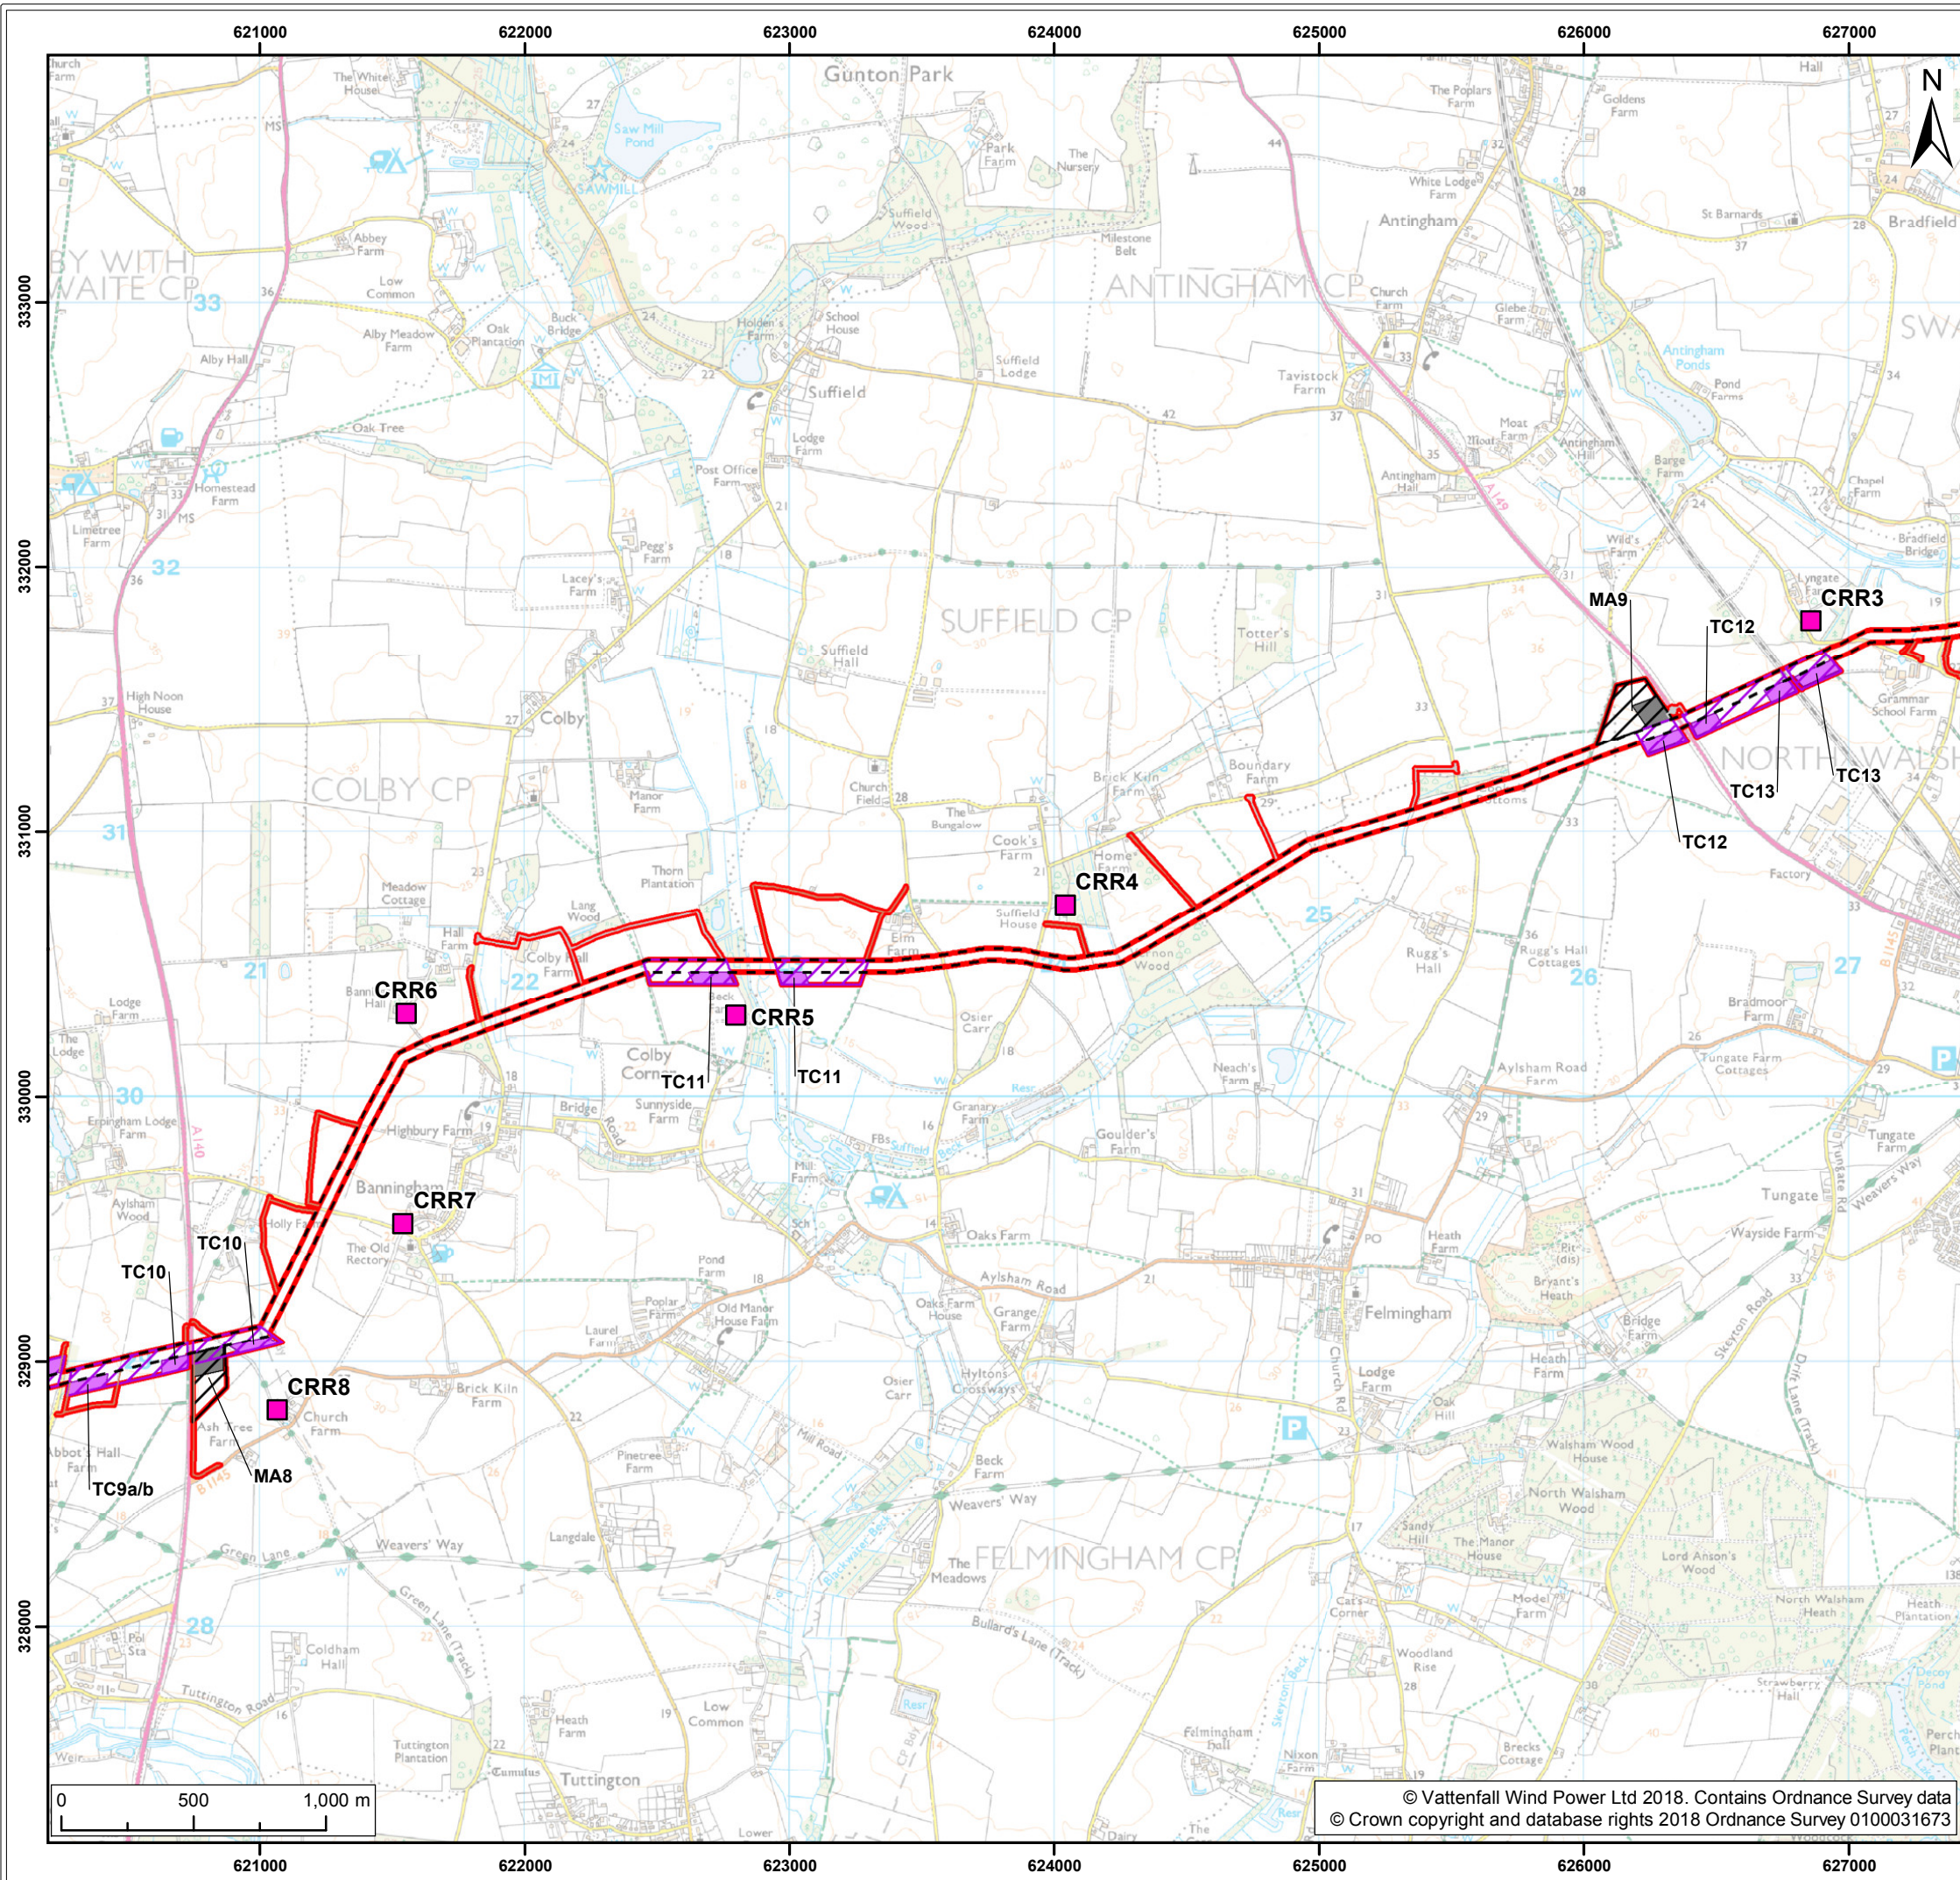

Legend:

- Norfolk Vanguard onshore red line boundary
- Onshore cable route**
 - Onshore cable route
 - Trenchless crossing zone (e.g. HDD)
 - Indicative trenchless crossing compound
 - Mobilisation zone
 - Indicative mobilisation area compound
- Access**
 - Construction access
 - Operation access
- Noise receptor location**
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:


Noise receptor locations
(map 3 of 9)

00082

Figure:	25.2	Drawing No: PB4476-005-025-002				
Revision:	Date:	Drawn:	Checked:	Size:	Scale:	
04	22/05/2018	NJ	MS	A3	1:25,000	
03	26/04/2018	AB	MS	A3	1:25,000	

Co-ordinate system: British National Grid EPSG: 27700



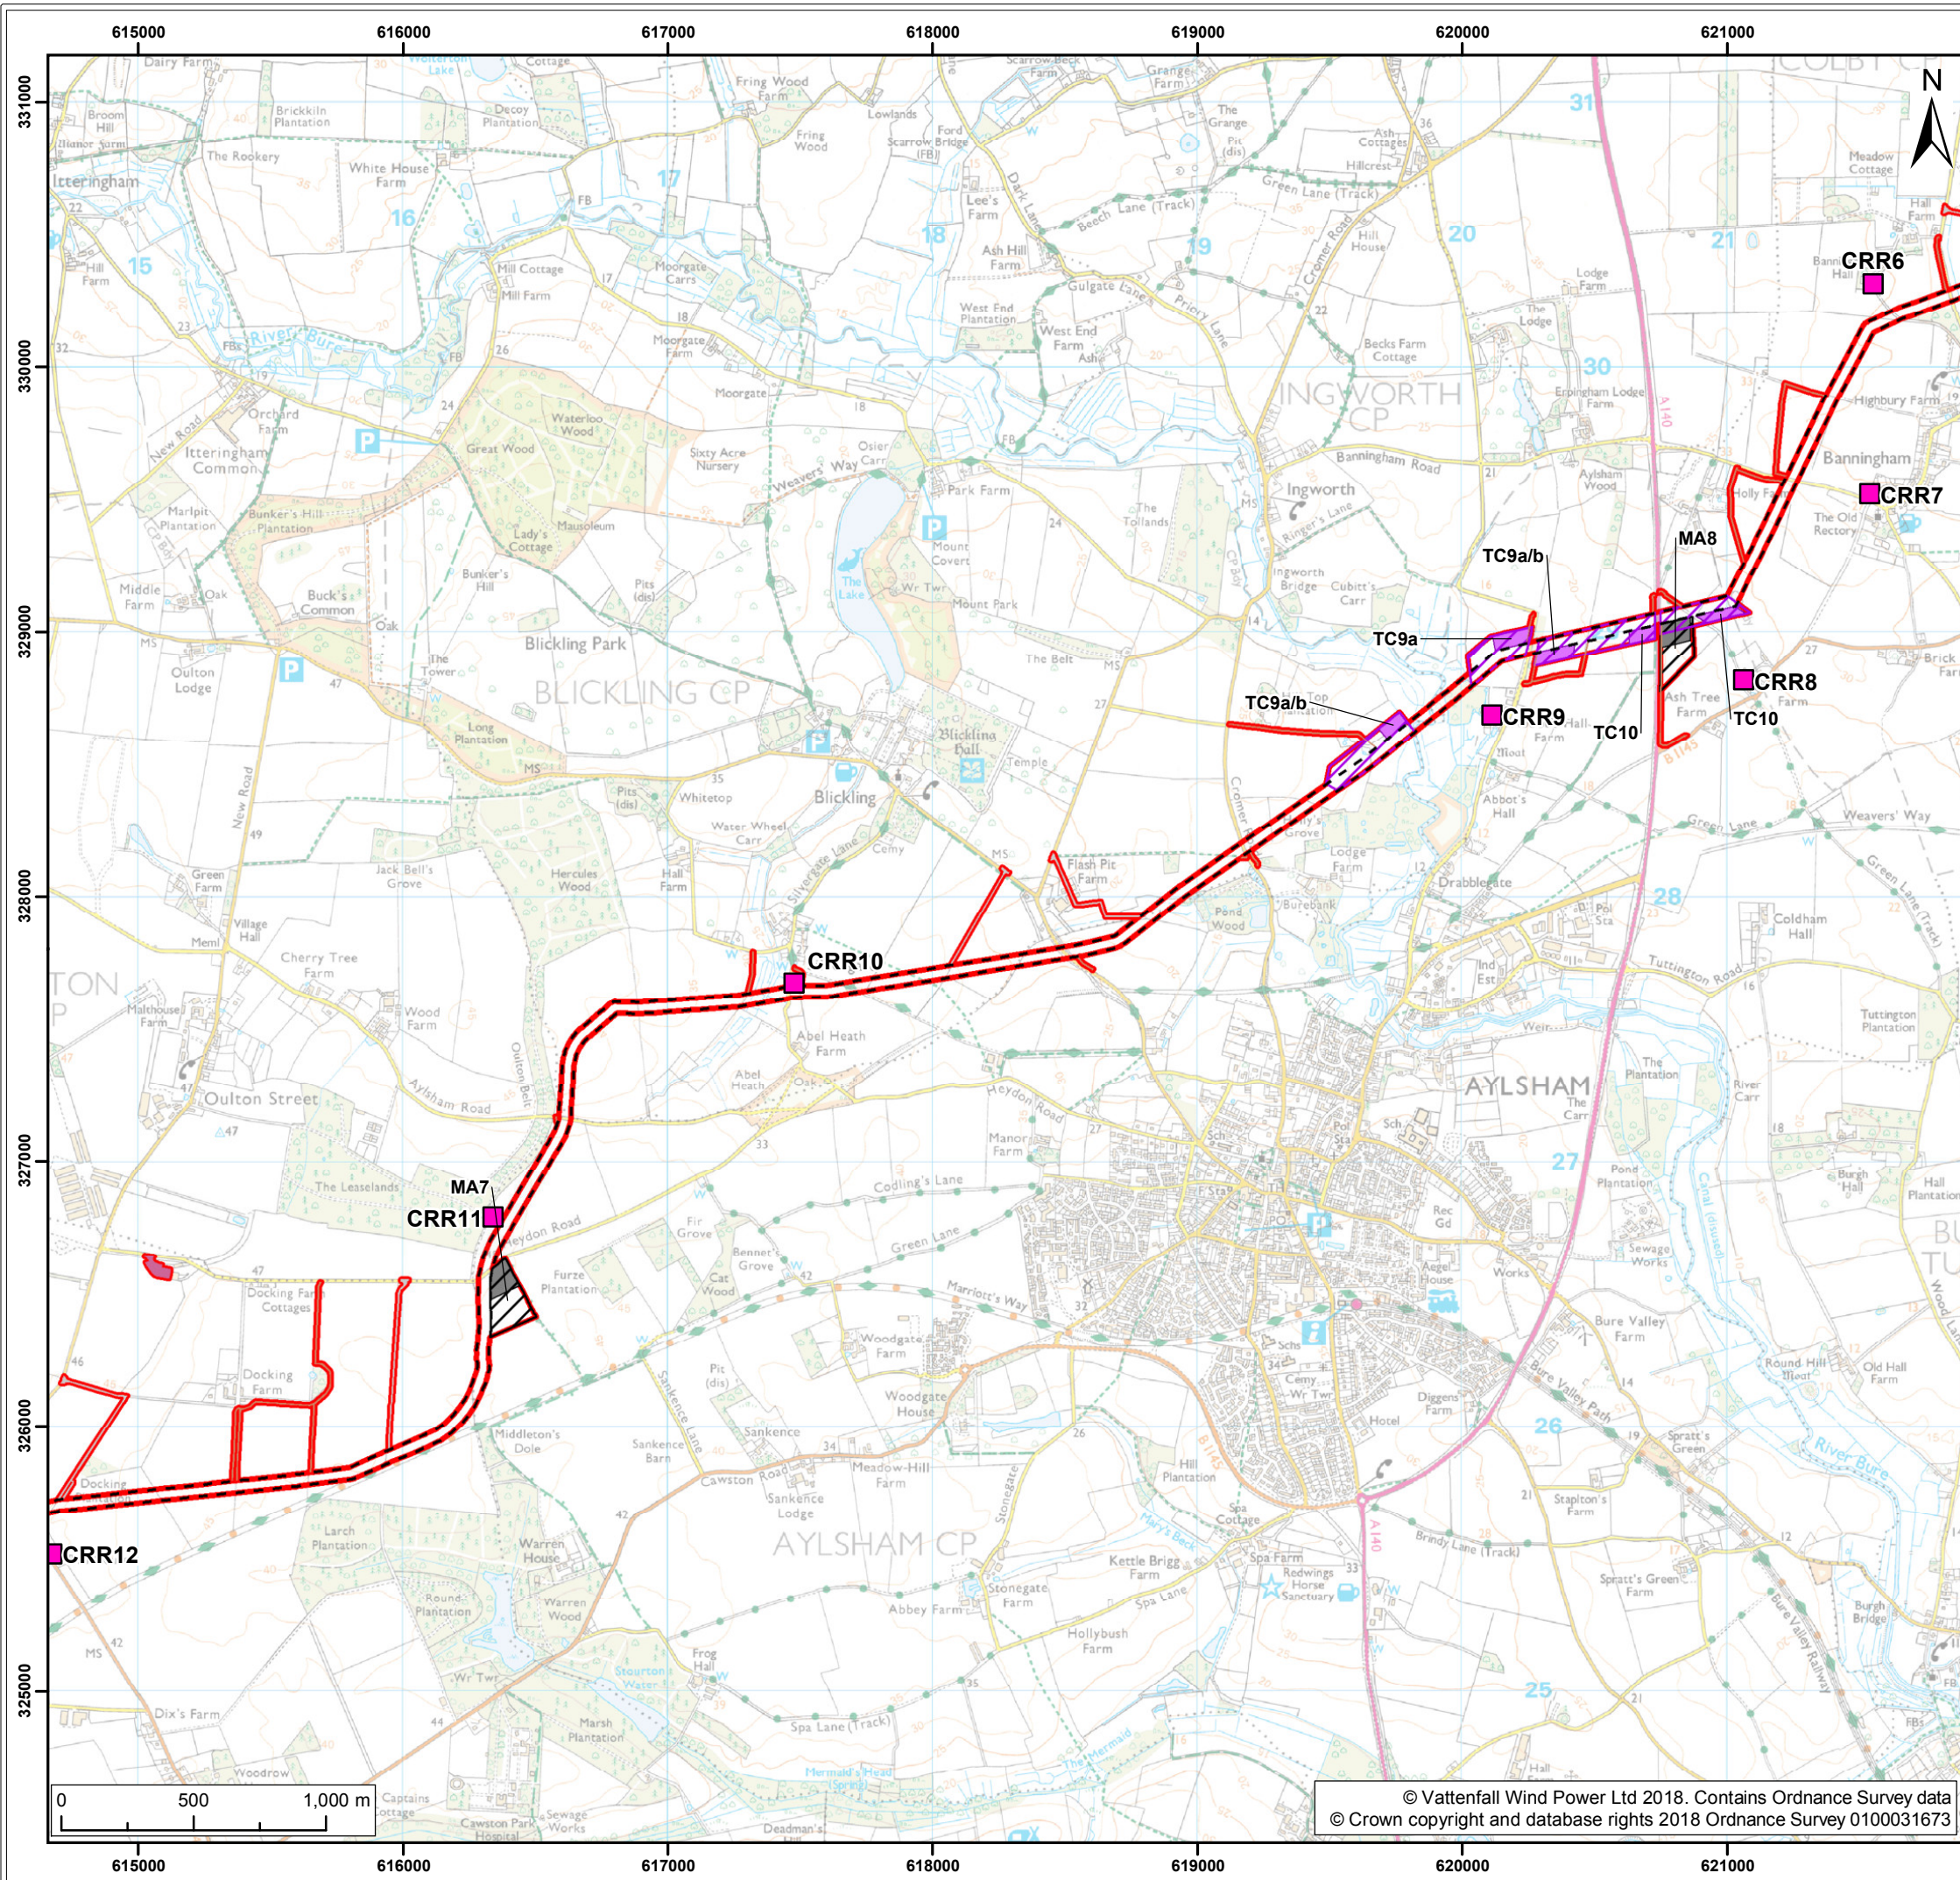

Legend:

- Norfolk Vanguard onshore red line boundary
- Onshore cable route**
 - Onshore cable route
 - Trenchless crossing zone (e.g. HDD)
 - Indicative trenchless crossing compound
 - Mobilisation zone
 - Indicative mobilisation area compound
 - Cable logistics area
- Access**
 - Construction access
 - Operation access
- Noise receptor location**
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement


Title:

Noise receptor locations
(map 4 of 9)

Figure: 25.2		Drawing No: PB4476-005-025-002			
Revision:	Date:	Drawn:	Checked:	Size:	Scale:
04	22/05/2018	NJ	MS	A3	1:25,000
03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700

© Vattenfall Wind Power Ltd 2018. Contains Ordnance Survey data
© Crown copyright and database rights 2018 Ordnance Survey 0100031673

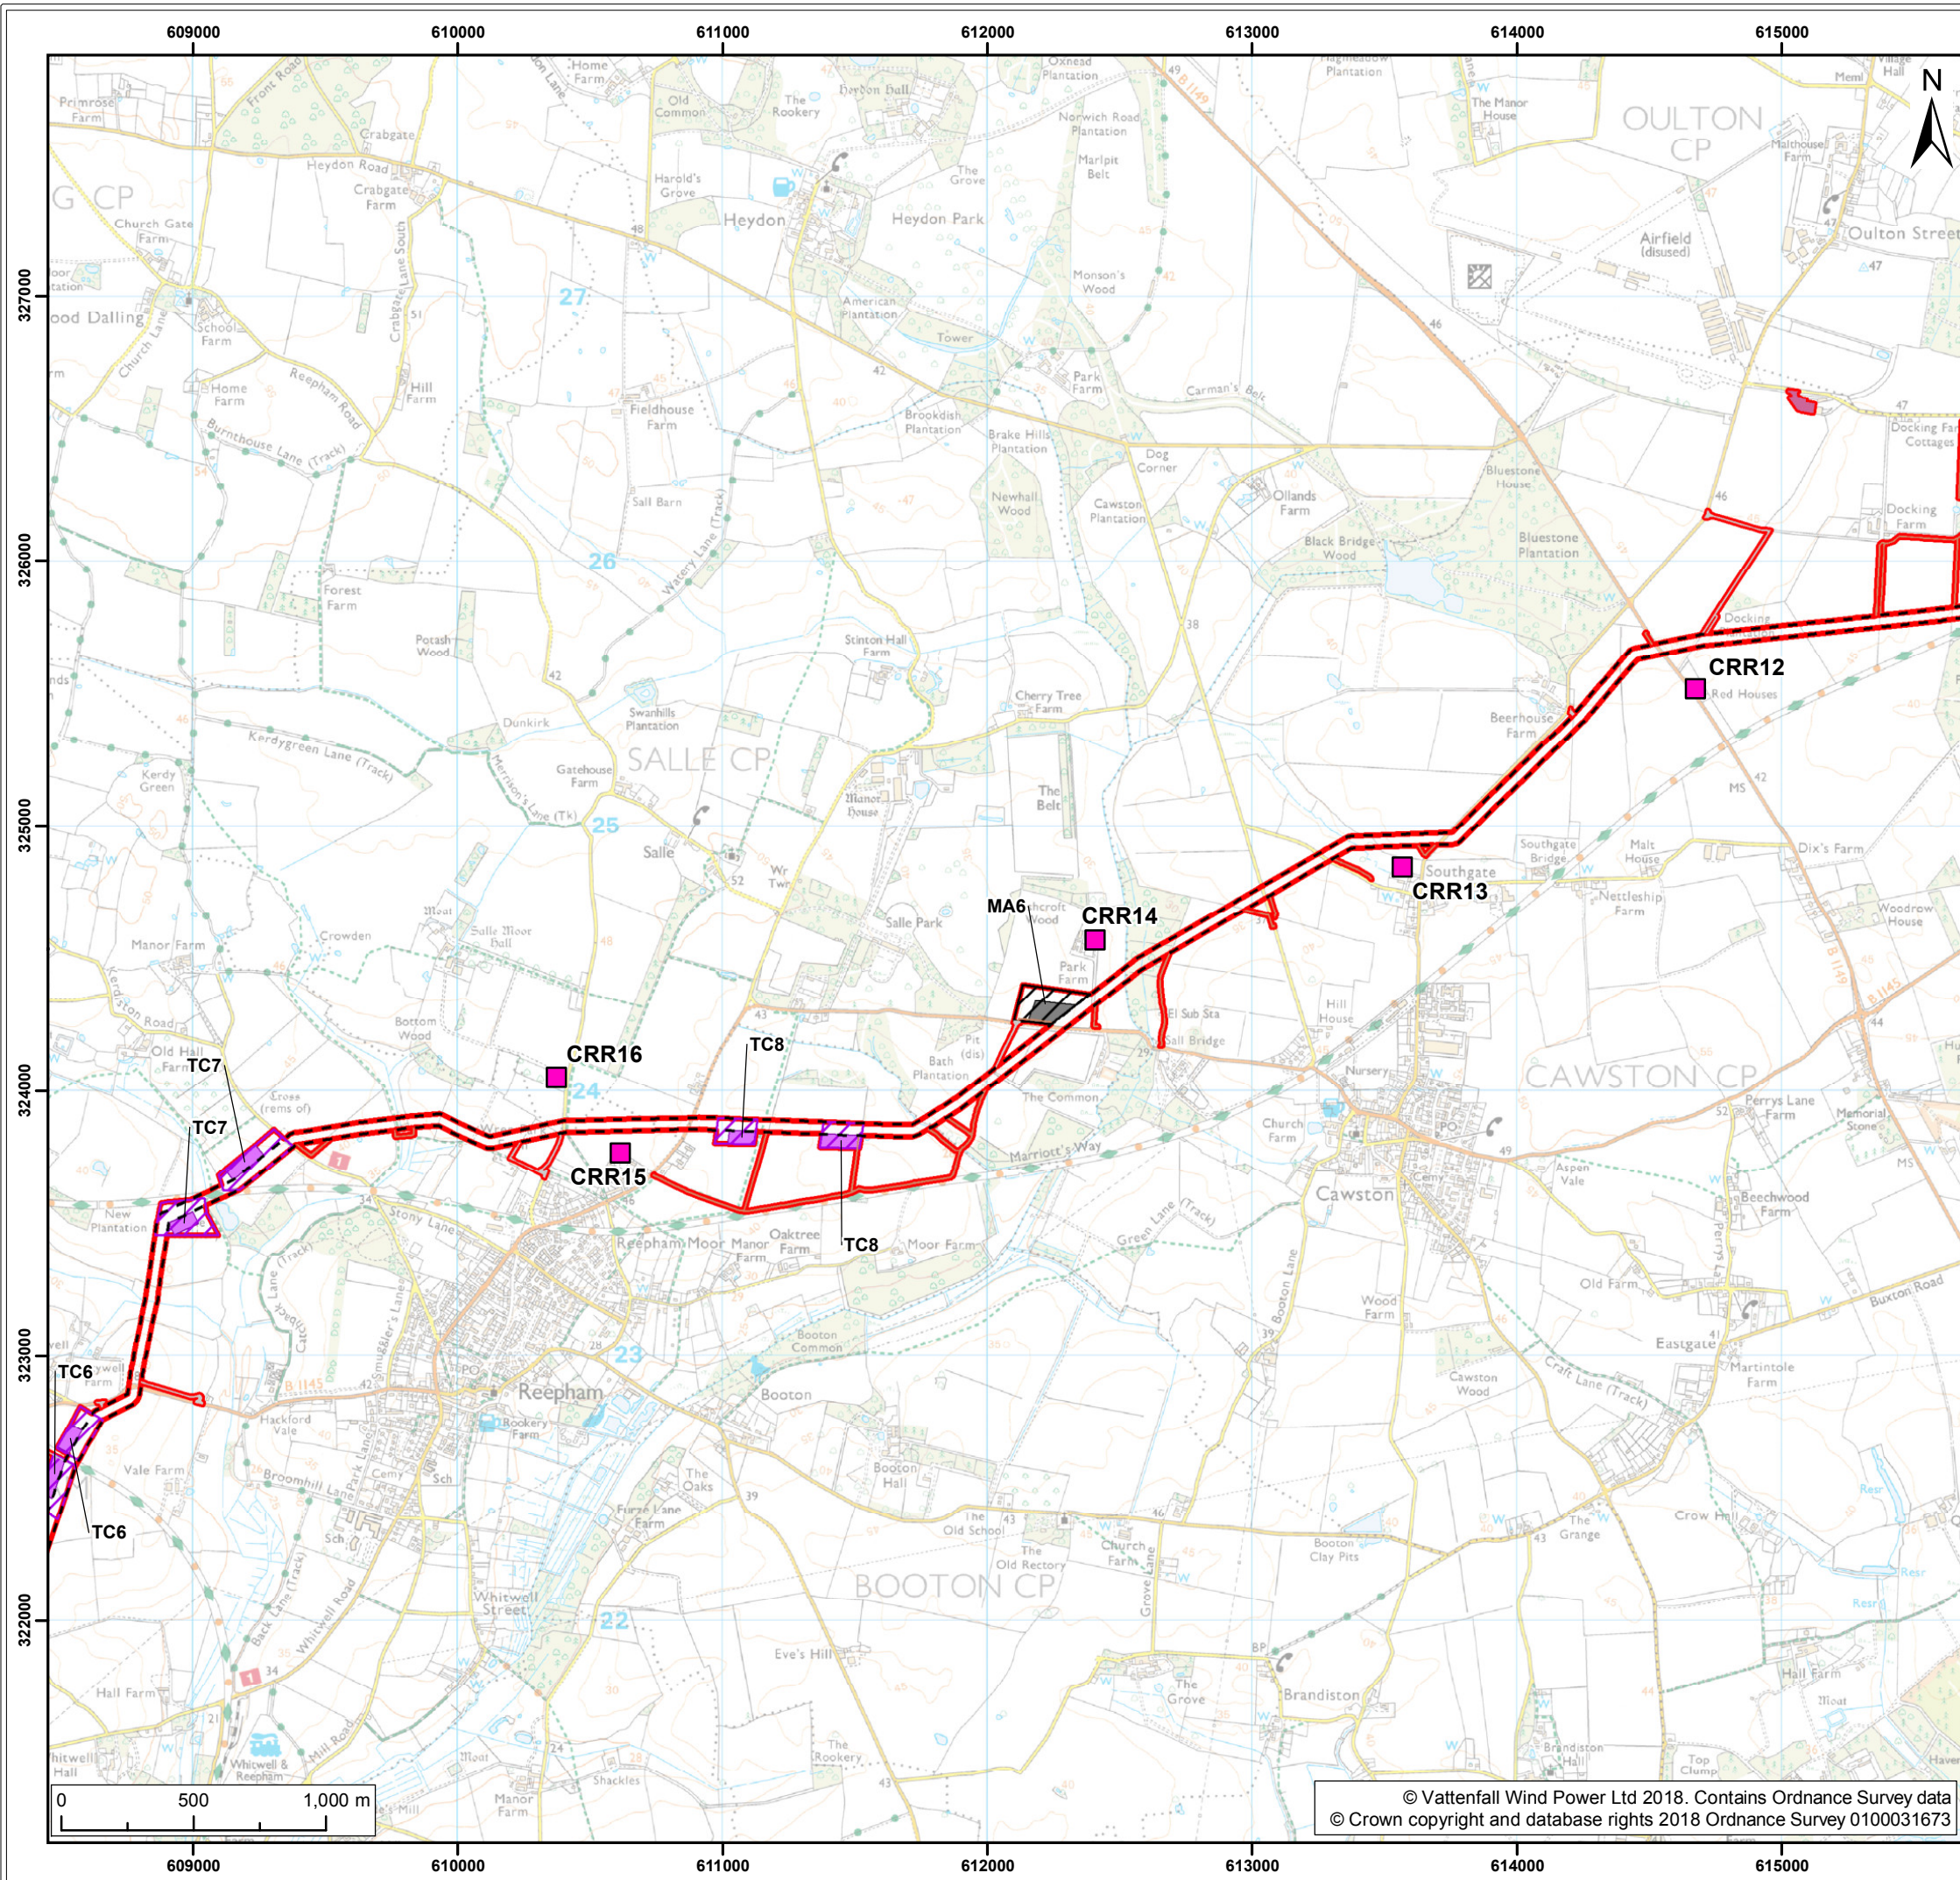

- Legend:
- Norfolk Vanguard onshore red line boundary
 - Onshore cable route**
 - Onshore cable route
 - Trenchless crossing zone (e.g. HDD)
 - Indicative trenchless crossing compound
 - Mobilisation zone
 - Indicative mobilisation area compound
 - Cable logistics area
 - Access**
 - Construction access
 - Operation access
 - Noise receptor location**
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:


Noise receptor locations
(map 5 of 9)

Figure: 25.2		Drawing No: PB4476-005-025-002			
Revision:	Date:	Drawn:	Checked:	Size:	Scale:
04	22/05/2018	NJ	MS	A3	1:25,000
03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700



© Vattenfall Wind Power Ltd 2018. Contains Ordnance Survey data
© Crown copyright and database rights 2018 Ordnance Survey 0100031673

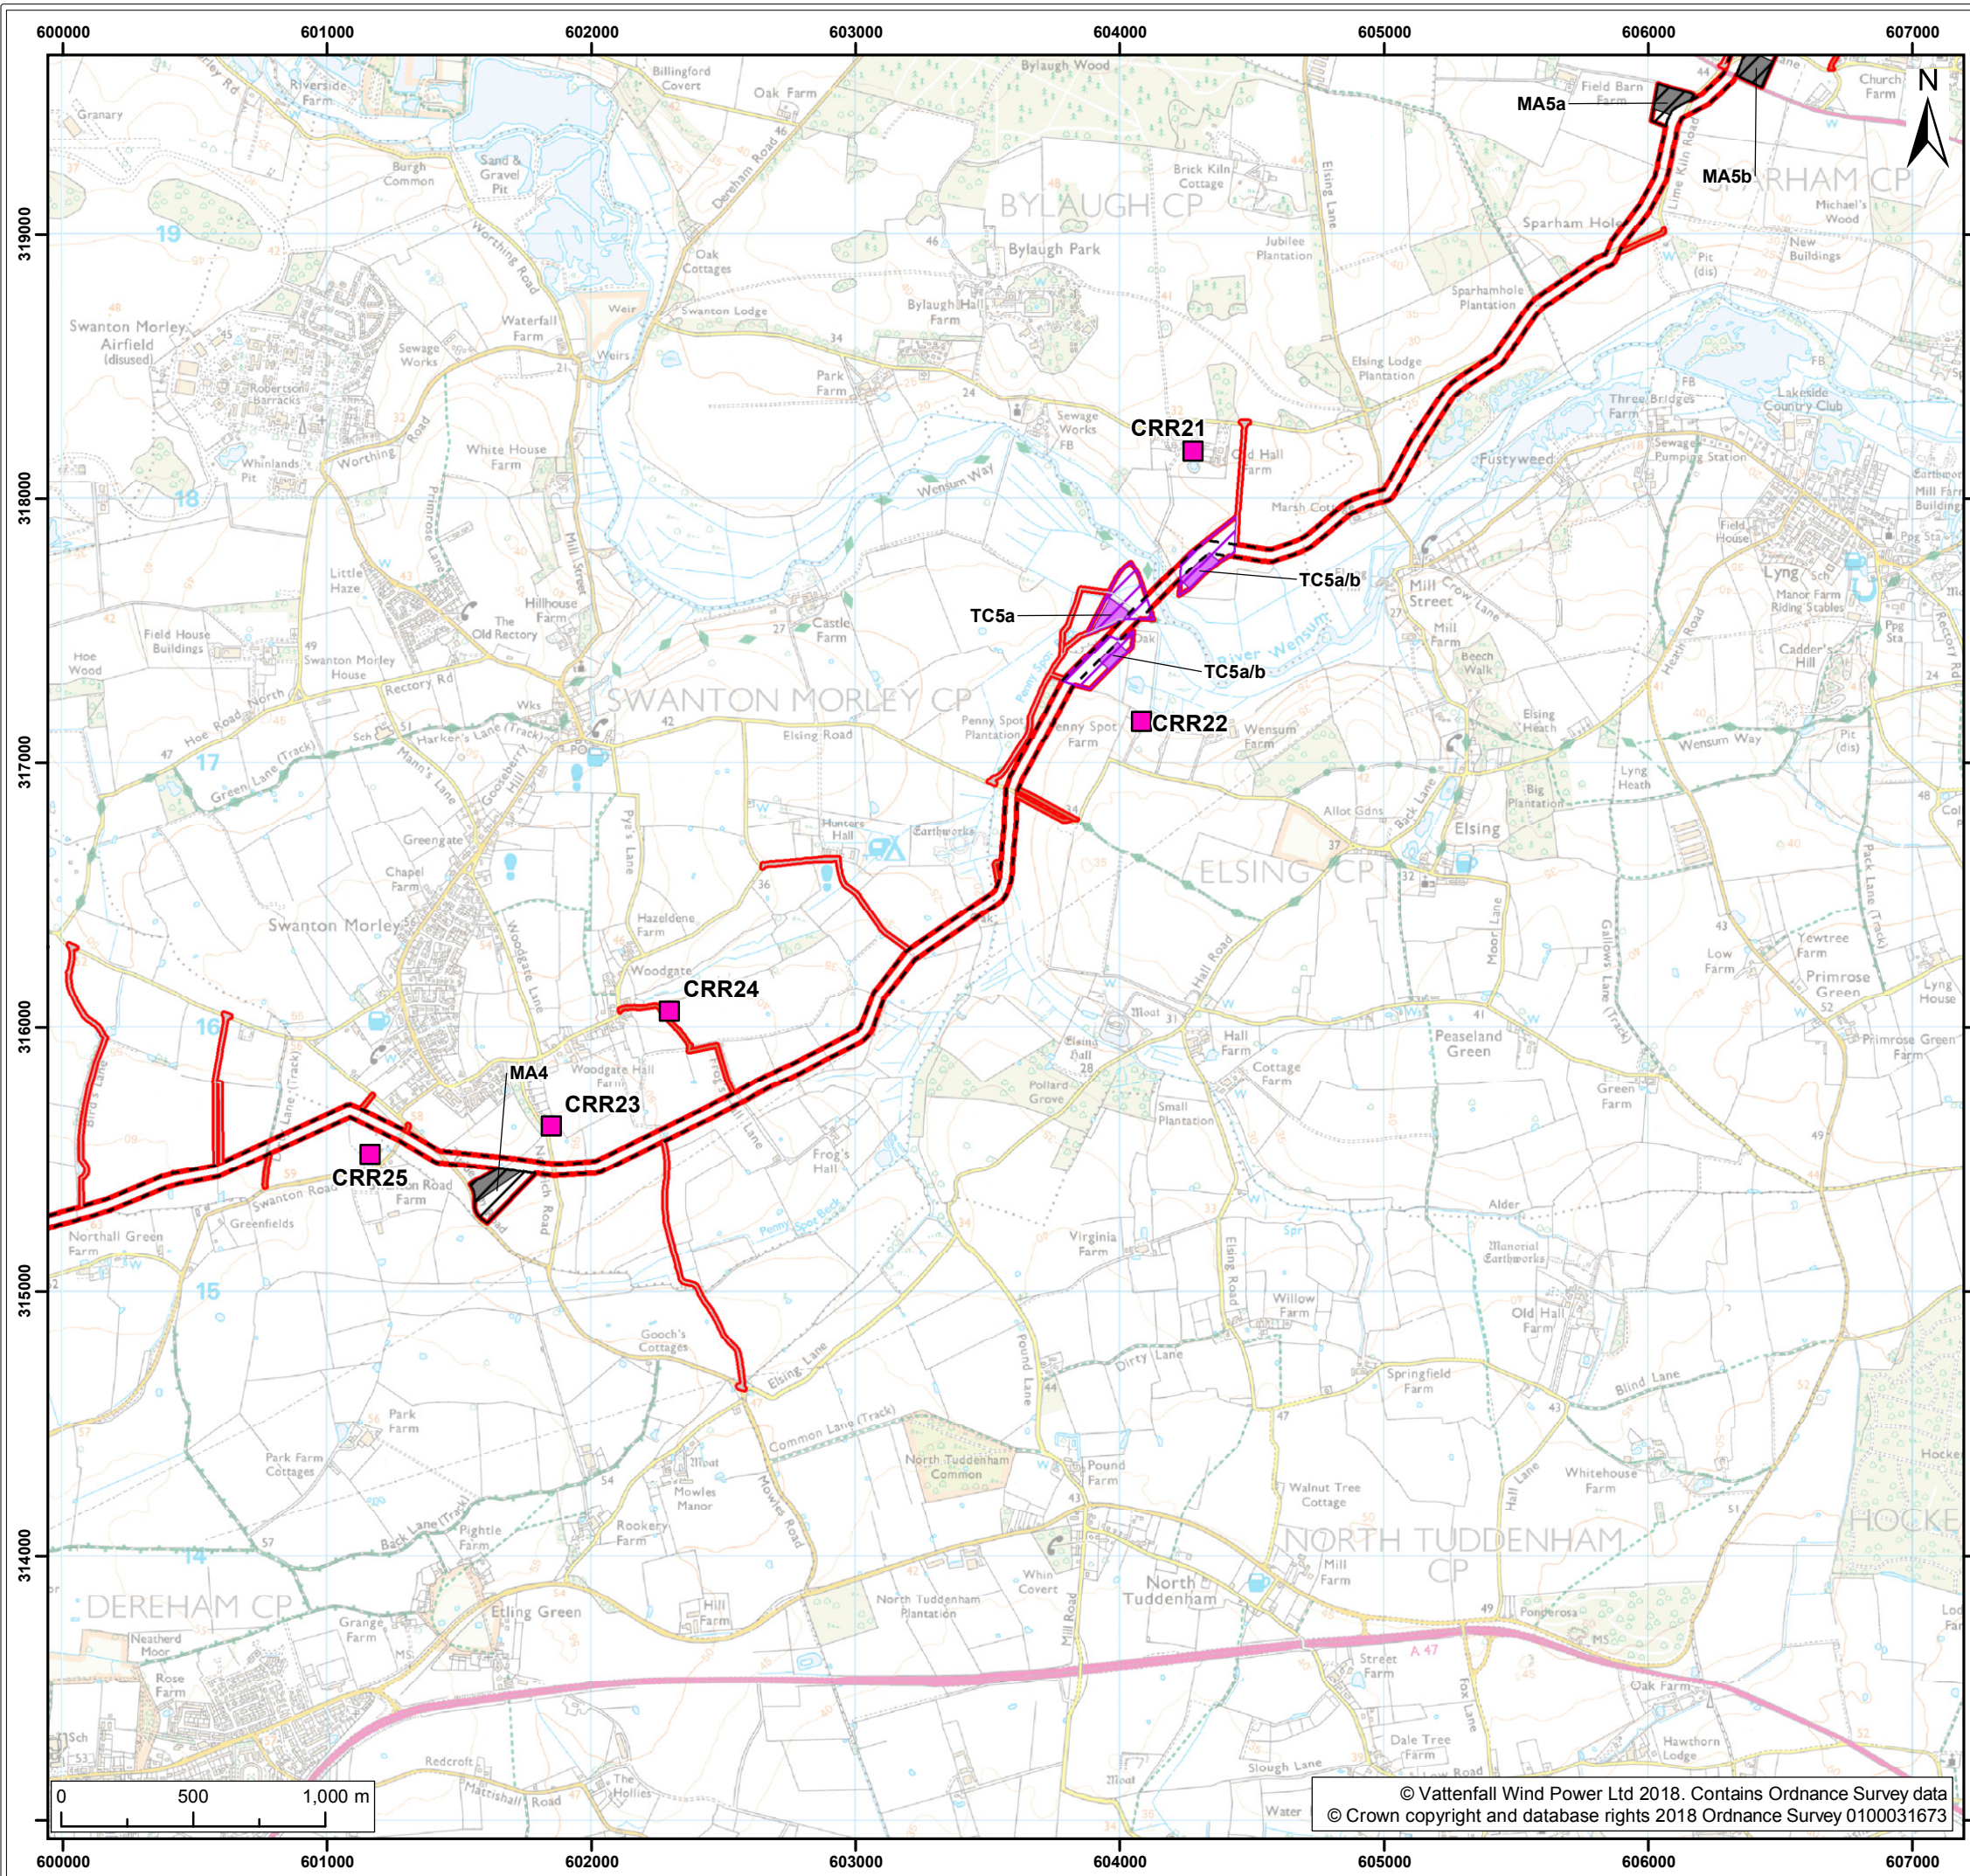

Legend:

- Norfolk Vanguard onshore red line boundary
- Onshore cable route
- Trenchless crossing zone (e.g. HDD)
- Indicative trenchless crossing compound
- Mobilisation zone
- Indicative mobilisation area compound
- Access
 - Construction access
 - Operation access
- Noise receptor location
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:

Noise receptor locations (map 7 of 9)


Figure: 25.2		Drawing No: PB4476-005-025-002			
Revision:	Date:	Drawn:	Checked:	Size:	Scale:
04	22/05/2018	NJ	MS	A3	1:25,000
03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700

VATTENFALL




Enhancing Society Together

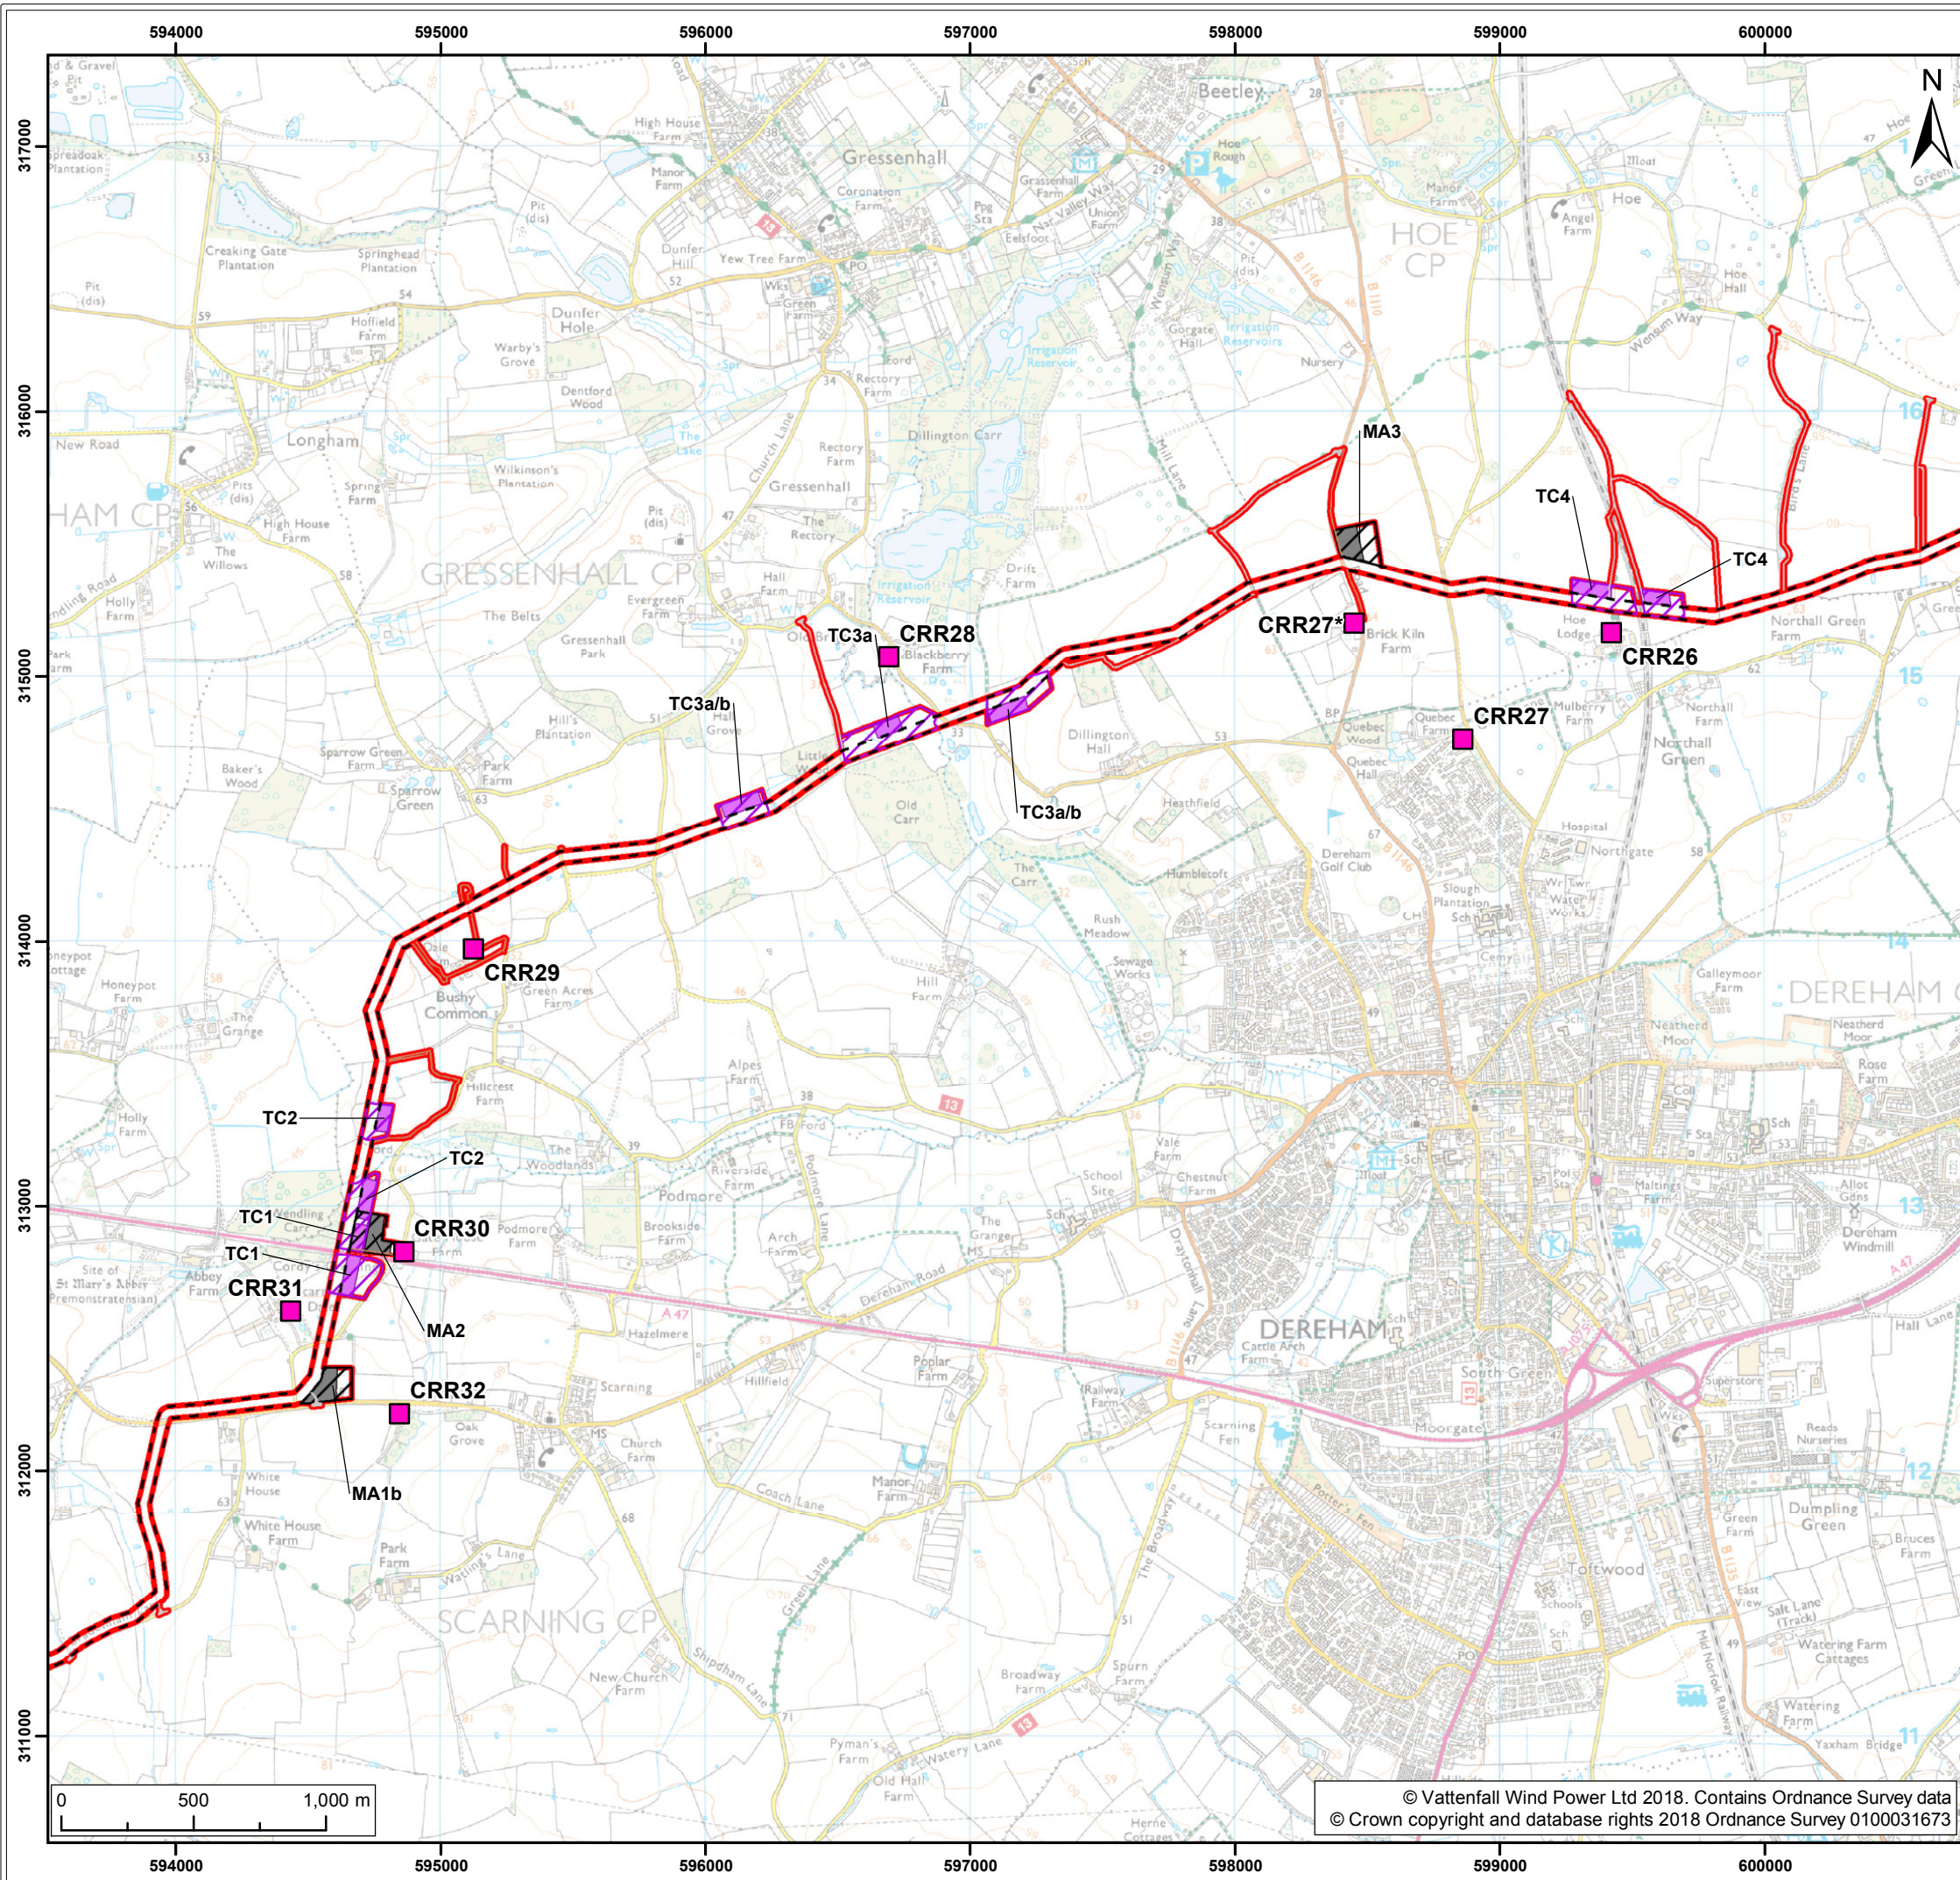

- Legend:
- Norfolk Vanguard onshore red line boundary
 - Onshore cable route
 - Trenchless crossing zone (e.g. HDD)
 - Indicative trenchless crossing compound
 - Mobilisation zone
 - Indicative mobilisation area compound
 - Access
 - Construction access
 - Operation access
 - Noise receptor location
 - Onshore cable corridor noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:

Noise receptor locations
(map 8 of 9)


3	Figure: 25.2		Drawing No: PB4476-005-025-002			
	Revision:	Date:	Drawn:	Checked:	Size:	Scale:
	04	22/05/2018	NJ	MS	A3	1:25,000
	03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700

VATTENFALL




Enhancing Society Together

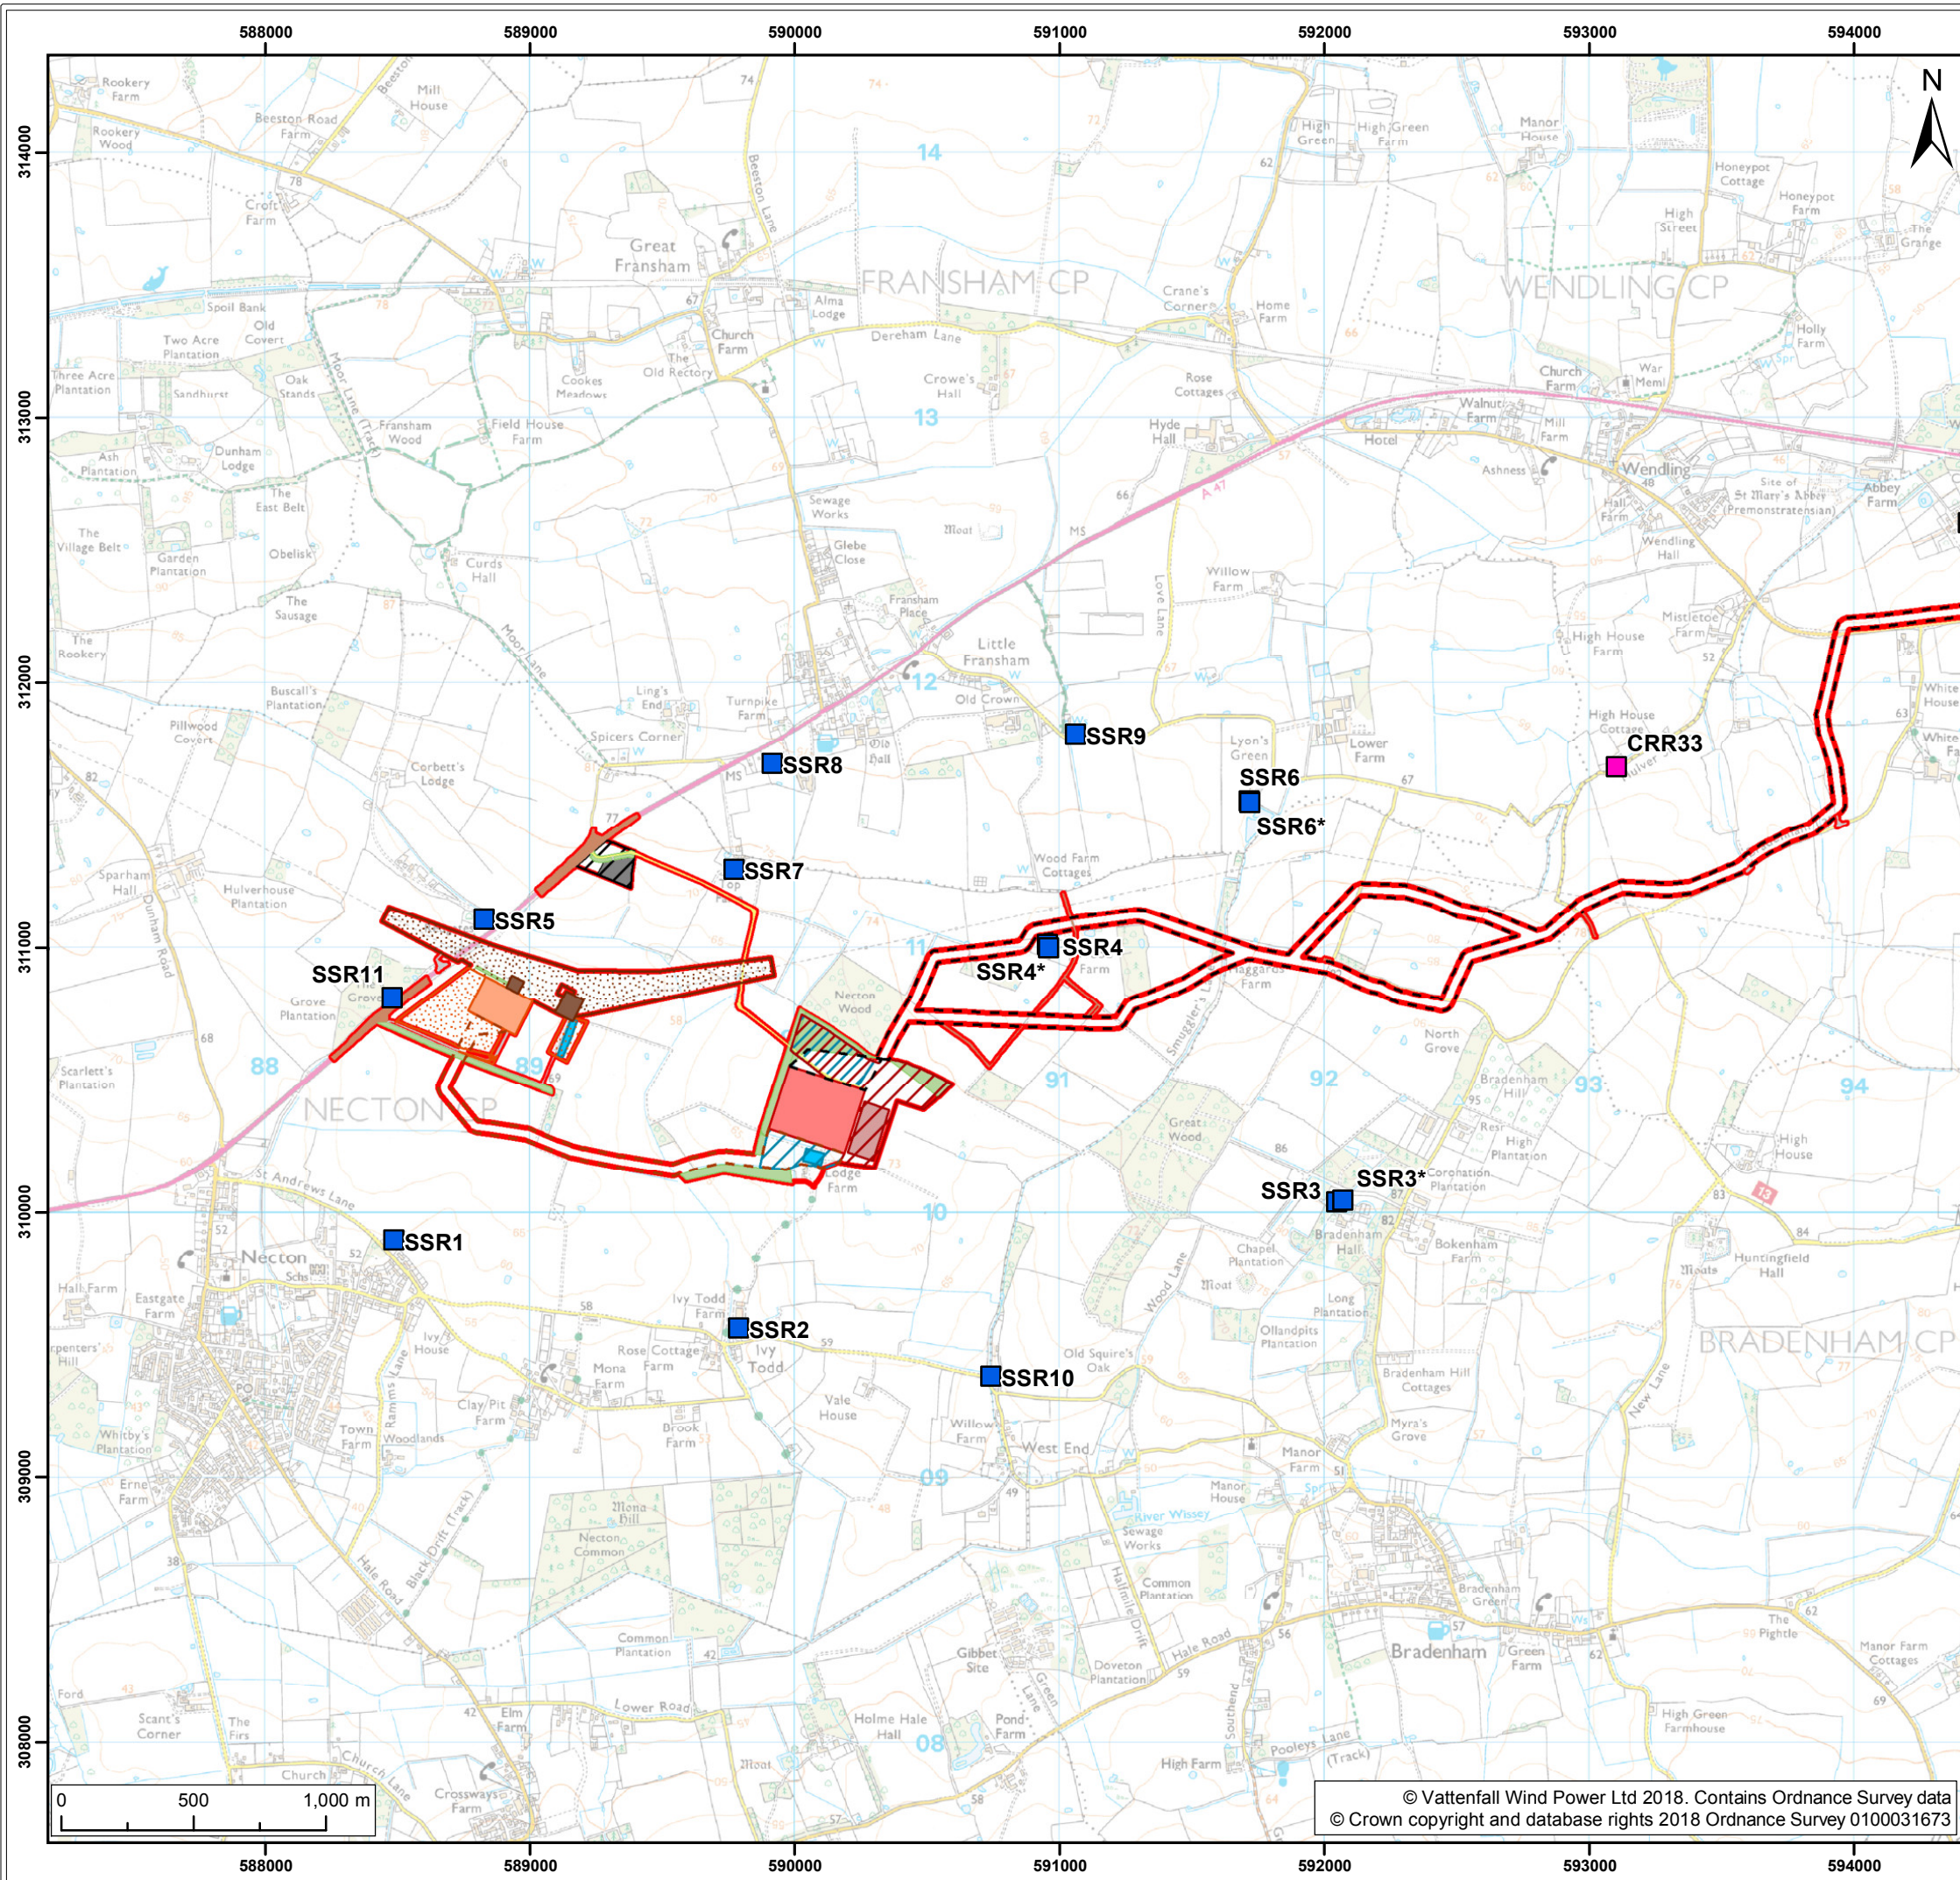

Legend:

- Norfolk Vanguard onshore red line boundary
- Onshore cable route
- Onshore 400kv cable route
- Mobilisation zone
- Indicative mobilisation area compound
- Access
 - Permanent access
 - Construction access
 - Operation access
- Onshore project substation
 - Onshore project substation
 - Onshore project substation temporary construction compound zone
 - Indicative onshore project substation temporary construction compound
- National Grid
 - National Grid substation extension
 - National Grid new / replacement overhead line tower
 - National Grid temporary works
 - Overhead line temporary works
- Mitigation areas
 - Attenuation pond zone
 - Indicative attenuation pond
 - Indicative mitigation planting
- Noise receptor location
 - Onshore cable corridor noise receptor location
 - Onshore project substation noise receptor location

Note: *alternative monitoring location

Project:	Report:
Norfolk Vanguard	Environmental Statement

Title:

Noise receptor locations (map 9 of 9)

30600

Figure: 25.2	Drawing No: PB4476-005-025-002				
Revision:	Date:	Drawn:	Checked:	Size:	Scale:
04	22/05/2018	NJ	MS	A3	1:25,000
03	26/04/2018	AB	MS	A3	1:25,000

Co-ordinate system: British National Grid EPSG: 27700

VATTENFALL

Royal HaskoningDHV
Enhancing Society Together