
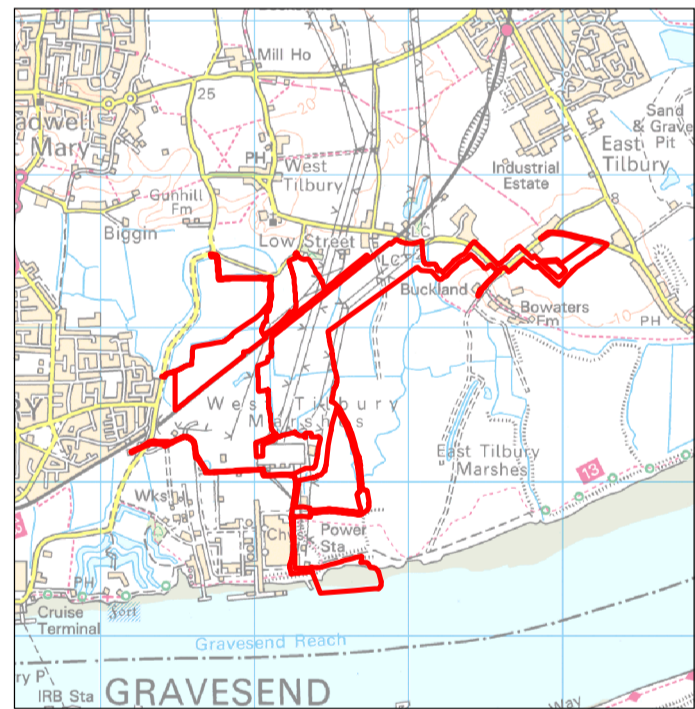



Legend

 Order Limits



Date: 19/05/2020
Created by: MS
Checked by: TD
Doc no: 10872-0136-21
Scale: A1@ 1:10,000
Reference System: OSGB36
Projection: BNG




Rev	Date	Remark




APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Index Sheet

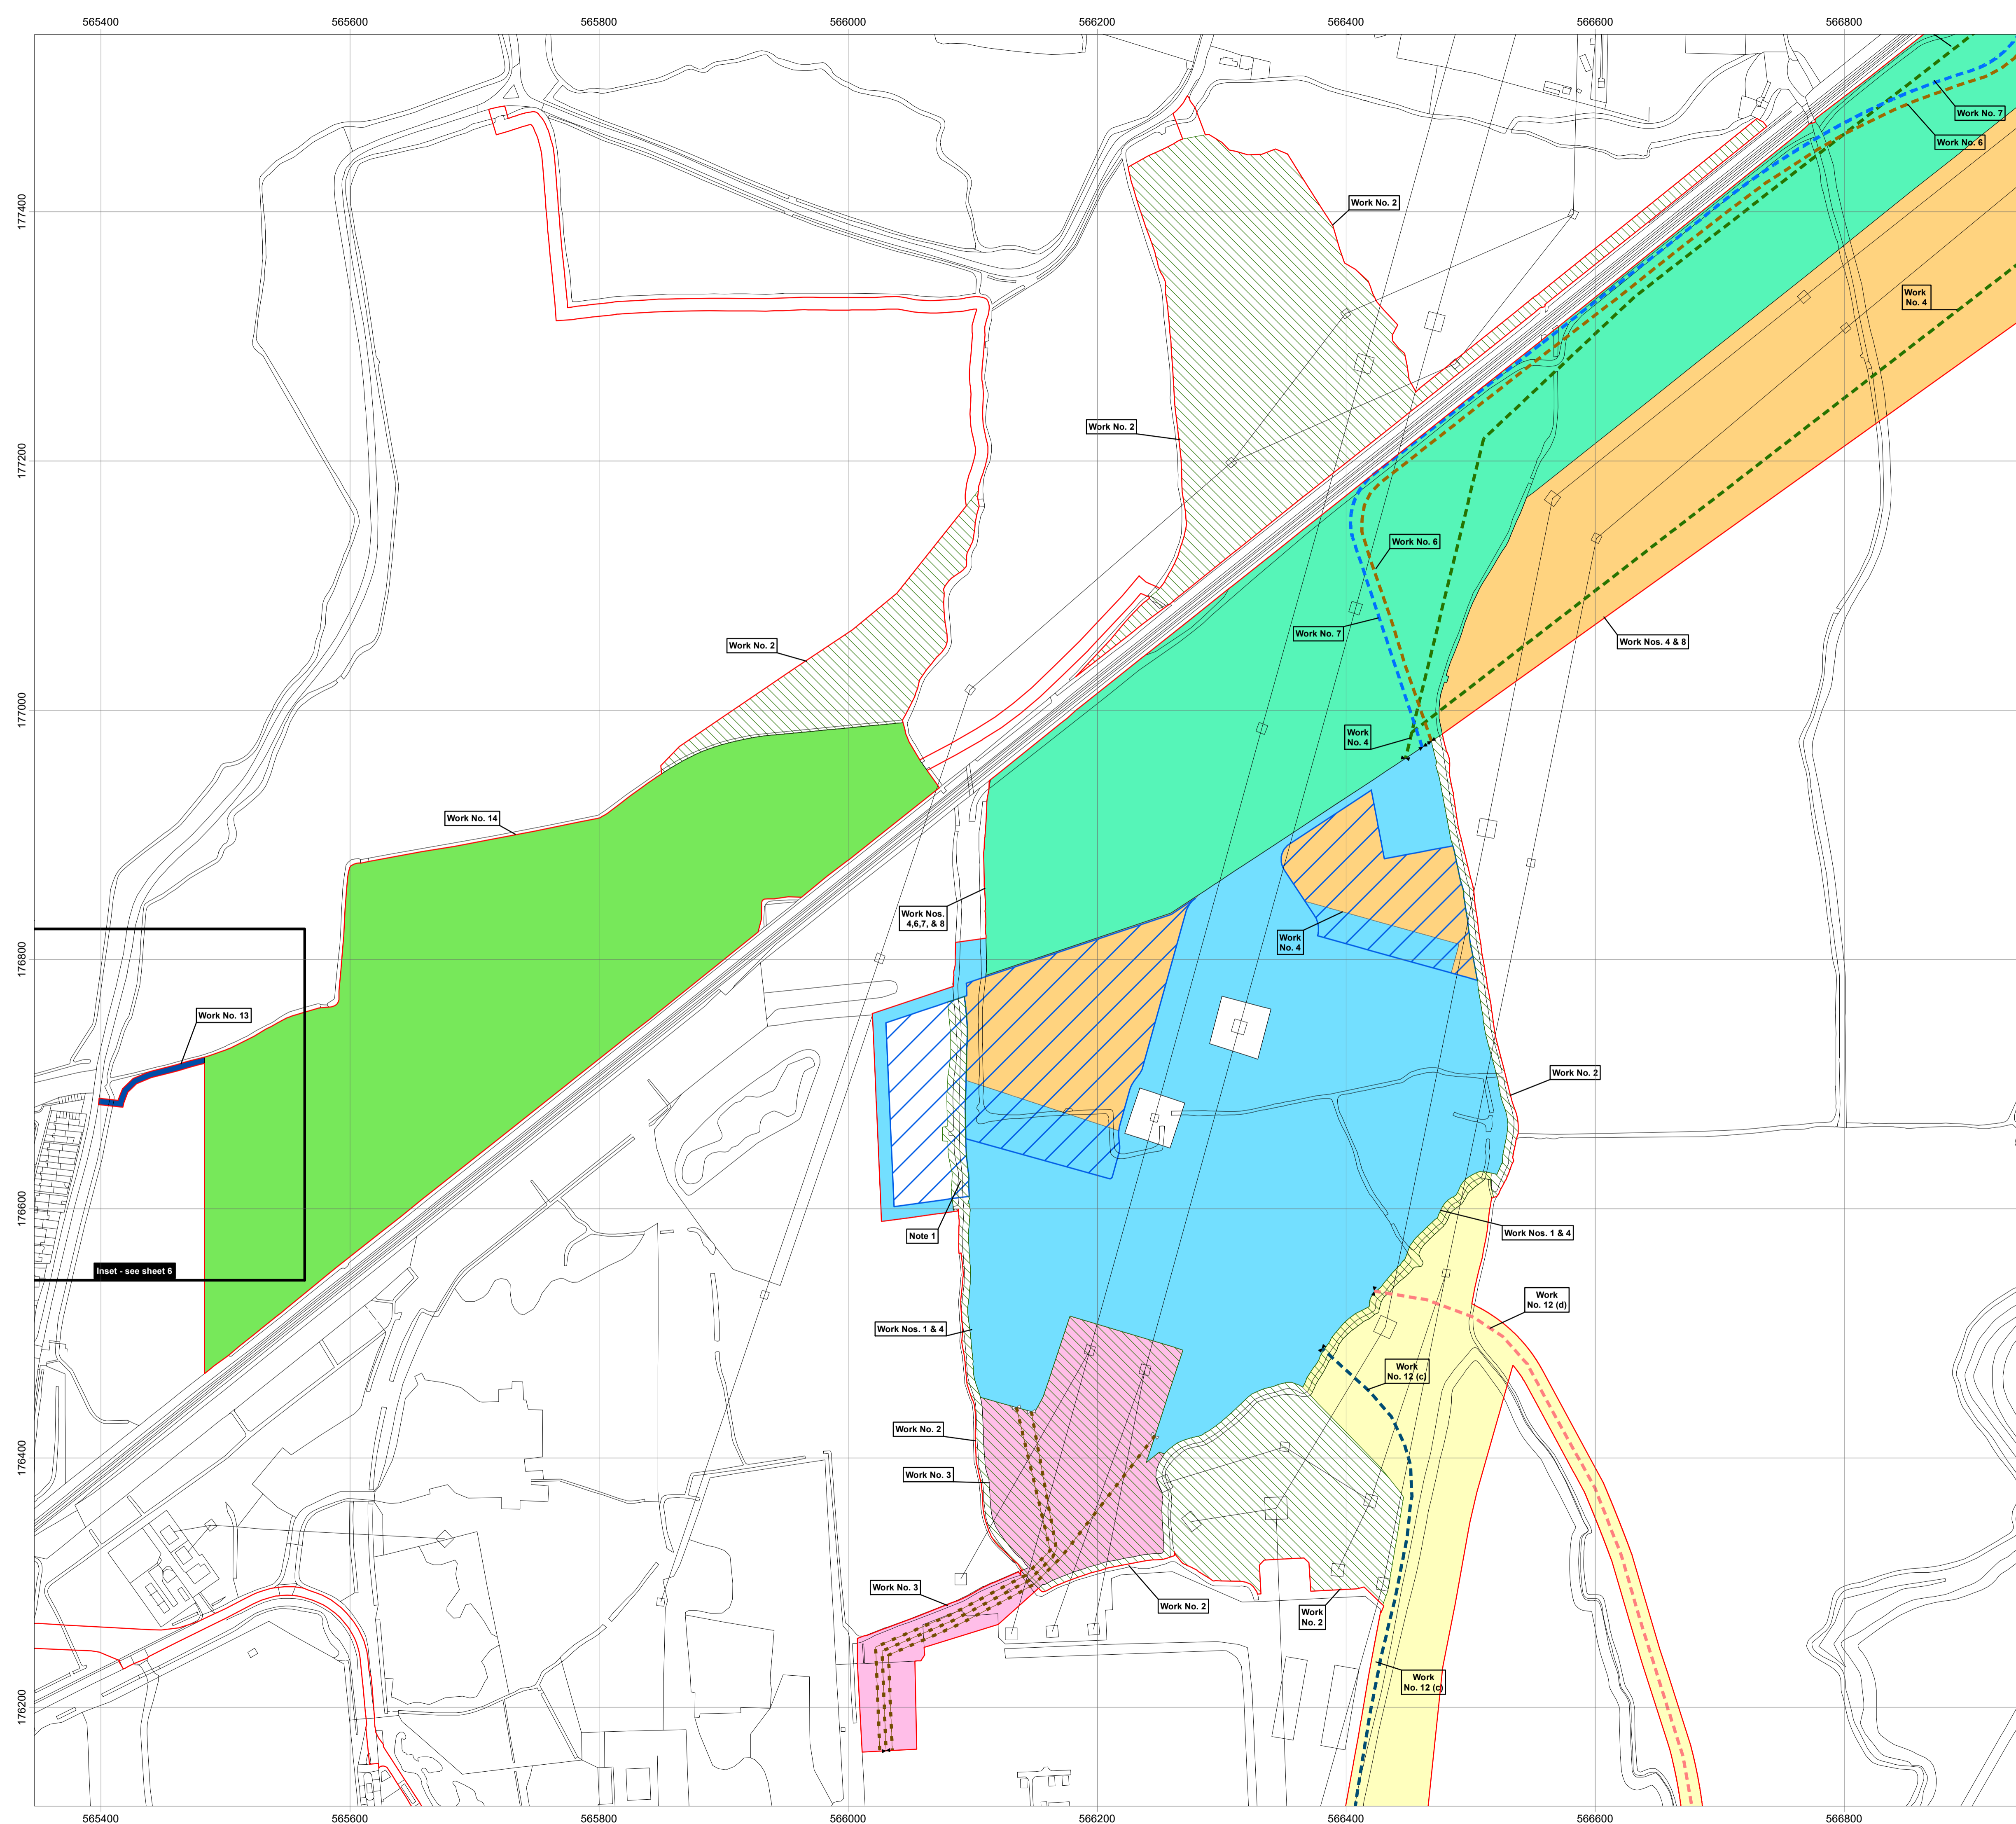





Legend

- | Order Limits | |
|---|--|
|  | Work No. 3A indicative centreline |
|  | Work No. 4 indicative centreline |
|  | Work No. 6 indicative centreline |
|  | Work No. 7 indicative centreline |
|  | Work No. 12 (c) indicative centreline |
|  | Work No. 12 (d) indicative centreline |
|  | Start of linear work |
|  | End of linear work |
|  | Work No. 1 and Work No. 4 limit of deviation |
|  | Work No. 2 |
|  | Work No. 3 limit of deviation |
|  | Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8 |
|  | Work No. 4 limit of deviation and Work No. 8 |
|  | Work No. 12 limit of deviation |
|  | Work No. 13 |
|  | Work No. 14 |
|  | Land for carbon capture readiness (CCR) |

Note 1: Ditch to be retained unless CCR land is developed.

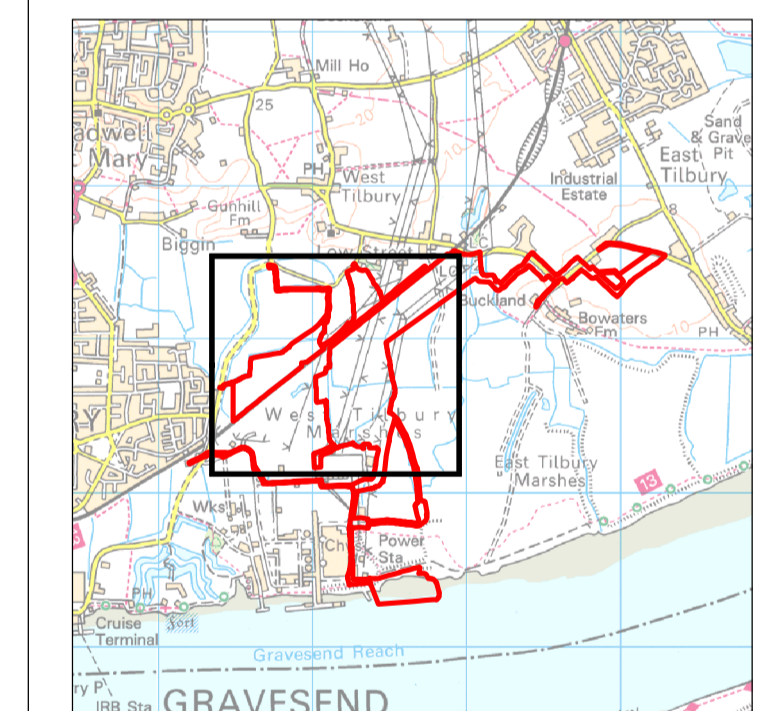

Date: 19/05/2020
Created by: MS
Checked by: TD
Doc no: 10872-0136-21
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG

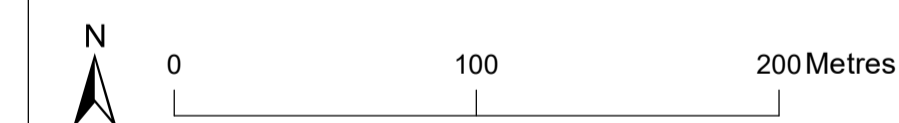

Rev	Date	Remark

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3


Thurrock Flexible Generation Plant
Work Plans
Sheet 2 of 6






Legend

- Order Limits
- Work No. 4 indicative centreline
- Work No. 6 indicative centreline
- Work No. 7 indicative centreline
- Start of linear work
- National Grid gas pipeline Feeder 18
- Work No. 4
- Work No. 4 limit of deviation and Work No. 5
- Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8
- Work No. 4 limit of deviation and Work No. 8

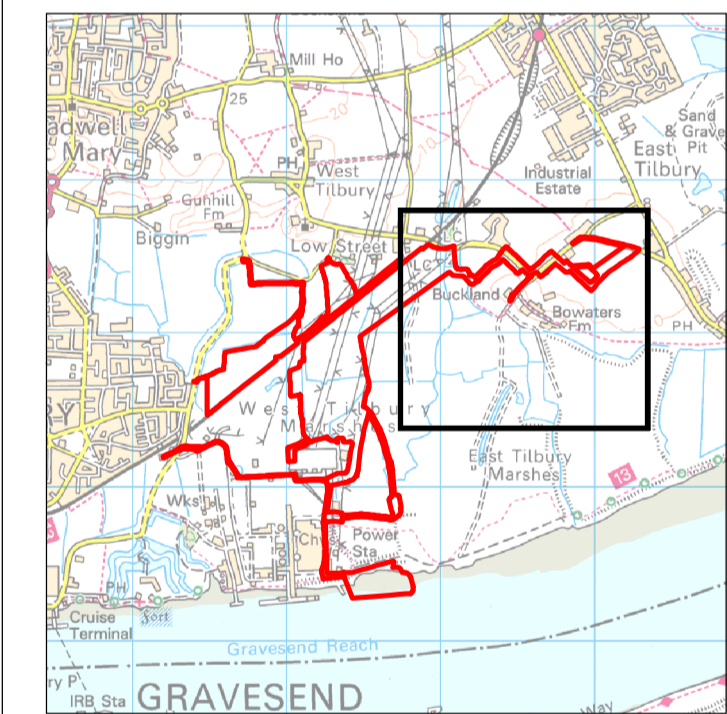

Date: 19/05/2020
Created by: MS
Checked by: TD
Doc no: 10872-0136-21
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG

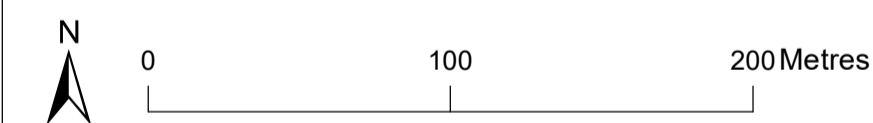


Rev	Date	Remark

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Sheet 3 of 6




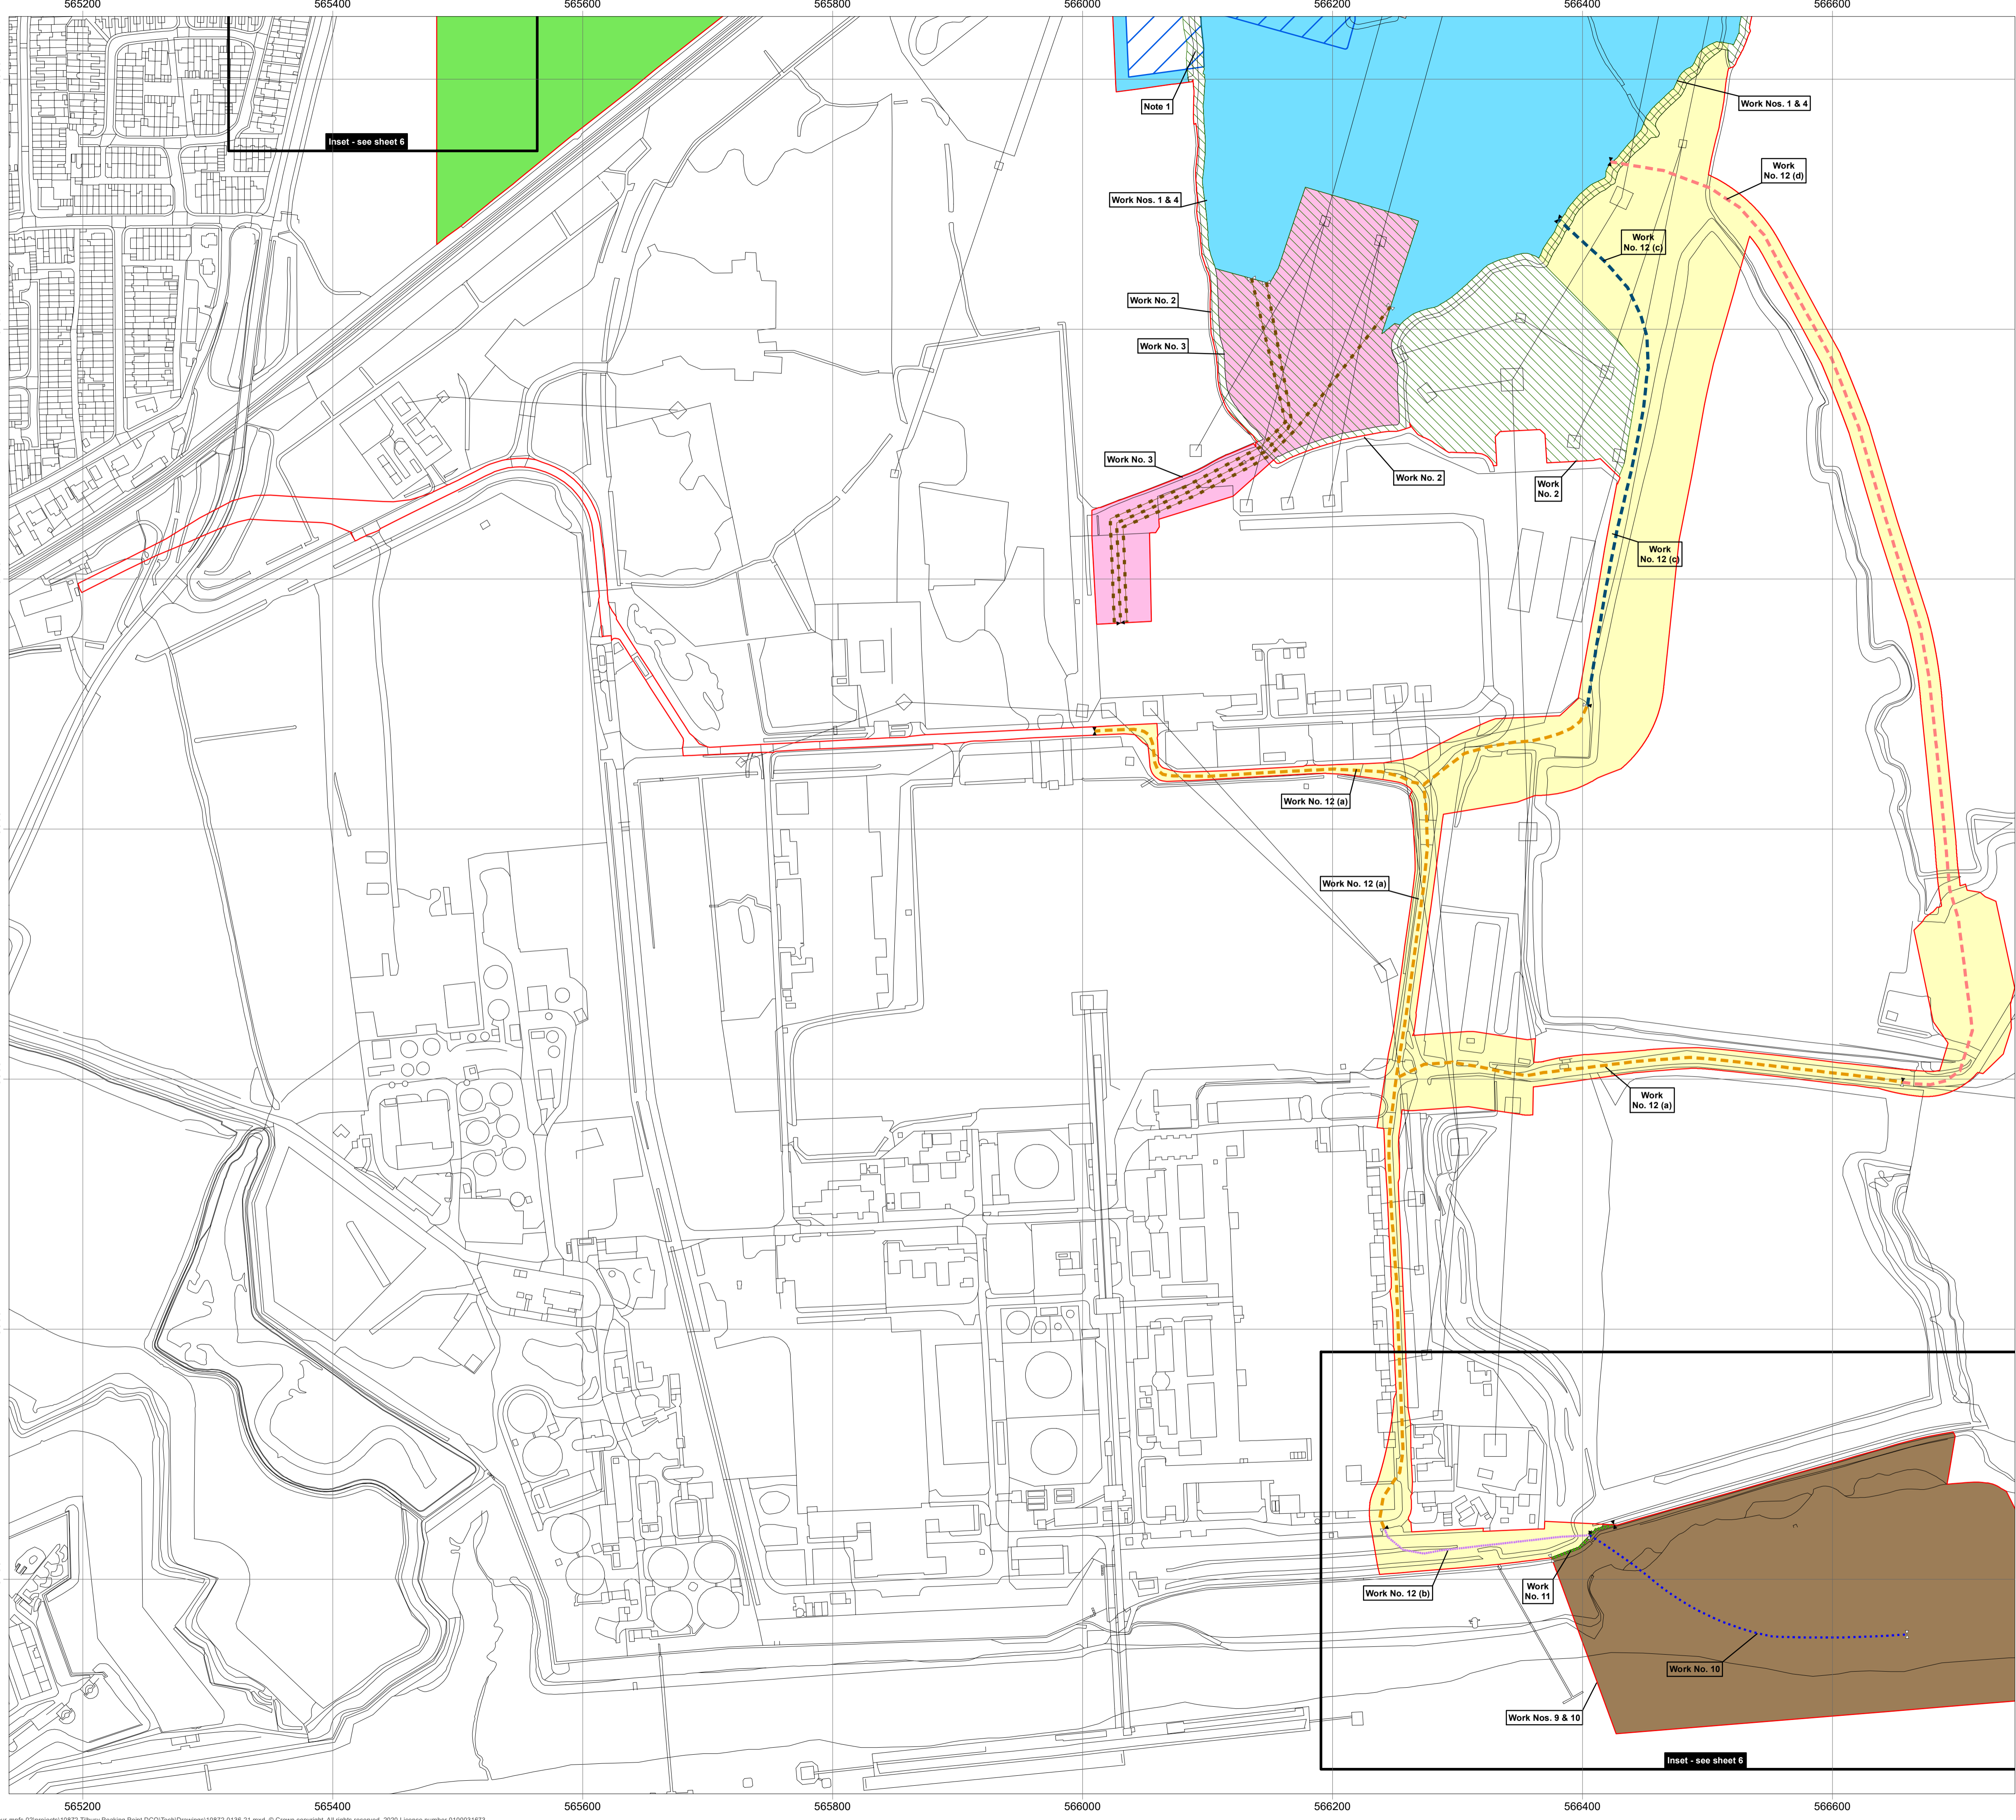


Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 9 limit of deviation and Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Work No. 14
- Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

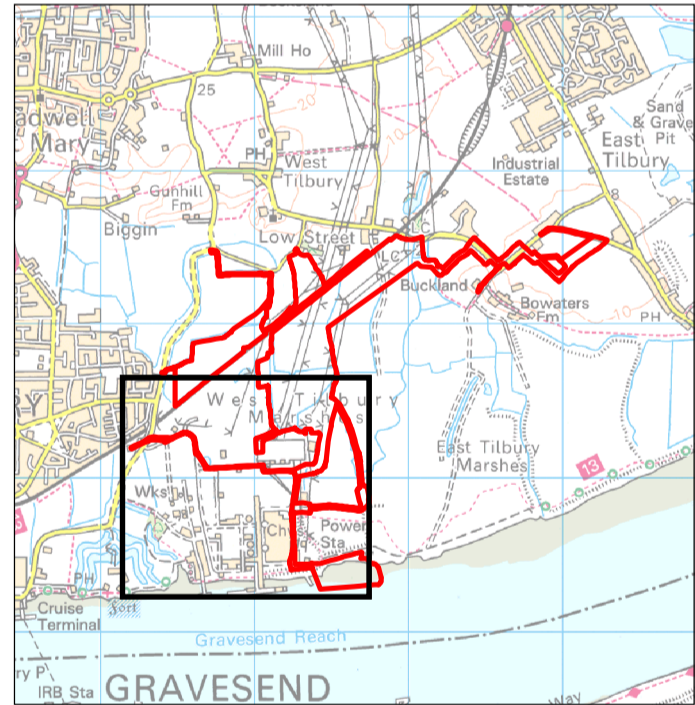

Date: 19/05/2020
Created by: MS
Checked by: TD
Doc no: 10872-0136-21
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG




Rev	Date	Remark

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Sheet 4 of 6




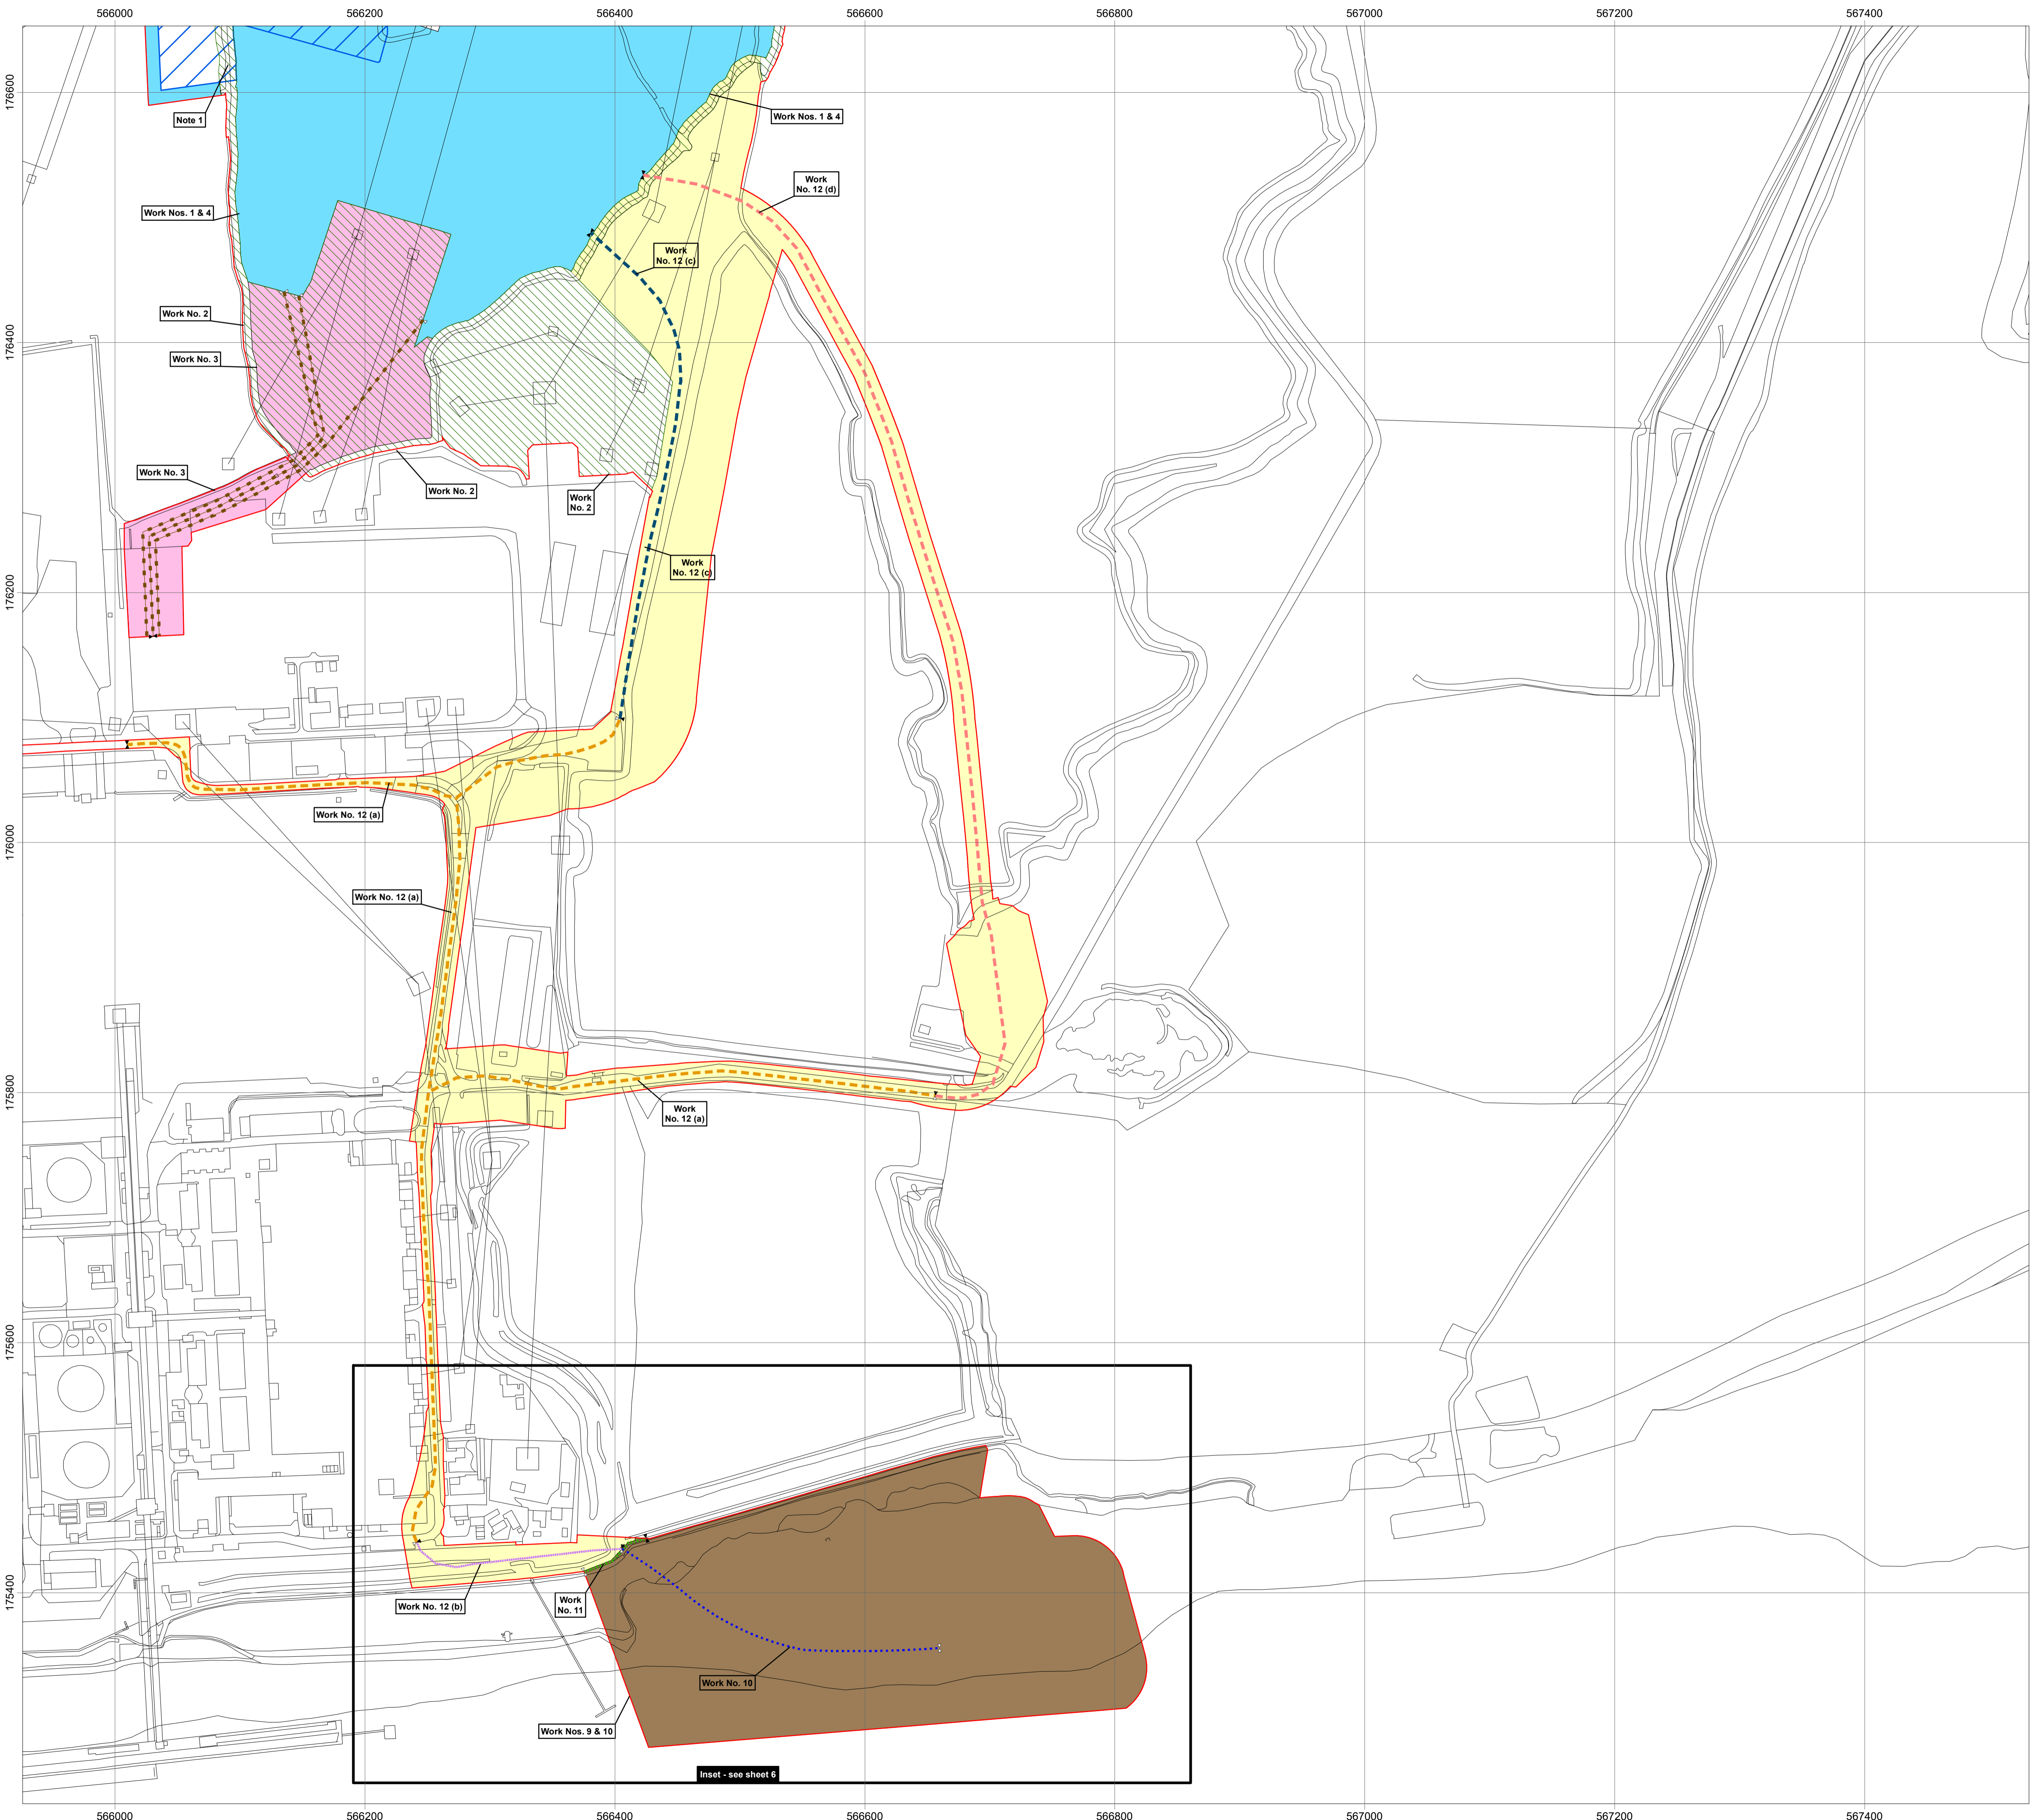


Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 9 limit of deviation and Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Land for carbon capture readiness (CCR)



Note 1: Ditch to be retained unless CCR land is developed.

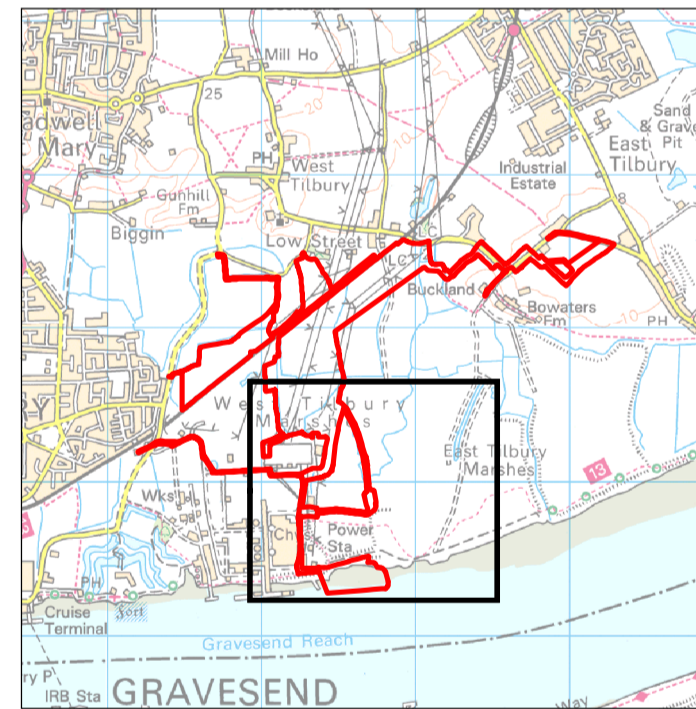

Date: 19/05/2020
Created by: MS
Checked by: TD
Doc no: 10872-0136-21
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG

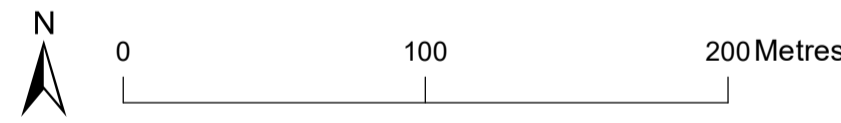


Rev	Date	Remark
APFP Regulations Reference: 5(2)(j) Application Document Number: A2.3		
Thurrock Flexible Generation Plant Work Plans Sheet 5 of 6		

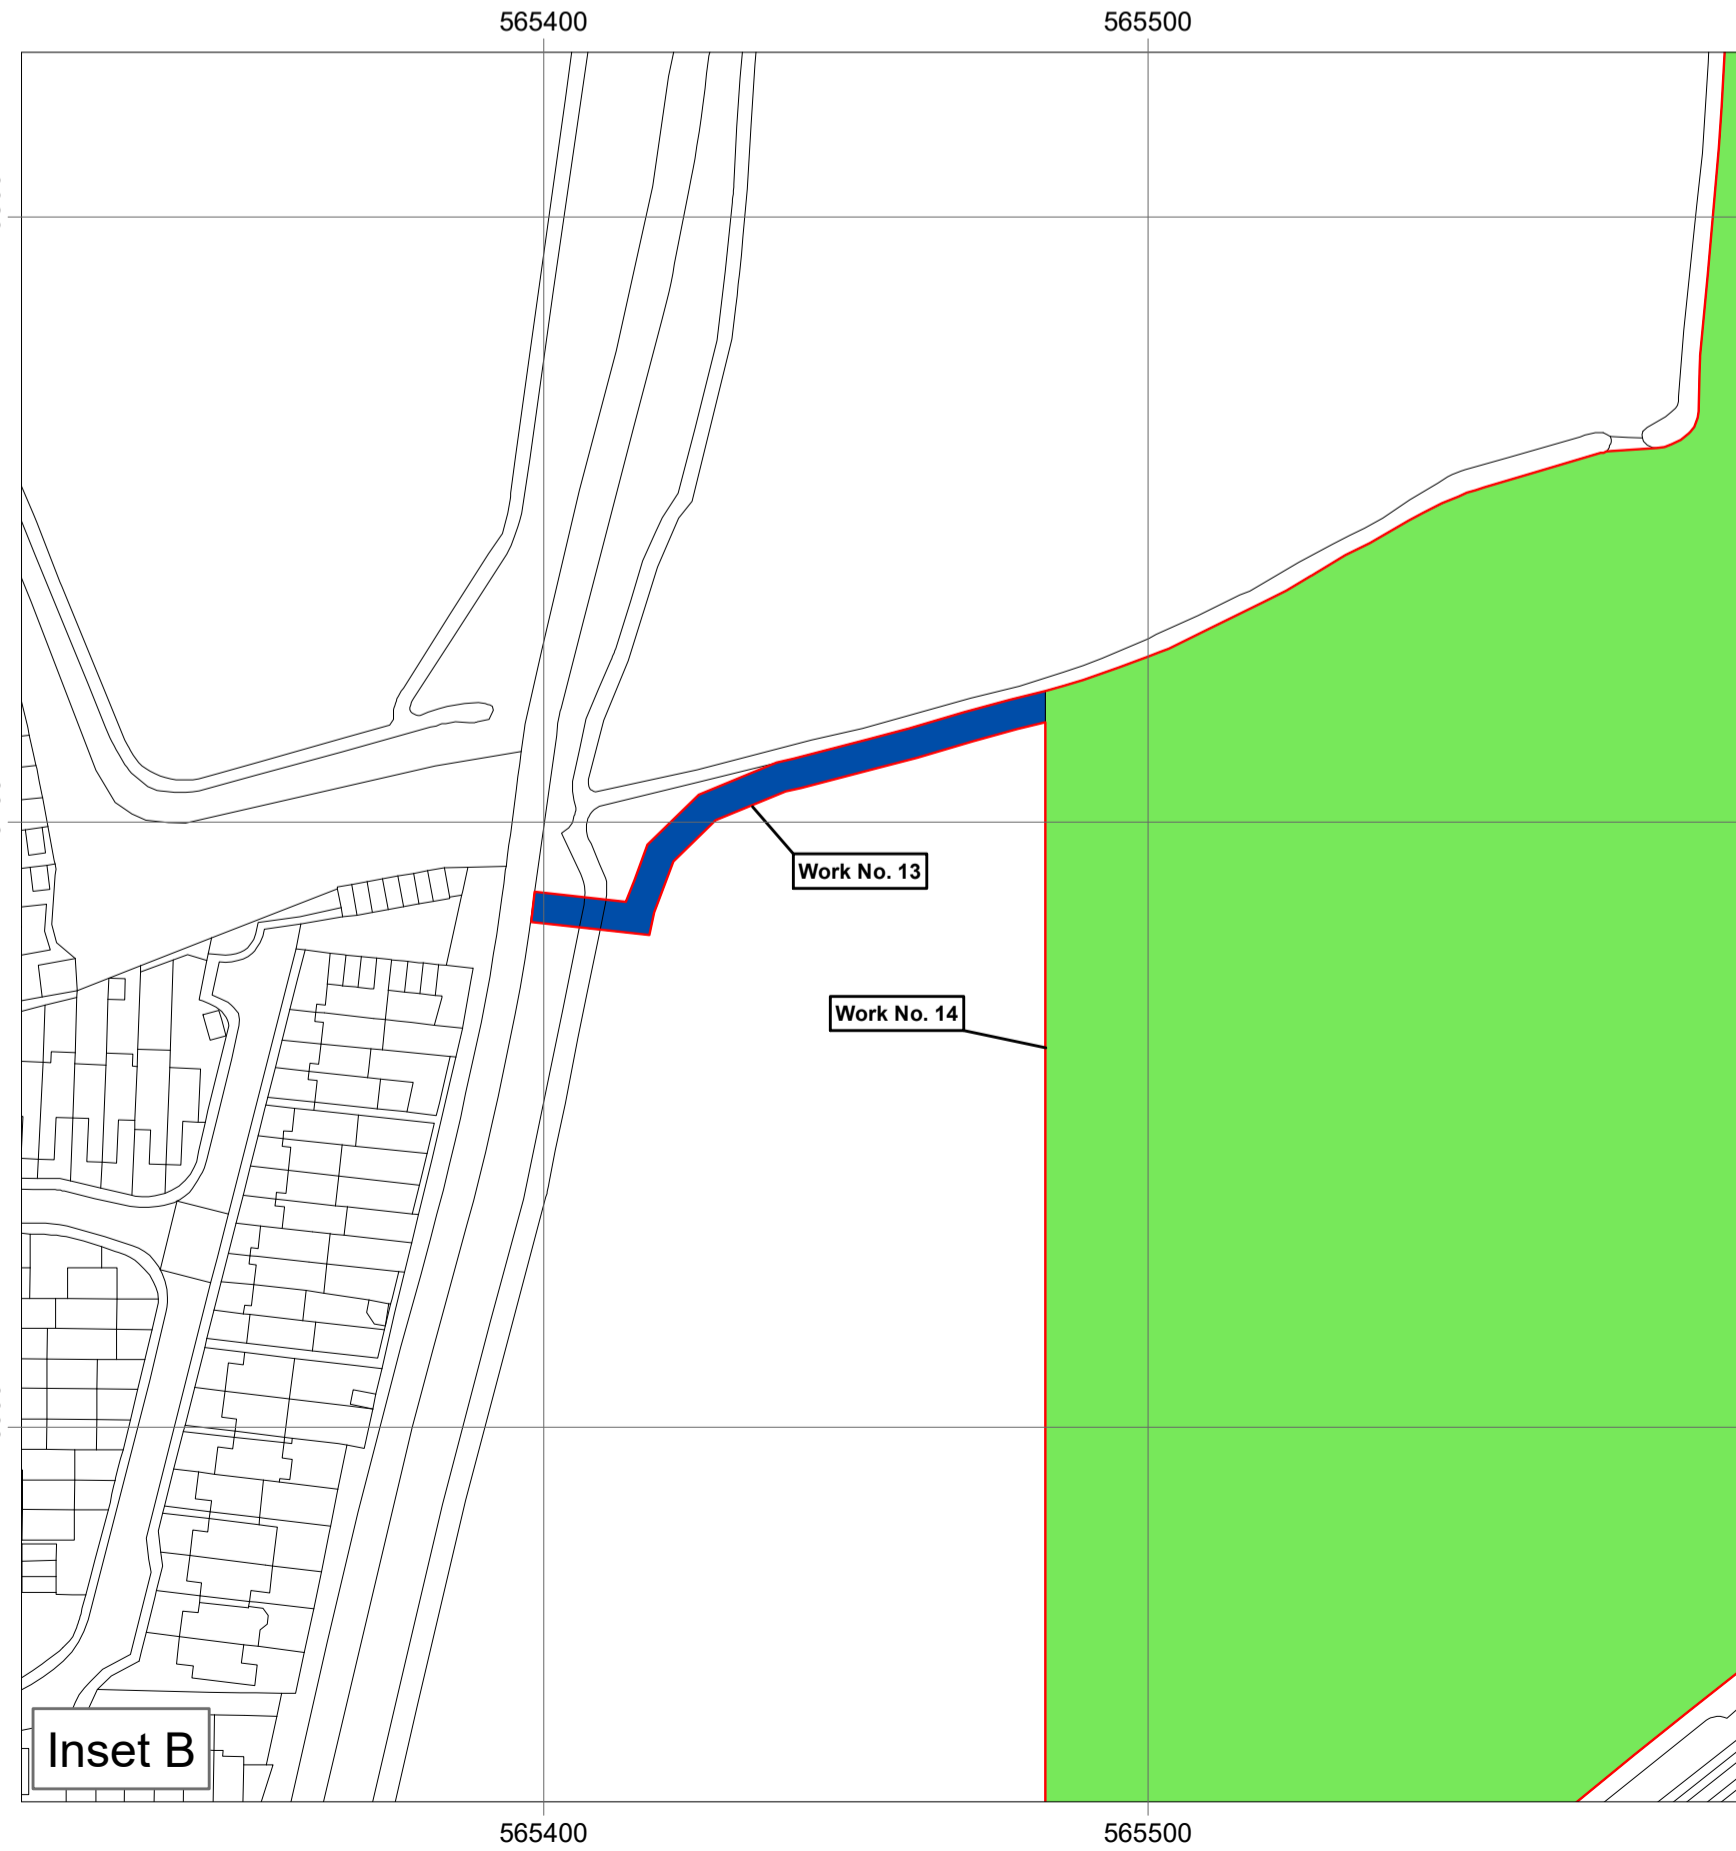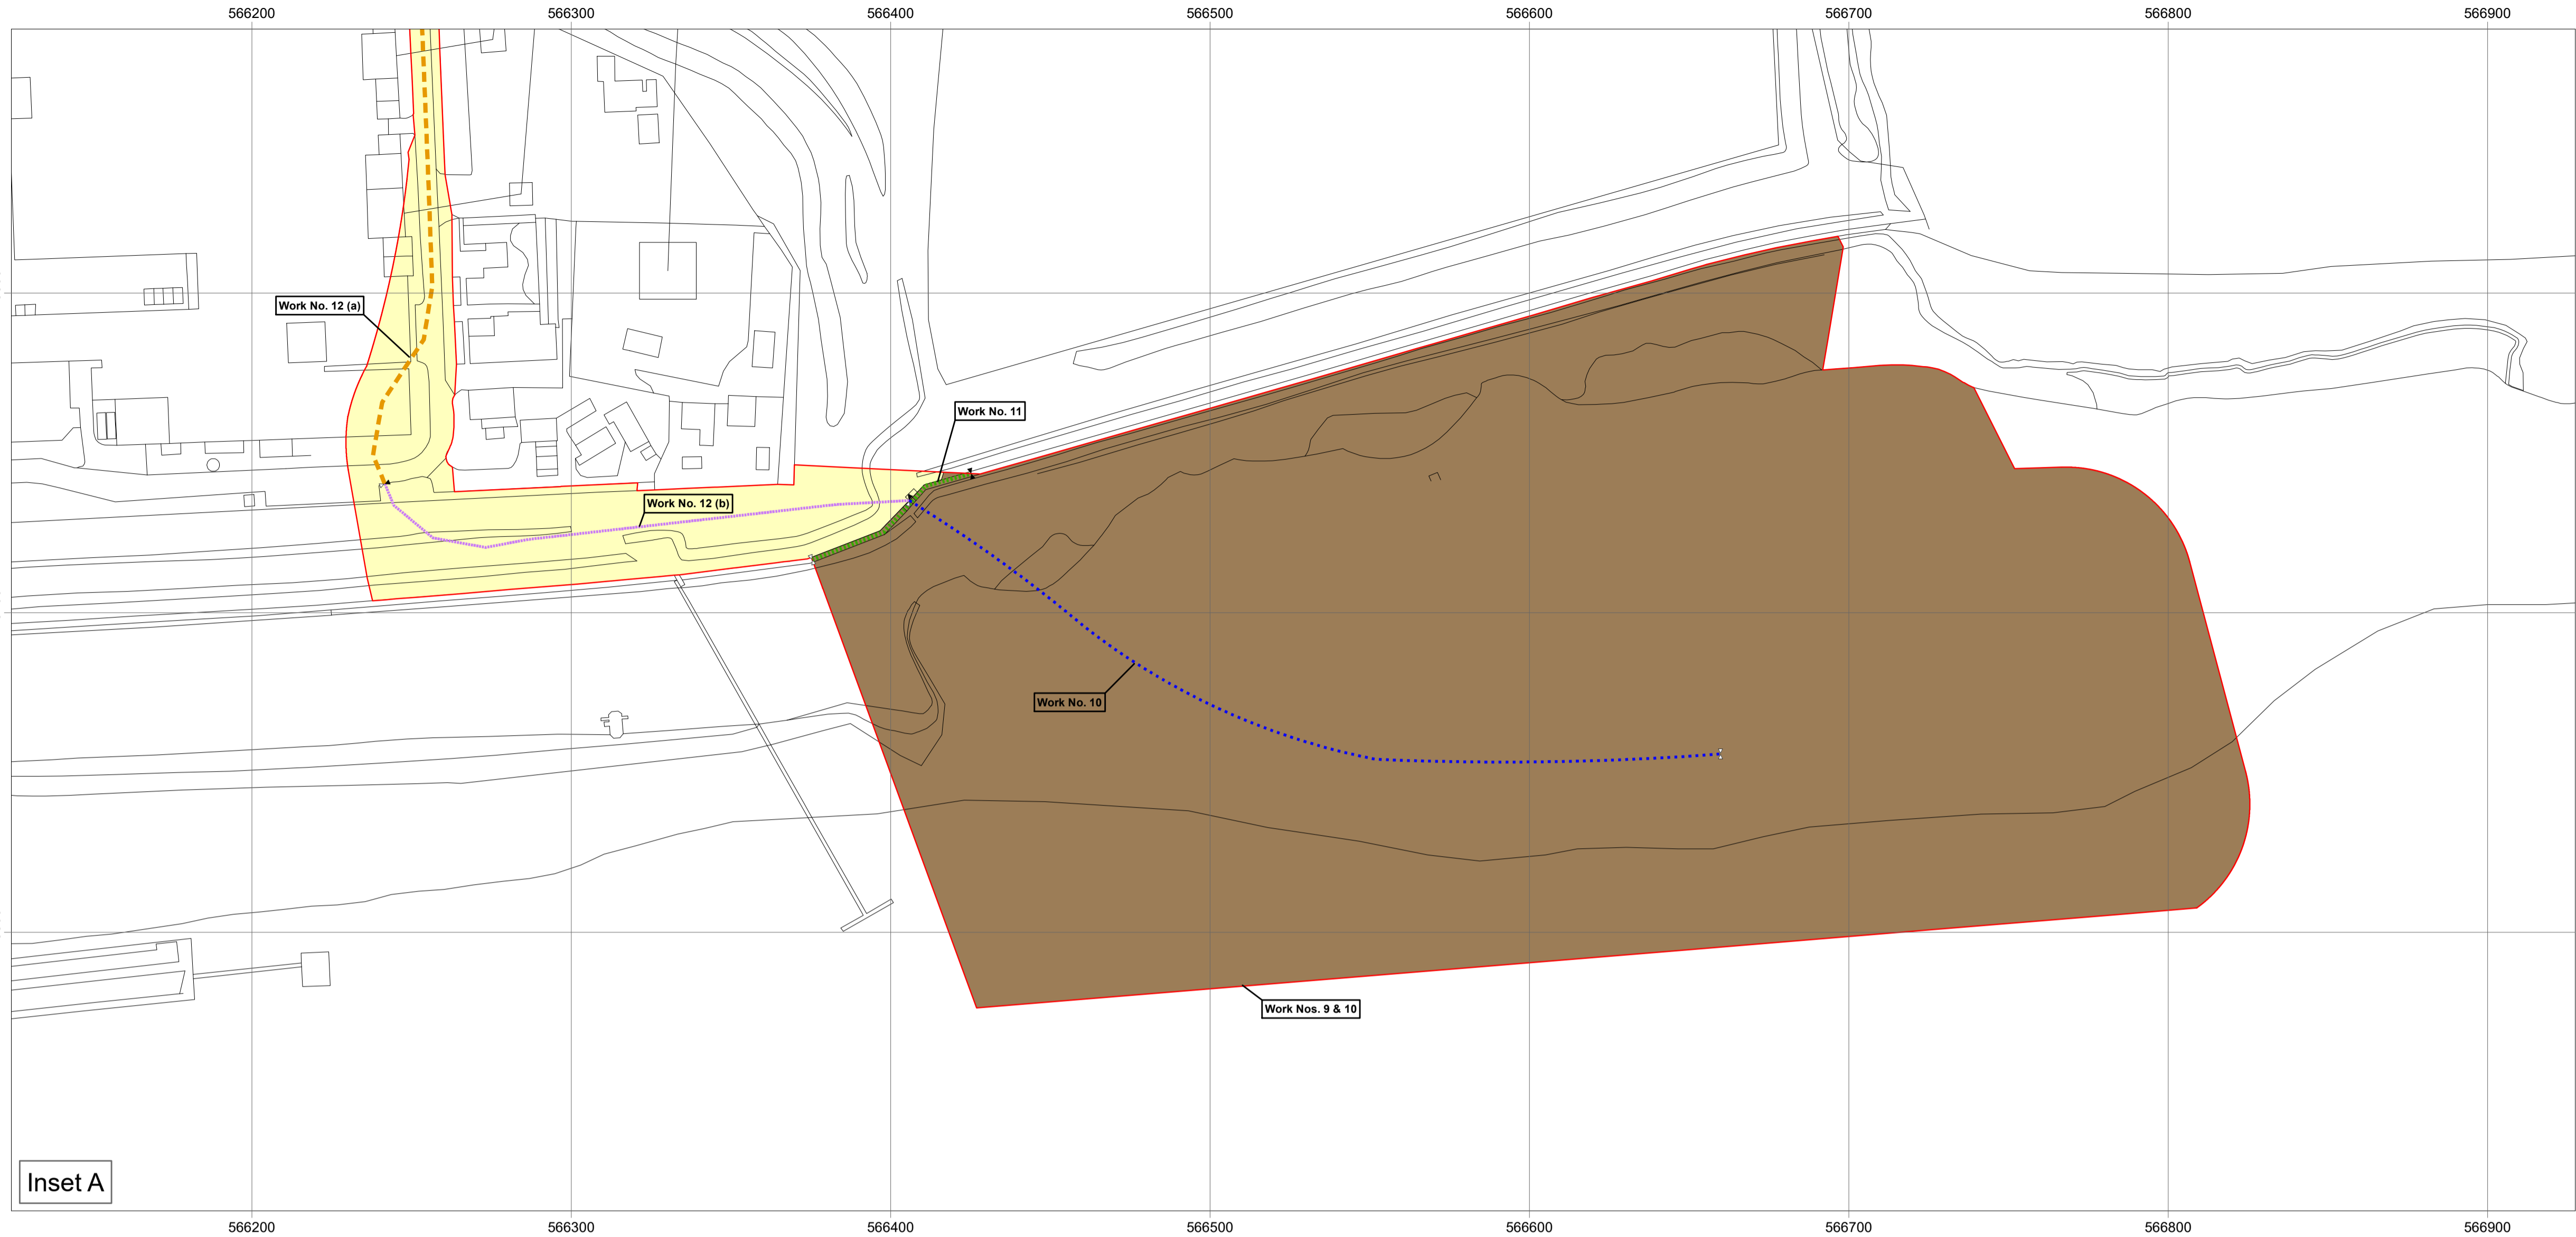

Legend

- Order Limits
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 9 limit of deviation and Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Work No. 13
- Work No. 14

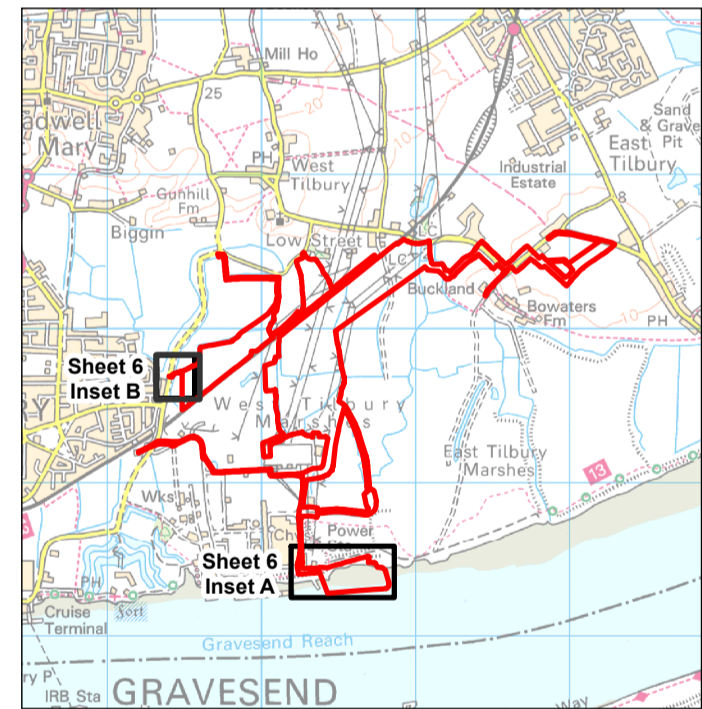

Date: 26/02/2020
Created by: MS
Checked by: TD
Doc no: 10872-0205-07
Scale: A1@ 1:1,250
Reference System: OSGB36
Projection: BNG



Rev	Date	Remark
APFP Regulations Reference: 5(2)(j) Application Document Number: A2.3		
Thurrock Flexible Generation Plant Work Plans Sheet 6 of 6		
