



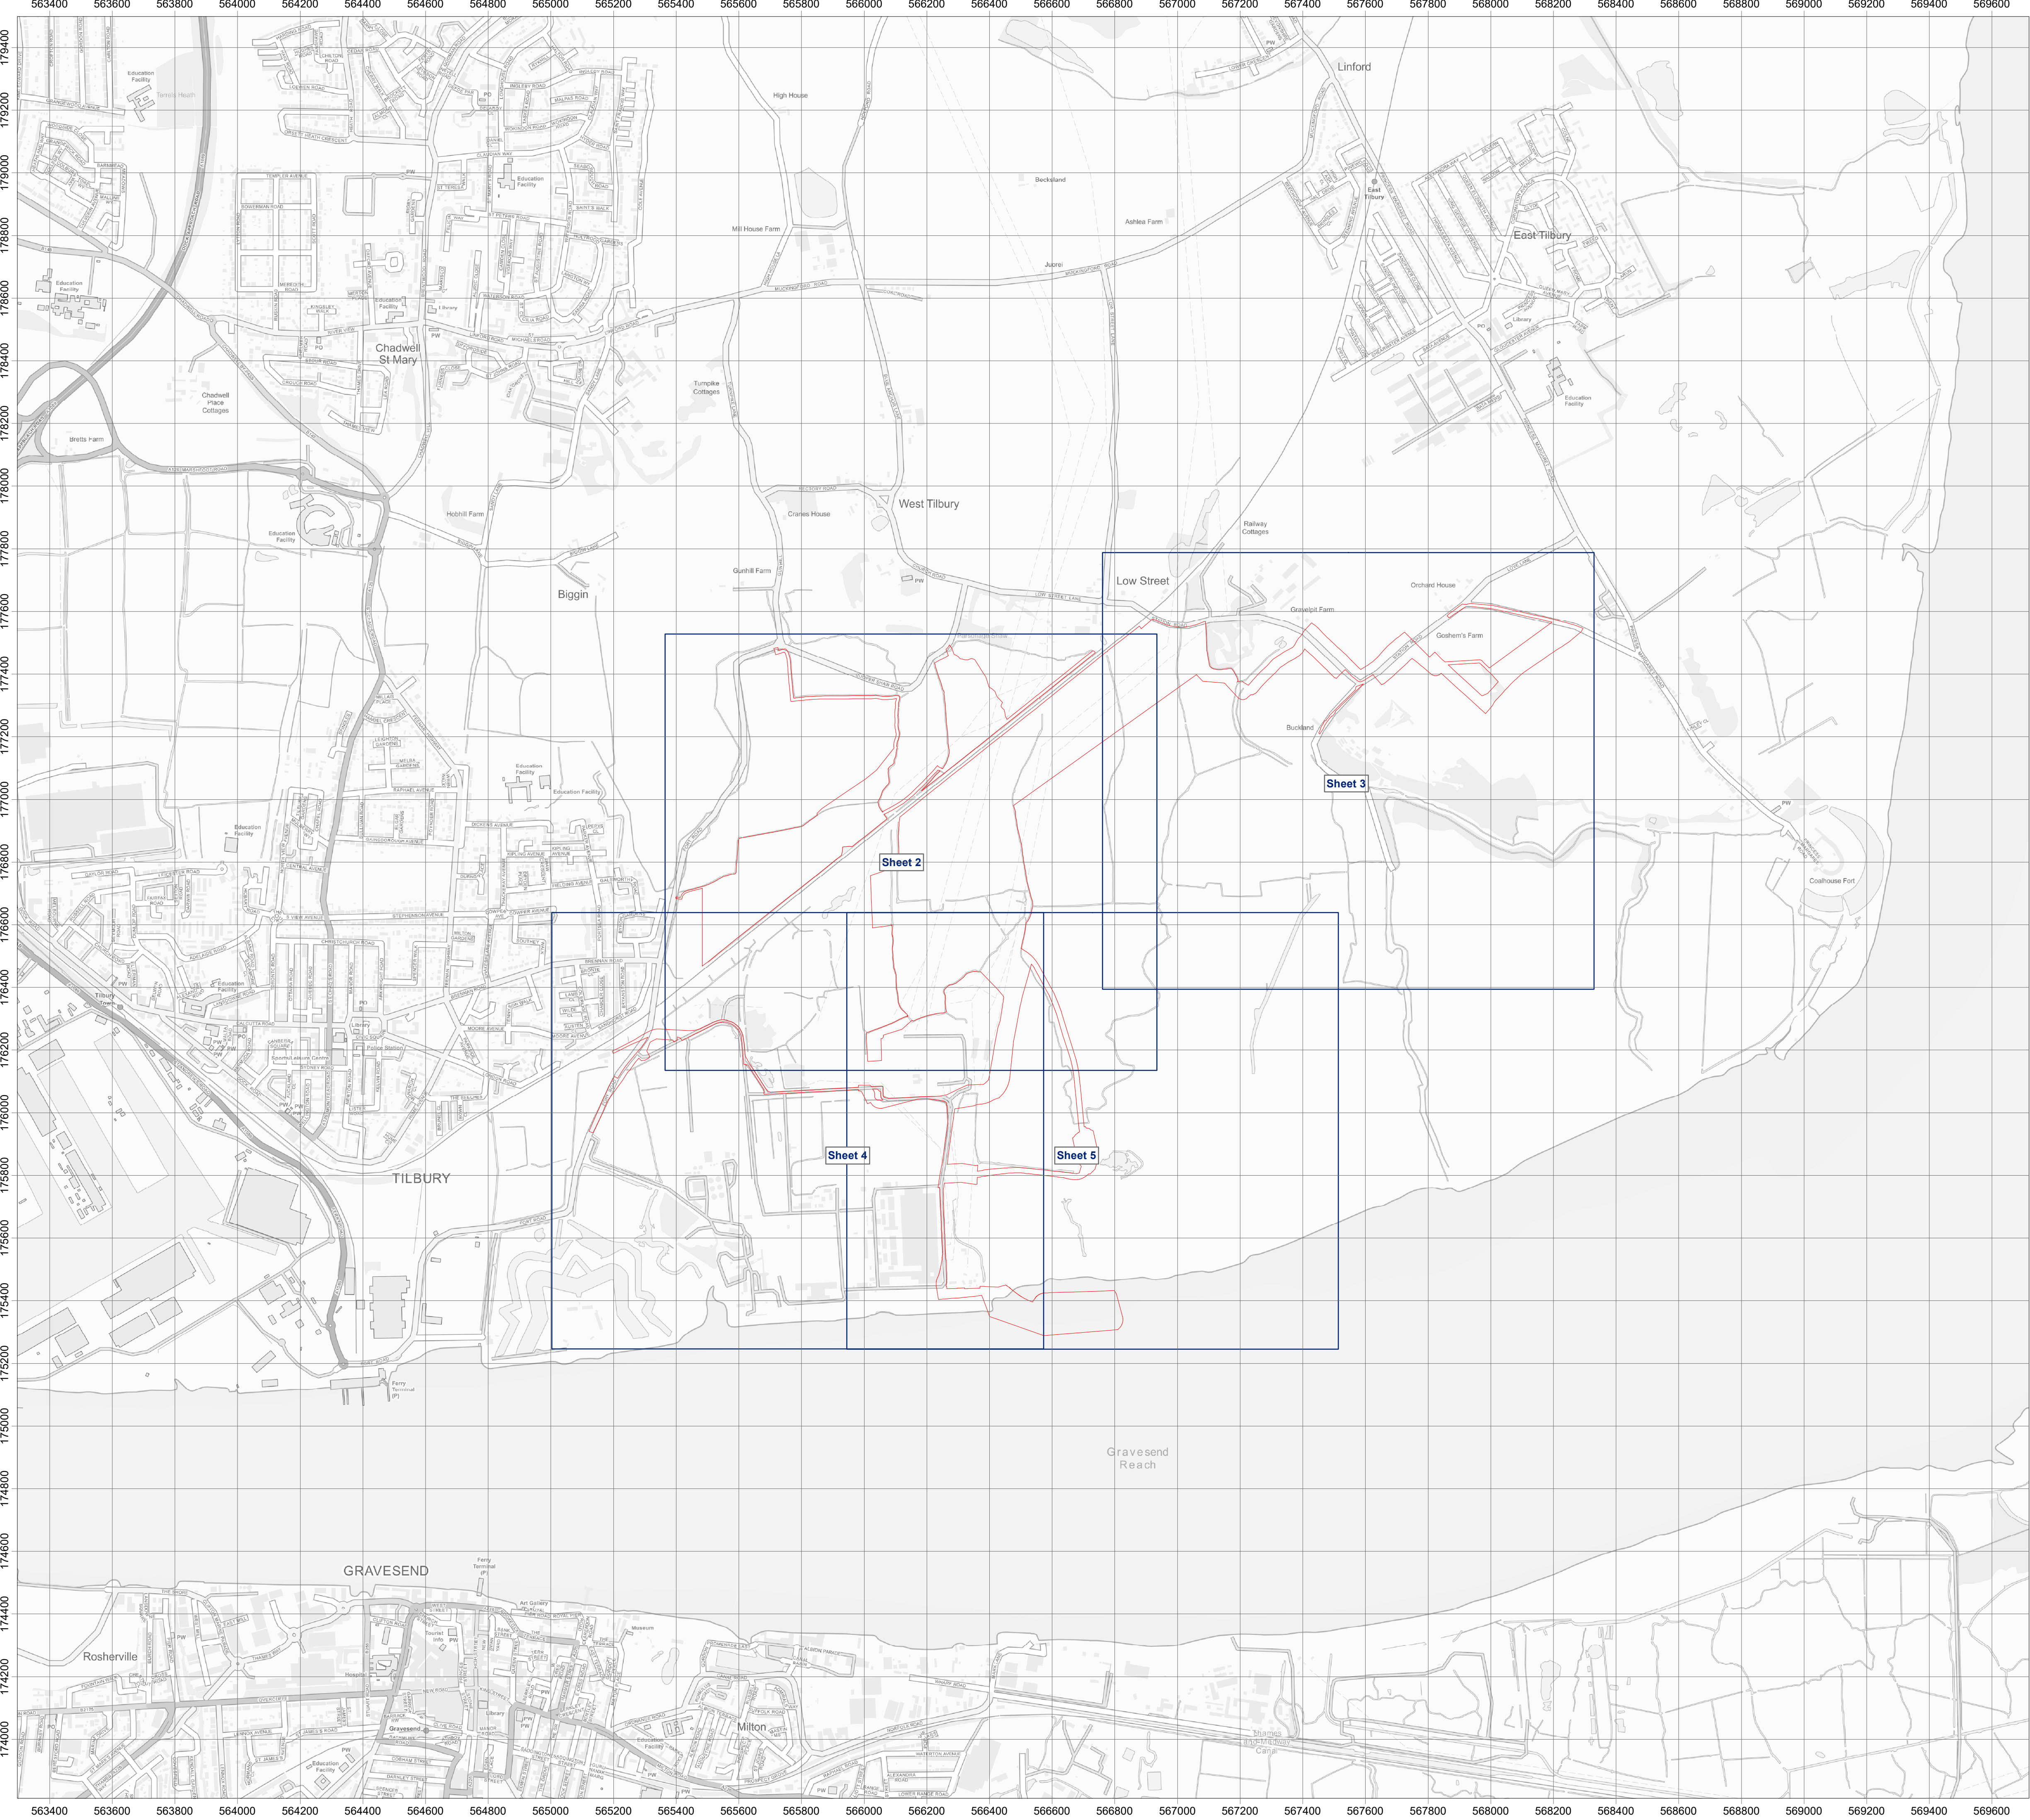


Legend

 Order Limits

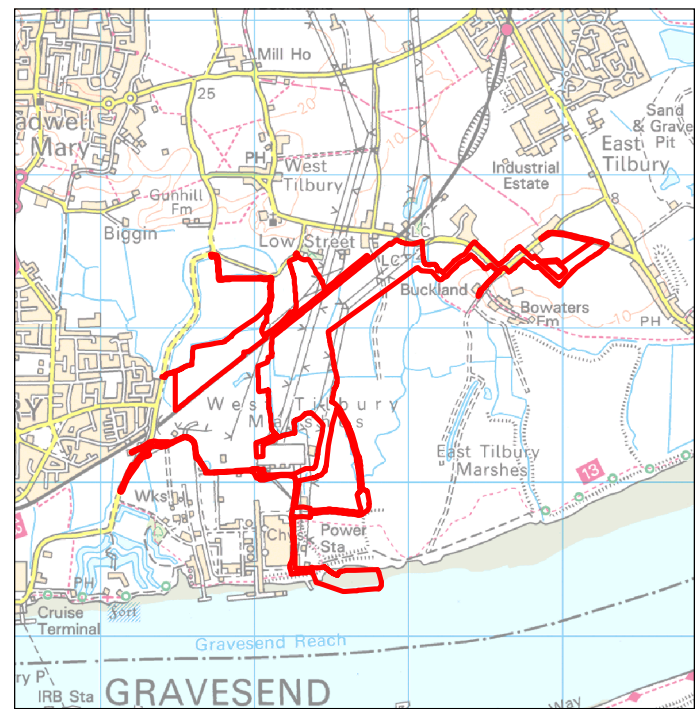

Date: 28/07/2021
Created by: MS
Checked by: TD
Doc no: 10872-0136-32
Scale: A1@ 1:10,000
Reference System: OSGB36
Projection: BNG




Rev	Date	Remark
1	23/07/20	S51 response: addition of sheet 6
2	30/10/20	Habitat creation changes
3	03/02/21	Work 10 order limits changes
4	19/04/21	Access change
5	28/07/21	Minor correction to Order Limits for Work 12(e)

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Index Sheet




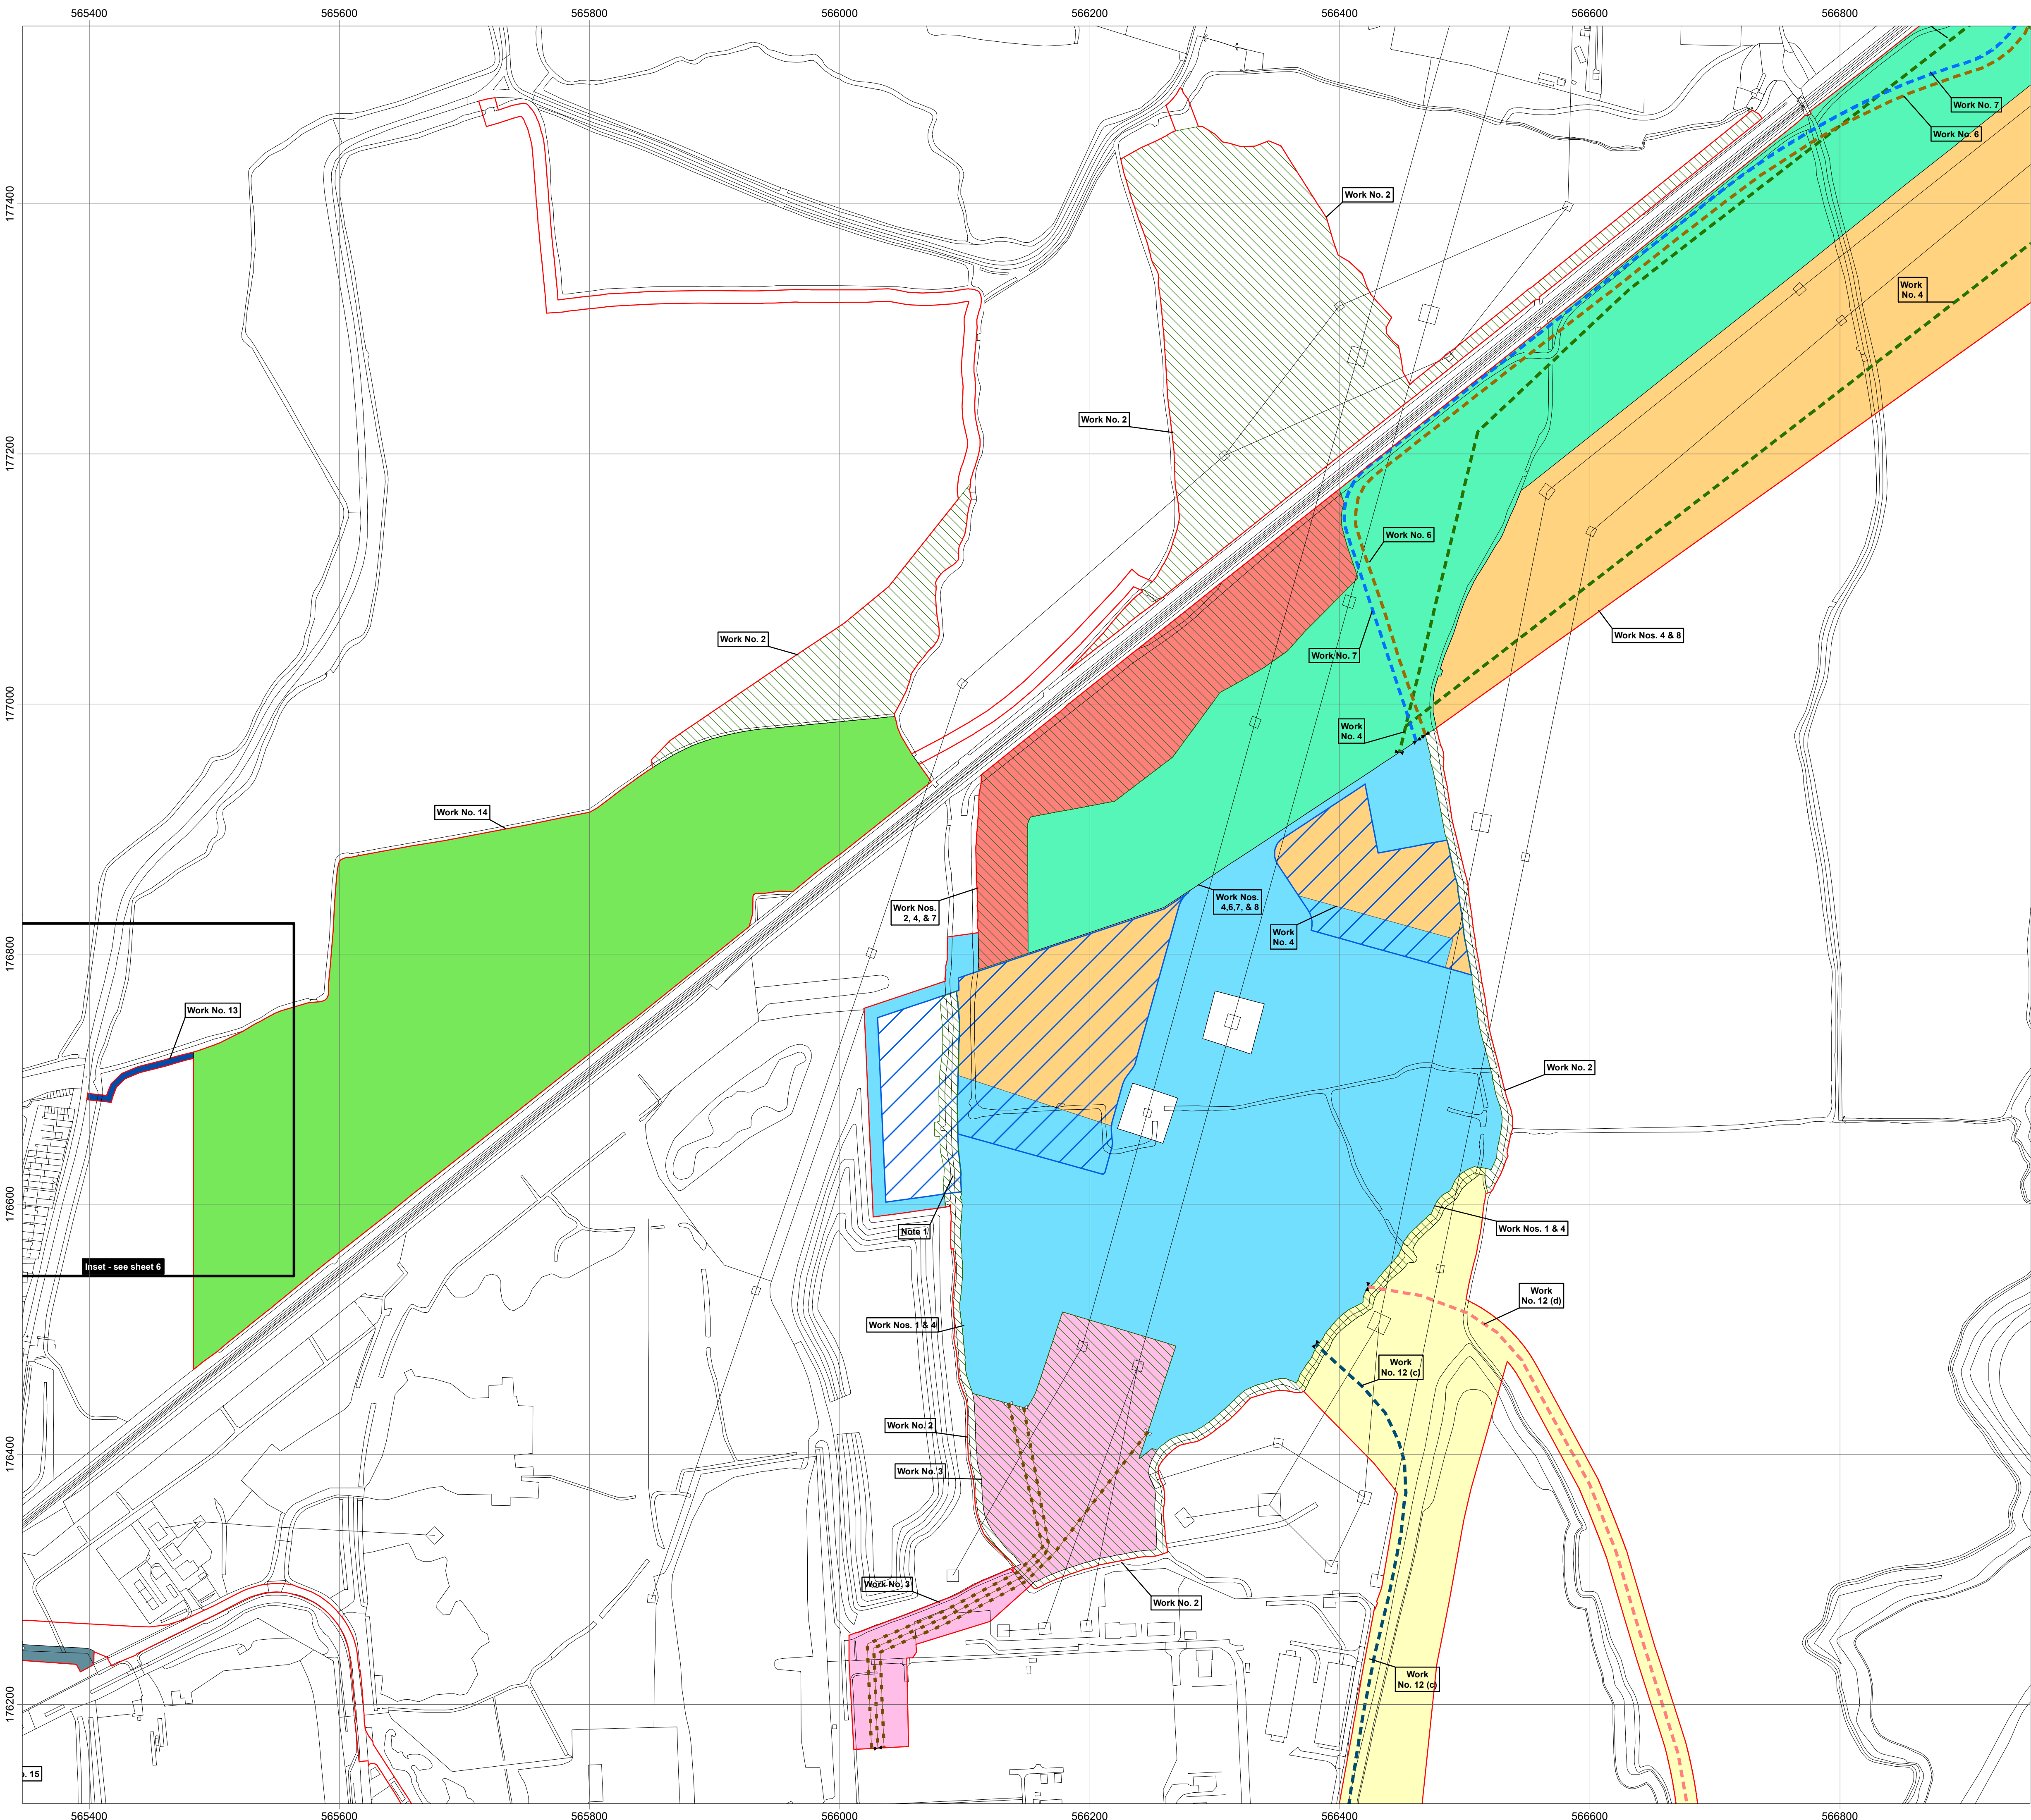


Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 4 indicative centreline
- Work No. 6 indicative centreline
- Work No. 7 indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Work No. 15 indicative centreline
- Start of linear work
- End of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8
- Work No. 4 limit of deviation and Work No. 7 limit of deviation
- Work No. 4 limit of deviation and Work No. 8
- Work No. 12 limit of deviation
- Work No. 13
- Work No. 14
- Work No. 15
- Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

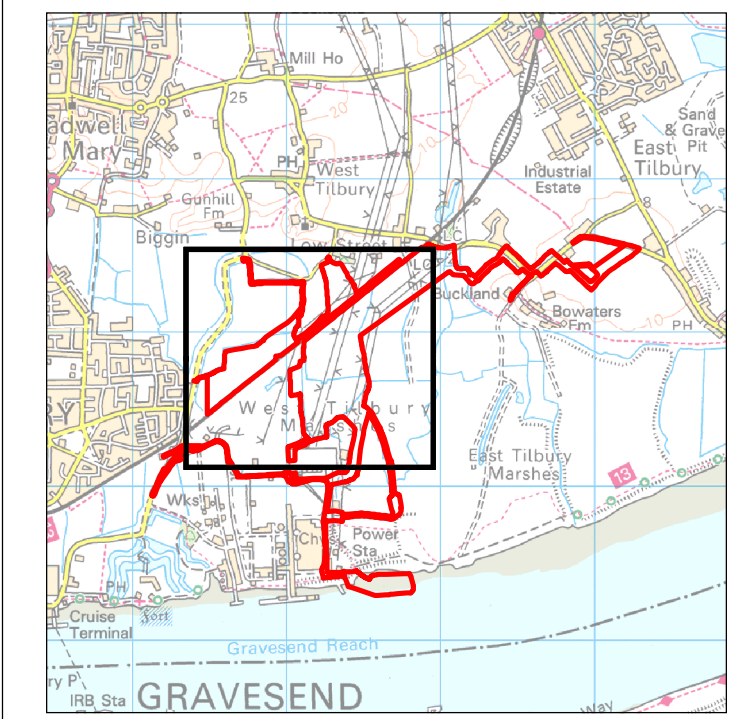

Date: 28/07/2021
Created by: MS
Checked by: TD
Doc no: 10872-0136-32
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG

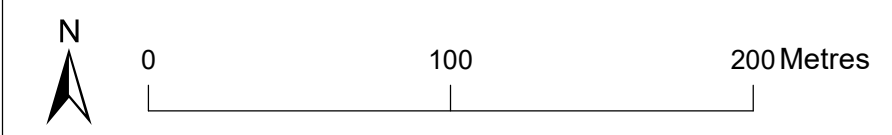


Rev	Date	Remark
1	23/07/20	S51 response: addition of sheet 6
2	30/10/20	Habitat creation changes
3	03/02/21	Work 10 order limits changes
4	19/04/21	Access change
5	28/07/21	Minor correction to Order Limits for Work 12(e)

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3


Thurrock Flexible Generation Plant Work Plans Sheet 2 of 6



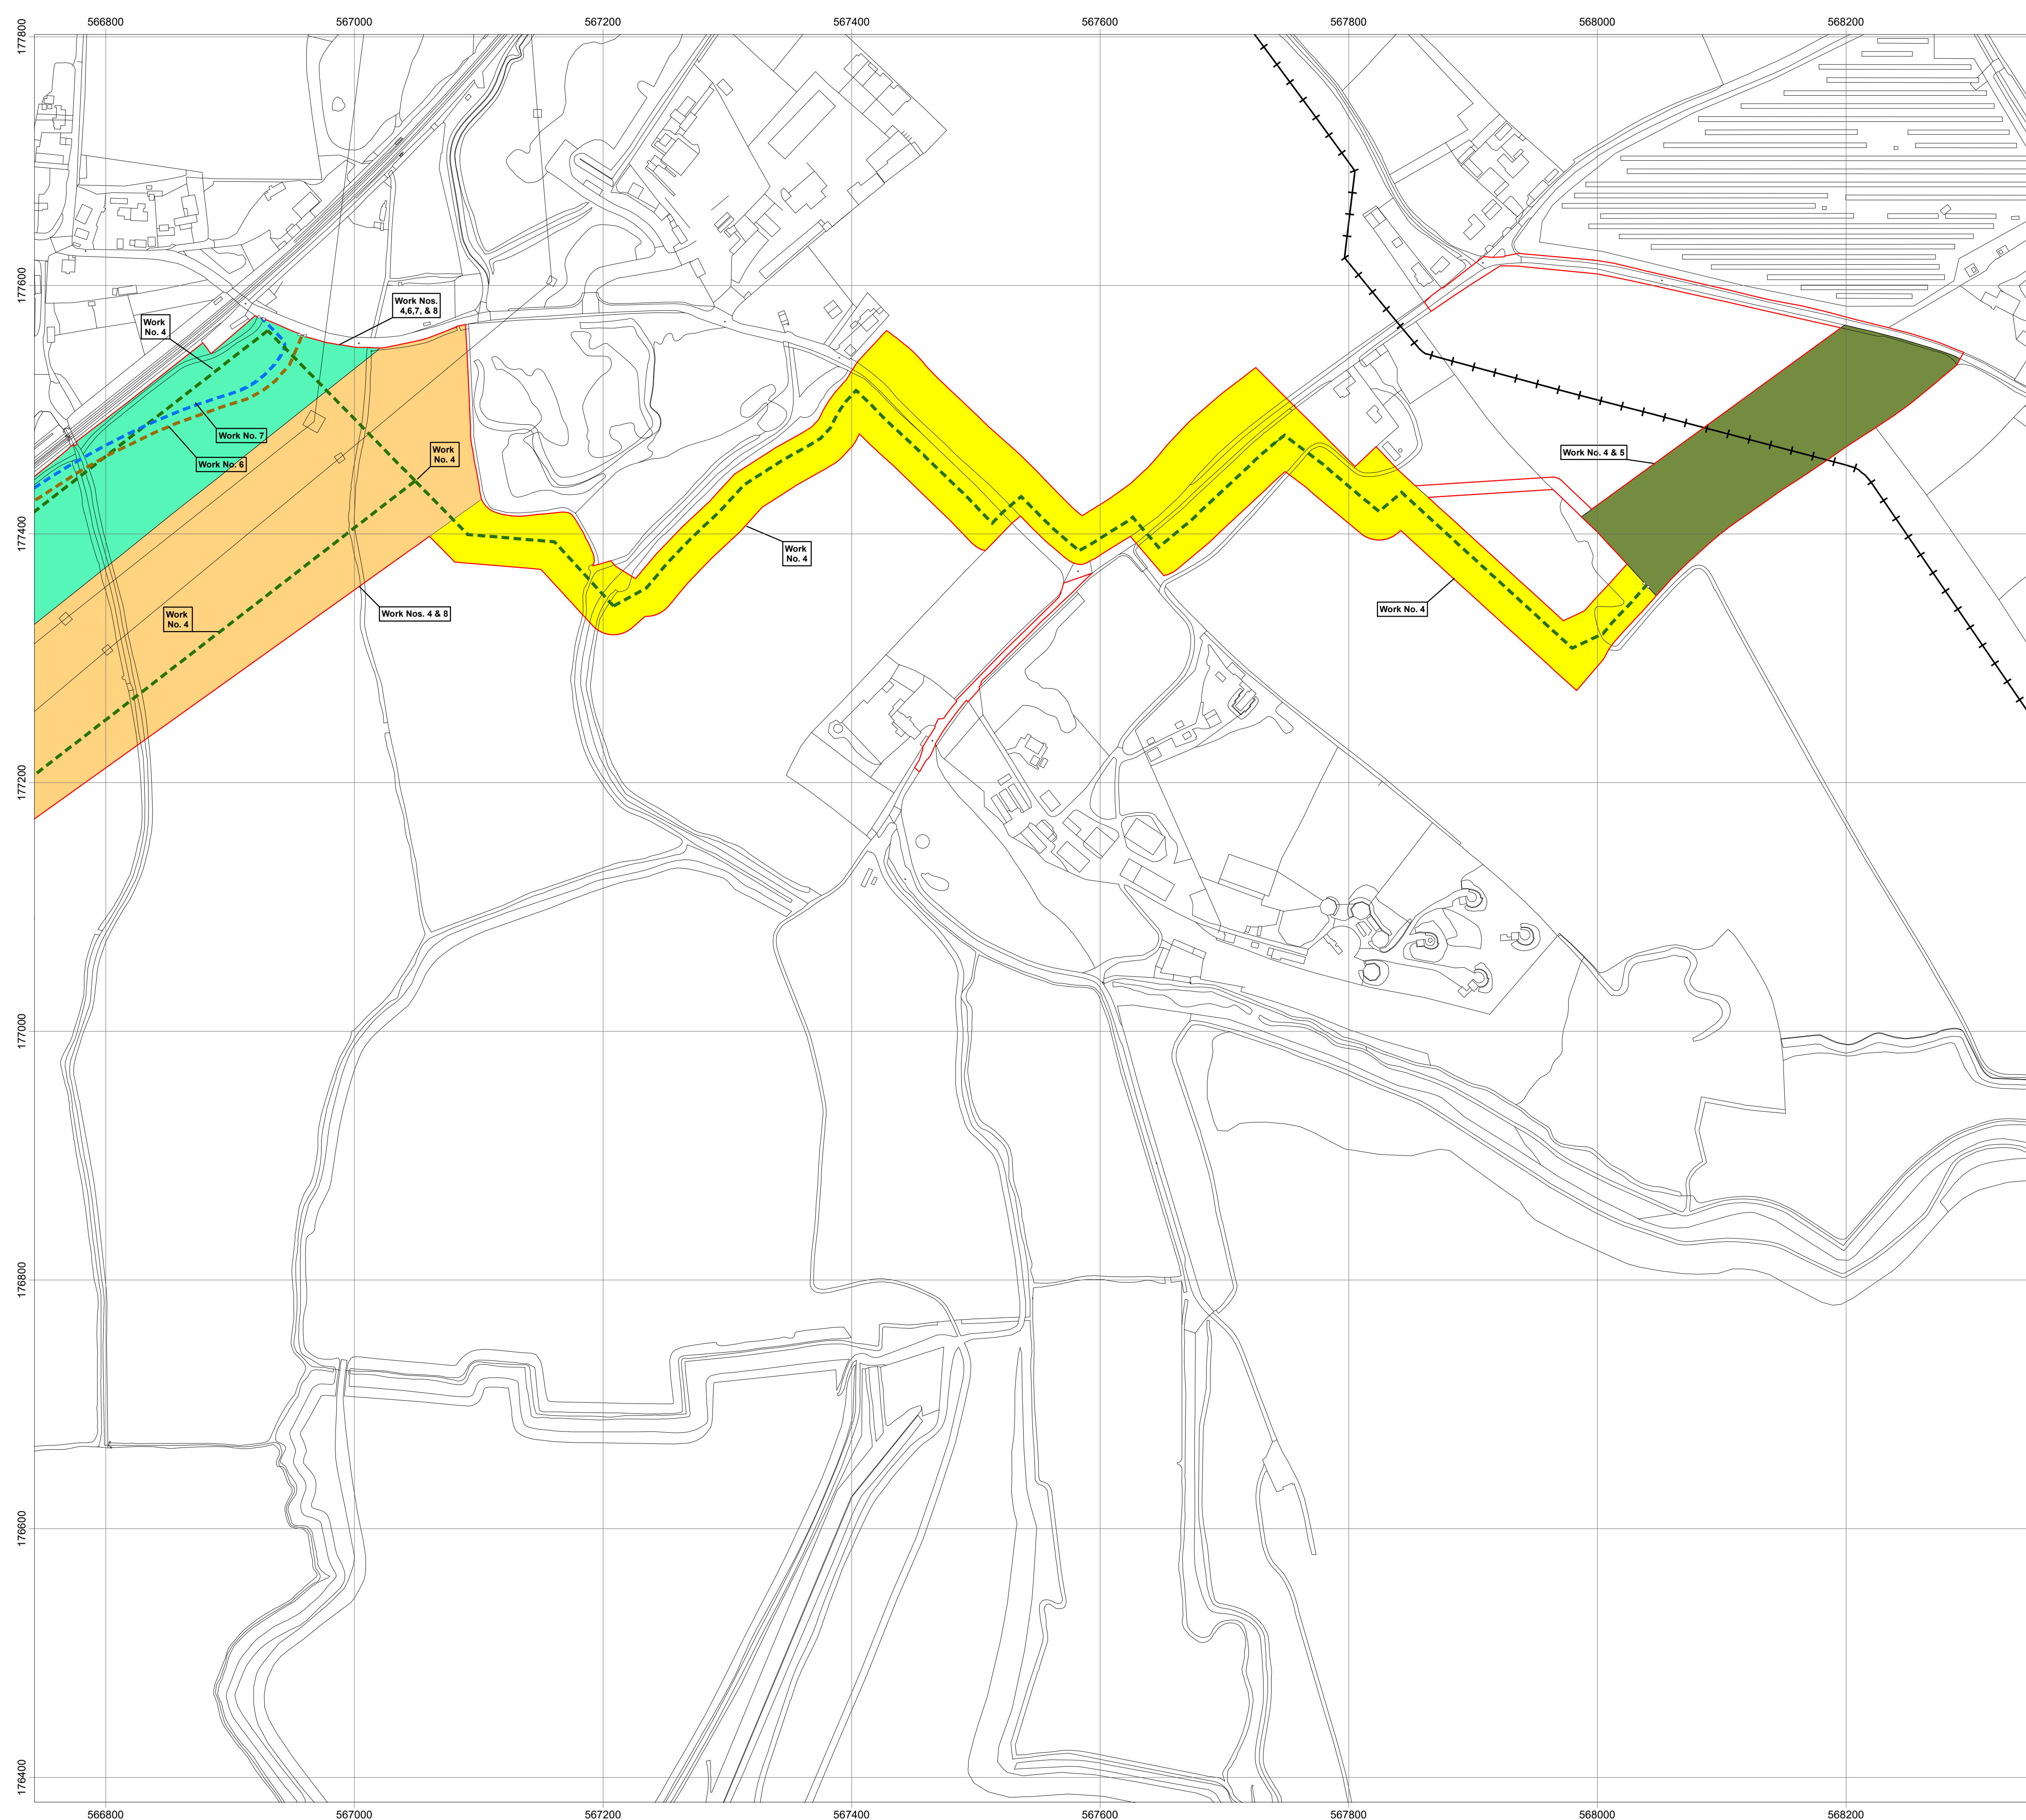


Legend

- | | |
|---|--|
|  | Order Limits |
|  | Work No. 4 indicative centreline |
|  | Work No. 6 indicative centreline |
|  | Work No. 7 indicative centreline |
|  | Start of linear work |
|  | National Grid gas pipeline Feeder 18 |
|  | Work No. 4 |
|  | Work No. 4 limit of deviation and Work No. 5 |
|  | Work No. 4 limit of deviation, Work No. 6 limit of deviation, Work No. 7 limit of deviation and Work No. 8 |
|  | Work No. 4 limit of deviation and Work No. 8 |

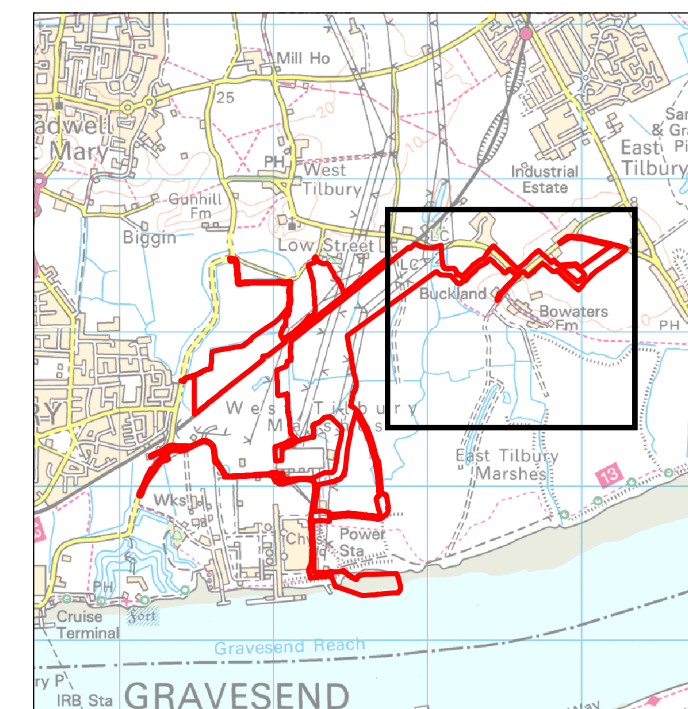

Date: 28/07/2021
Created by: MS
Checked by: TD
Doc no: 10872-0136-32
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG

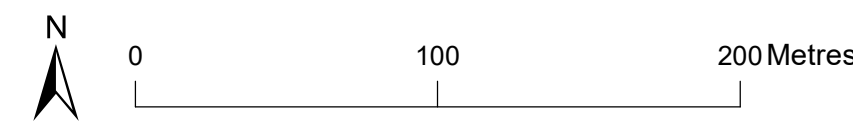


Rev	Date	Remark
1	23/07/20	S51 response: addition of sheet 6
2	30/10/20	Habitat creation changes
3	03/02/21	Work 10 order limits changes
4	19/04/21	Access change
5	28/07/21	Minor correction to Order Limits for Work 12(e)

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Sheet 3 of 6




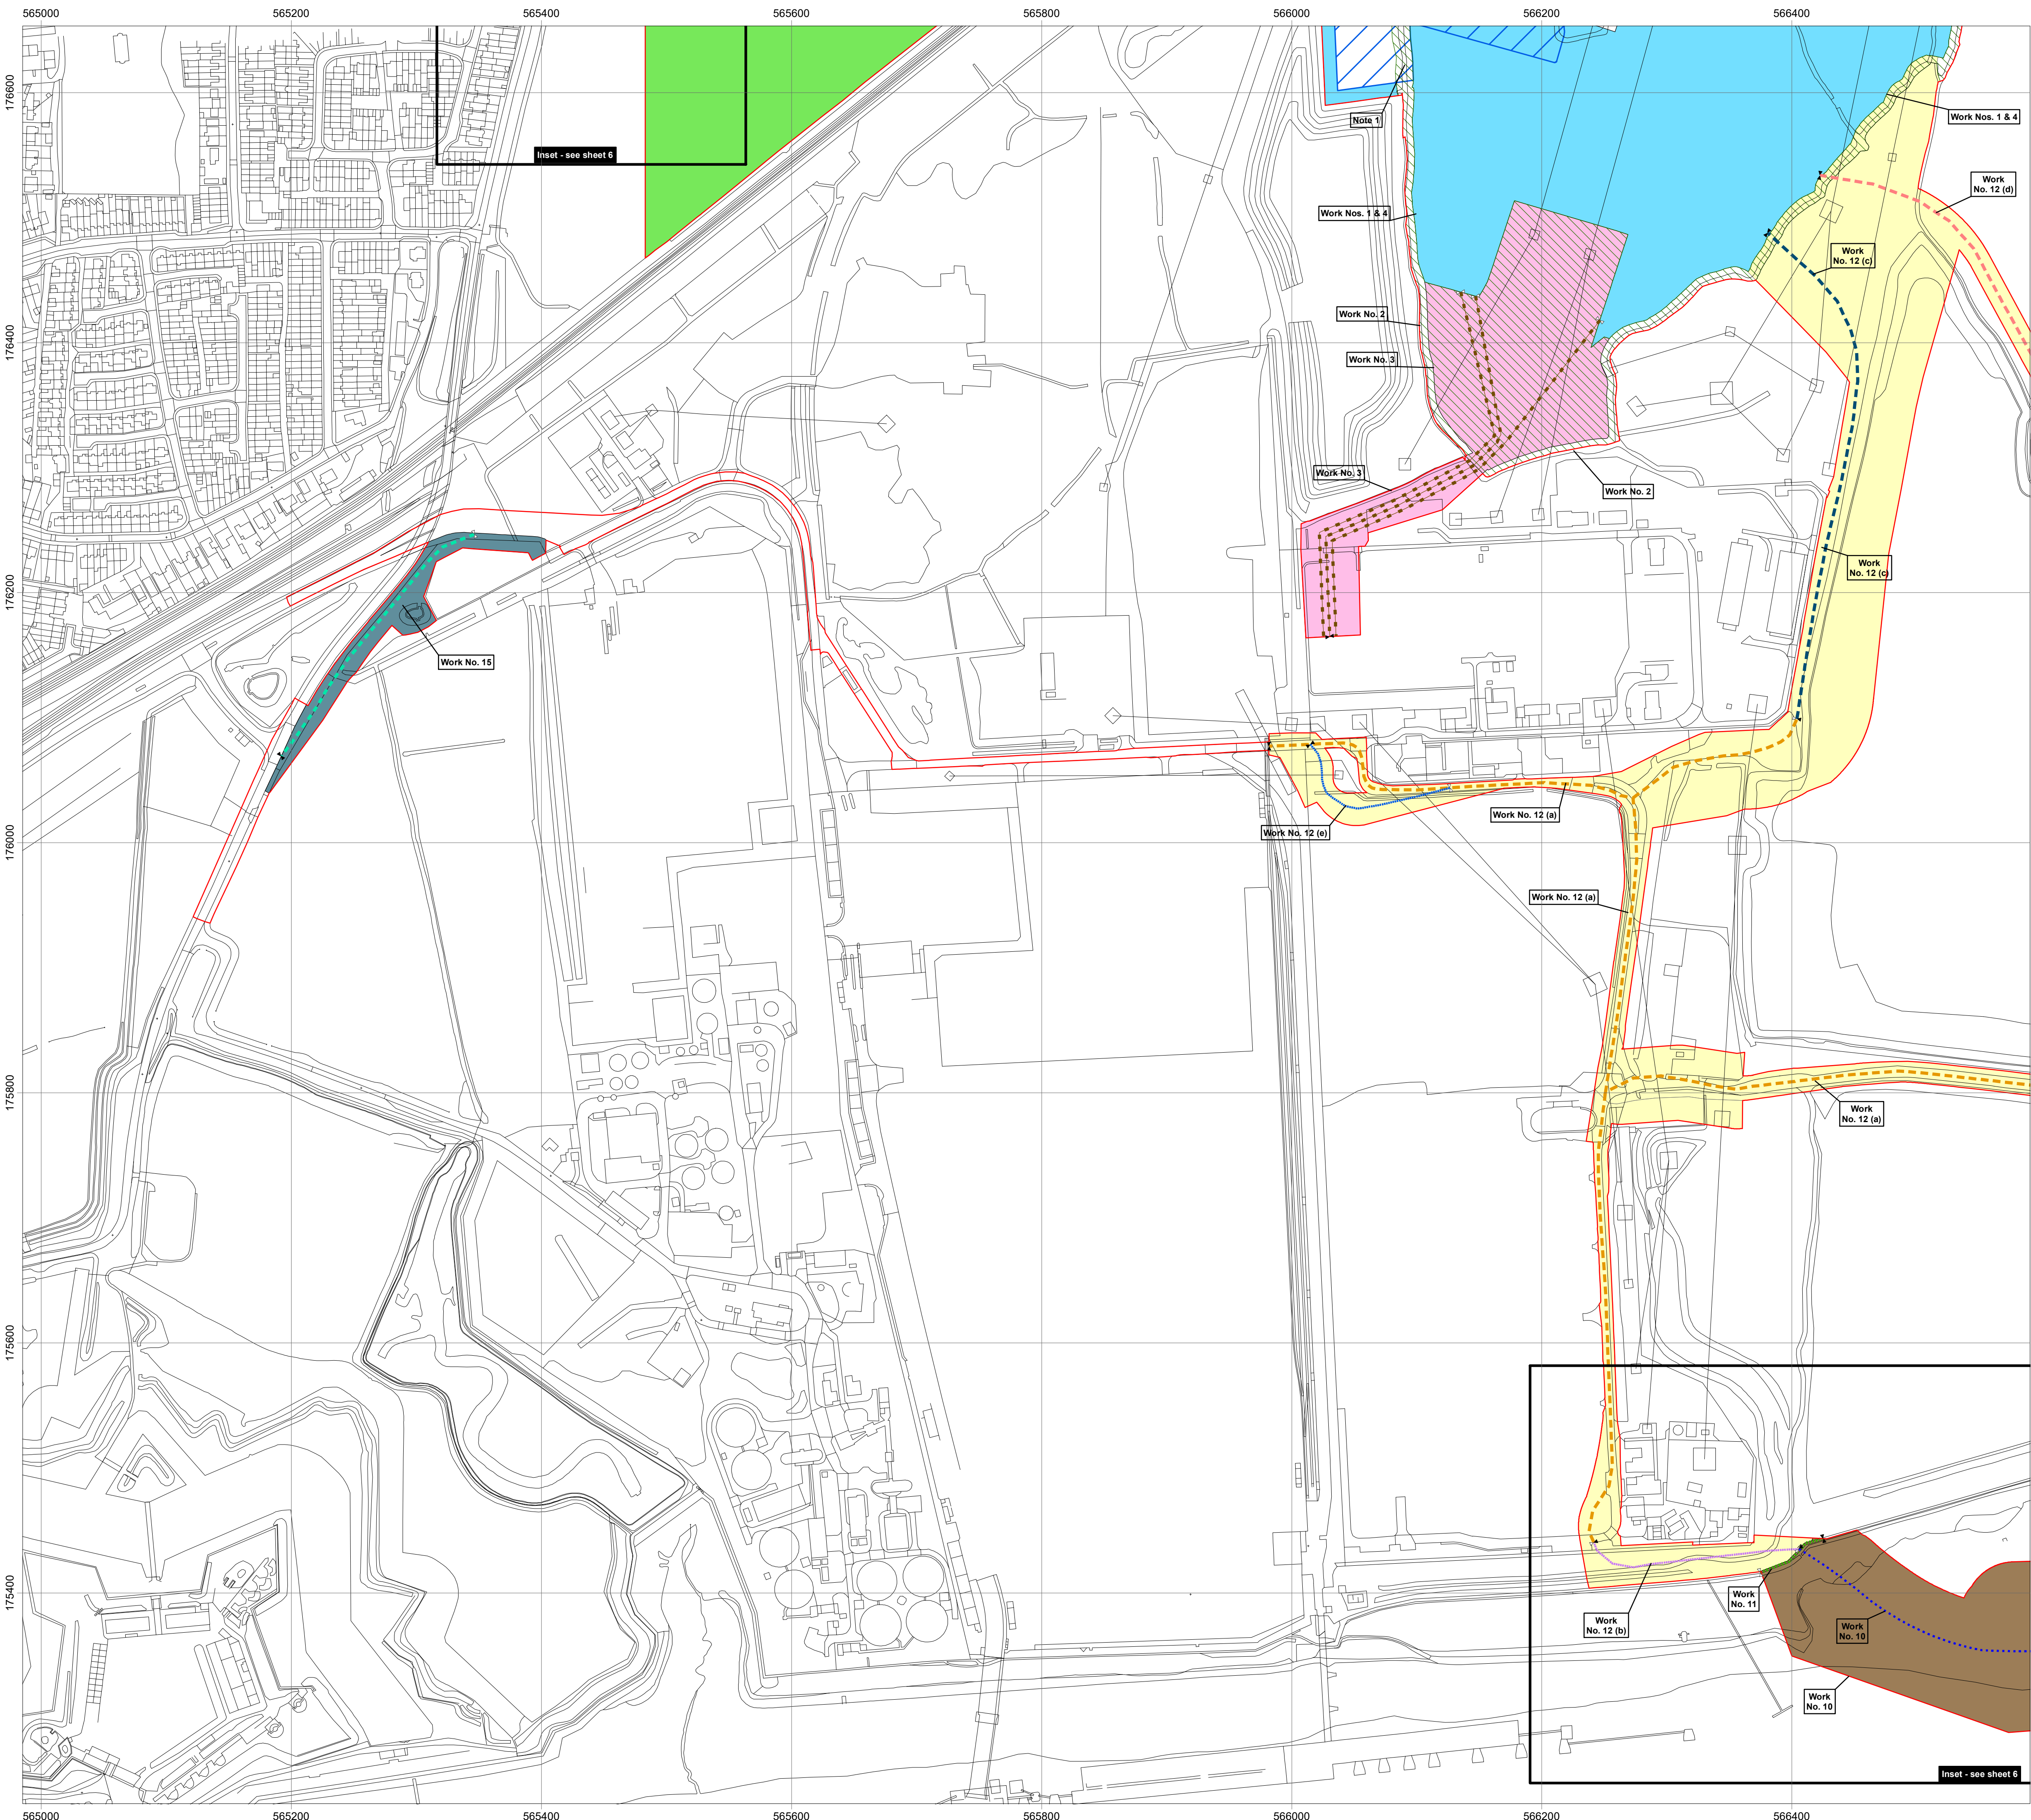


Legend

- Order Limits
- Work No. 3A indicative centreline
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Work No. 12 (c) indicative centreline
- Work No. 12 (d) indicative centreline
- Work No. 12 (e) indicative centreline
- Work No. 15 indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 1 and Work No. 4 limit of deviation
- Work No. 2
- Work No. 3 limit of deviation
- Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Work No. 14
- Work No. 15
- Land for carbon capture readiness (CCR)

Note 1: Ditch to be retained unless CCR land is developed.

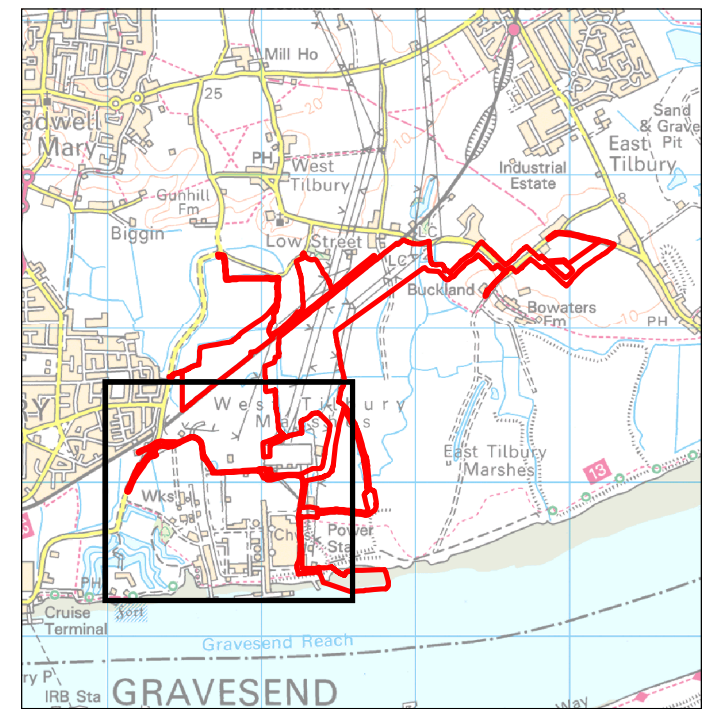

Date: 28/07/2021
Created by: MS
Checked by: TD
Doc no: 10872-0136-32
Scale: A1@ 1:2,500
Reference System: OSGB36
Projection: BNG




Rev	Date	Remark
1	23/07/20	S51 response: addition of sheet 6
2	30/10/20	Habitat creation changes
3	03/02/21	Work 10 order limits changes
4	19/04/21	Access change
5	28/07/21	Minor correction to Order Limits for Work 12(e)

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3


Thurrock Flexible Generation Plant
Work Plans
Sheet 4 of 6



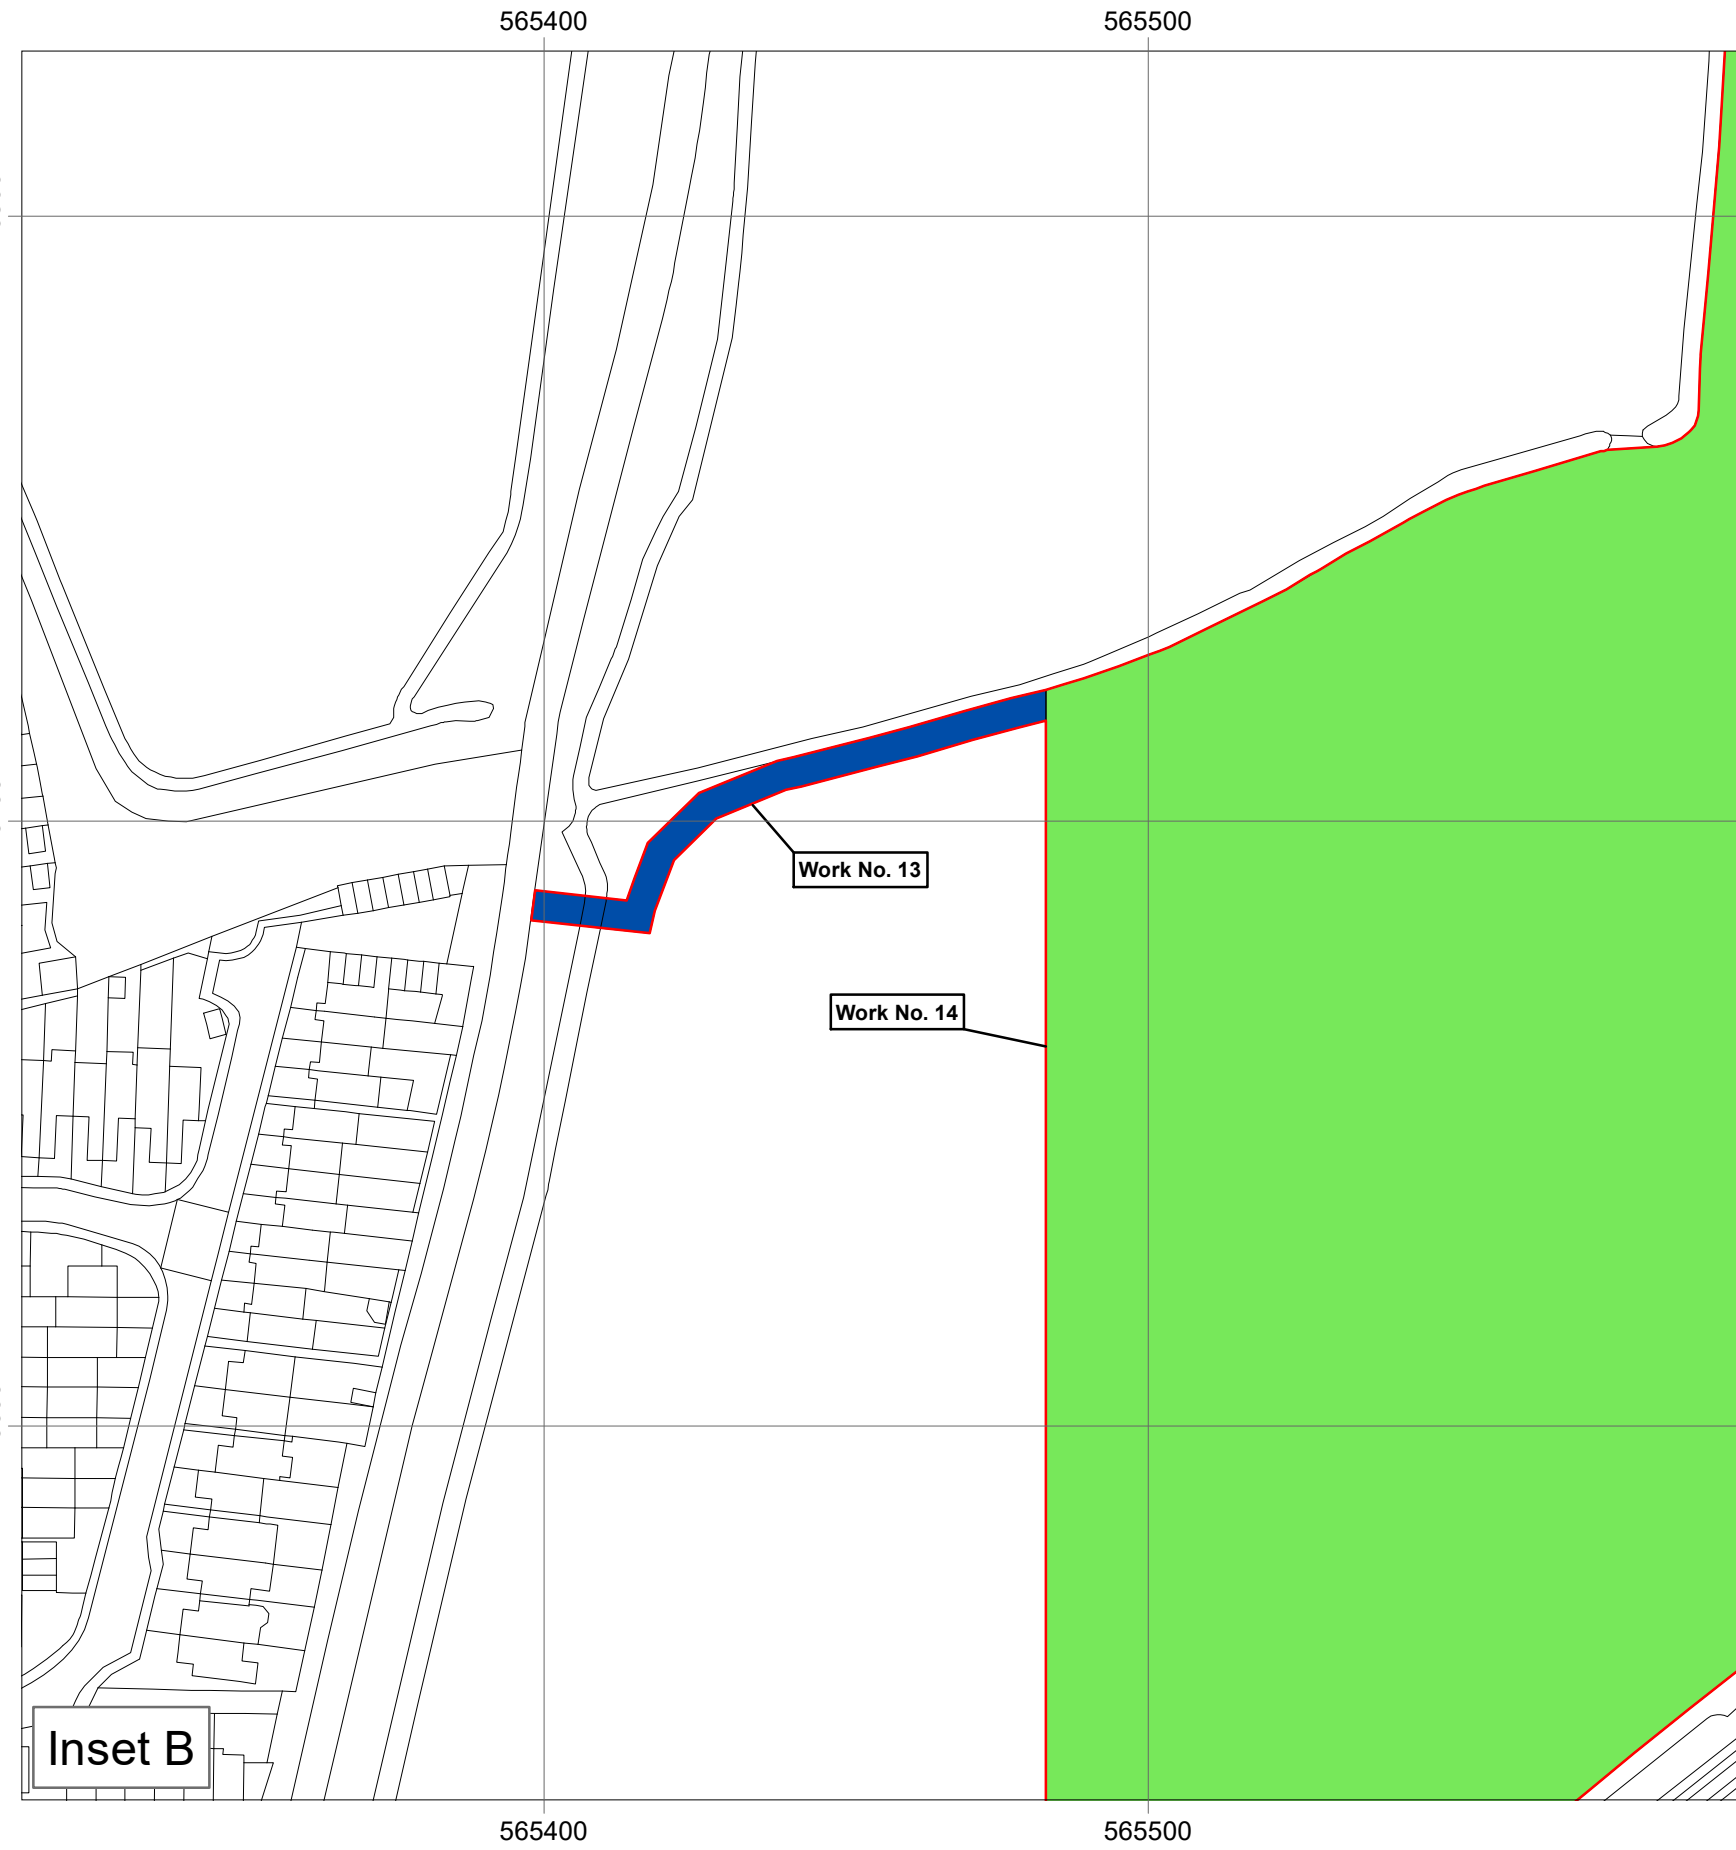

Legend

- Order Limits
- Work No. 10 indicative centreline
- Work No. 11
- Work No. 12 (a) indicative centreline
- Work No. 12 (b) indicative centreline
- Start of linear work
- End of linear work
- Co-terminus start of linear work and end of linear work
- Work No. 10 limit of deviation
- Work No. 12 limit of deviation
- Work No. 13
- Work No. 14

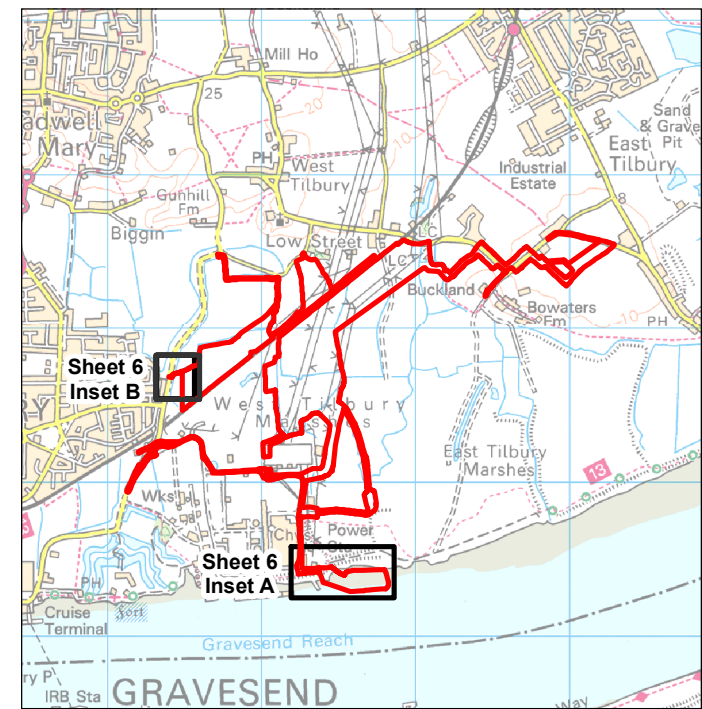

Date: 28/07/21
Created by: MS
Checked by: TD
Doc no: 10872-0205-14
Scale: A1@ 1:1,250
Reference System: OSGB36
Projection: BNG



Rev	Date	Remark
1	23/07/20	S51 response: addition of sheet 6
2	30/10/20	Habitat creation changes
3	08/02/21	Work 10 order limits changes
4	19/04/21	Access change
5	28/07/21	Minor correction to Order Limits for Work 12(e)

APFP Regulations Reference: 5(2)(j)
Application Document Number: A2.3

Thurrock Flexible Generation Plant
Work Plans
Sheet 6 of 6

