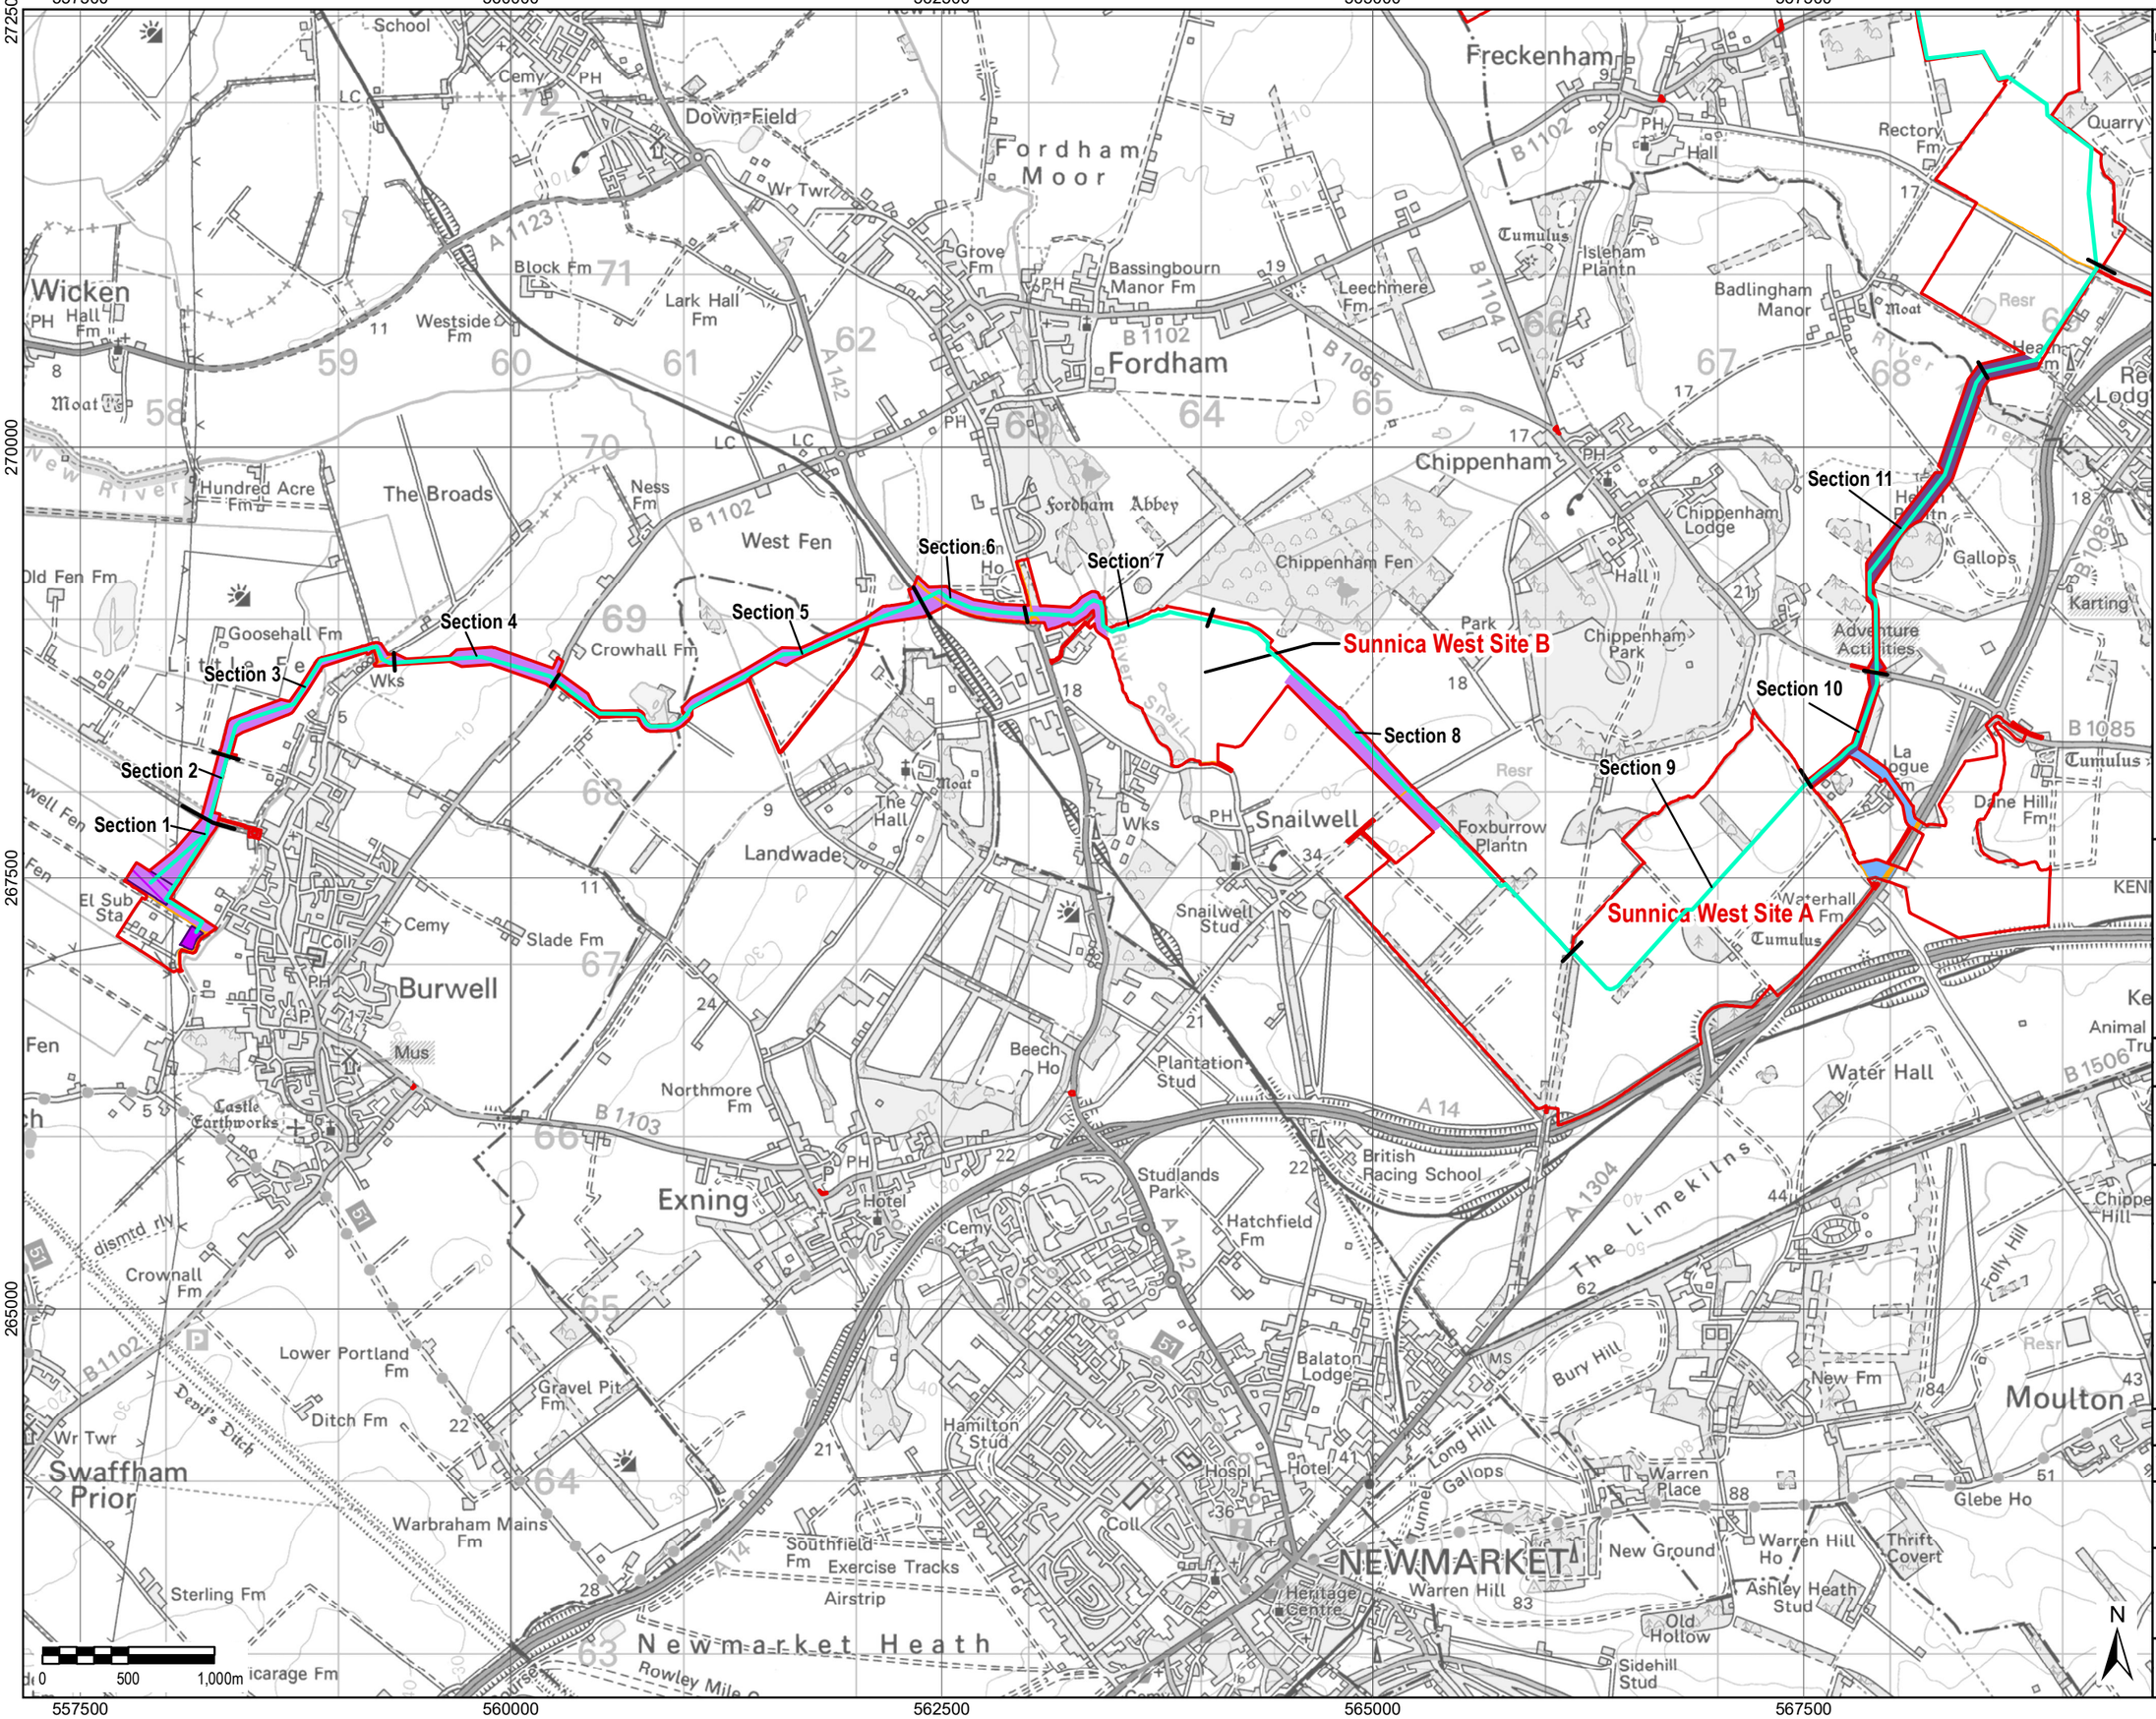

THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR AND IS SUBJECT TO AMENDMENT

LEGEND

- The Order limits
- Cable Section
- Proposed 132kV Cable Route
- Maximum corridor for Grid Connection Route A
- Maximum corridor for Grid Connection Route B
- High Voltage Connection Corridors
- Public Highway within Scheme
- National Grid Substation Extension Burwell - Option 1
- National Grid Substation Extension Burwell - Option 2

NOTE:
Public highways run through the Sunnica East Site, which are not part of the site boundary. These have been digitised based on the 1:1250 scale OS Mastermap.

Document Reference: EN010106/APP/6.3
APFP Regulation: 5(2)(a)

Copyright:
Contains OS data © Crown copyright and database right 2019

Purpose of Issue
FOR DCO SUBMISSION

Client
SUNNICA LTD

Project Title
sunnica energy farm

Drawing Title
FIGURE 3-22B
CABLE ROUTE
CONSTRUCTION SECTIONS

Drawn	Checked	Approved	Date
LL	DW	NC	21/10/2021

AECOM Internal Project No.	Scale @ A3
60589004	1:35,000

THIS DOCUMENT HAS BEEN PREPARED PURSUANT TO AND SUBJECT TO THE TERMS OF AECOM'S APPOINTMENT BY ITS CLIENT. AECOM ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS ORIGINAL CLIENT OR FOLLOWING AECOM'S EXPRESS AGREEMENT TO SUCH USE, AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

AECOM
Unit 1 Wellbrook Court,
Girton,
Cambridge, CB3 0NA
United Kingdom
Telephone (01223) 488000
www.aecom.com

AECOM

Drawing Number	Rev
60589004_ES_SD_022B	0