


GENERAL INSTALLATION

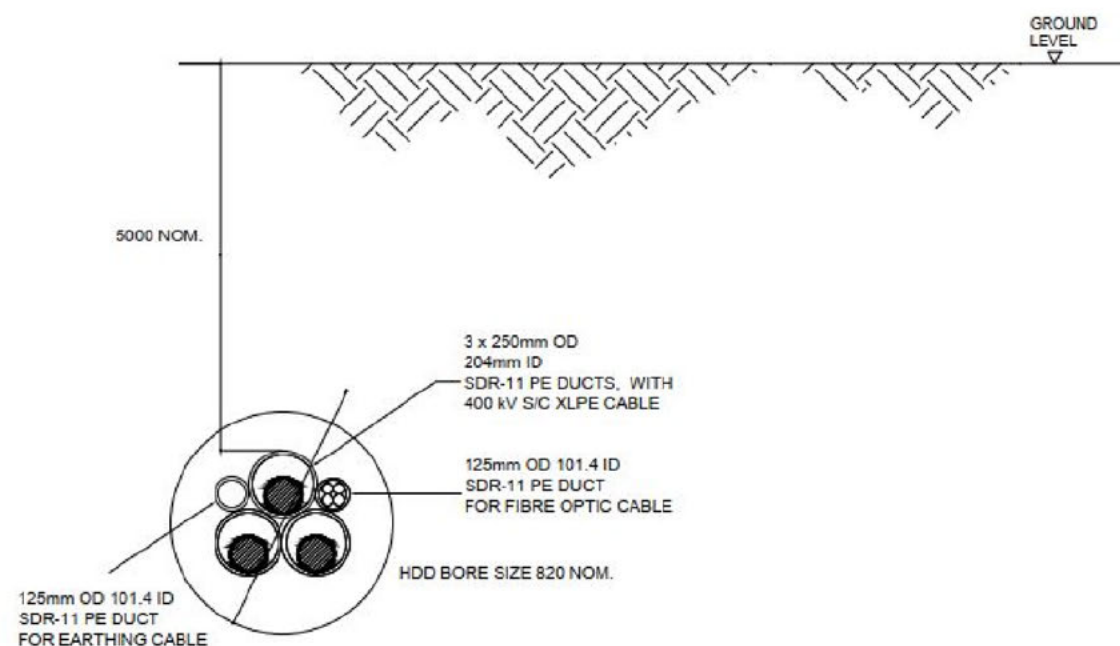

HDD INSTALLATION

NOTE:
Document Reference: EN010106/APP/6.3
AEPF Regulation: 5(2)(a)

Purpose of Issue
FOR DCO SUBMISSION

Client
SUNNICA LTD

Project Title


Drawing Title
FIGURE 3-31
CABLE ROUTE CROSS
SECTIONS - 400KV
SOLUTION (ILLUSTRATIVE)

Drawn	Checked	Approved	Date
LL	DW	NC	04/07/2022

AECOM Internal Project No.	Scale @ A3
60589004	NOT TO SCALE

THIS DOCUMENT HAS BEEN PREPARED PURSUANT TO AND SUBJECT TO THE
TERMS OF AECOM'S APPOINTMENT BY ITS CLIENT. AECOM ACCEPTS NO LIABILITY
FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS ORIGINAL CLIENT OR
FOLLOWING AECOM'S EXPRESS AGREEMENT TO SUCH USE AND ONLY FOR THE
PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

AECOM
Unit 1 Welbrook Court
Girton
Cambridge CB3 0NA
United Kingdom
Telephone (01223) 488000

AECOM

Drawing Number	Rev
60589004_ES_SD_031	0

