

**KEY**

Site Boundary  
(Ref: DX-01-P01 Rev11)

Solar Farm Zone  
(Ref: DX-01-P02 Rev11)

Substation and BESS Compound  
(Ref: DX-01-P02 Rev11)

**Modelled Flood Depth (m)**Fluvial 'Design Flood'  
1% AEP (1 in 100 RP) Fluvial Defended  
+ Climate Change (Higher Central)  
Ref: AEG0851\_ENSO\_BAS\_SCENA\_Q0100\_CC\_HIGHER\_051\_d\_Max-CLIPPED <= 0.001 0.001 - 0.100 0.100 - 0.200 0.200 - 0.300 0.300 - 0.400 0.400 - 0.500 0.500 - 0.600 0.600 - 0.700 0.700 - 0.800 0.800 - 0.900 > 0.900

05001000150020002500 m

1:25,000

Stratton Park House, Wanborough Road  
Swindon, SN3 4HG

Telephone  
01793 828000

Website  
www.pfapl.com

For Planning  
This drawing is produced for the purposes of supporting a planning application and should not be relied upon for tender, pricing, or construction purposes.

- NOTES
1. Drawing is based upon Order Limits Location Plan, Enso Energy Drawing No. DX-01-P01 Rev11 dated 15/02/2024.

2. Drawing is based upon Parameter Plan, Enso Energy Drawing No. DX-01-P02 Rev 11 dated 15/04/2024.

3. Field Numbers based upon Field Boundaries Plan, Enso Energy Drawing No. DX-01-P44 Rev 04 dated 15/04/2024.

4. Flood risk data based on the results from the site-specific flood model produced by Aegaea. Details contained in Hydraulic Model Technical Note (Document Ref: AEG0851\_YO8\_EnsoEnergy\_03 Rev A dated 16/05/2024).

5. Drawing should be read in conjunction with Flood Risk Assessment produced by PFA Consulting (Document Ref: E216-DOC01-FRA-Issue 1, June 2024).

6. May contain Ordnance Survey data © Crown copyright 2020 Ordnance Survey 10024198.

7. Contains public sector information licensed under the Open Government Licence v3.0.

8. Contains OS data © Crown copyright and database right 2022.

9. Contains third party information.

Rev #	Date	Description	Drawn	Check
1	04.06.24	First issue.	BF	SAM

Status

FOR PLANNING

Client

Enso Green Holdings D Limited

Project

Helios Renewable Energy Project

Drawing Title

Fluvial 'Design Flood' Flood Depths

Drawing No.

E216/153

REV #

Date: June 2024


Scale: As Shown

Email: bfox@pfapl.com







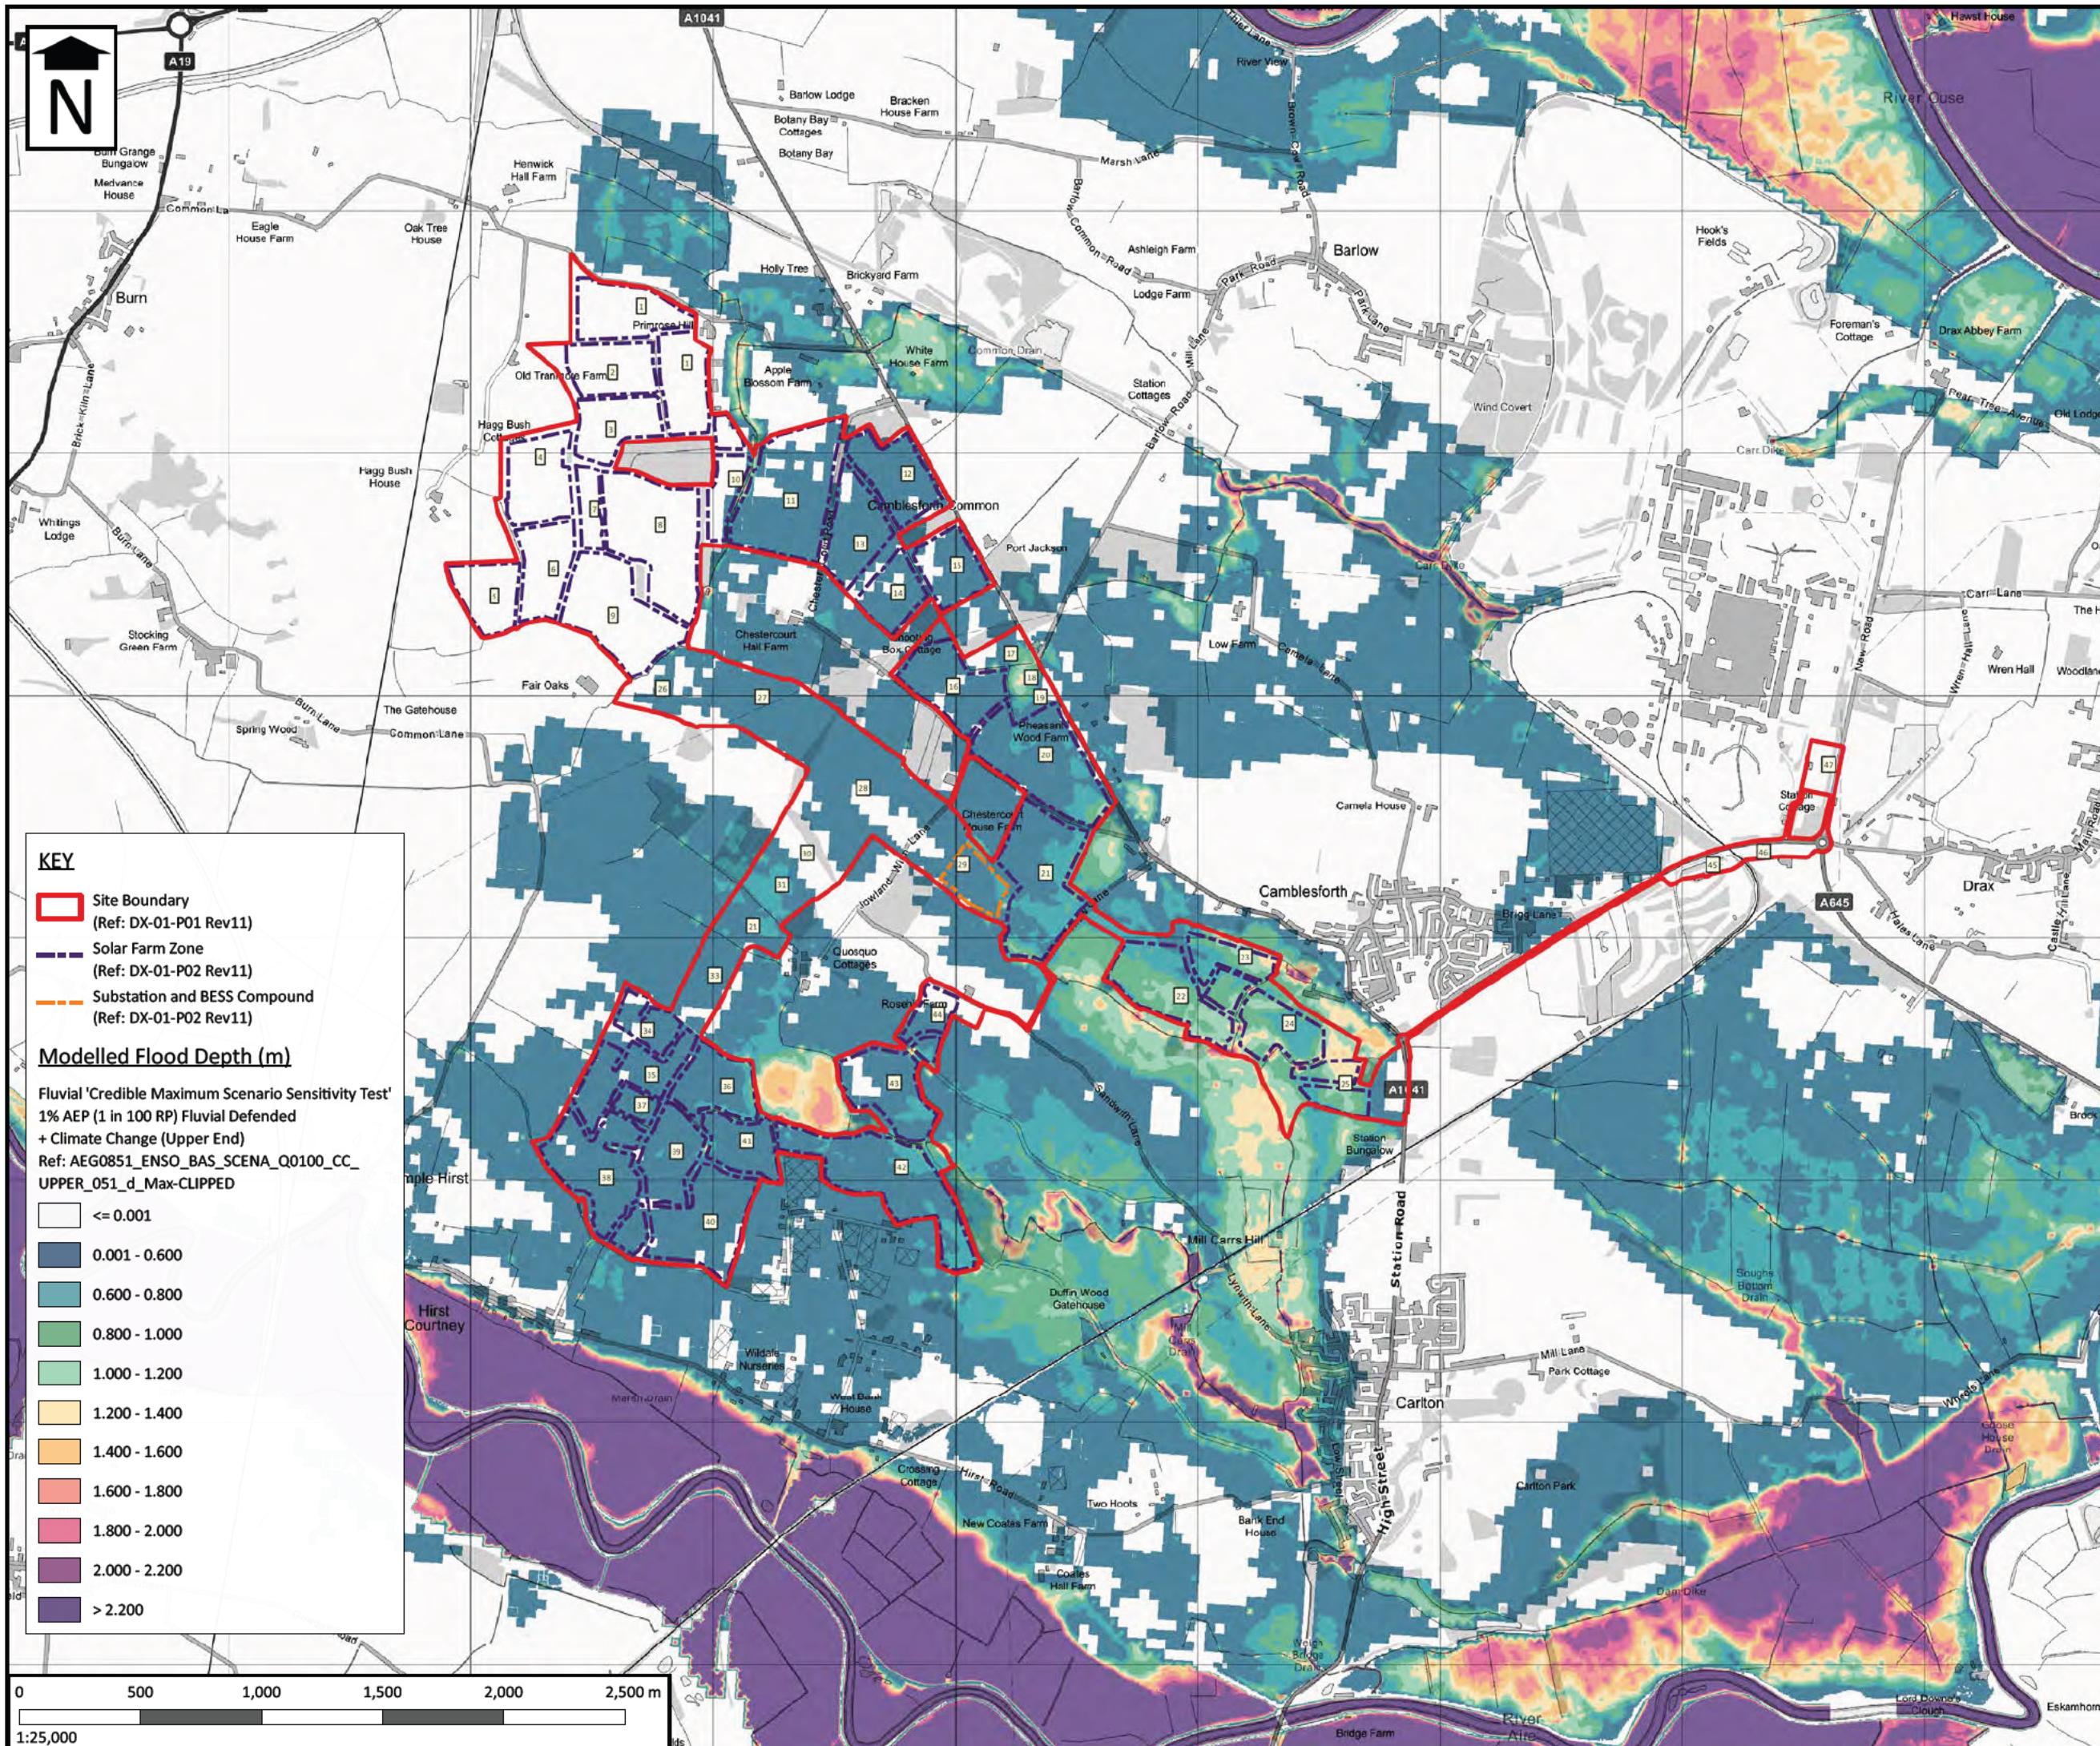

**KEY**

- Site Boundary (Ref: DX-01-P01 Rev11)
- Solar Farm Zone (Ref: DX-01-P02 Rev11)
- Substation and BESS Compound (Ref: DX-01-P02 Rev11)

**Modelled Flood Depth (m)**

Fluvial 'Credible Maximum Scenario Sensitivity Test'  
1% AEP (1 in 100 RP) Fluvial Defended  
+ Climate Change (Upper End)  
Ref: AEG0851\_ENSO\_BAS\_SCENA\_Q0100\_CC\_UPPER\_051\_d\_Max-CLIPPED

<= 0.001
0.001 - 0.600
0.600 - 0.800
0.800 - 1.000
1.000 - 1.200
1.200 - 1.400
1.400 - 1.600
1.600 - 1.800
1.800 - 2.000
2.000 - 2.200
> 2.200

**PFA**  
consulting

Stratton Park House, Wanborough Road  
Swindon, SN3 4HG

Telephone  
01793 828000

Website  
www.pfapl.com

For Planning  
This drawing is produced for the purposes of supporting a planning application and should not be relied upon for tender, pricing, or construction purposes.

- NOTES**
- Drawing is based upon Order Limits Location Plan, Enso Energy Drawing No. DX-01-P01 Rev11 dated 15/02/2024.
  - Drawing is based upon Parameter Plan, Enso Energy Drawing No. DX-01-P02 Rev 11 dated 15/04/2024.
  - Field Numbers based upon Field Boundaries Plan, Enso Energy Drawing No. DX-01-P44 Rev 04 dated 15/04/2024.
  - Flood risk data based on the results from the site-specific flood model produced by Aegaea. Details contained in Hydraulic Model Technical Note (Document Ref: AEG0851\_YO8\_EnsoEnergy\_03 Rev A dated 16/05/2024).
  - Drawing should be read in conjunction with Flood Risk Assessment produced by PFA Consulting (Document Ref: E216-DOC01-FRA-Issue 1, June 2024).
  - May contain Ordnance Survey data © Crown copyright 2020 Ordnance Survey 10024198.
  - Contains public sector information licensed under the Open Government Licence v3.0.
  - Contains OS data © Crown copyright and database right 2022.
  - Contains third party information.

Rev #	Date	Description	Drawn	Check
1	04.06.24	First issue.	BF	SAM

Status **FOR PLANNING**

Client **Enso Green Holdings D Limited**

Project **Helios Renewable Energy Project**

Drawing Title **Fluvial 'Credible Maximum Scenario Sensitivity Test' Flood Depths**


Drawing No. **E216/154** REV #

Date: June 2024 Scale: As Shown  
Email: bfox@pfapl.com







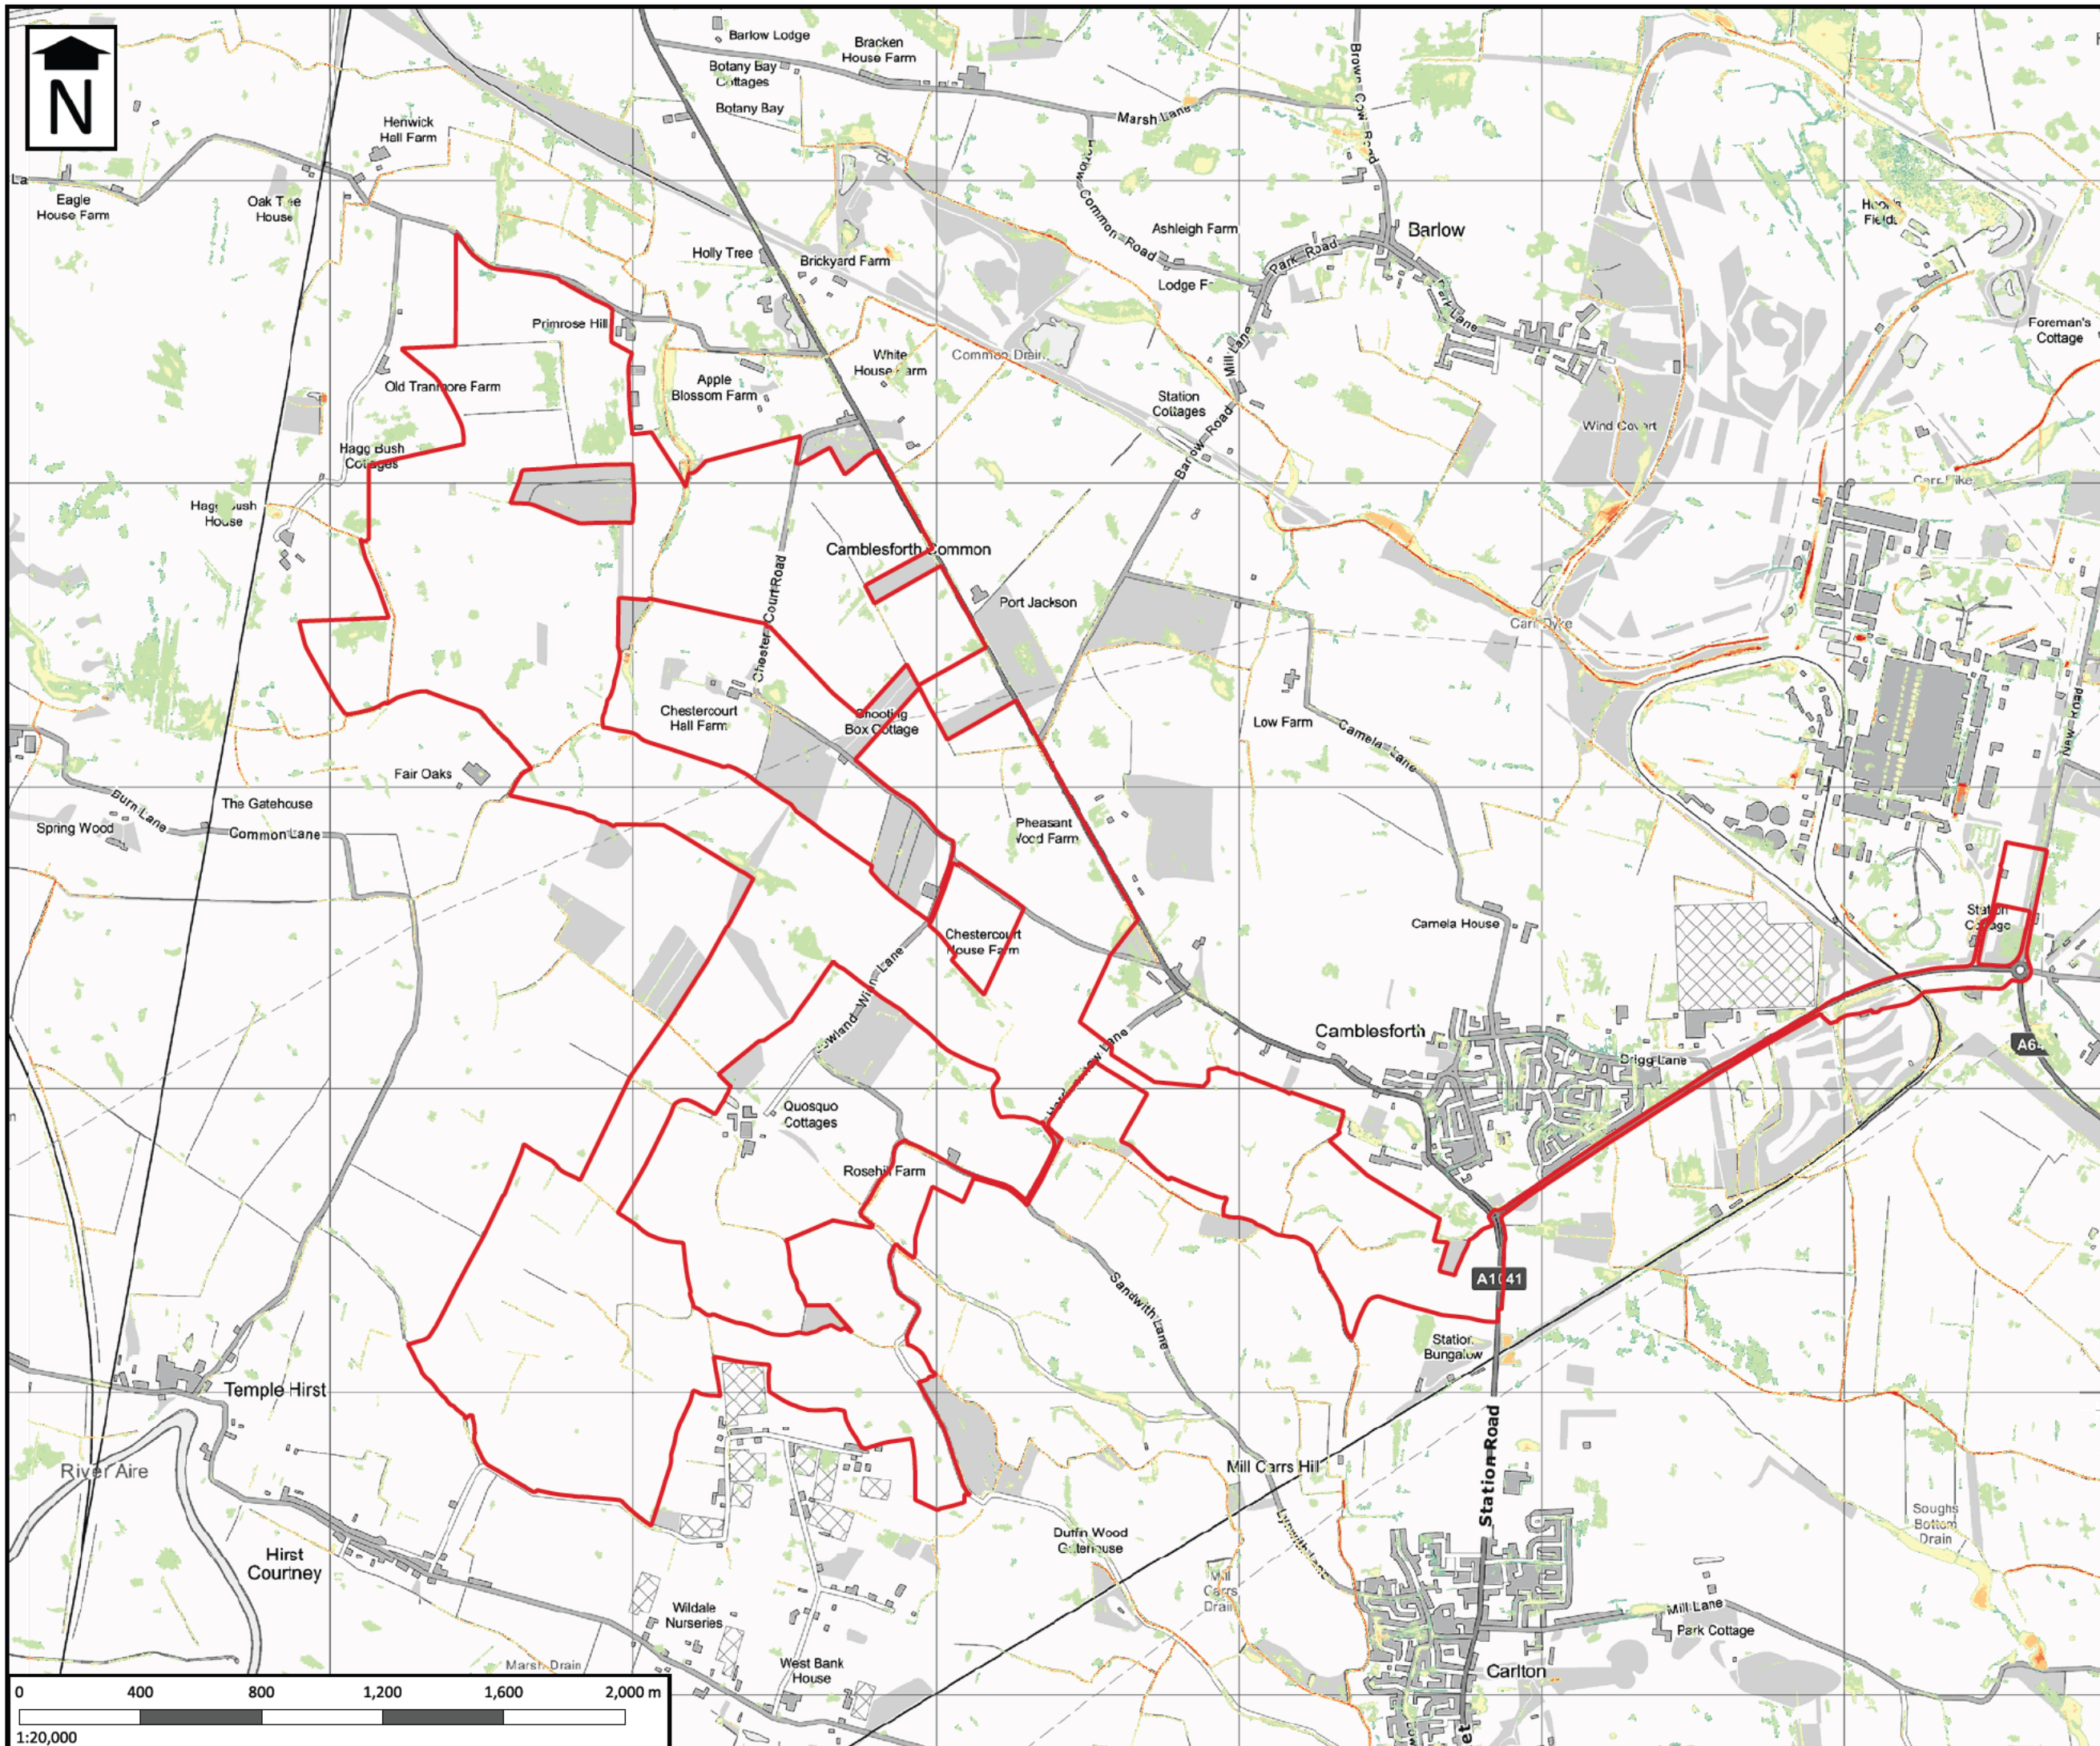

For Planning  
This drawing is produced for the purposes of supporting a  
planning application and should not be relied upon for tender,  
pricing, or construction purposes.

**KEY**

— Site Boundary

Risk of Flooding from Surface Water  
Low Risk Modelled Flood Depth (m)  
Ref: RoFSW\_SE62\_Depth\_1in1000

0.00 - 0.15
0.15 - 0.30
0.30 - 0.60
0.60 - 0.90
0.90 - 1.20
> 1.20

- NOTES**
- Drawing is based upon drawing number  
DX-01-P01 Rev10 Site Boundary by Enso Energy  
dated 07/02/2024.
  - Contains public sector information licensed  
under the Open Government Licence v3.0.

Rev	Date	Description	Drawn	Check
#	NI	First issue.	RS	BF
A	31.05.23	Site boundary updated.	RS	BF
B	22/08/23	Update to Red Line Boundary	IS	BF
C	14/02/24	Update to Red Line Boundary	JS	BF

Status

**FOR PLANNING**

Client

**Enso Green Holdings D Limited**

Project

**Helios Renewable Energy  
Project**

Drawing Title

**Risk of Flooding from  
Surface Water  
(1 in 1000 yr)**

Drawing No. **E216/02**

REV C



Date: May 2023 Scale: As Shown

Email: rsmith@pfapl.com







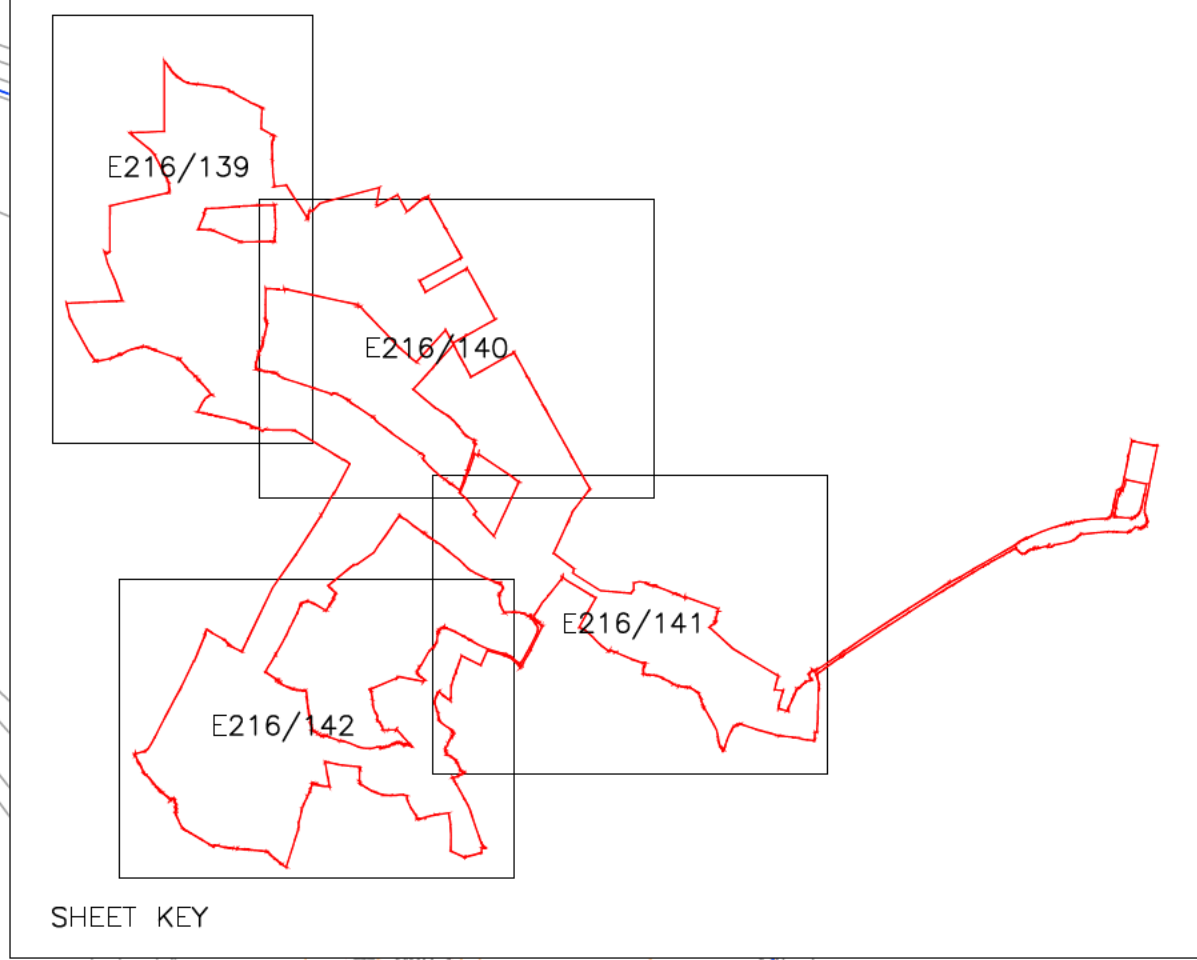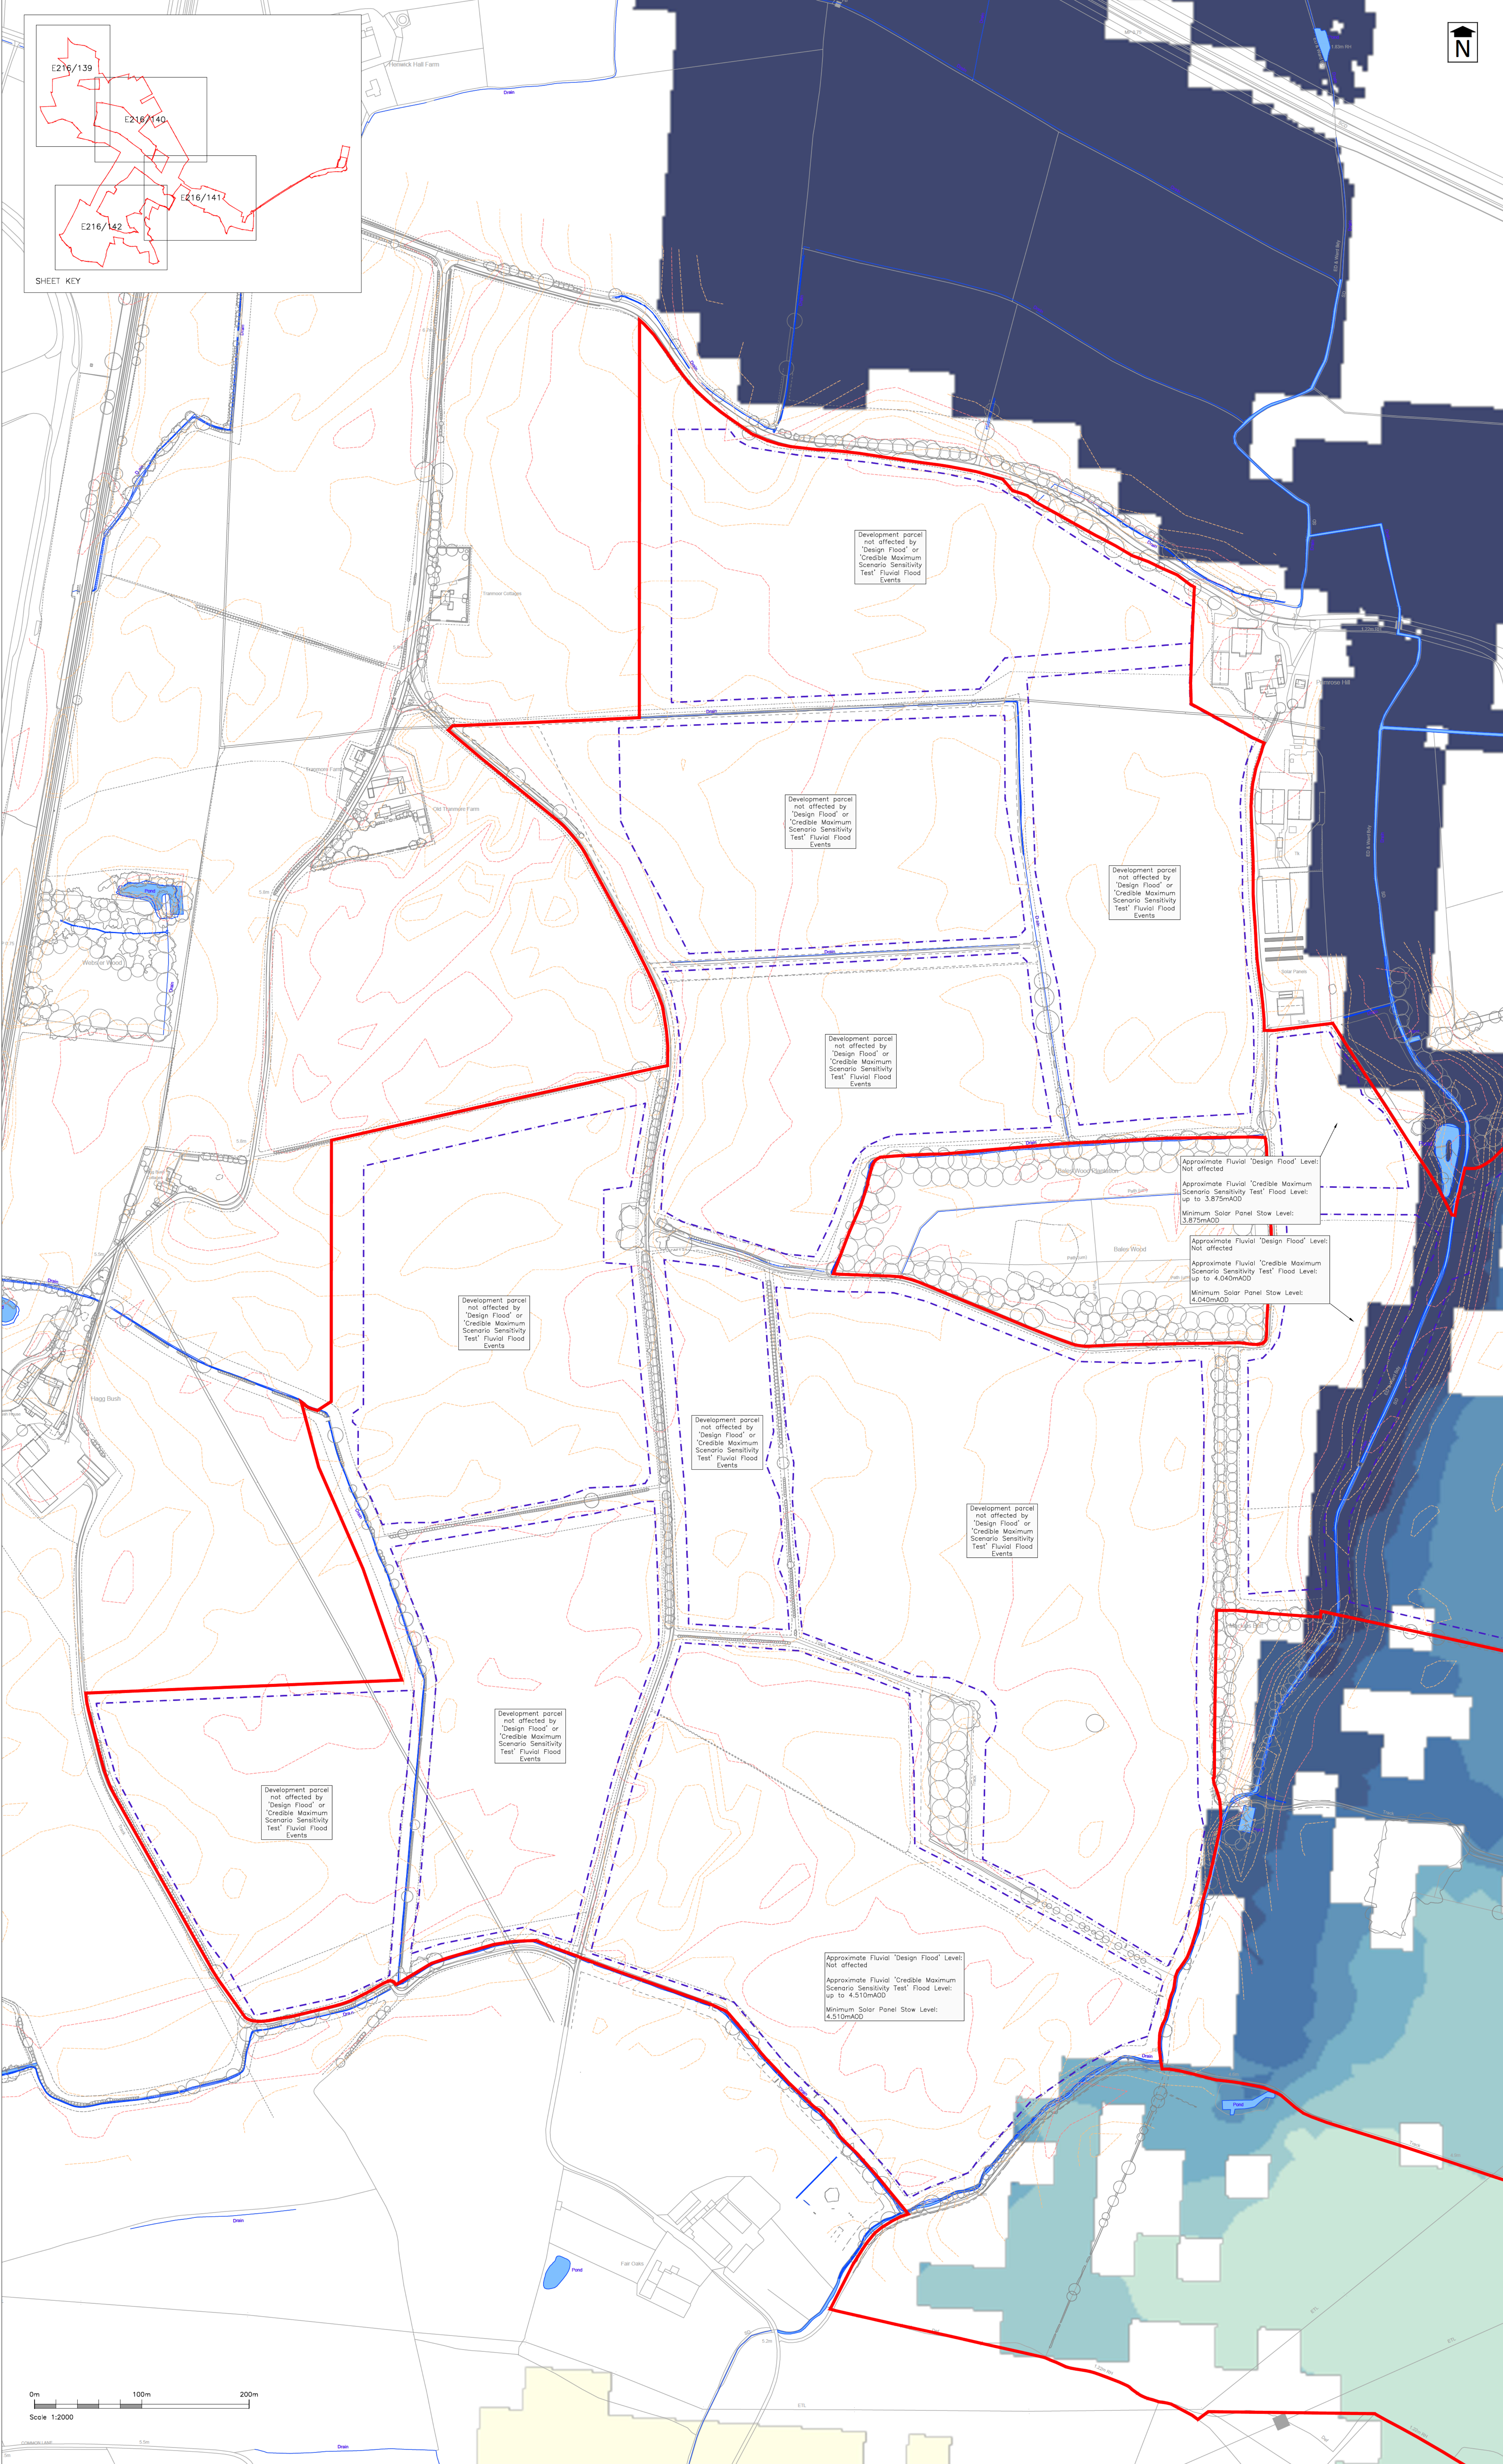

Stratton Park House, Wanborough Road  
Swindon, SN3 4HG

Telephone  
01793 828000

Website  
www.pfapl.com

For Planning  
This drawing is produced for the purposes of supporting a planning application and should not be relied upon for tender, pricing, or construction purposes.

#### NOTES

1. Site Boundary based upon Order Limits Location Plan, Enso Energy Drawing No. DX-01-P01 Rev 11, dated 15/02/24.
2. Drawing based upon Parameter Plan, Enso Energy Drawing No. DX-01-P02 Rev 11, dated 15/04/24.
3. Flood risk data based on the results from the site-specific flood model produced by Ageas. Details contained in Hydraulic Model Technical Note (Document Ref: AIC00851\_Y08\_EnsoEnergy\_03 Rev A dated 16/02/24).
4. Drawing should be read in conjunction with Flood Risk Assessment produced by PFA Consulting (Document Ref: E216-DD001-IRA-Issue 1, June 2024).
5. Contains public sector information licensed under the Open Government Licence v3.0.
6. Contains OS data © Crown copyright and database right, 2022.
7. Contains third party information.
8. Minimum equipment levels subject to detailed design and will be informed by an Environment Agency approved site-specific flood model.
9. Minimum equipment levels rounded to nearest 0.005m.

#### Summary of Flood Mitigation Measures

The Proposed Development extends into areas of elevated flood risk from the fluvial 'design flood'. The Proposed Development would be designed to appropriately safe in the fluvial 'design flood' without increasing flood risk elsewhere. The Proposed Development would be designed to be resilient to the fluvial 'credible maximum scenario sensitivity test' flood event with the implementation of adaptation measures where necessary at the appropriate time.


The following design flood mitigation and adaptation measures are proposed:

- A flood warning and evacuation plan for the relevant phases of the Proposed Development would be contained in the detailed CEMP, OEMP or DEMP and the construction contractor and operating staff would register to receive flood alerts / warnings from the EA and follow site evacuation procedures during periods of elevated flood risk.
- During times of elevated tidal and fluvial flood risk the solar arrays within the areas of elevated flood risk would be rotated to the horizontal stow position which would be a minimum of 0.3m above the fluvial 'design flood' level or the stow position set above the fluvial 'credible maximum scenario sensitivity test' level, whichever is greater.
- Panel supports and security fencing in flood risk areas would be securely tied into the ground and designed to allow for the effect of flowing water pressures and to be resistant to inundation during a flood event.
- Security fencing mesh size in flood risk areas (fluvial 'design flood') would be increased to 0.15m square to minimise the risk of it collecting debris.
- Ancillary control equipment will be preferentially located in areas of very low surface water flood risk and very low fluvial flood risk in the fluvial 'design flood' and in areas affected by flood depths <0.6m in the fluvial 'credible maximum scenario sensitivity test' flood event.
- Substation and BISS Compound will be preferentially located in areas of very low surface water flood risk and very low fluvial flood risk in the fluvial 'design flood'.
- The level of ancillary control equipment will be raised at least 0.3m (and up to 0.6m) above existing ground level to manage residual risk.
- As an adaptation measures the Substation and BISS Compound would be protected by a suitably designed earth flood defence bund. The height of the proposed earth flood defence bund would be raised at least +0.6m above the fluvial 'credible maximum scenario sensitivity test' flood level to protect the equipment from inundation.
- The Flood Management Strategy for the Site will keep under review the need to implement a level for level floodplain compensation scheme for the Substation and BISS Compound to mitigate the effect of the earth flood defence bund. A preliminary floodplain compensation scheme within the DCO limits has been shown to be feasible.
- On-site watercourses are retained and existing watercourse crossings are utilised where possible within the Proposed Development.
- Where possible all development (including security fencing) is at least 7m from the on-site ancillary watercourses in accordance with Safety Area (SAB) byelaws. Additional consents may be required for watercourse crossings (site access or services) and landscape planting where this is not achieved.

#### Key

- Site Boundary
- Solar Farm Zone
- Substation and BISS Compound
- Watercourse
- Contours

Modelled Flood Levels (mAOD)  
Fluvial 'Credible Maximum Scenario Sensitivity Test'  
1% AEP (1 in 100 RP) Fluvial Defended  
+ Climate Change (Upper End)  
Ref: AIC00851\_ENSO\_BMS\_SC004\_00100\_CC  
UPPER\_001\_n\_Max-CLIPPED

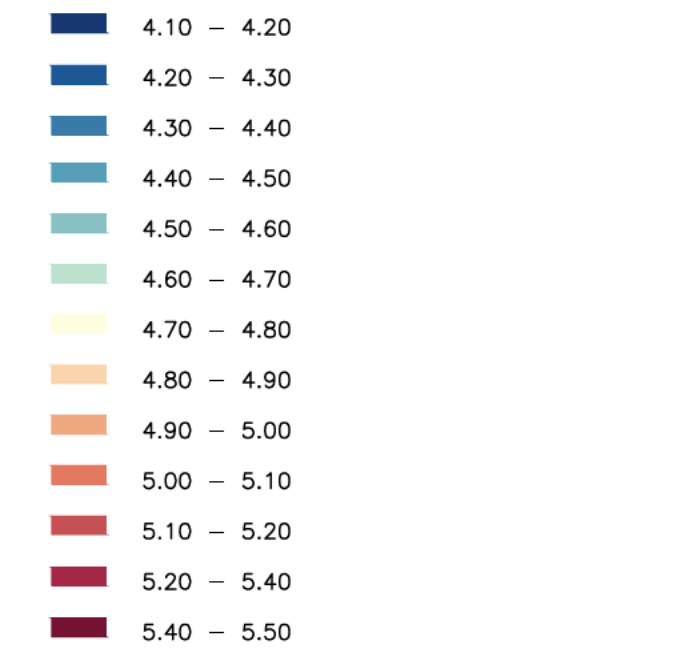

Note: Modelled flood levels to be reviewed following Environment Agency approval of the site-specific flood model.

Rev	Date	Description	Drawn	Check
#	13/02/24	First Issue	JS	BF
A	04/06/24	Flood mitigation and adaptation measures updated to reflect site-specific flood modelling (May 2024).	BF	SAM

Status  
**FOR PLANNING**

Client

Enso Green Holdings D Ltd

Project

Helios Renewable Energy  
Project

Drawing Title

Minimum Equipment  
Levels Sheet 1 of 4

Drawing No. **E216/139**

Rev A

Date: February 2024  
E-Mail: [pfapl.com](mailto:pfapl.com)

Scale: 1:2000 @ A0