

Tween Bridge Solar Farm

Environmental Statement

Figure 2.3: Heights Parameters Zonal Plan

Planning Act 2008


Infrastructure Planning (Applications: Prescribed Forms
and Procedure) Regulations 2009

APFP Regulation 5(2)(a)

Document Reference: 6.4.2.3

August 2025


Revision 1

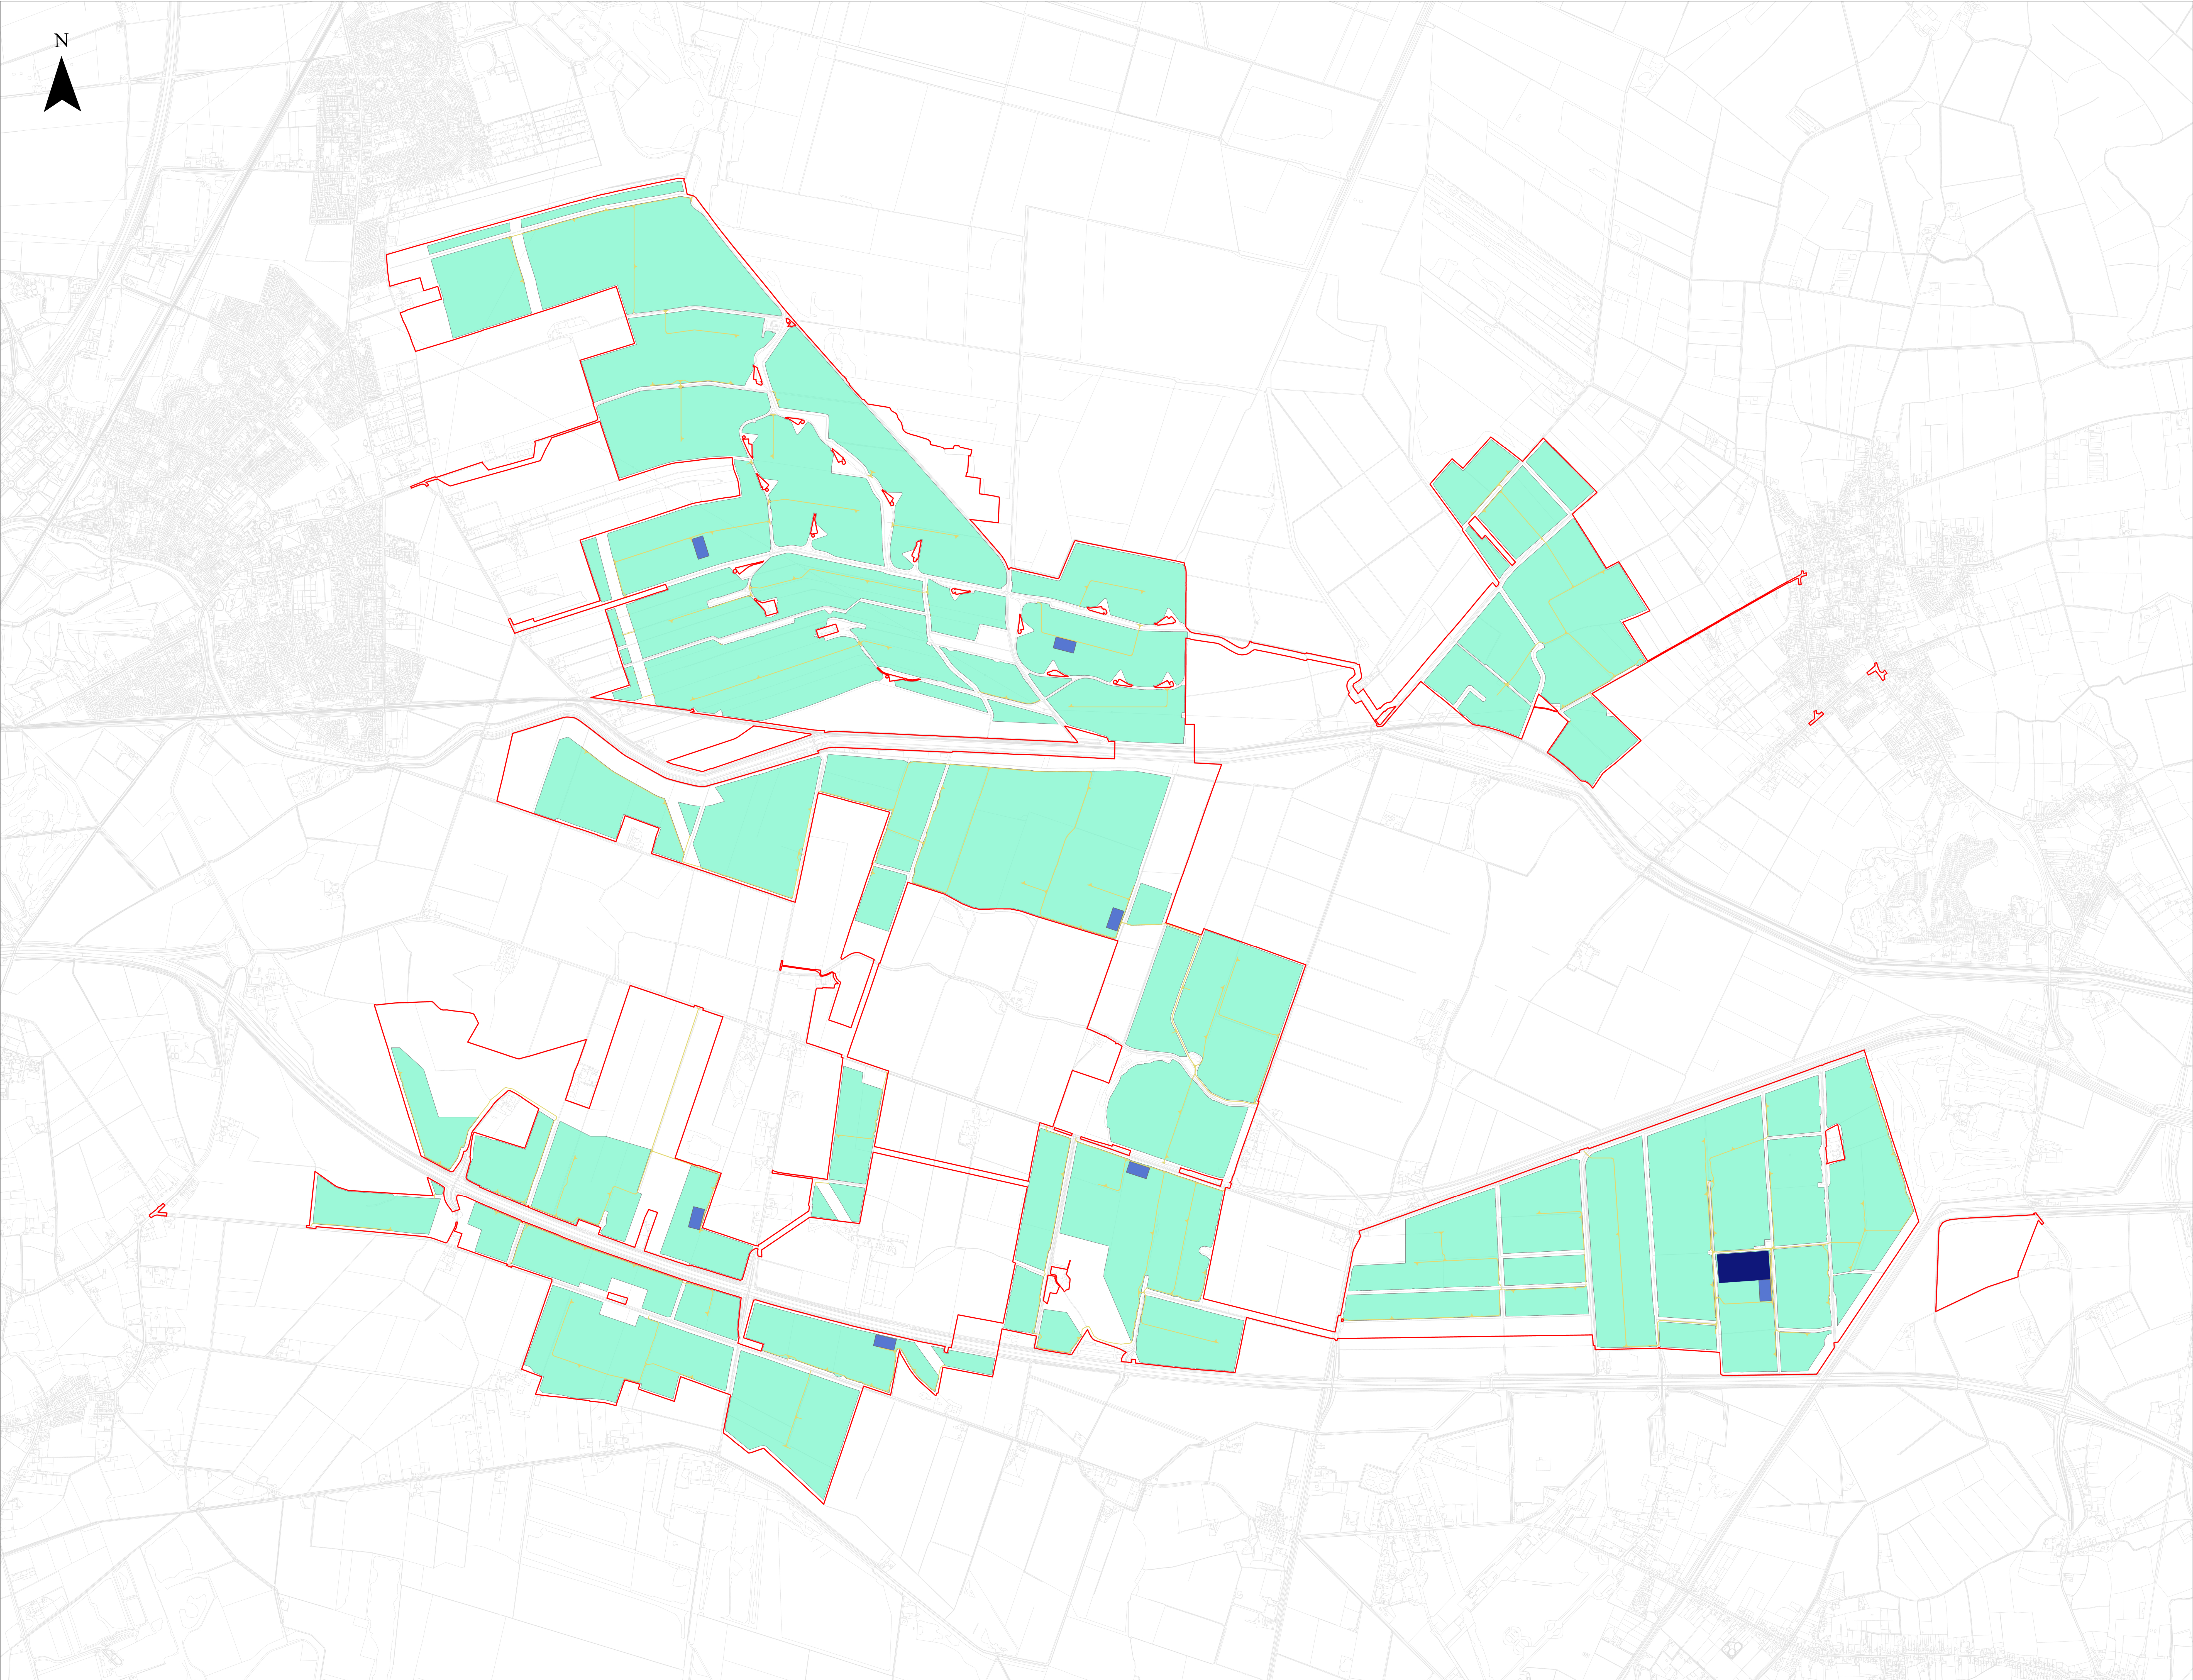

- LEGEND**
- Order Limits
 - Internal Access Tracks
 - Up to 3.6m height (Solar PV Modules up to 3m, Inverters and Bess up to 3.6m)
 - Up to 15m height (Onsite 400kV Substation: electrical equipment 13.0m)
 - Up to 15m height (Onsite 132kV Substation: electrical equipment 8.0m)


Notes

N/A

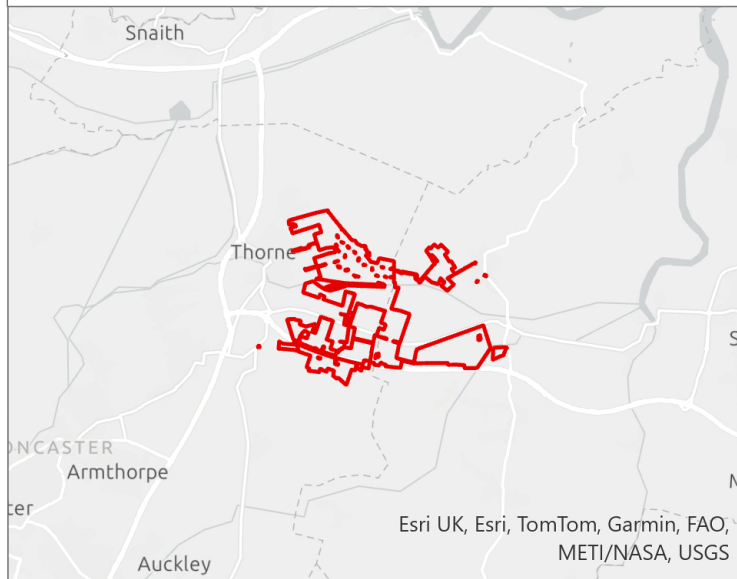

Tween Bridge Solar Farm

Drawing Ref: Environmental Statement Volume 3,
Figure 2.3: Height Parameters Zonal Plan

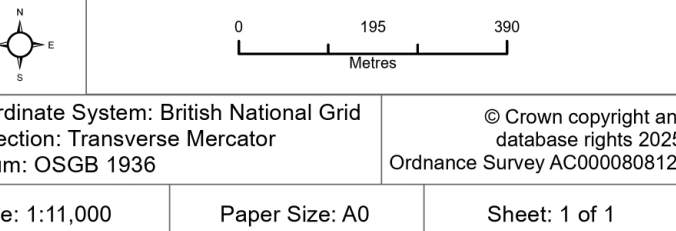

RWE

Document Reference: 6.4.2.3
Revision: 1
PINS Number: EN010148
Drawing Status: DCO Application
Drawn: NAM
Checked: EH
Approved: AD
Date: 20/08/2025