

# BEACON FEN ENERGY PARK

Planning Inspectorate Reference: EN010151


Figure 10.1 Proposed Solar Array Site, Existing Noise Sensitive Receptors and Measurement Positions

Document Reference: 6.4 ES Volume 3, 6.4.58

April 2025





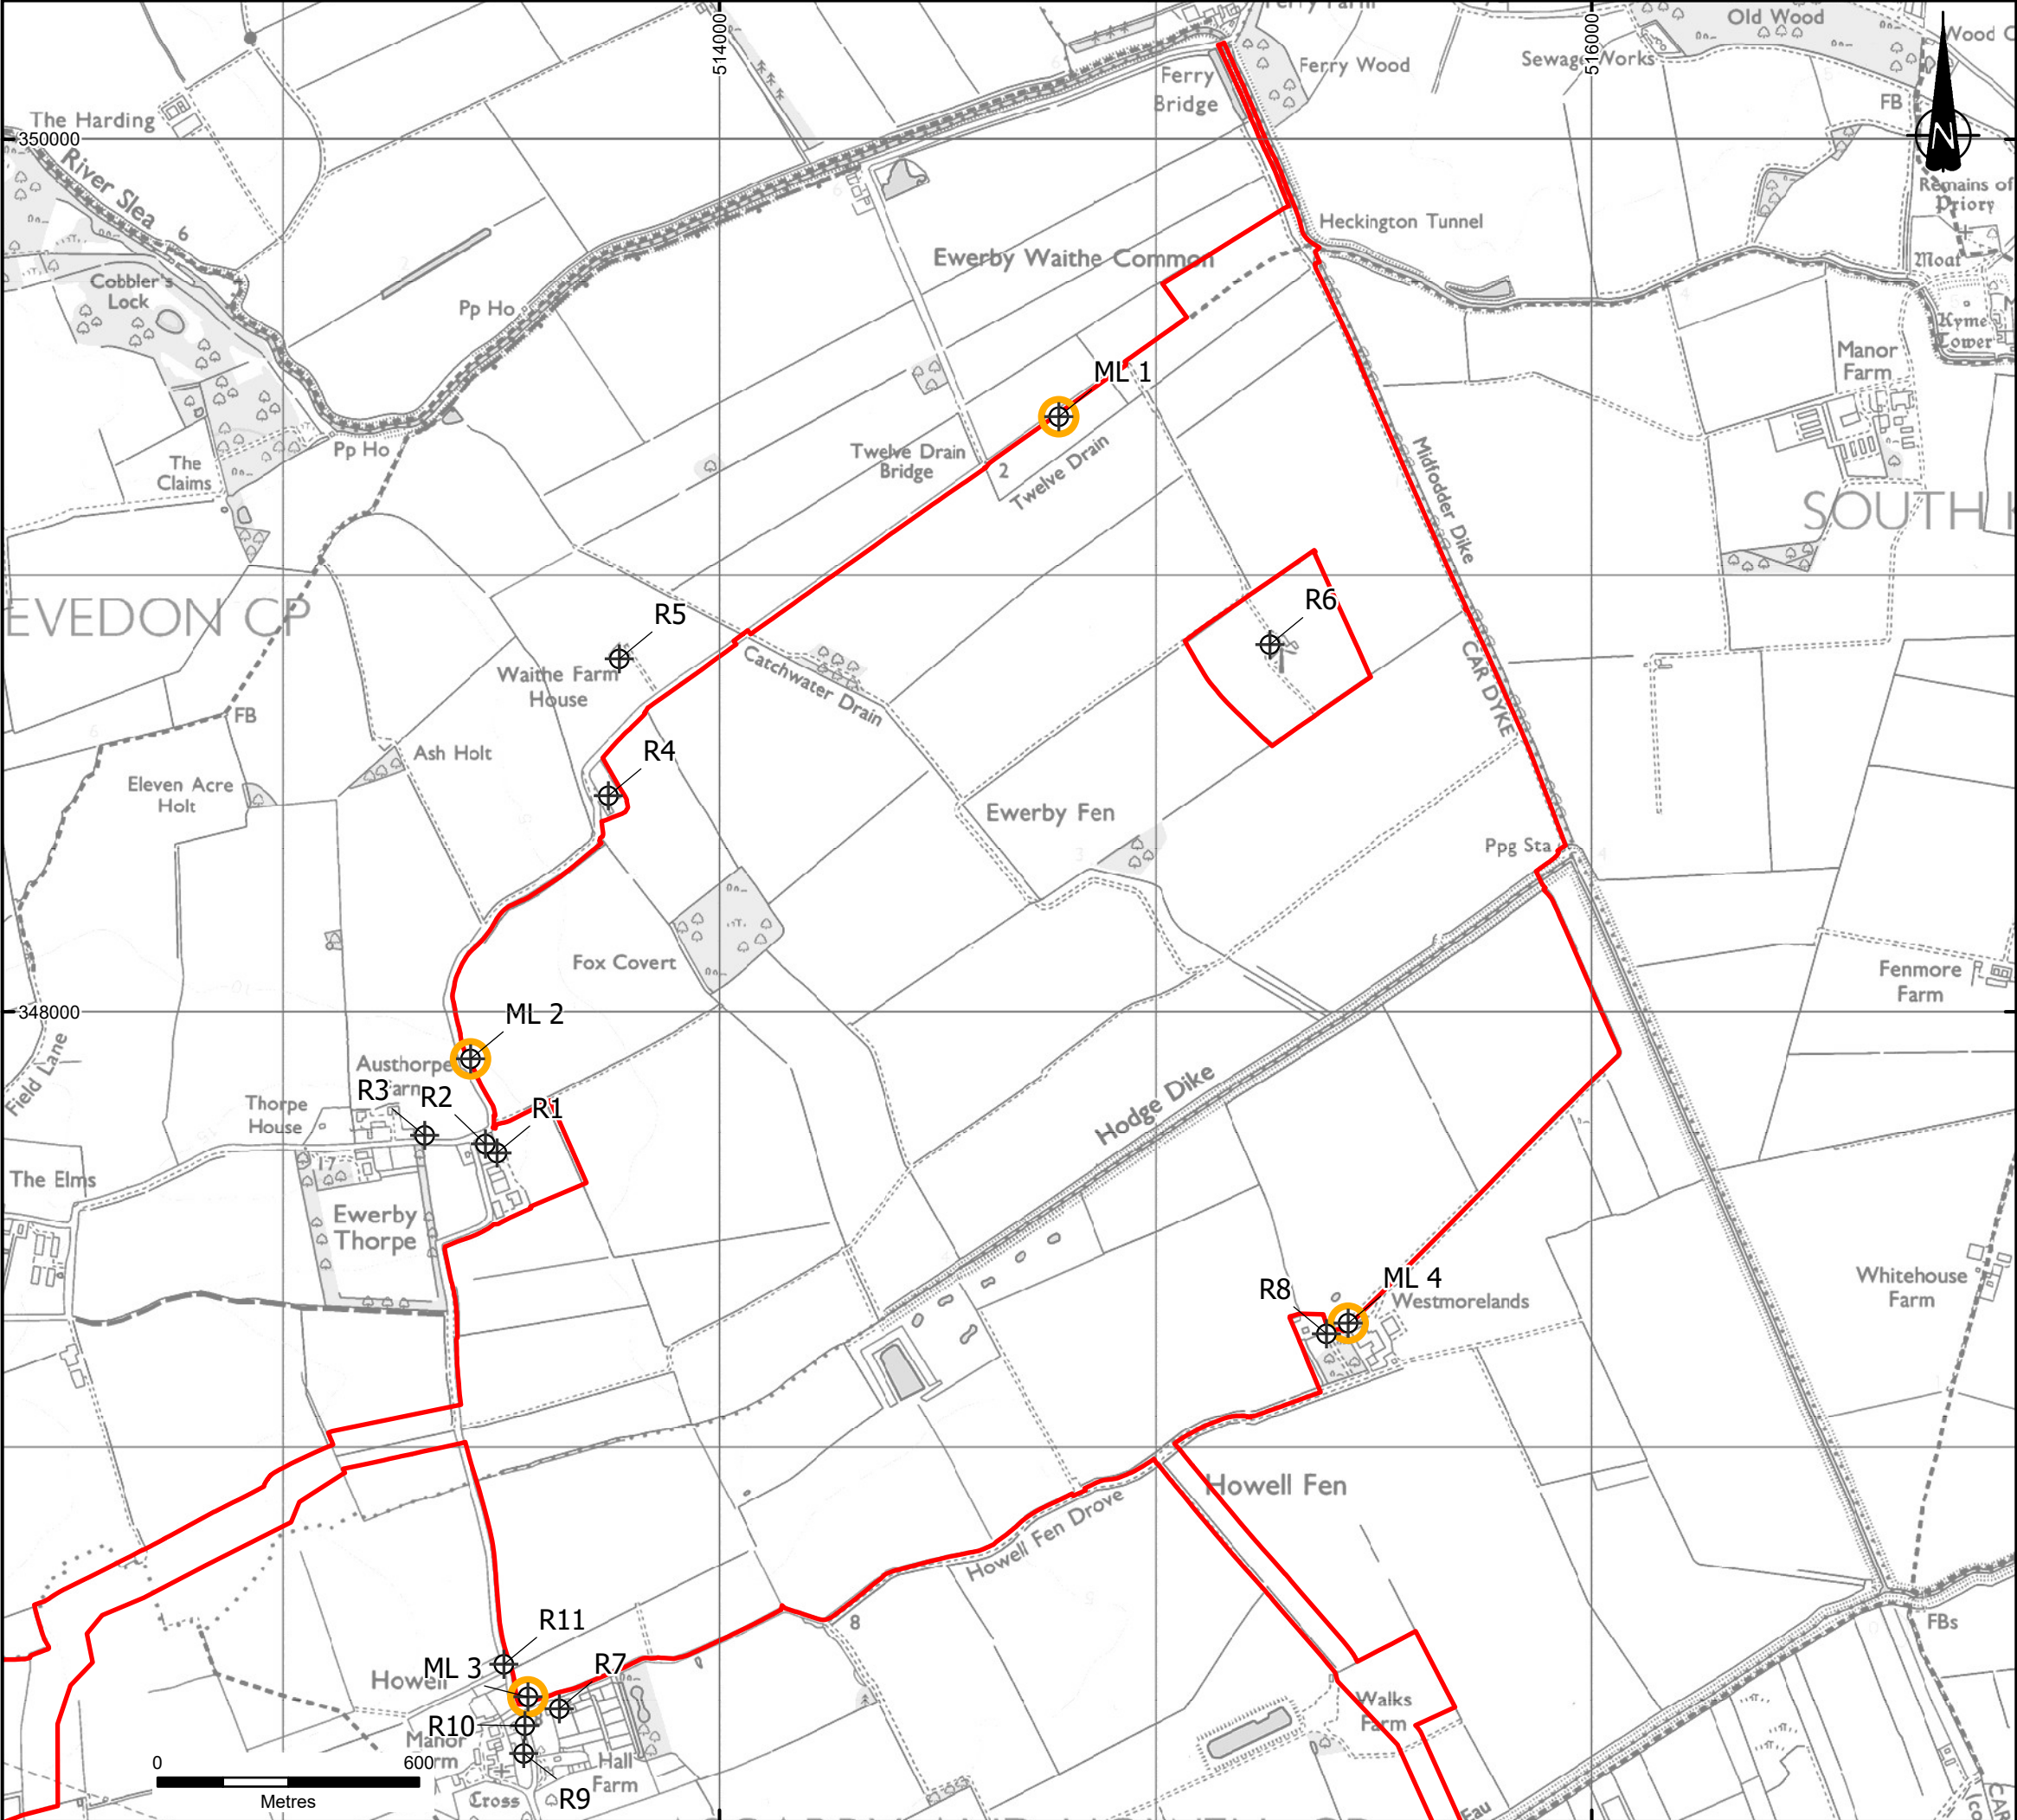

**KEY**

- DCO Order Limits
- Measurement Position
- Existing Receptors

**Notes:**

DCO Order Limits provided by Ardent Management on 04/02/2025.

© Crown copyright and database rights 2025 Ordnance Survey Licence No. AC0000808122

1	FIRST ISSUE	05/03/25	BL	JR	PB
REVISION	DETAILS	DATE	DRAWN	CHKD	APPD
CLIENT					
BEACON FEN ENERGY PARK LTD					
PROJECT					
BEACON FEN ENERGY PARK					
DRAWING TITLE					
FIGURE 10.1 PROPOSED SITE, EXISTING NOISE SENSITIVE RECEPTORS AND MEASUREMENT POSITIONS					
DRG No.		ST19595-156		REV	1
DRG SIZE		A3		SUIT. CODE	---
SCALE		1:15,000		DATE	05/03/2025
DRAWN BY		BL		APPROVED BY	PB
CHECKED BY		JR			

wardell  
armstrong

PART OF