
FENWICK SOLAR FARM

Fenwick Solar Farm
EN010152

Fenwick Solar Farm

Volume III Appendix 10-7: Arboricultural Impact Assessment Part 2 of 2
Document Reference: EN010152/APP/6.3

Regulation 5(2)(a)

Infrastructure Planning (Applications: Prescribed Forms and Procedure)
Regulations 2009

December 2024
Revision Number: 01

Revision History

Revision Number	Date	Details
00	October 2024	DCO application
01	December 2024	S51 Response

Prepared for:
Fenwick Solar Project Limited

Prepared by:
AECOM Limited

© 2024 AECOM Limited. All Rights Reserved.


This document has been prepared by AECOM Limited (“AECOM”) for sole use of our client (the “Client”) in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.

Annex C Tree Protection Plan

Author: GA Designer: JB Checked: TR Approved: AW

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

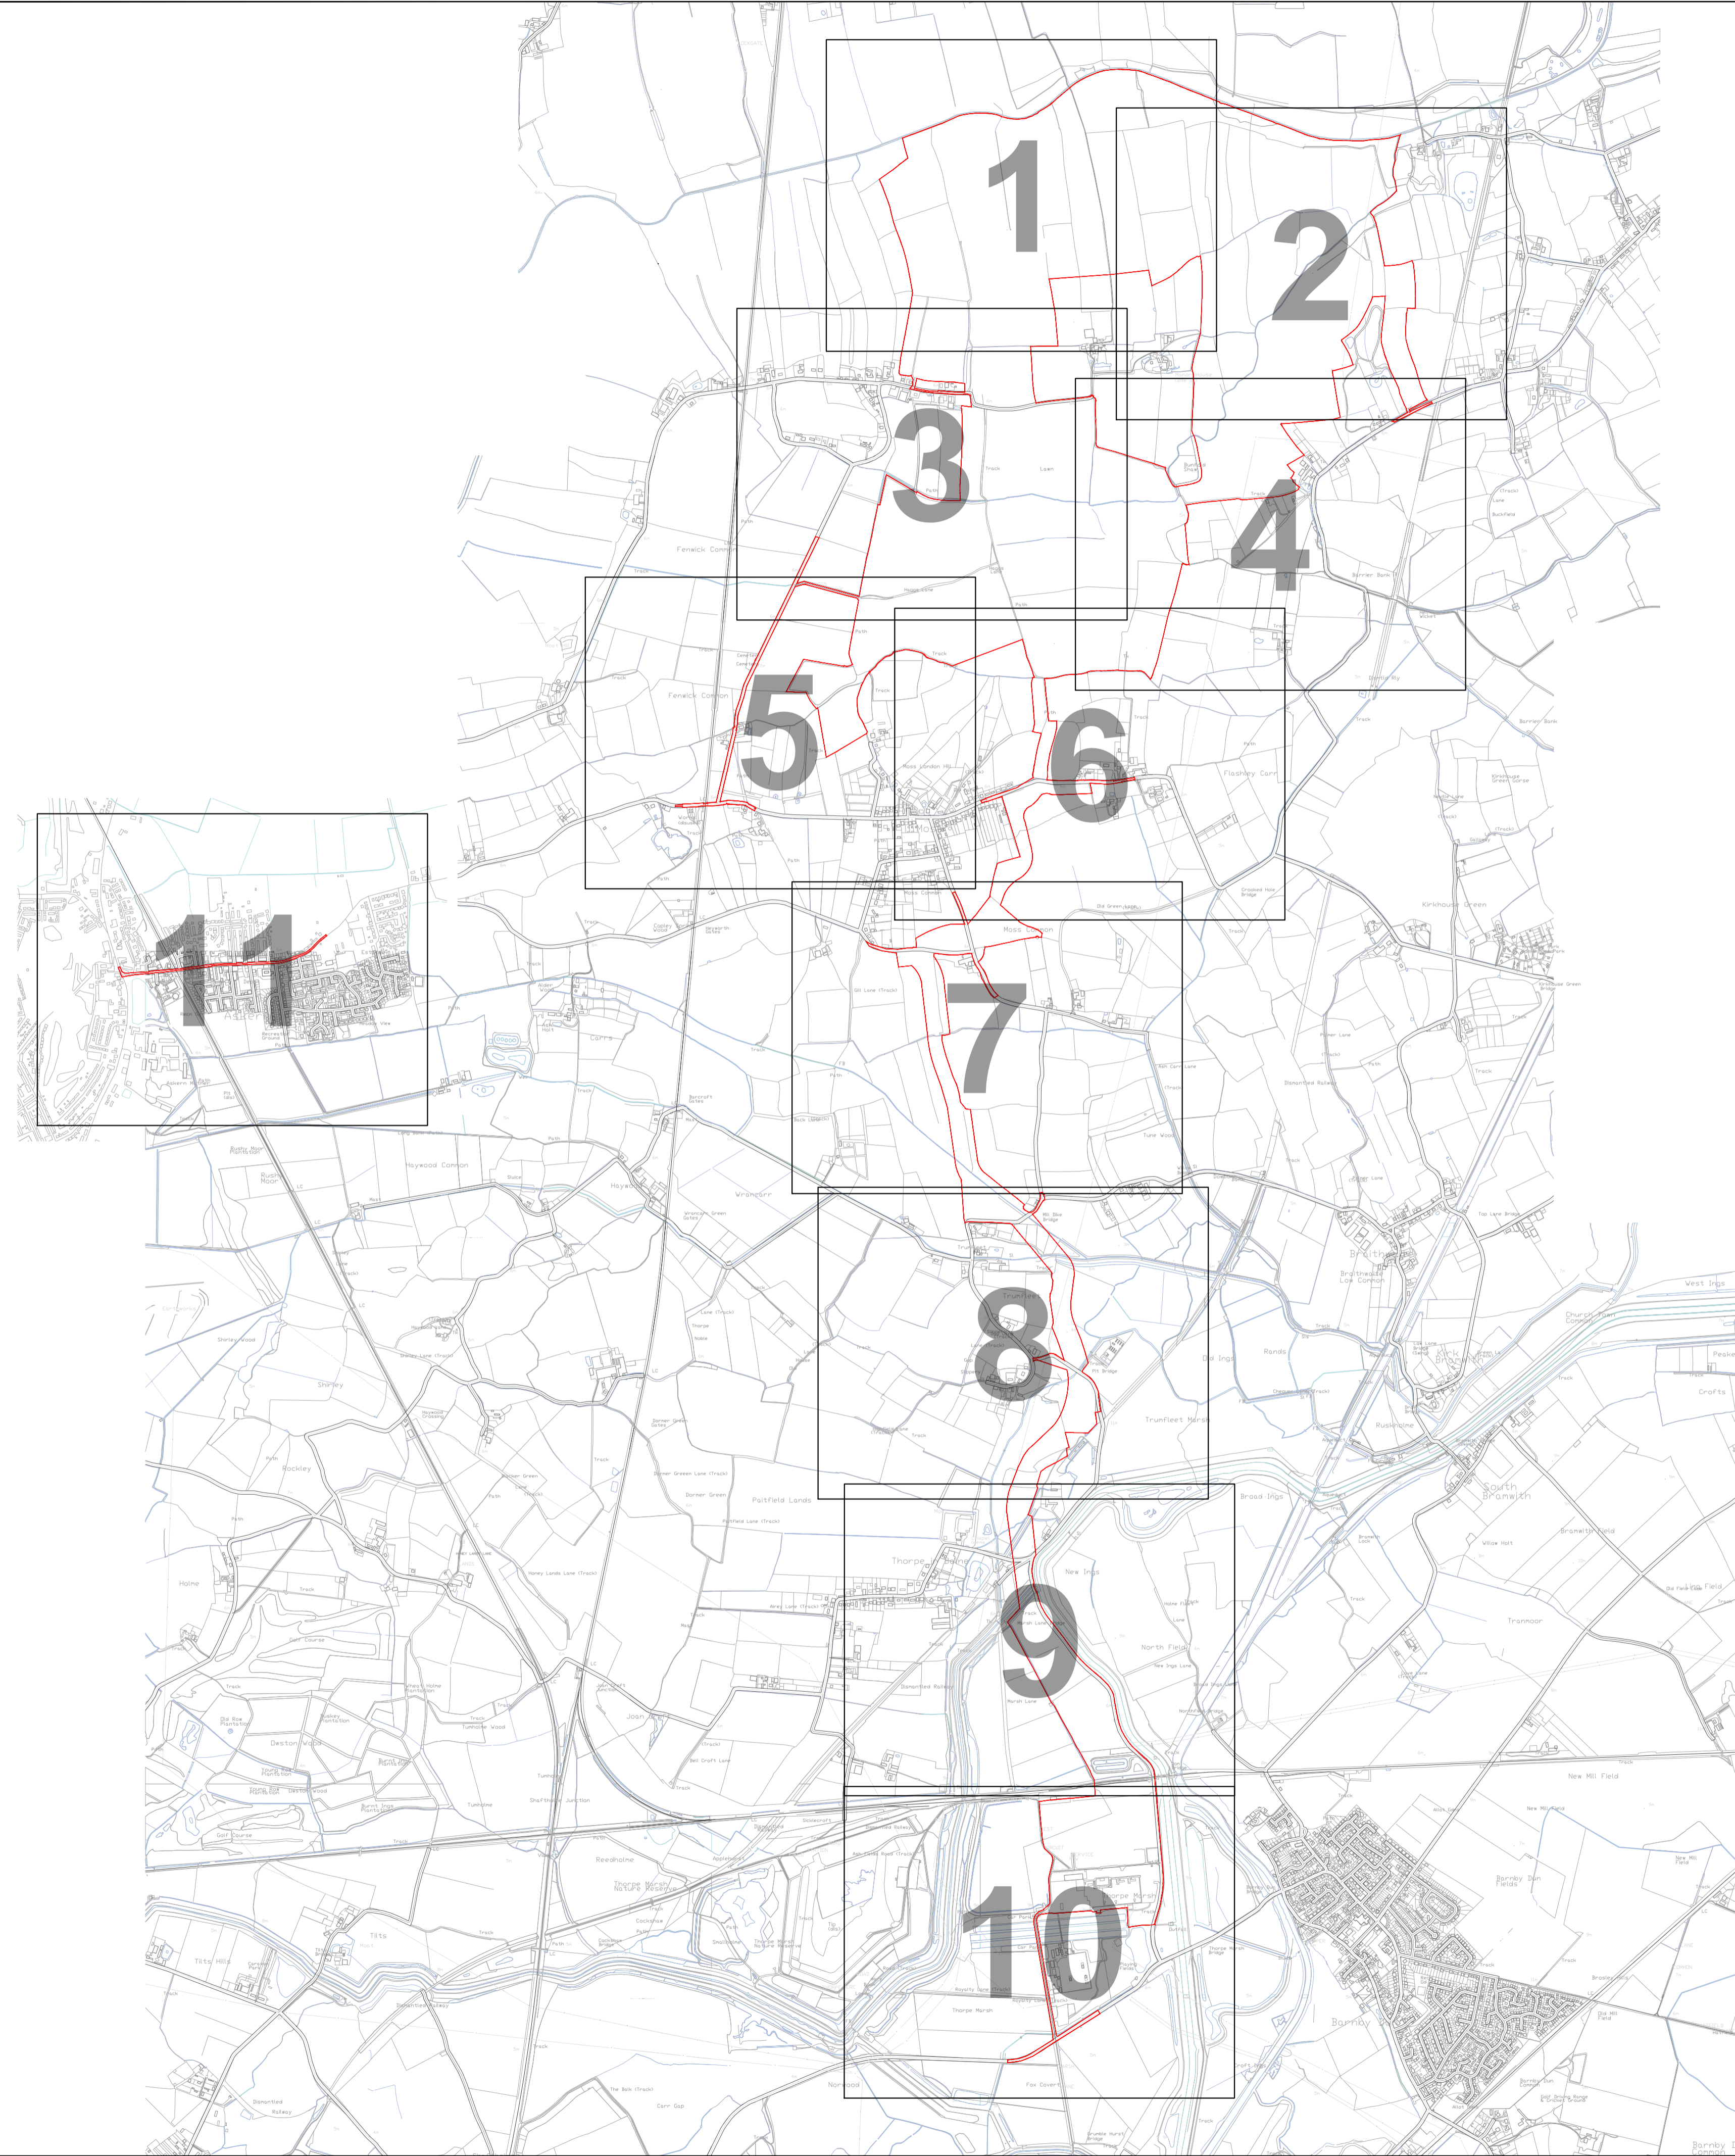

PROJECT
FENWICK SOLAR FARM


CLIENT
FENWICK SOLAR
PROJECT LIMITED
CONSULTANT

AECOM
Plumer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT
4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Option Plan-v1.2_CABLE_EASMENT.dwg
FENW-Overall Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

KEY PLAN

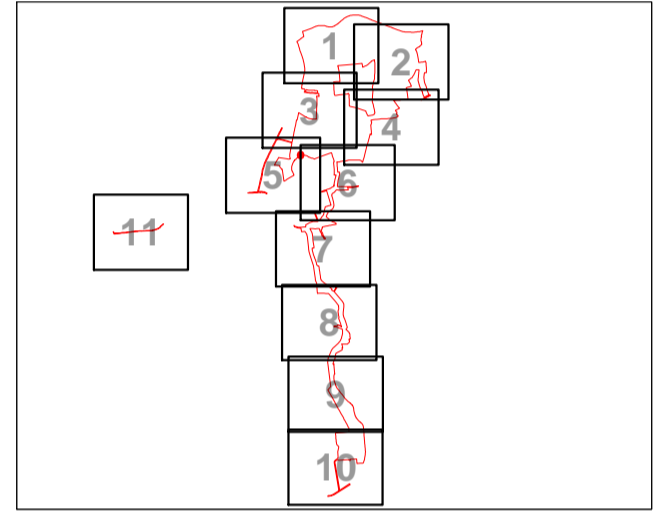

- KEY
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CONSIDERED AS AN ANCIENT WOODLAND)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

IR	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 00)

SHEET NUMBER
60698207-ACM-XX-XX-AB-TPP-000


REV.
P02

List saved by: BREWER (2024.12.05) Last Plotted: 2024.12.05
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.

Author: GA Designer: JB Checked: TR Approver: AW

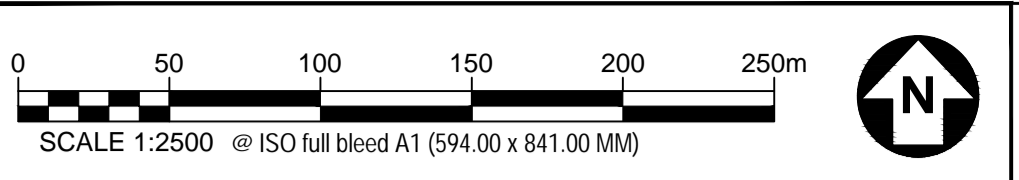


PROPOSALS KEY

- Deer Fencing
- 400kV Substation Palisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

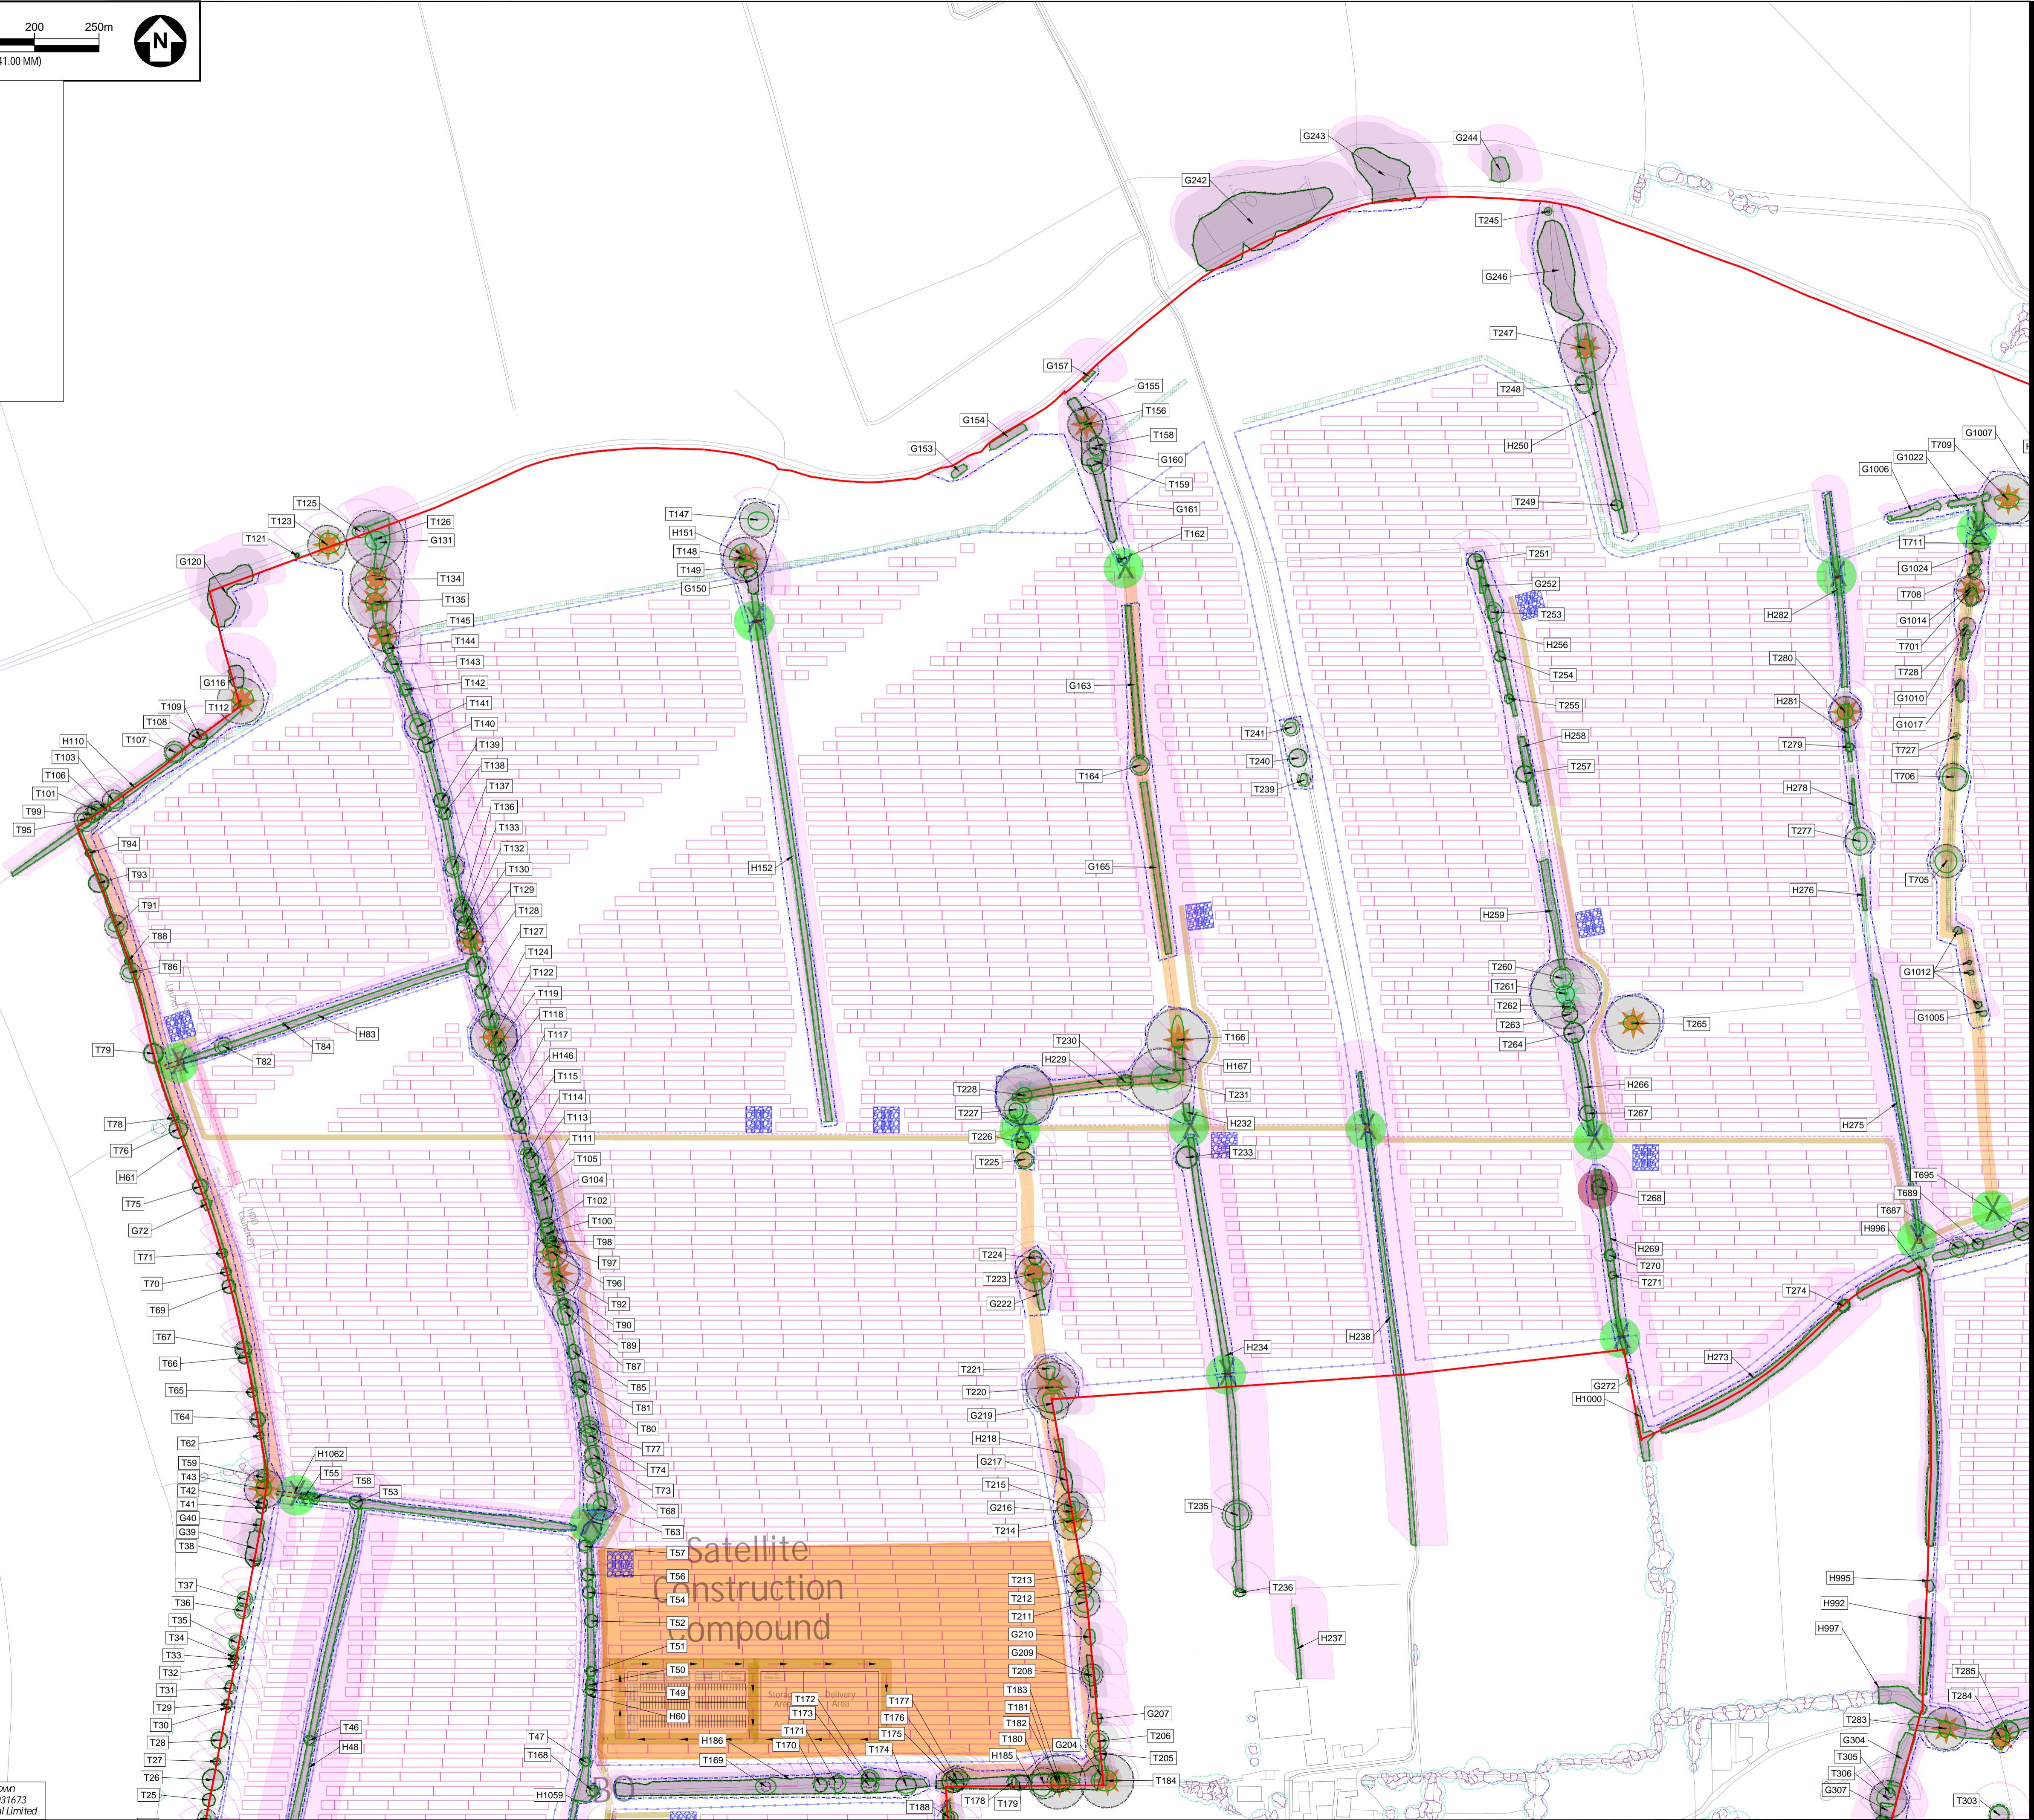

- GENERAL NOTES**
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORENTAL REPORT.
 - THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Optim-Plan-v1.2-CABLE_EASMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

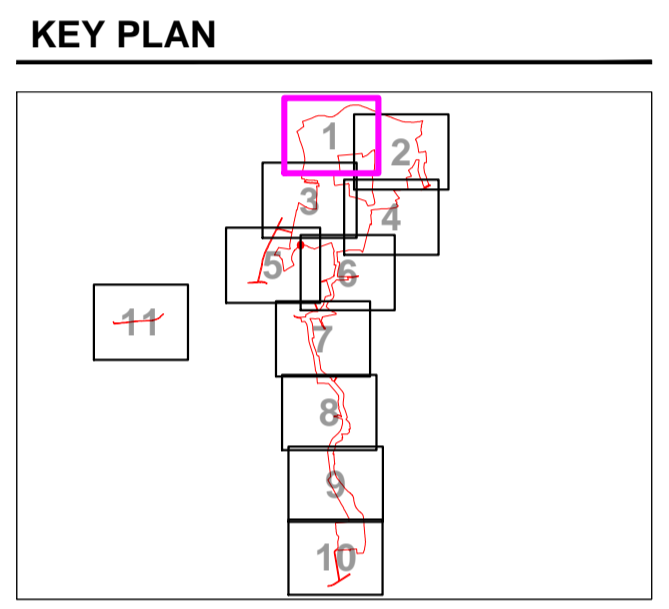

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (WORKING CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORENTAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CONSIDERED AS AN AREA OF PRIORITY HABITAT)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION

DRAWING STATUS
ISSUE



PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 1)

Last saved by: BREMER/2024.12.05, Last Plotted: 2024.12.05, Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673 Features National Tree Map data © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.

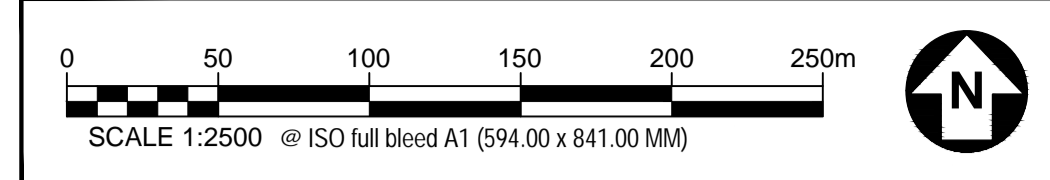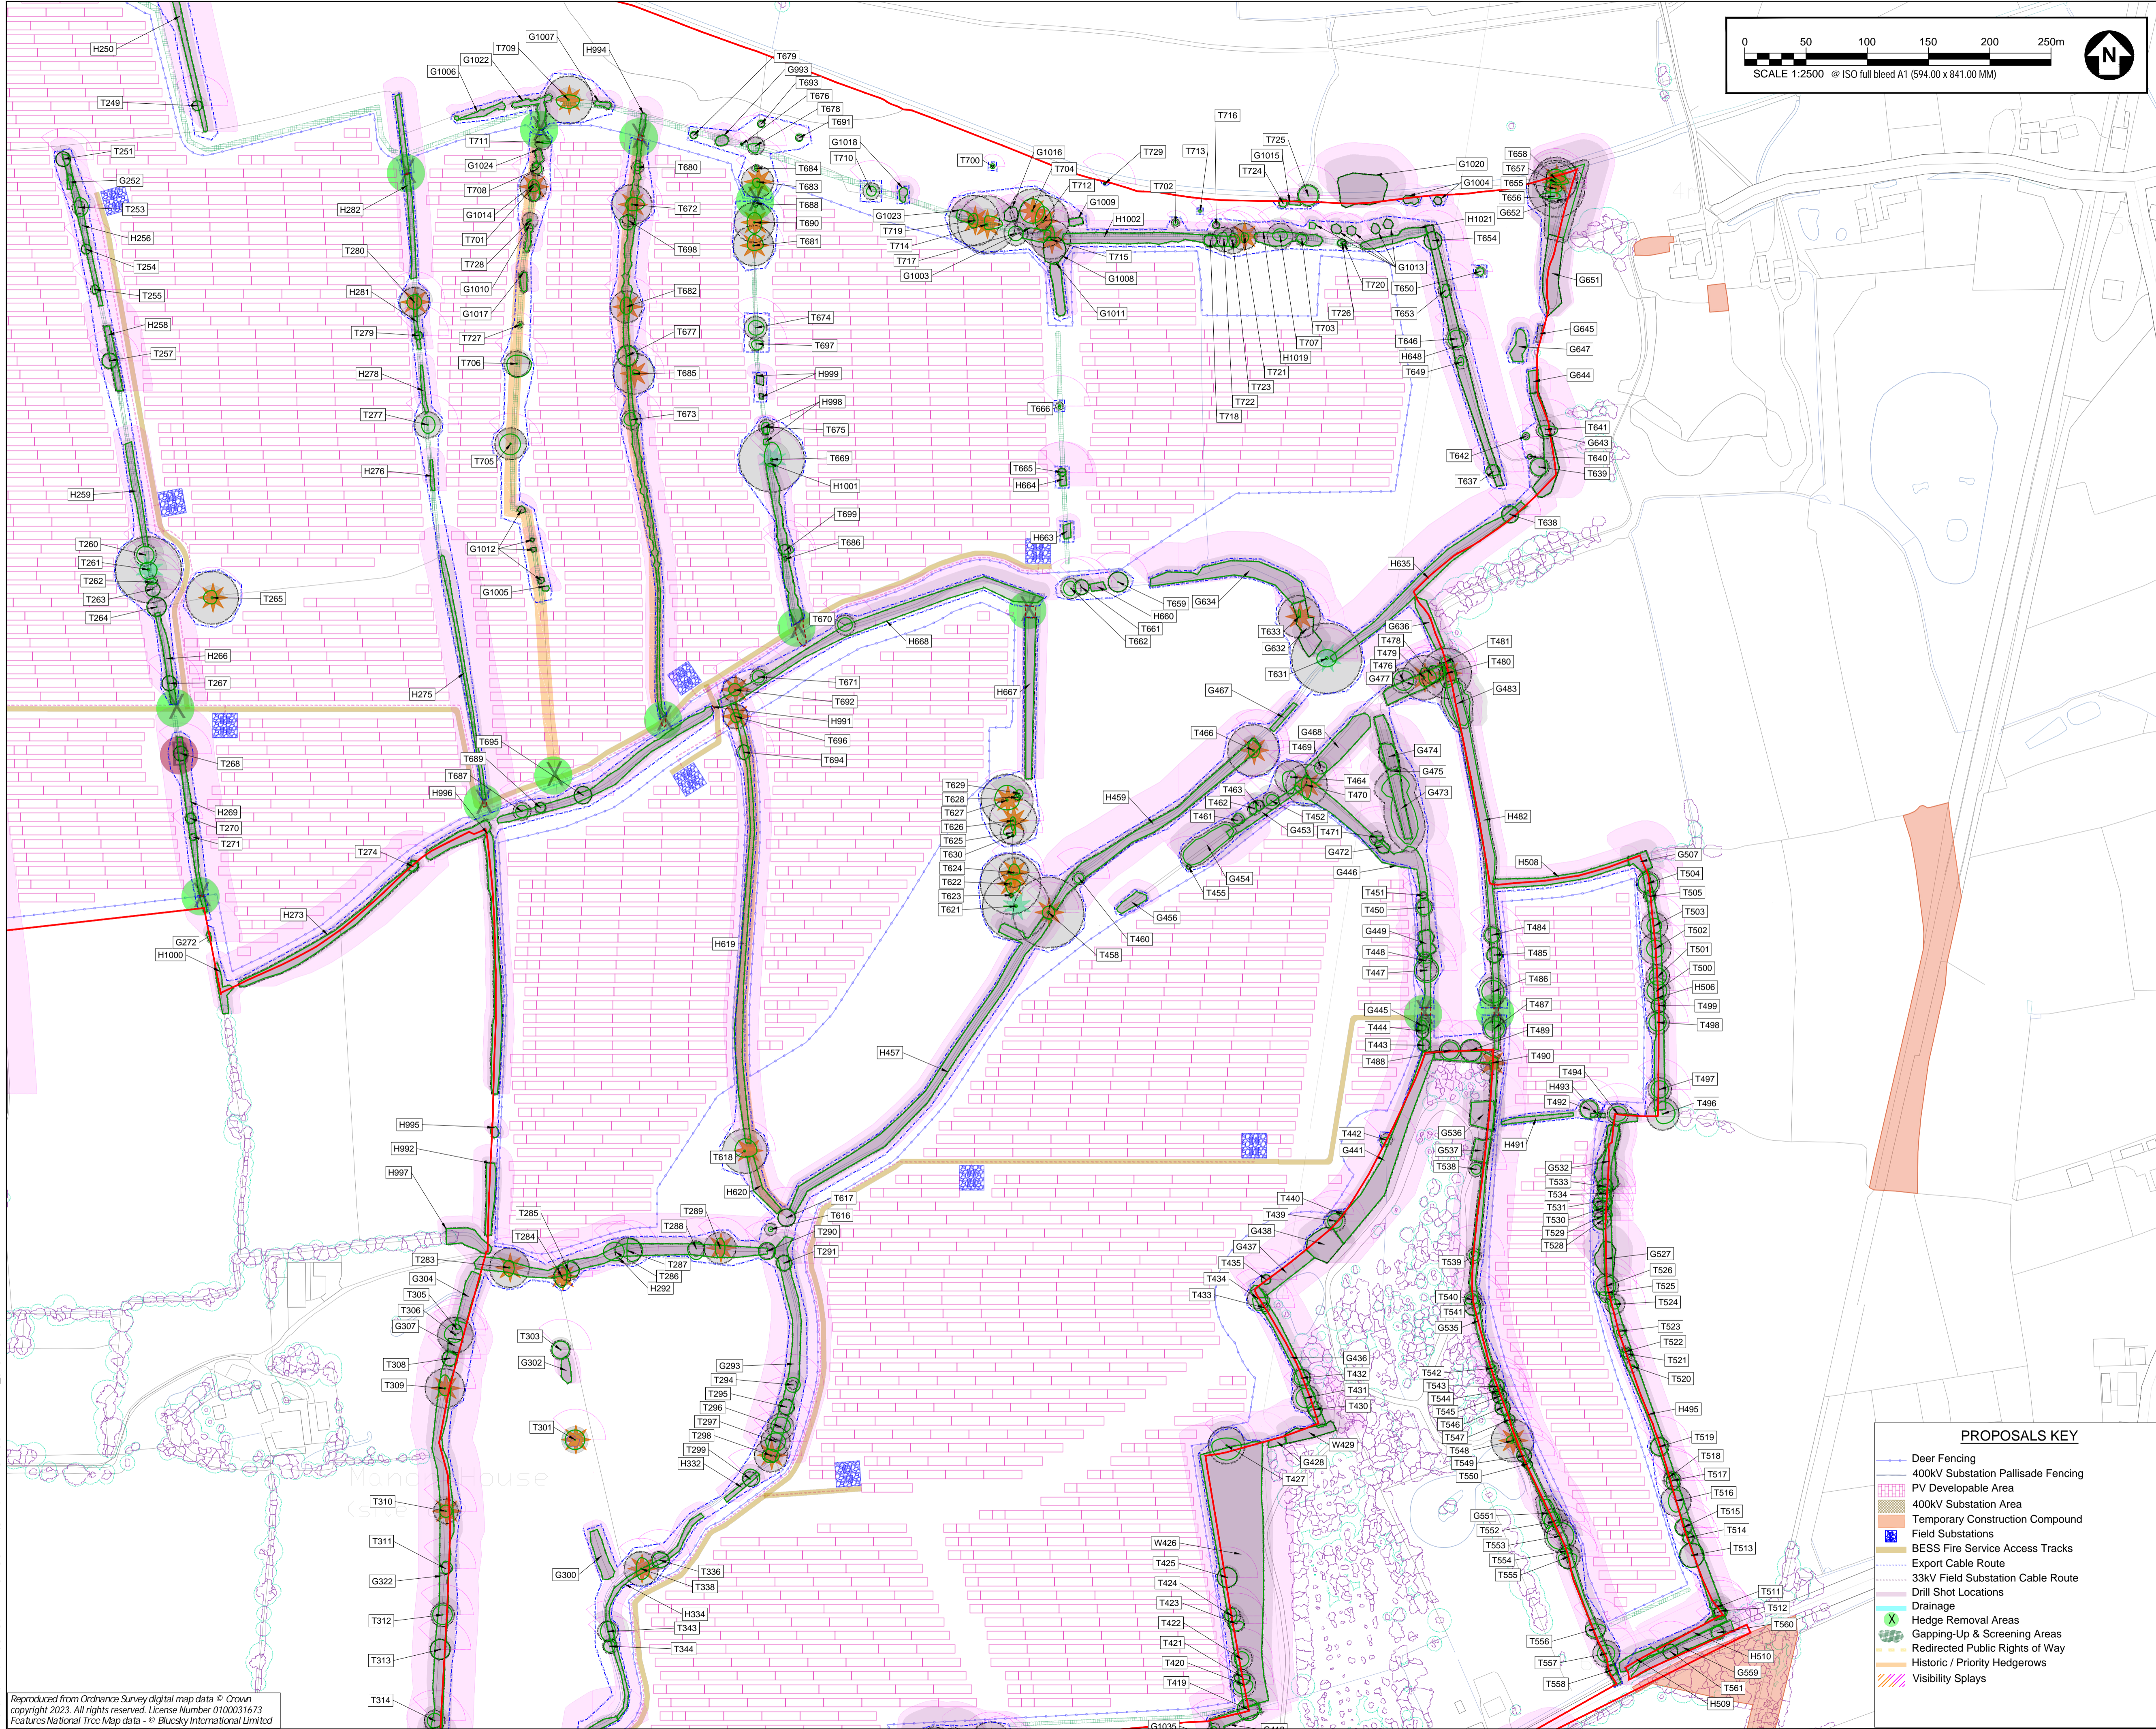


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR
PROJECT LIMITED
CONSULTANT

AECOM
Plumfer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)1752 238 6023
www.aecom.com

- GENERAL NOTES**
1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
 2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT
 4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE-CASEMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

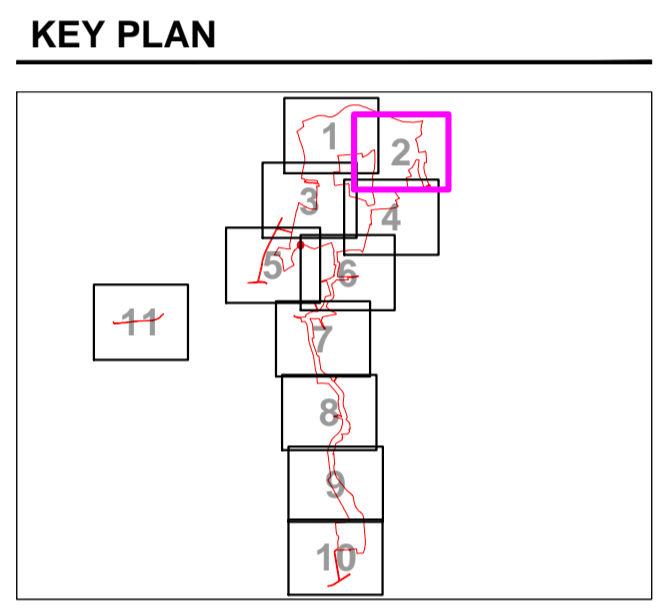

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS ANCHOR BY BODENAS)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

IR	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 2)


SHEET NUMBER **REV.**
60698207-ACM-XX-XX-AB-TPP-02 P02

- PROPOSALS KEY**
- Deer Fencing
 - 400kV Substation Pallsade Fencing
 - PV Developable Area
 - 400kV Substation Area
 - Temporary Construction Compound
 - Field Substations
 - BESS Fire Service Access Tracks
 - Export Cable Route
 - 33kV Field Substation Cable Route
 - Drill Shot Locations
 - Drainage
 - Hedge Removal Areas
 - Gapping-Up & Screening Areas
 - Redirected Public Rights of Way
 - Historic / Priority Hedgerows
 - Visibility Splays

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features: National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.


Author: GA Designer: JB Checked: TR Approved: AW

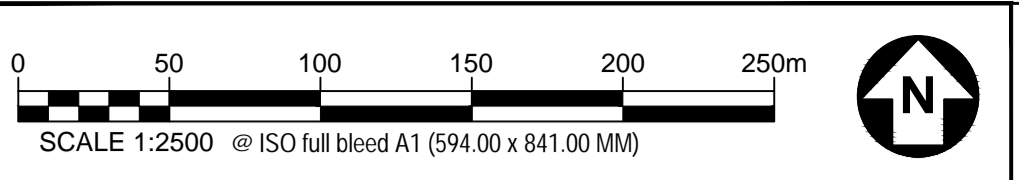

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Palisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

Let sent by BREMER (2024.12.05) Last Printed: 2024.12.05
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

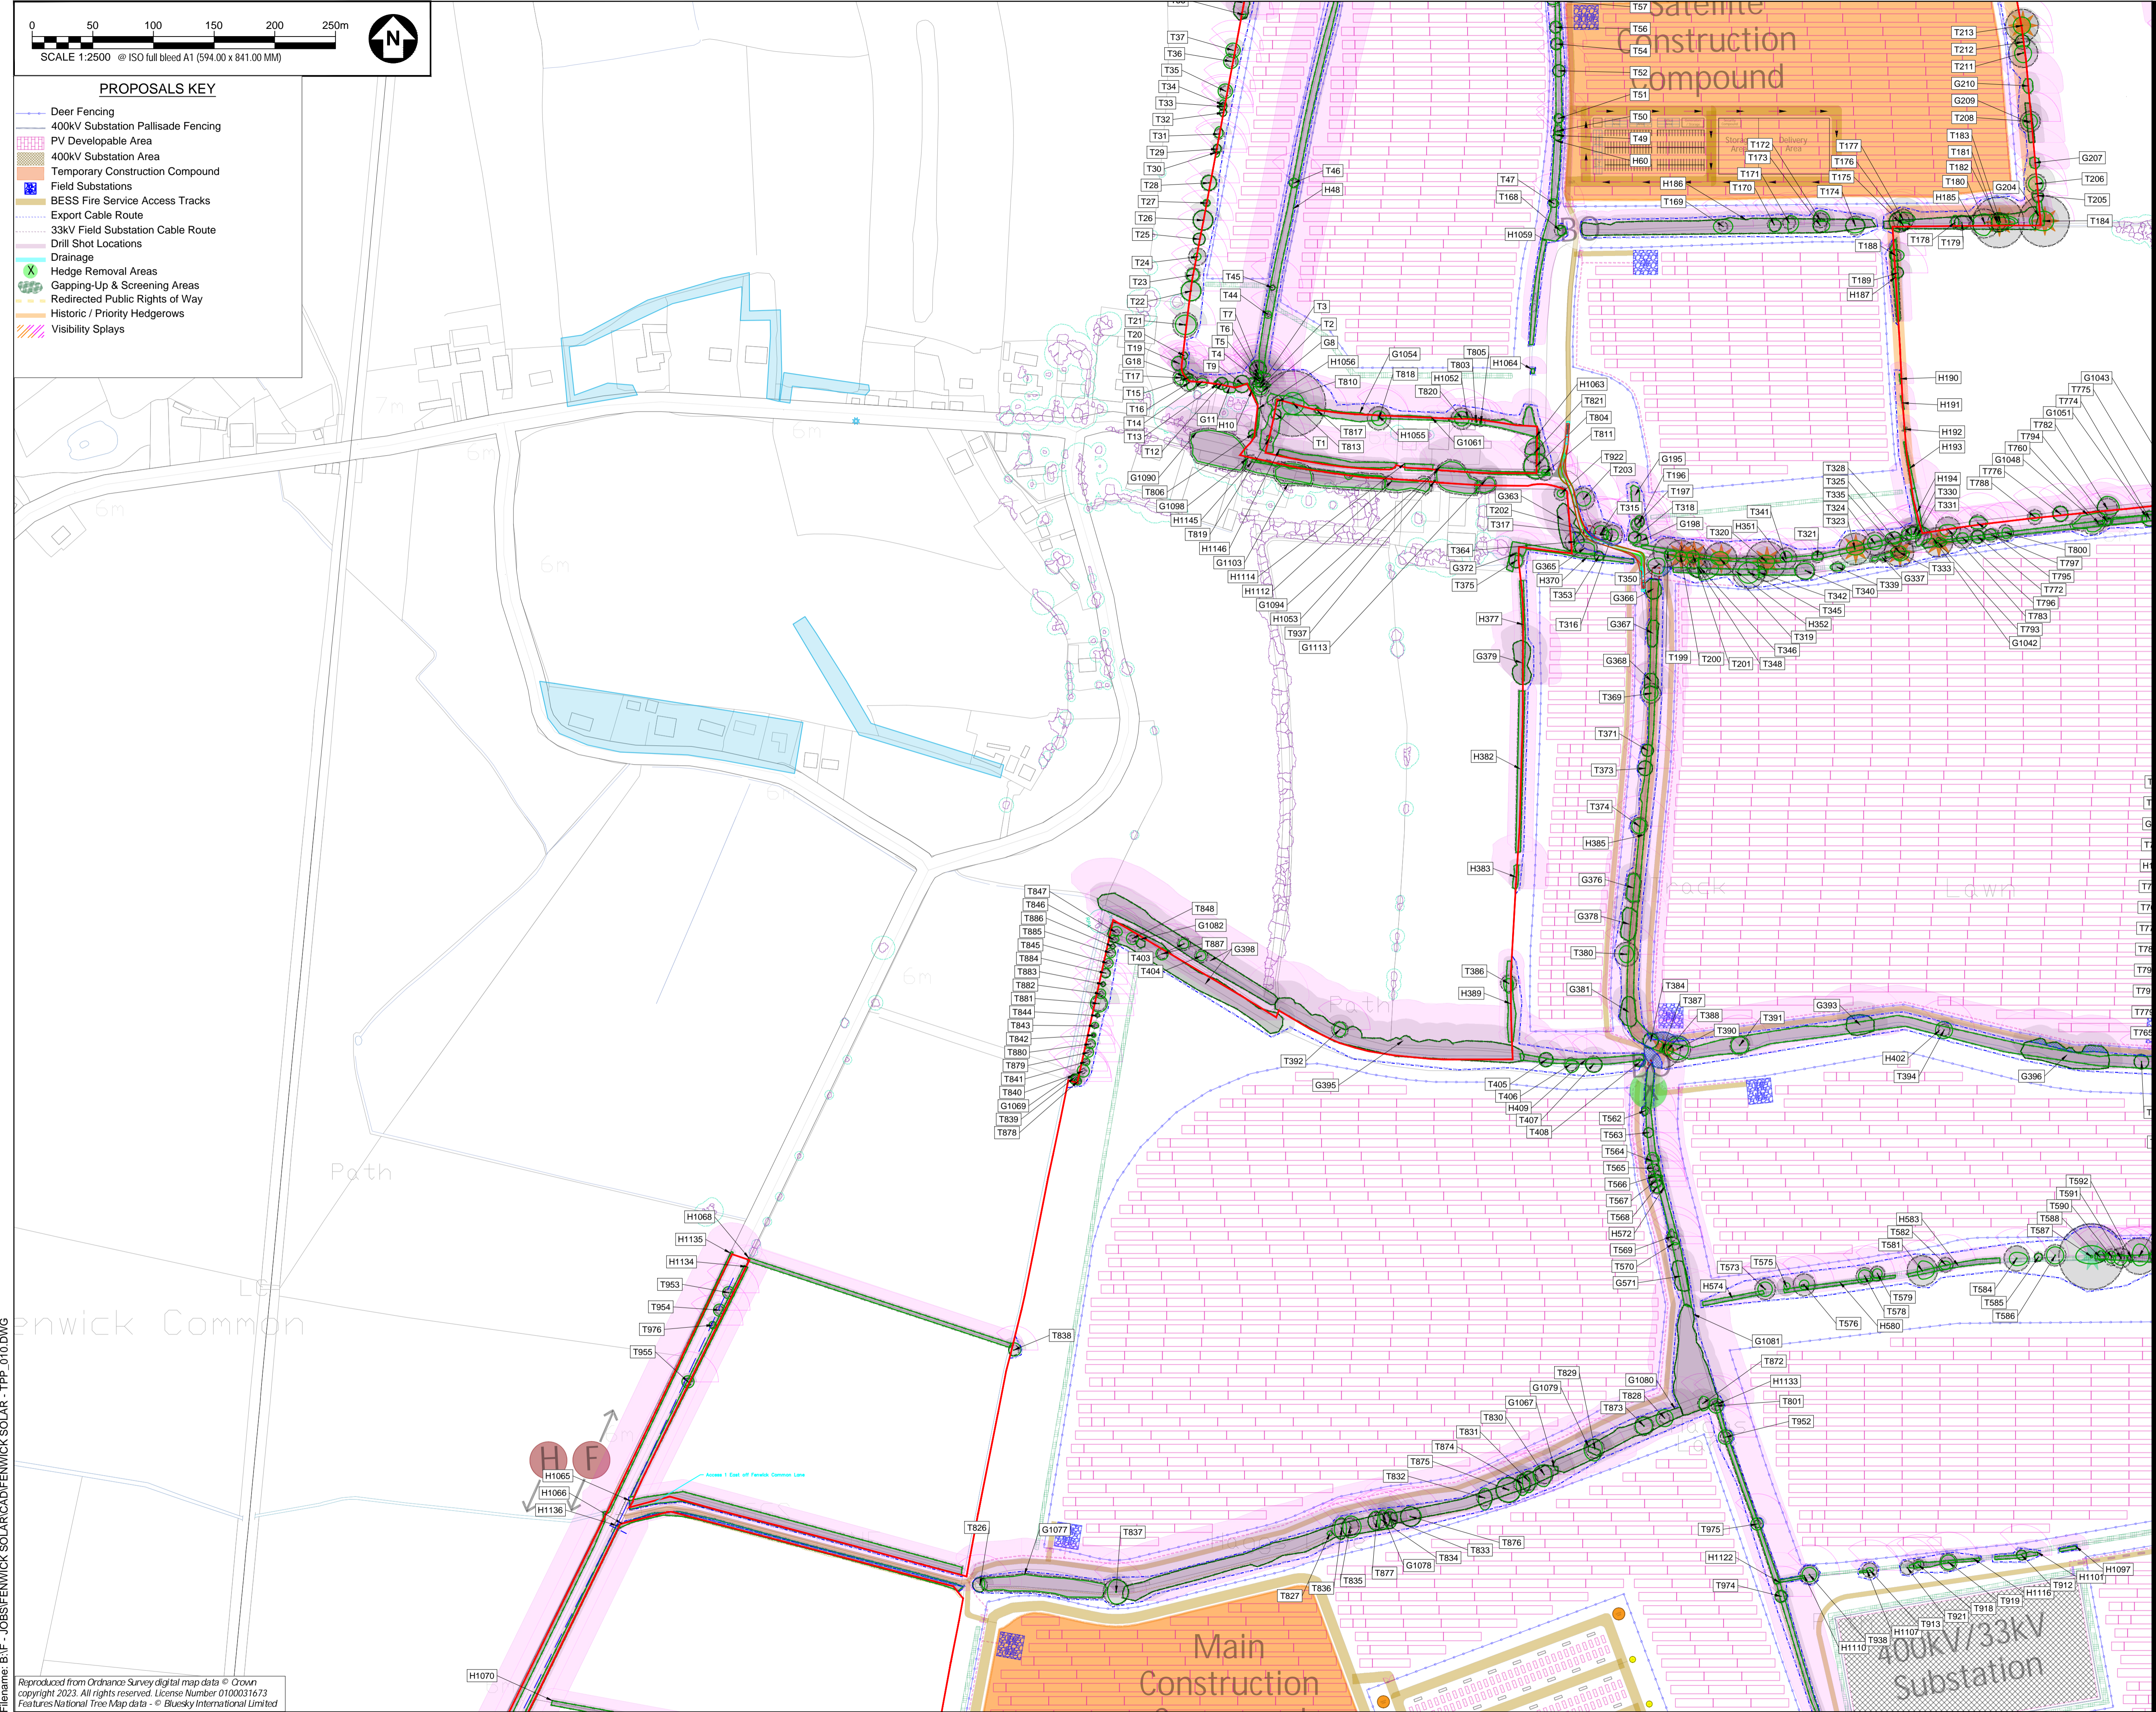


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED CONSULTANT

AECOM
Plumley House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)1752 238 6023
www.aecom.com

- GENERAL NOTES
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT
 - THE ORIGINAL OF THIS DRAWING HAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE_EASMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001-Access-Proposal-Model-P01.dwg

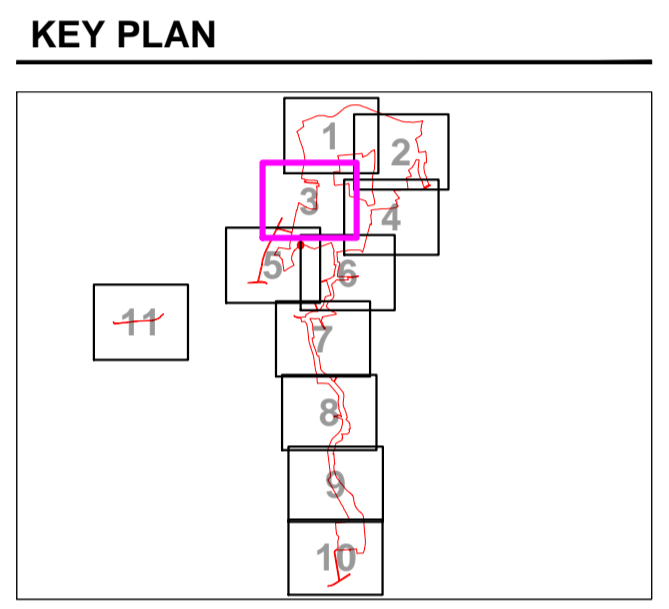

- KEY
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLESKEY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLESKEY LTD DATA)
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 3637:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 3637:2012)
 - ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CONSIDERED AS AN AREA OF PRIORITY HABITAT)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207


SHEET TITLE
TREE PROTECTION PLAN (SHEET 3)

SHEET NUMBER
60698207-ACM-XX-XX-AB-TPP-03

REV.
P02

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bleskey International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.

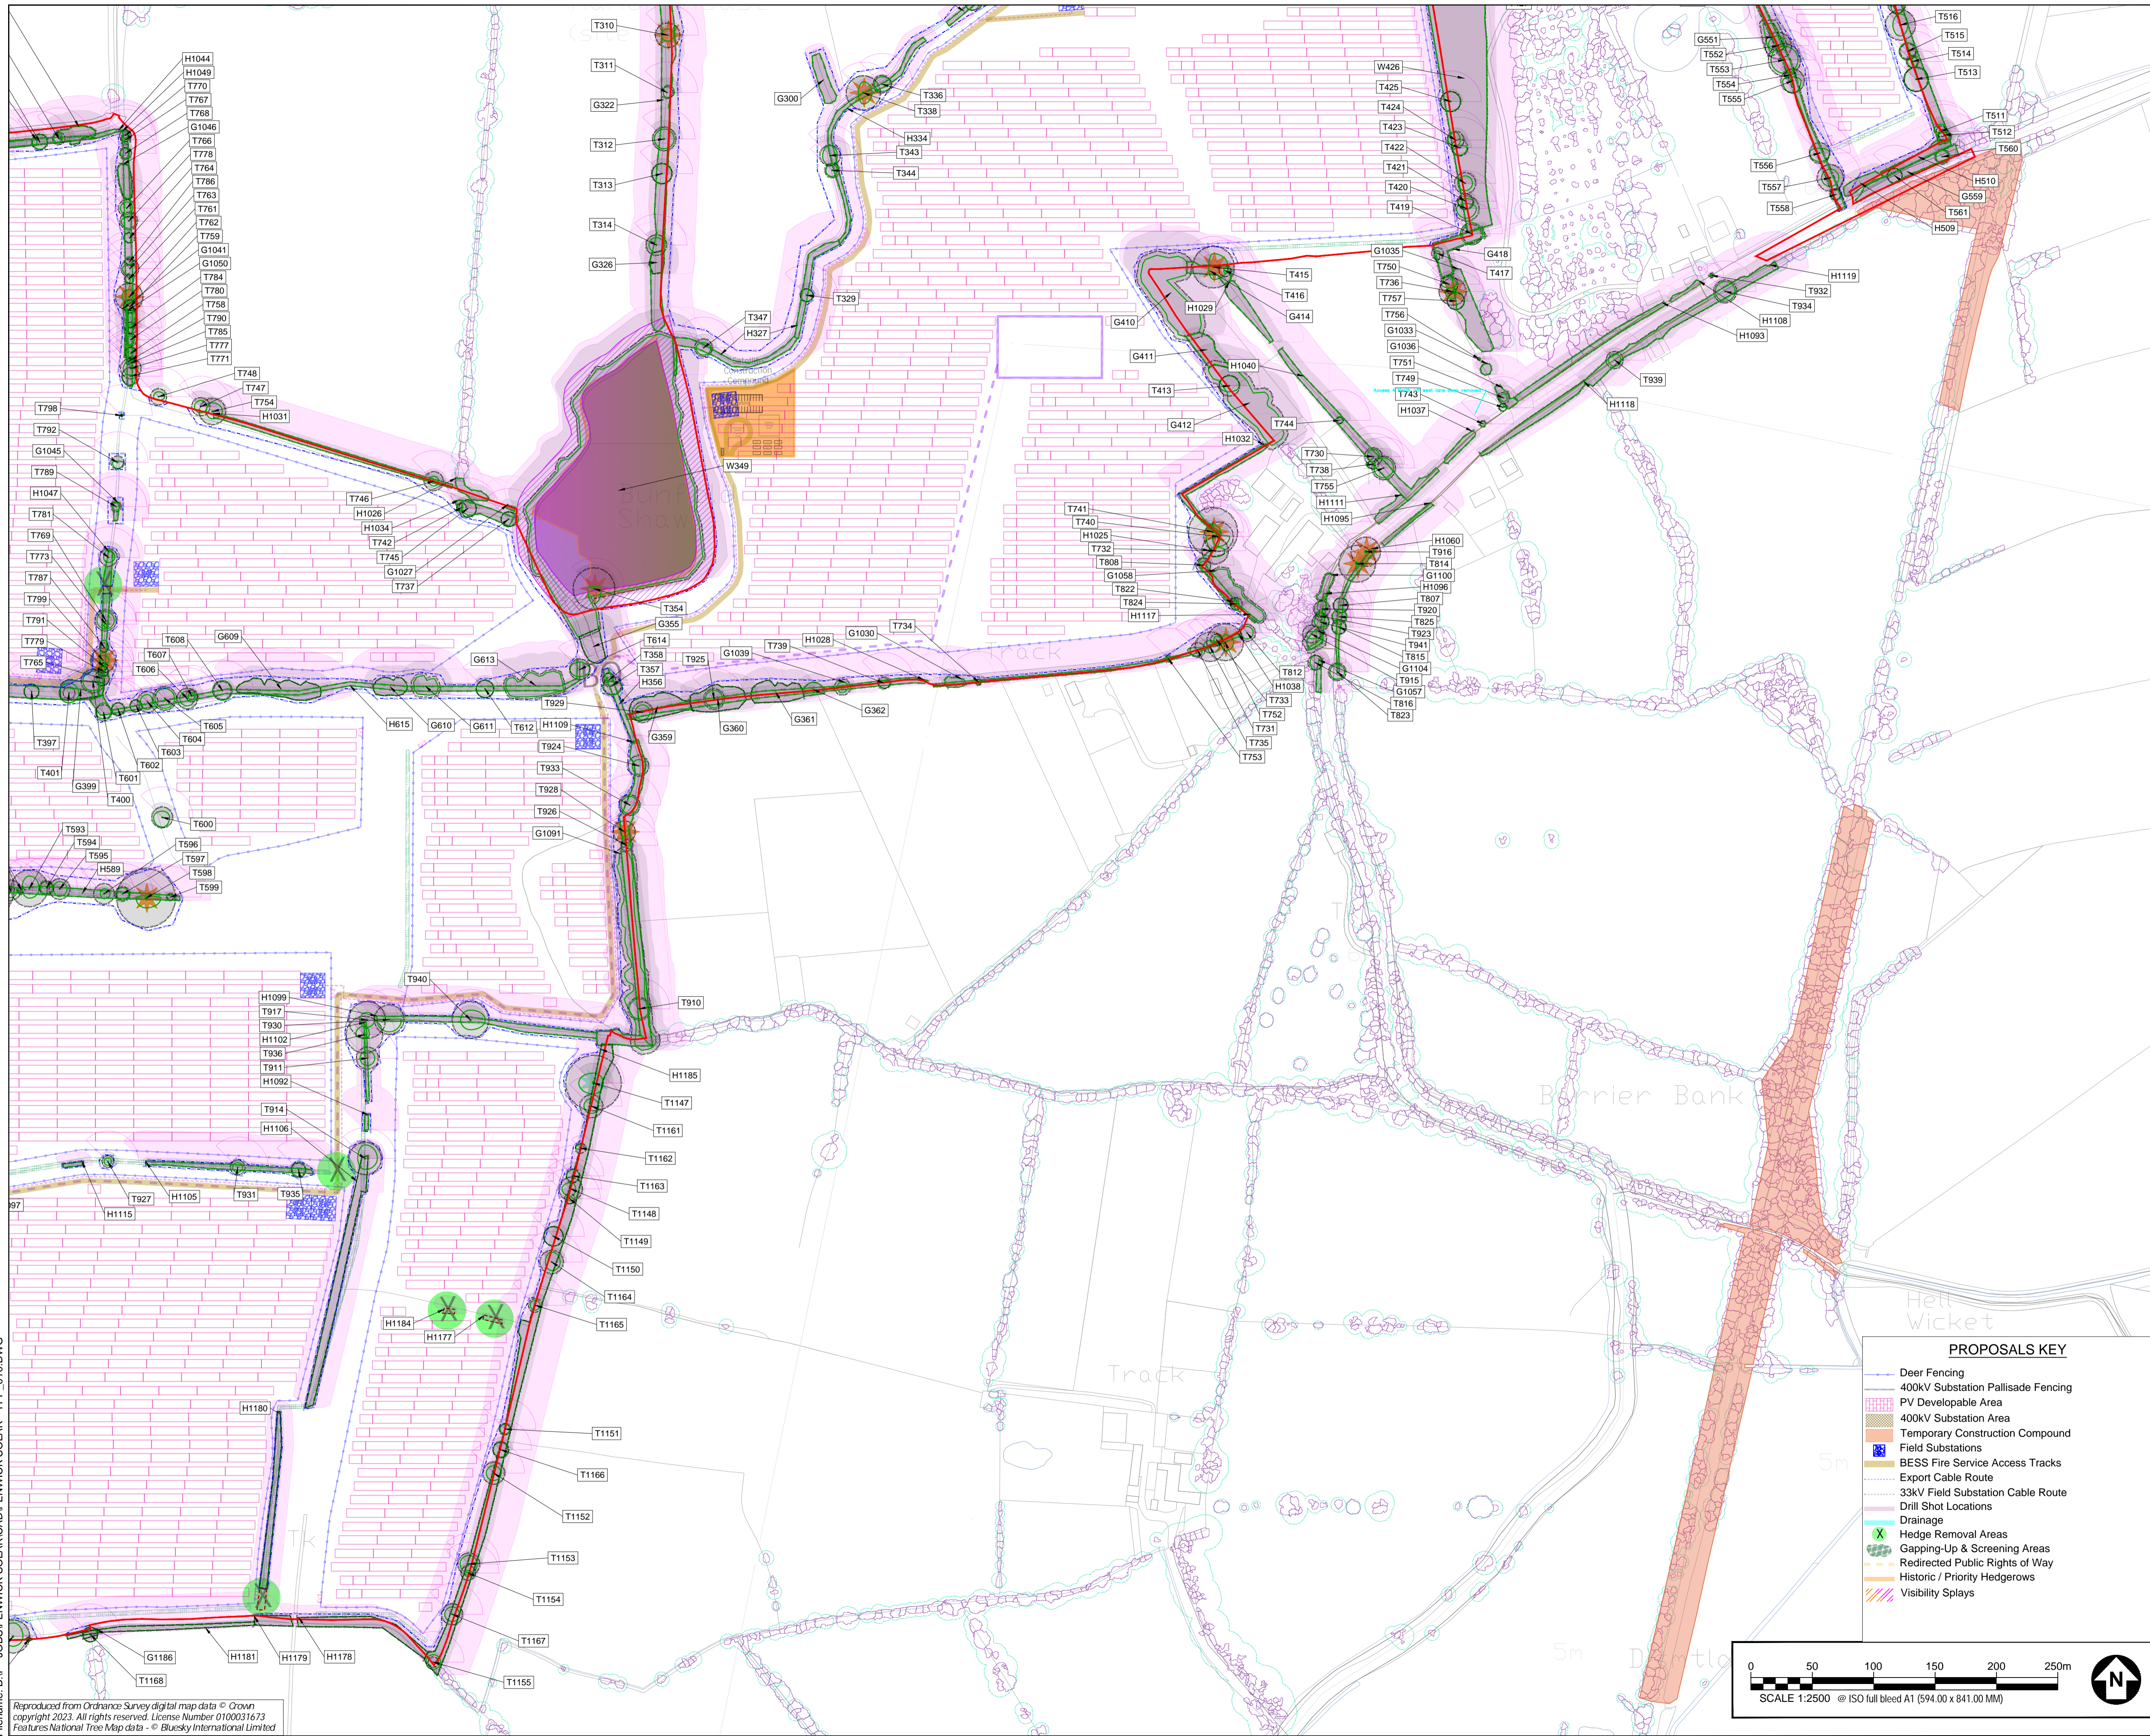


AECOM

PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT


AECOM
Plumley House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)1752 238 6023
www.aecom.com

- GENERAL NOTES**
1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
 2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT
 4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON
 5. DRAWING REFERENCES:
NTM Data_Mirus Survey Data.dwg
FENW-Cable Plan-v1.2-CABLE EXCISEMENT.dwg
FENW-Overall Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Protocol Model P01.dwg

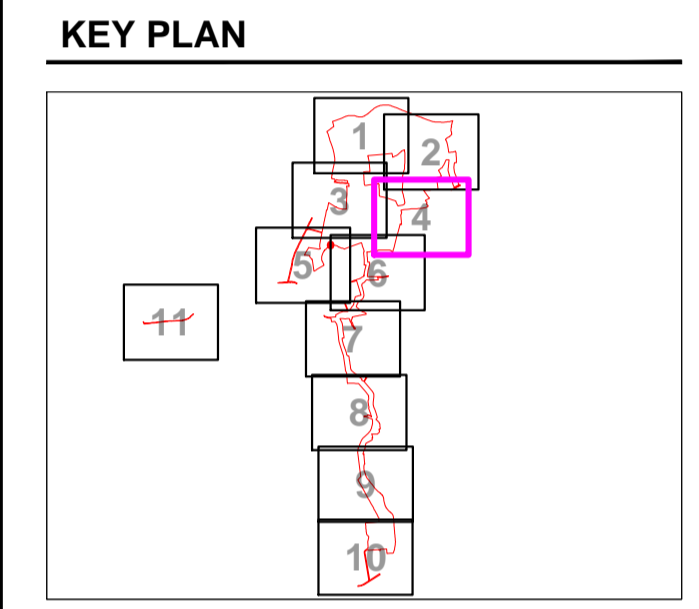

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
 - ★ VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ★ ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CLASSIFIED AS AN HABITAT BY BODENAS)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

- PROPOSALS KEY**
- Deer Fencing
 - 400kV Substation Pallisade Fencing
 - PV Developable Area
 - 400kV Substation Area
 - Temporary Construction Compound
 - Field Substations
 - BESS Fire Service Access Tracks
 - Export Cable Route
 - 33kV Field Substation Cable Route
 - Drill Shot Locations
 - Drainage
 - Hedge Removal Areas
 - Gapping-Up & Screening Areas
 - Redirected Public Rights of Way
 - Historic / Priority Hedgerows
 - Visibility Splays

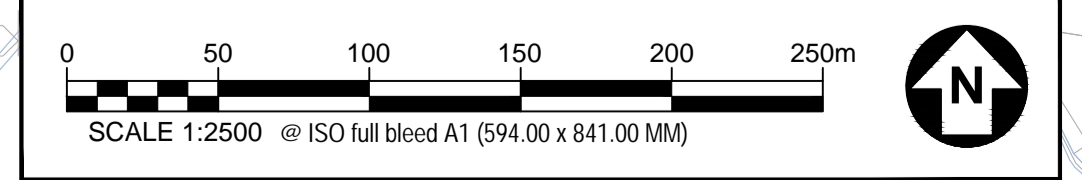

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION

DRAWING STATUS
ISSUE


PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 4)

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

KEY PLAN

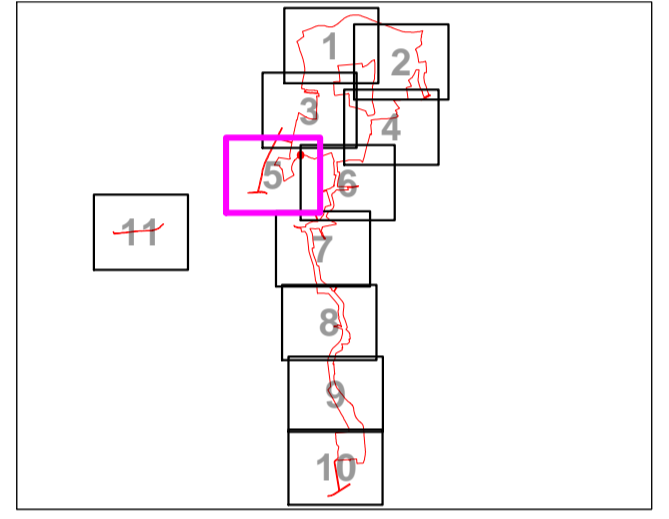

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION


PO2	04.10.24	SECOND ISSUE
PO1	16.08.24	FIRST ISSUE
IR	DATE	DESCRIPTION


DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 5)

SHEET NUMBER **REV.**
60698207-ACM-XX-XX-AB-TPP-05 P02

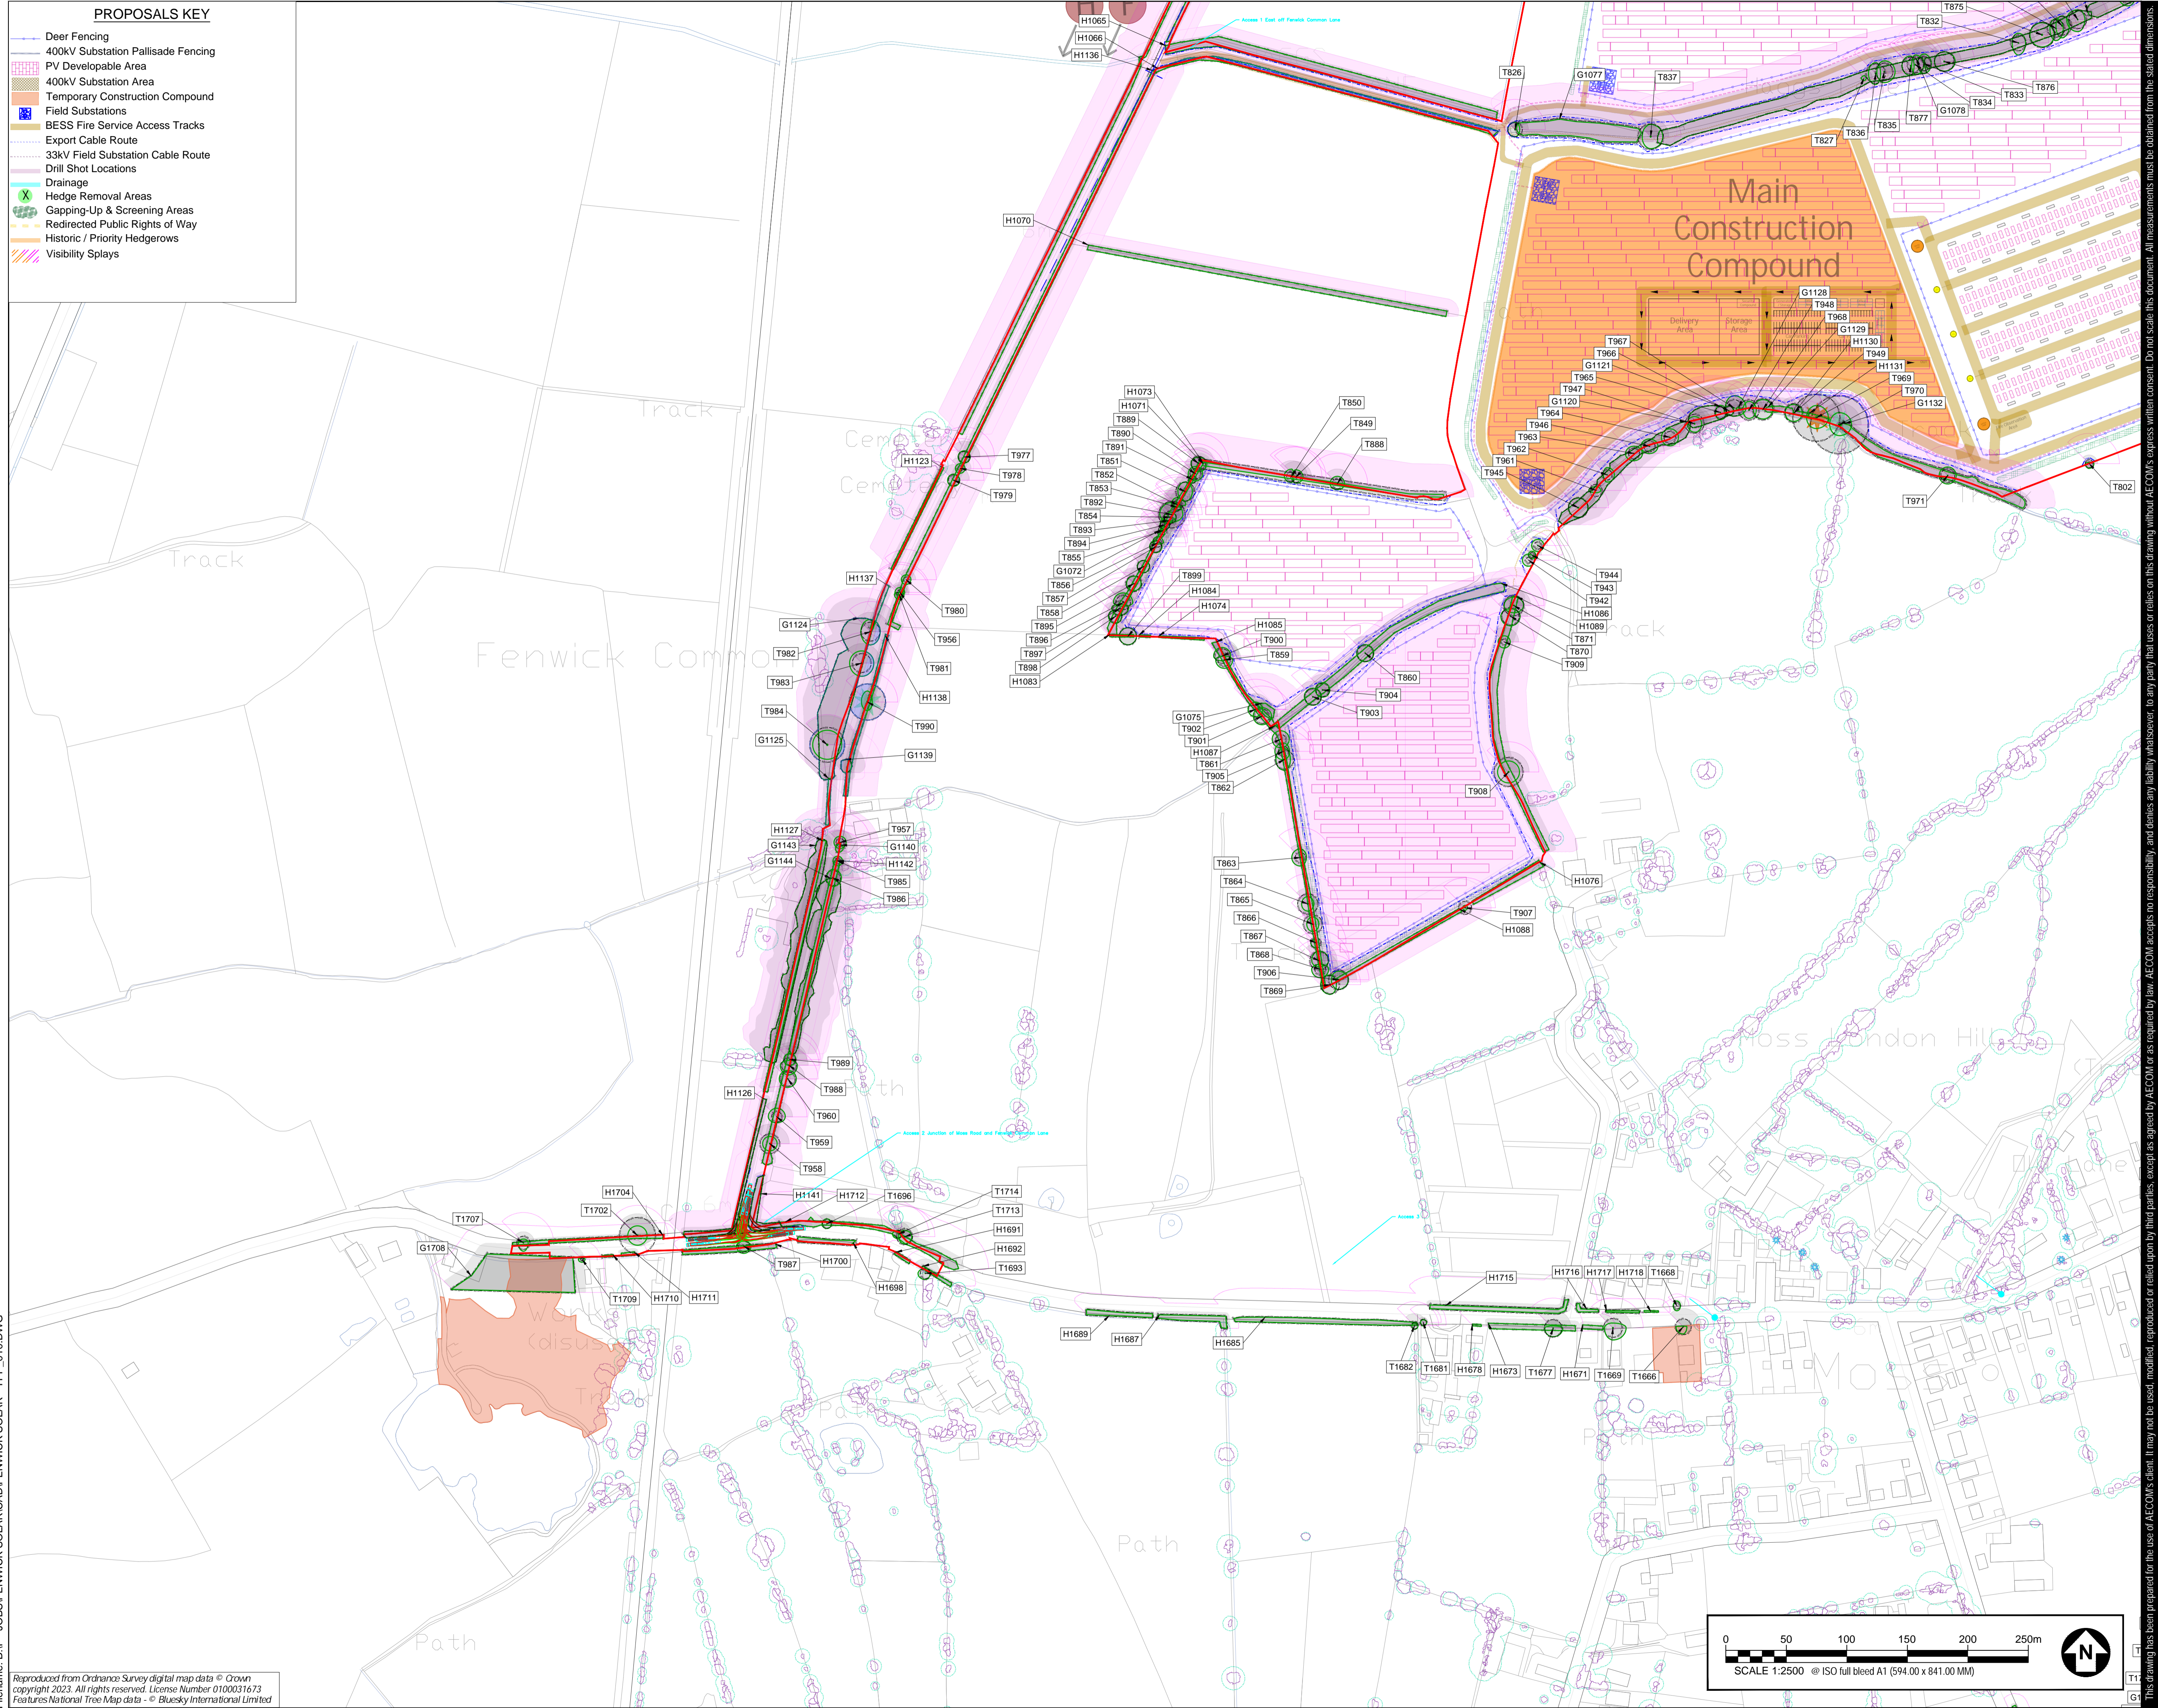

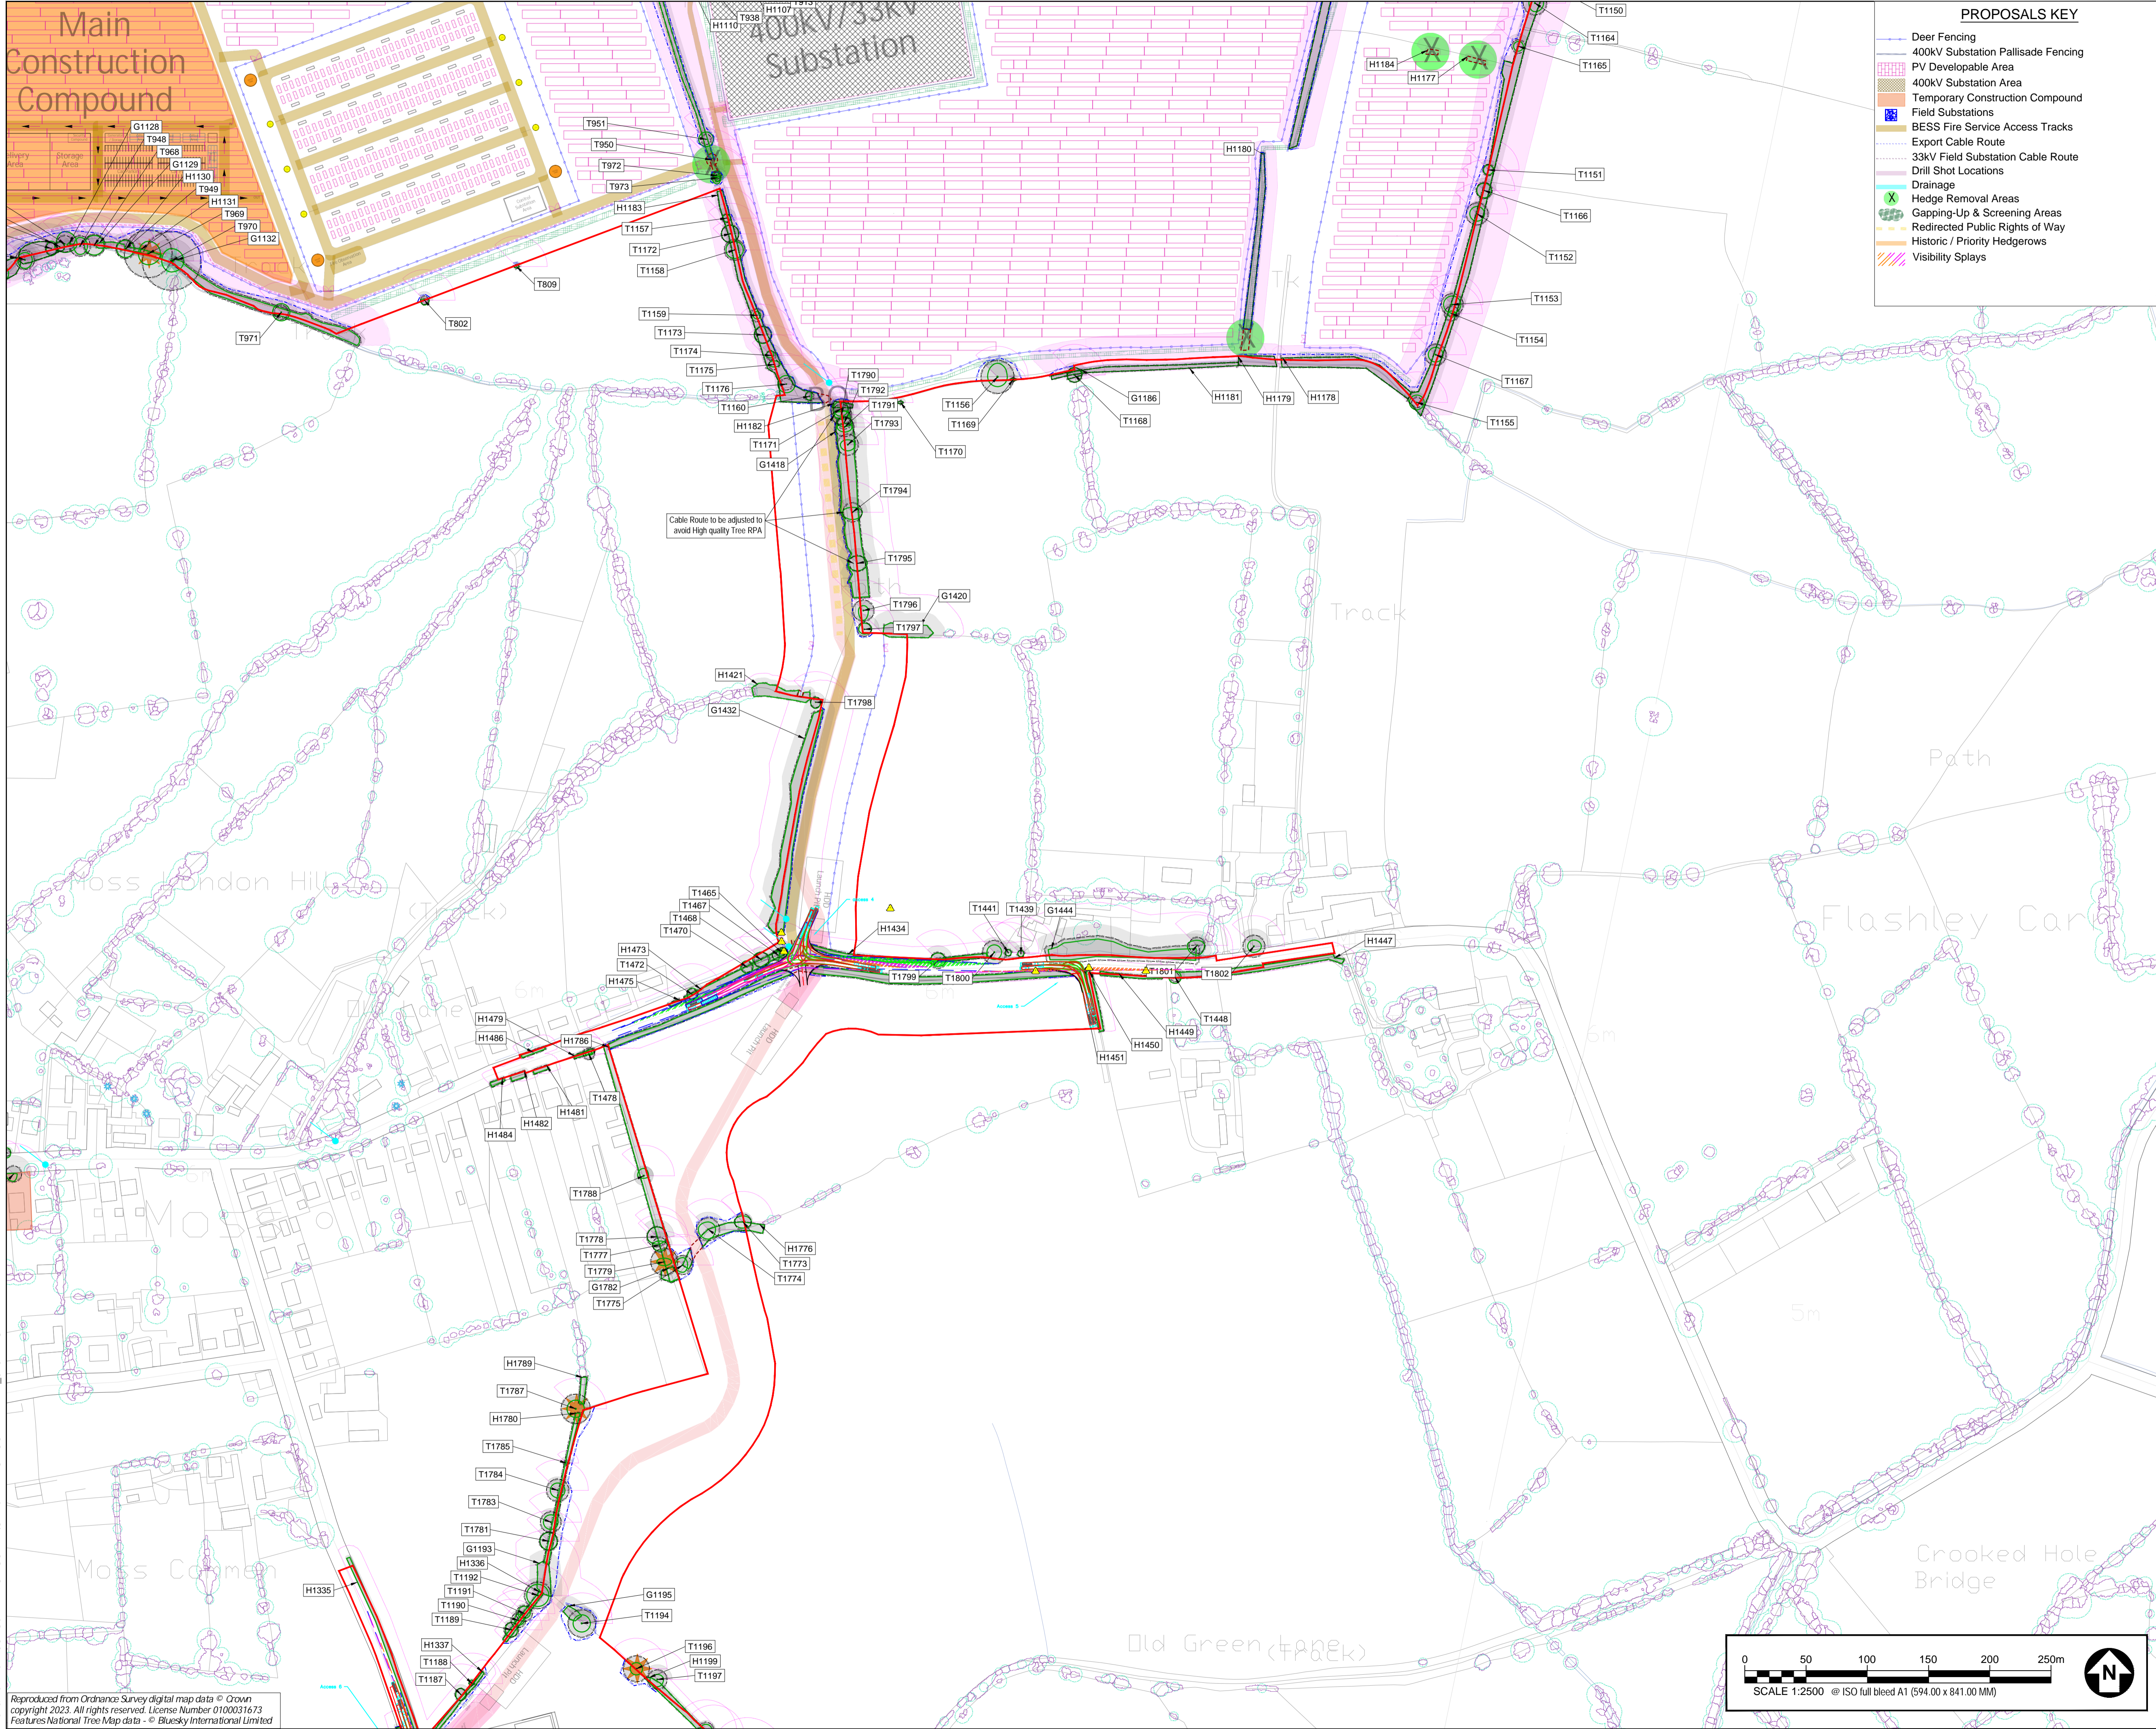

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- X Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays


AECOM

PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED CONSULTANT

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
 NTM_Data_Minus_Survey_Data.dwg
 FENW-Option Plan-v1.2_CABLE_CASING.dwg
 FENW-Overall Layout-v4.5_1_Simp3.dwg
 60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

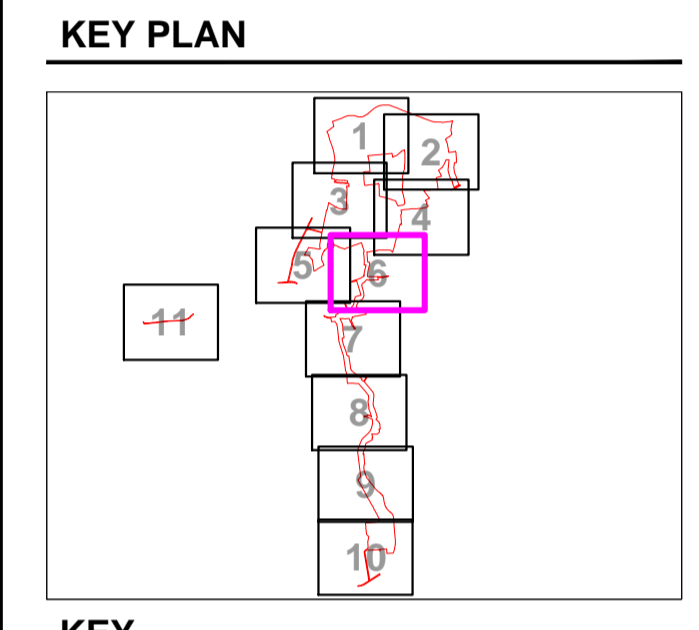

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING
- CONSTRUCTION EXCLUSION ZONE (TRACKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- ★ VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ★ ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CLASSIFIED AS AN ICH BY BODENAS)
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO) (CONSIDERED AN AREA OF PRIORITY HABITAT))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION


NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR	DATE	DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
 60698207

SHEET TITLE
TREE PROTECTION PLAN (SHEET 6)

SHEET NUMBER **REV.**
 60698207-ACM-XX-XX-AB-TPP-06 P02

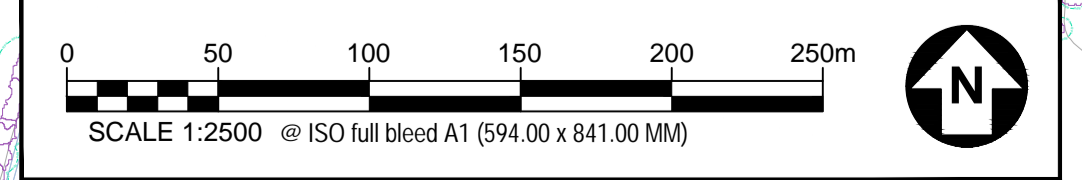



Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
 Features: National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

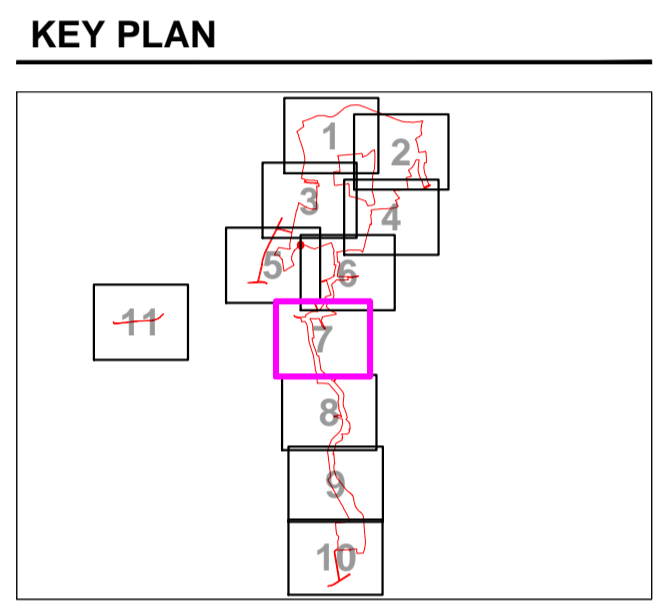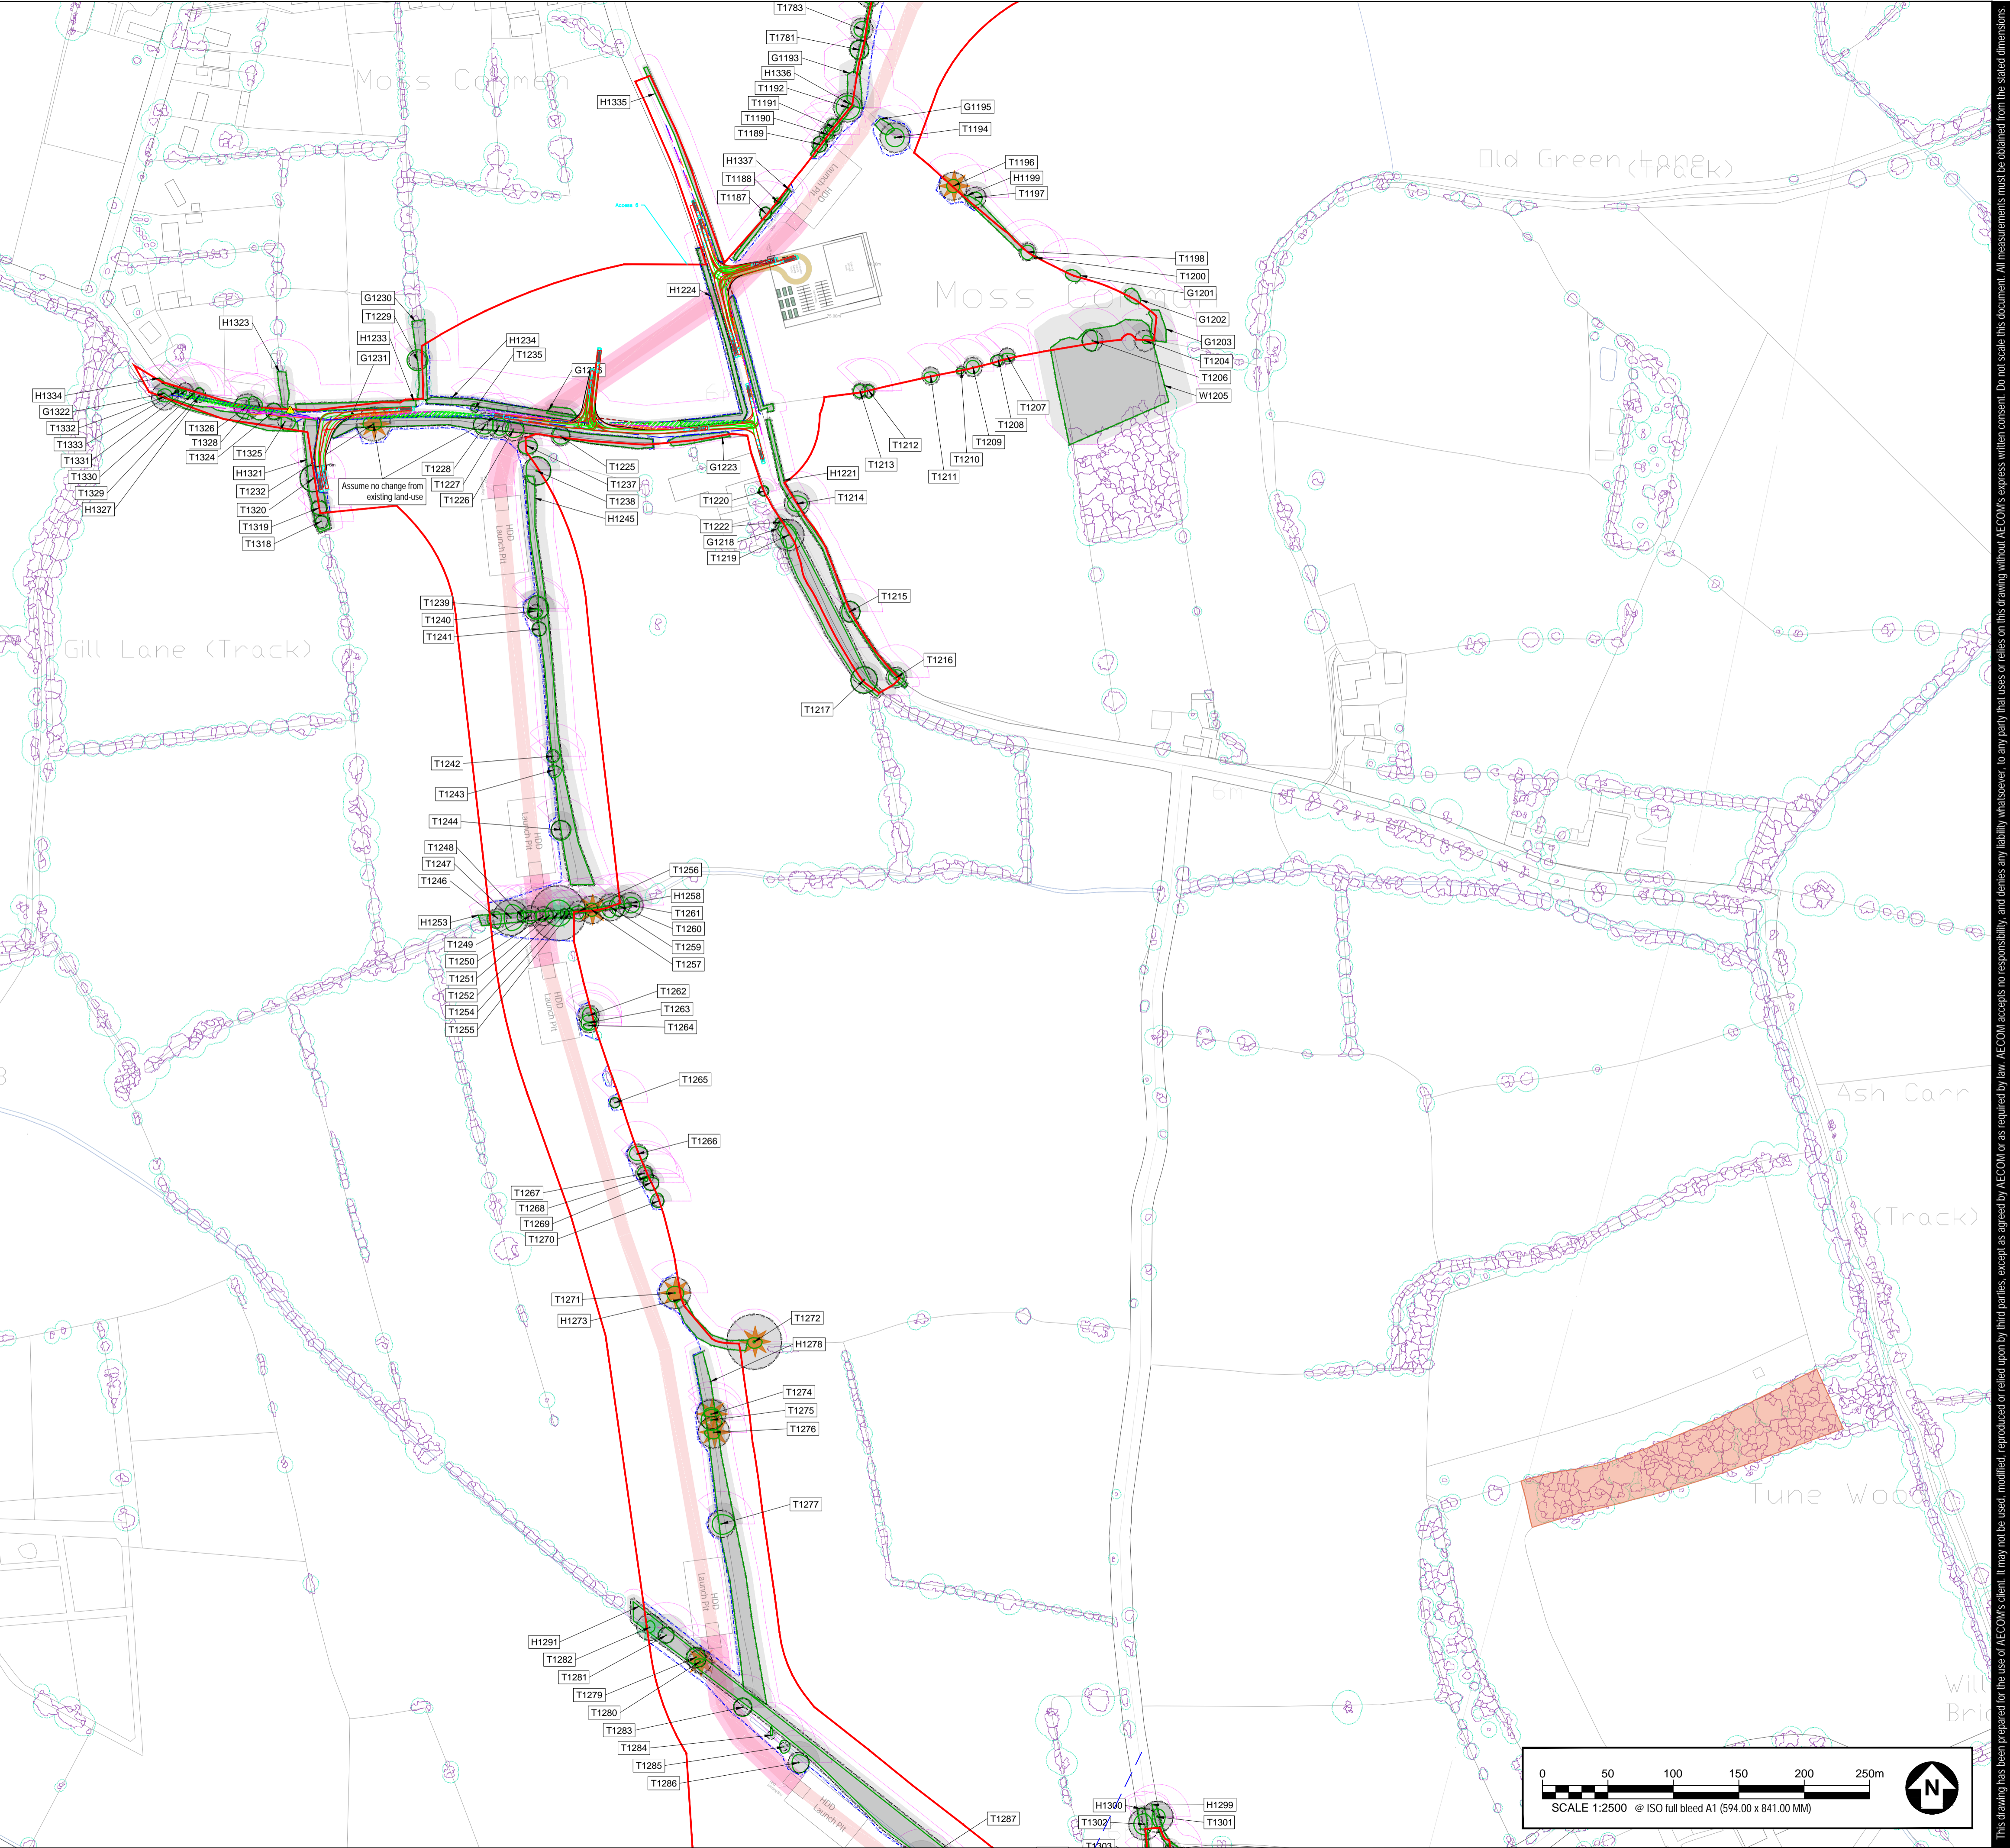

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION


DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN (SHEET 7)

SHEET NUMBER **REV.**

Last saved by: BREMER (2024.12.05) Last Plotted: 2024.12.05
 Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

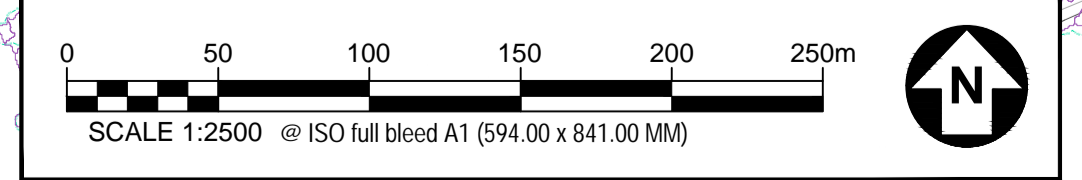


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE_EASMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

KEY PLAN

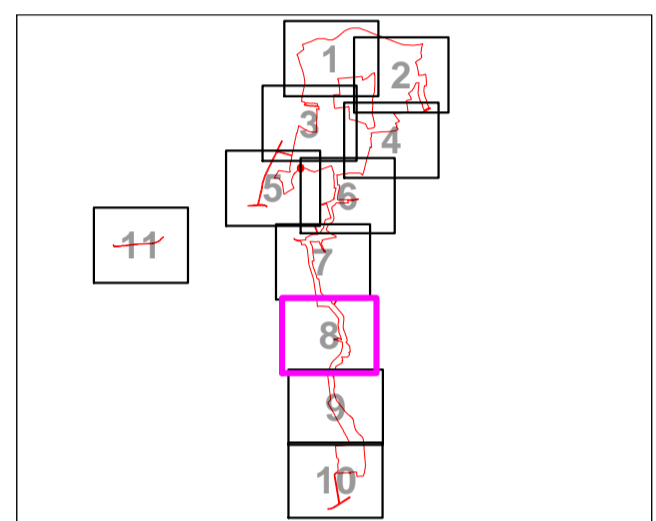

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CONSIDERED AS AN AREA OF PRIORITY HABITAT)
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO) (CONSIDERED AN AREA OF PRIORITY HABITAT))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION

DRAWING STATUS

ISSUE

PROJECT NUMBER

60698207

SHEET TITLE

TREE PROTECTION PLAN (SHEET 8)

SHEET NUMBER

60698207-ACM-XX-XX-AB-TPP-08



REV.

P02

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays


Author: GA Designer: JB Checked: TR Approved: AW

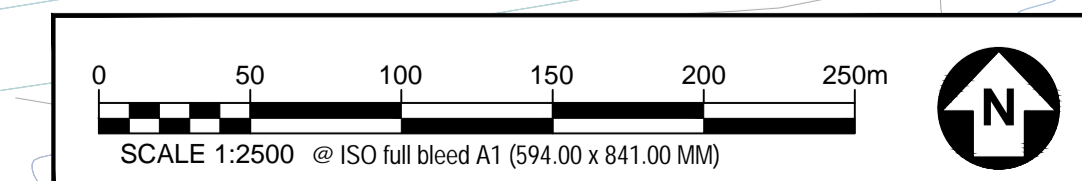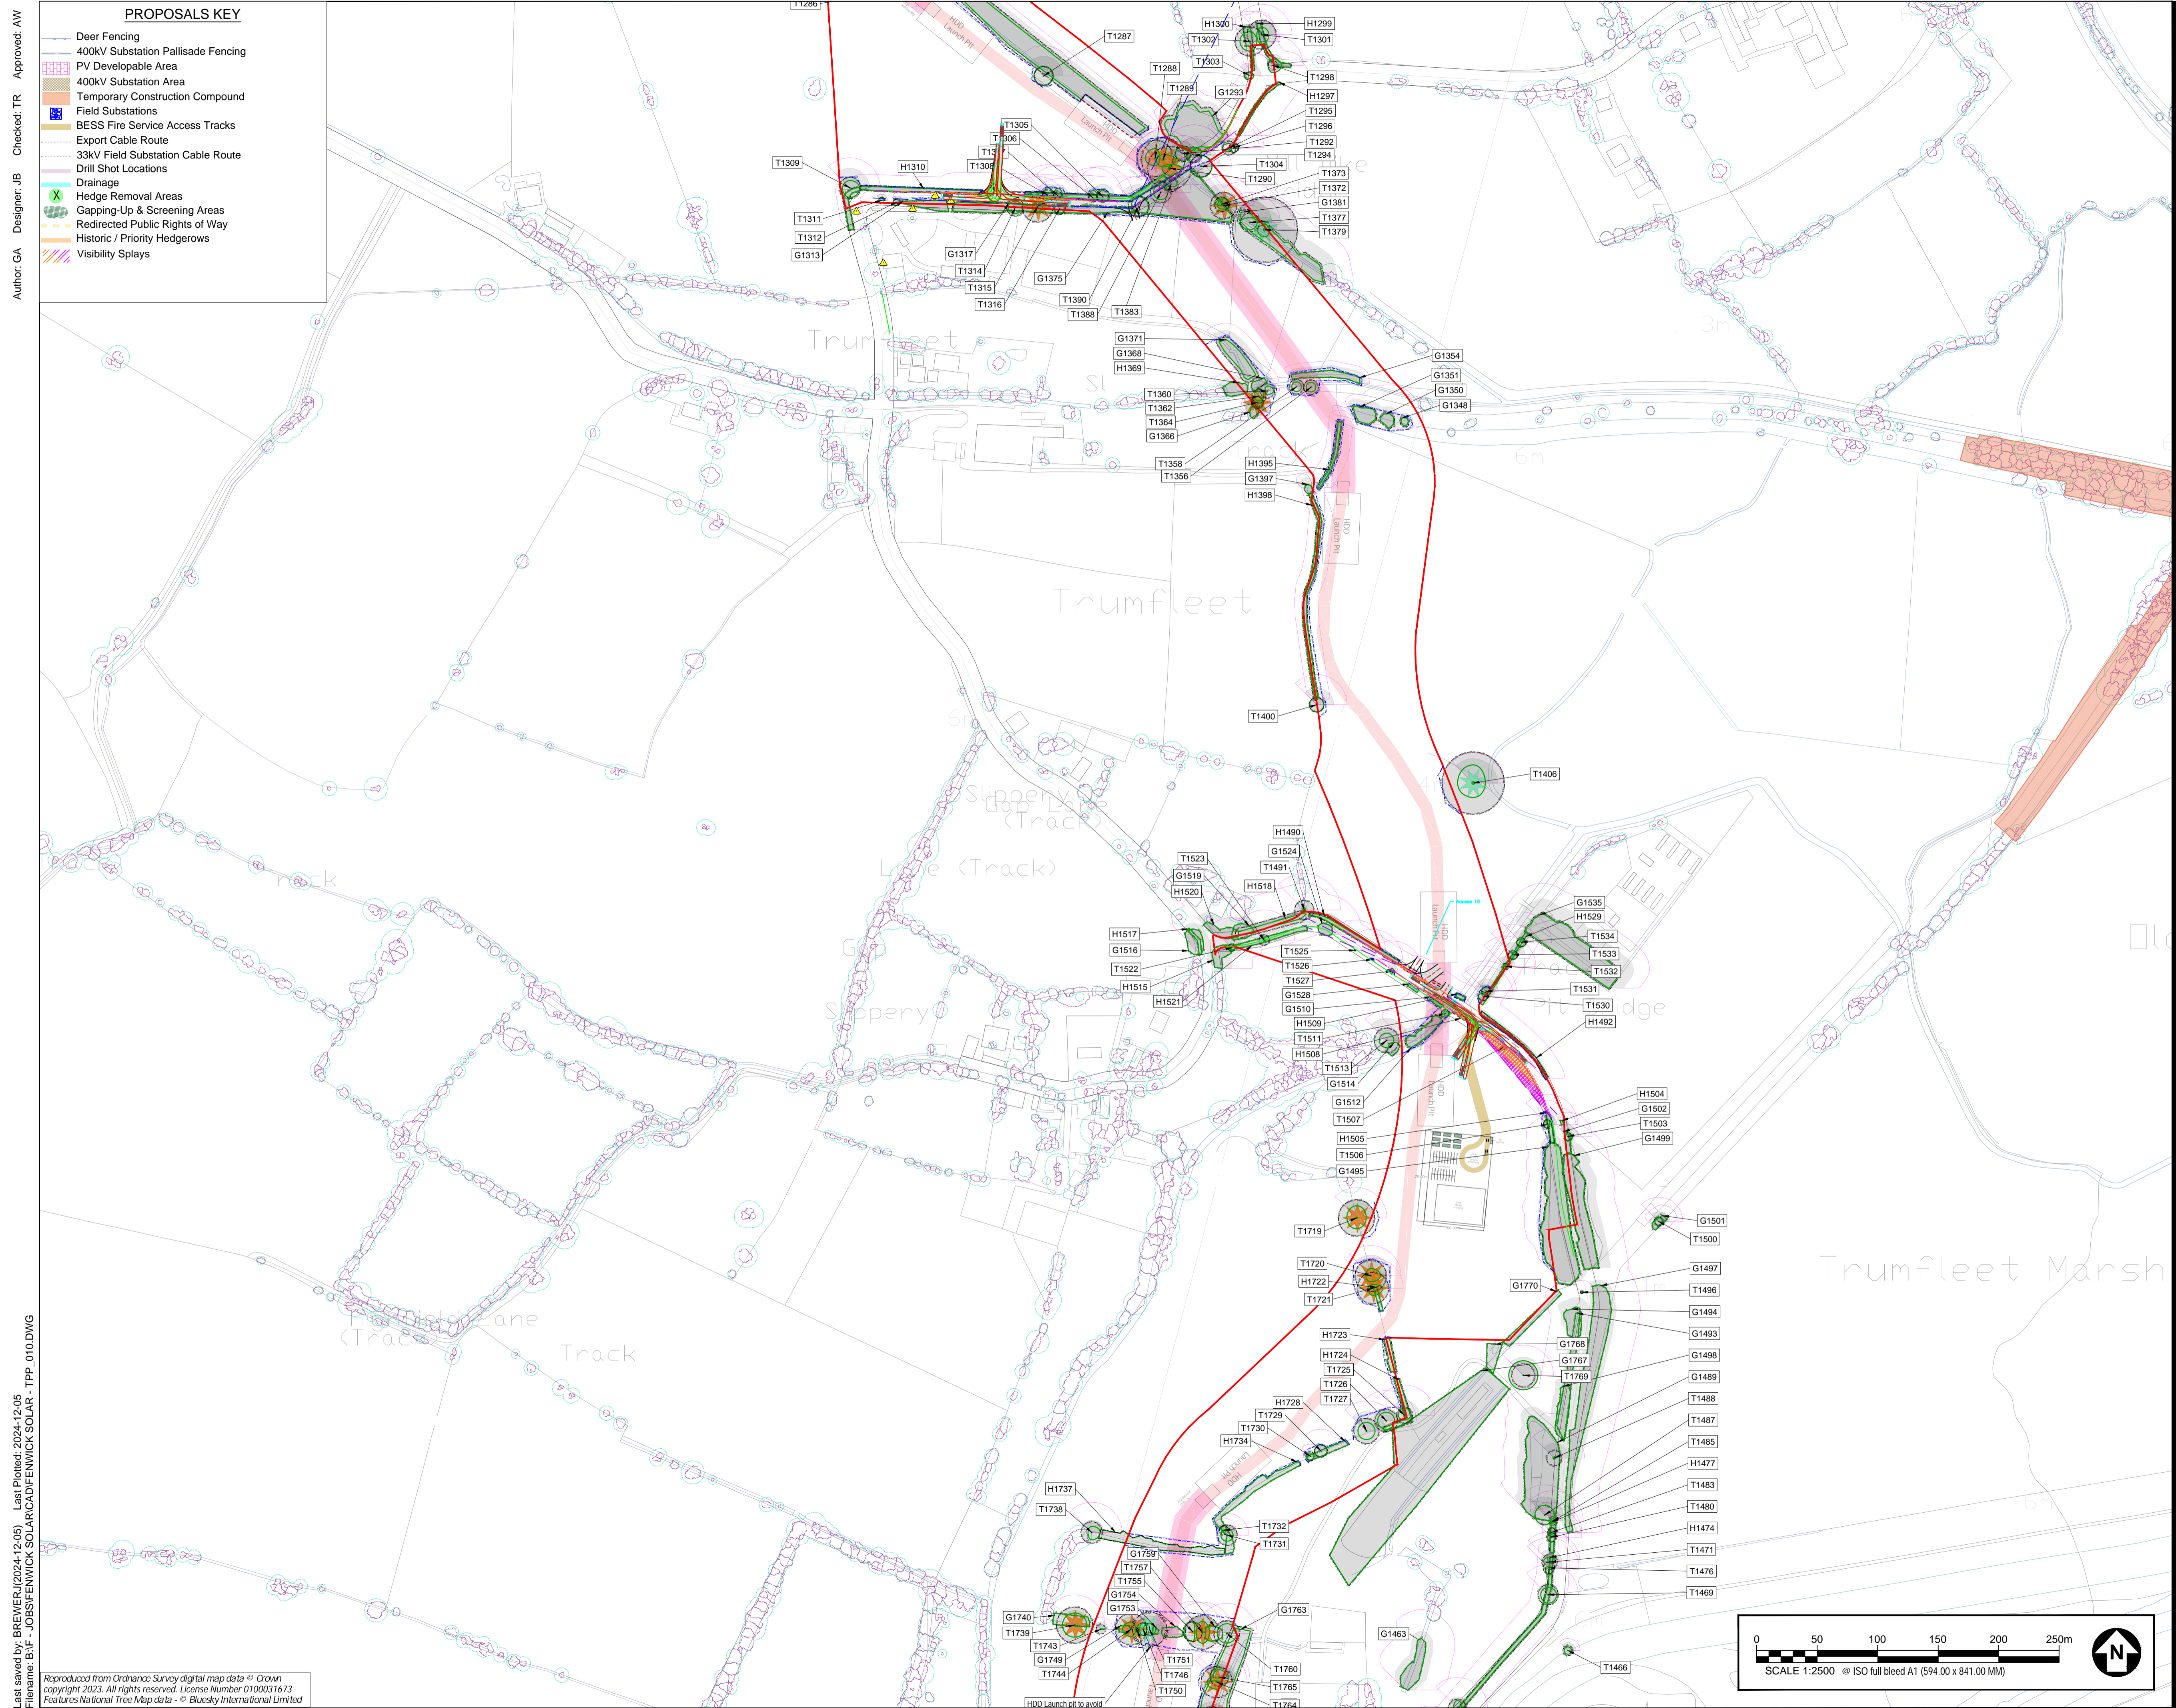

Last saved by: BREMER (2024.12.05) Last Plotted: 2024.12.05
 Filename: B:\JOB\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG
 Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
 Features: National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

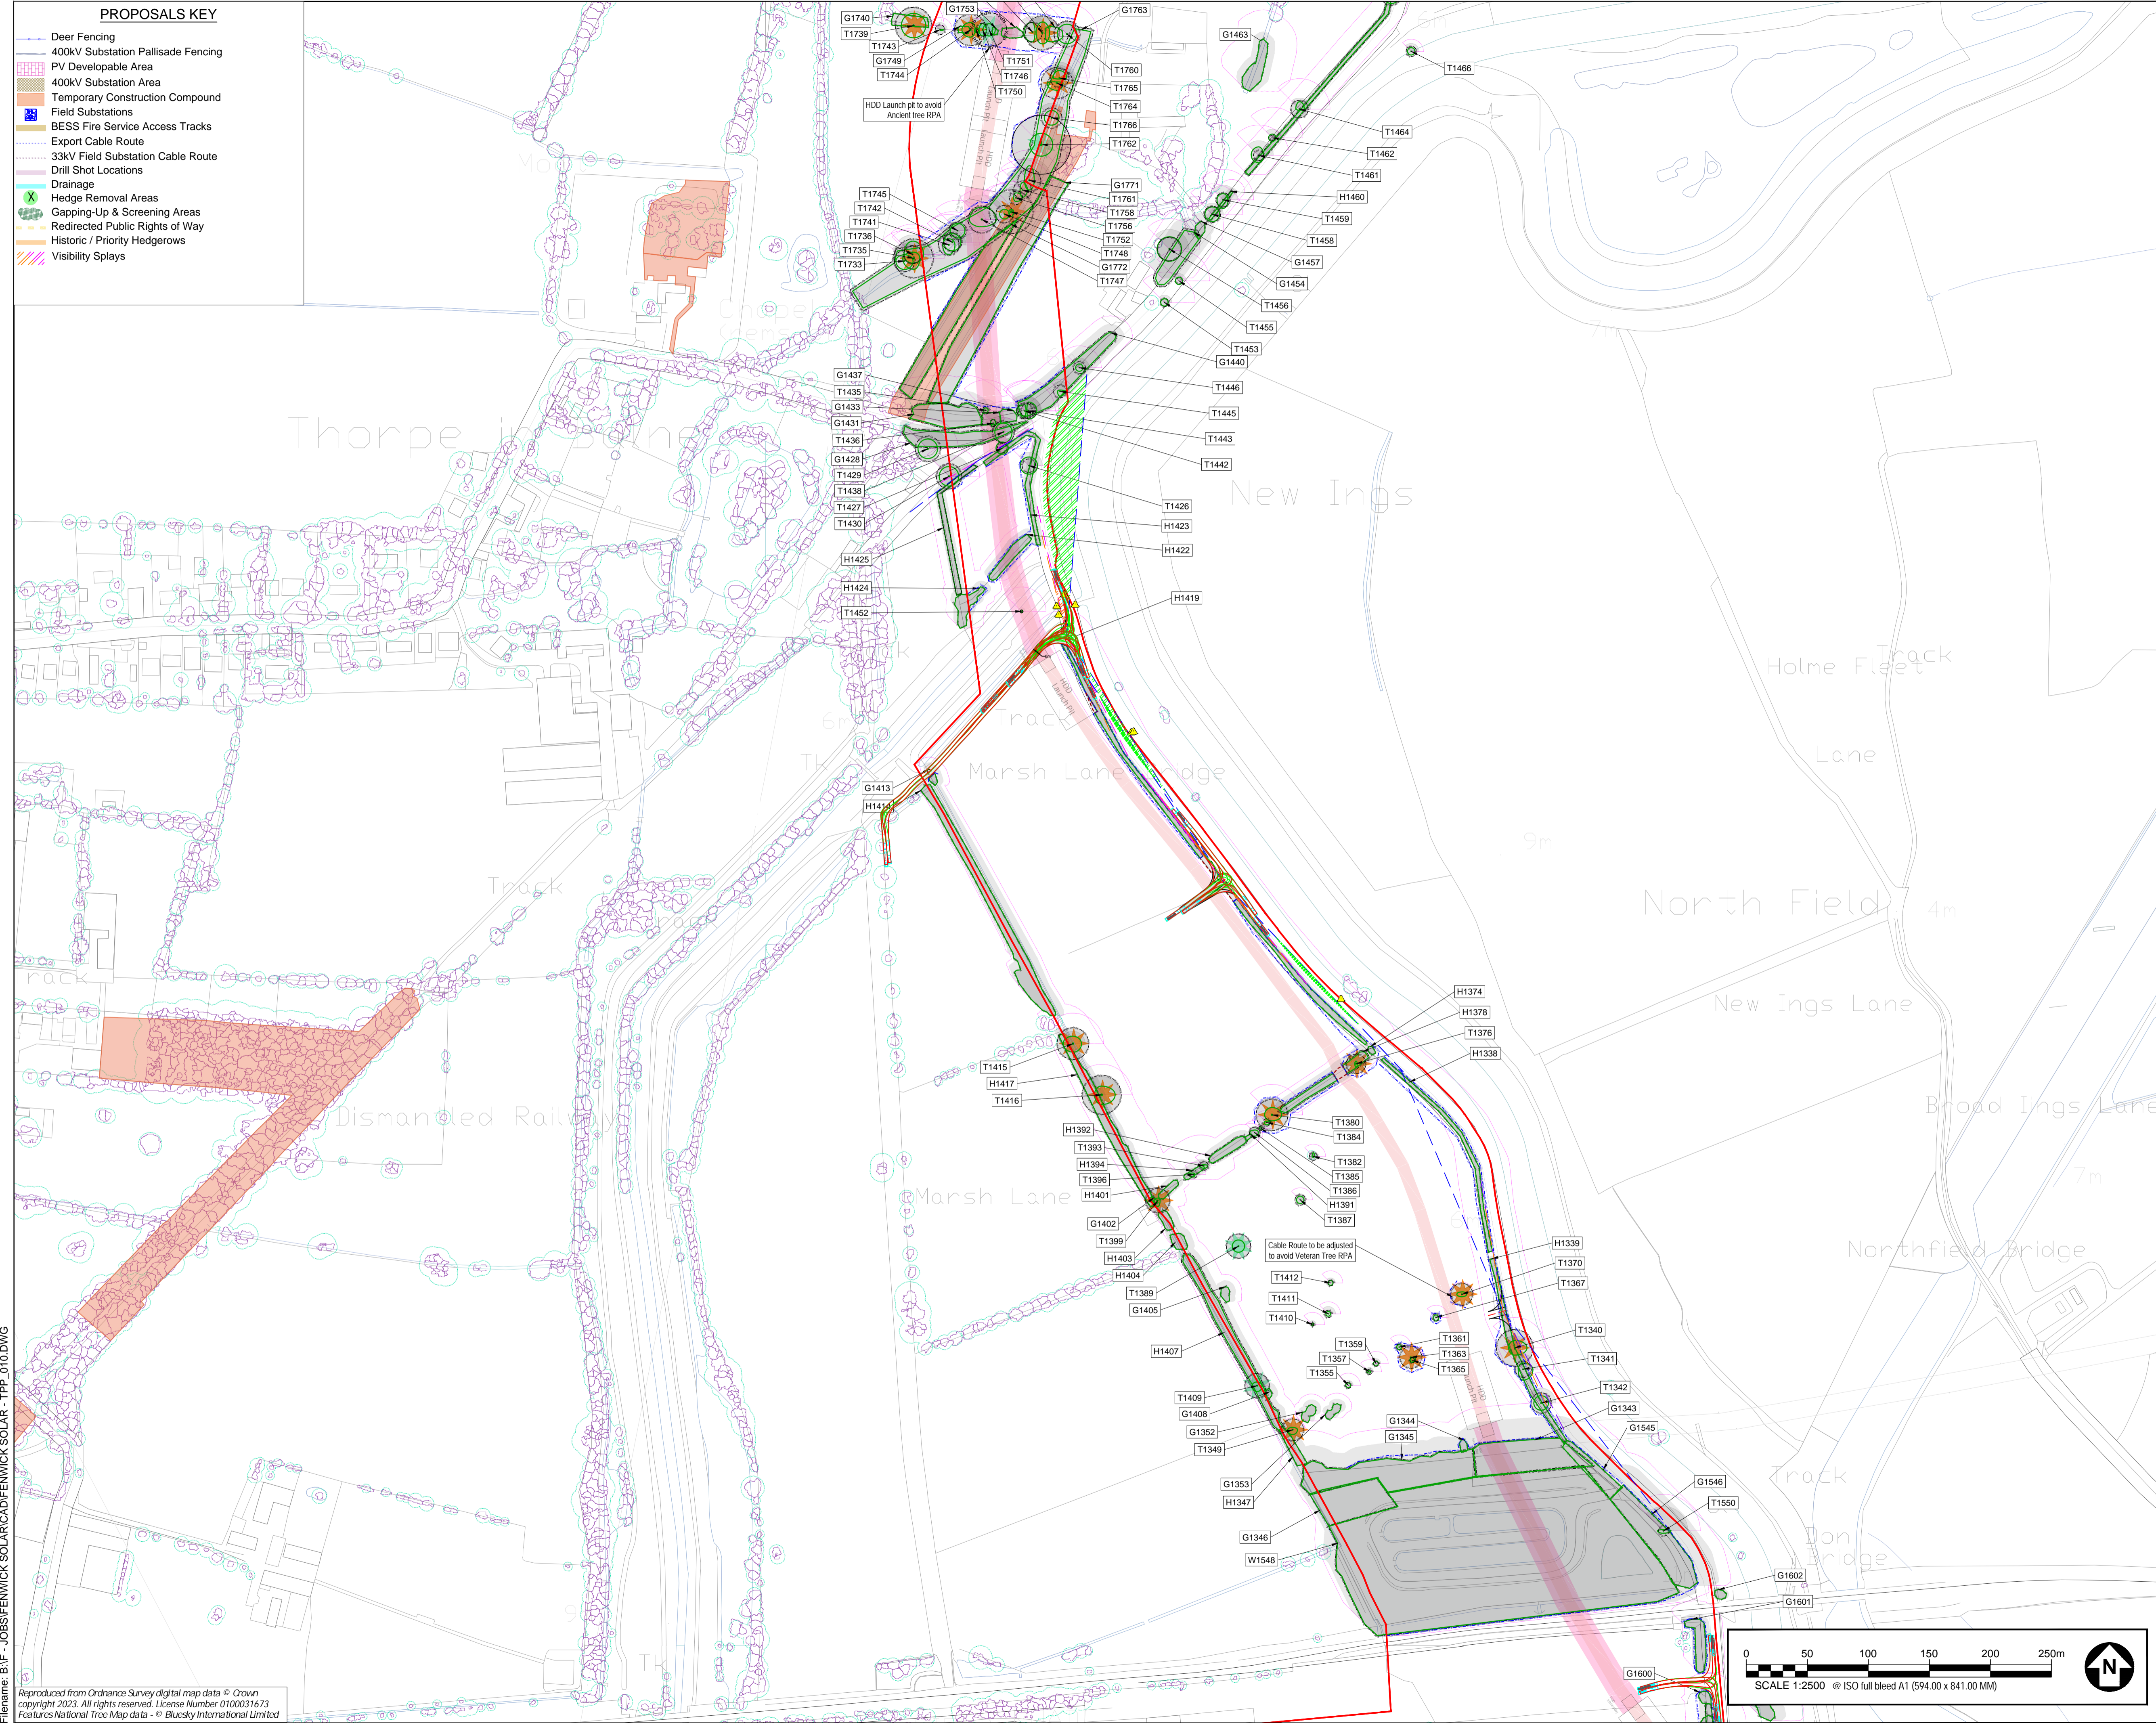


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT

AECOM
Plumfer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES**
1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
 2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORESCENTIAL REPORT.
 4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Options-Plan-v1.2-CABLE-CASEMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

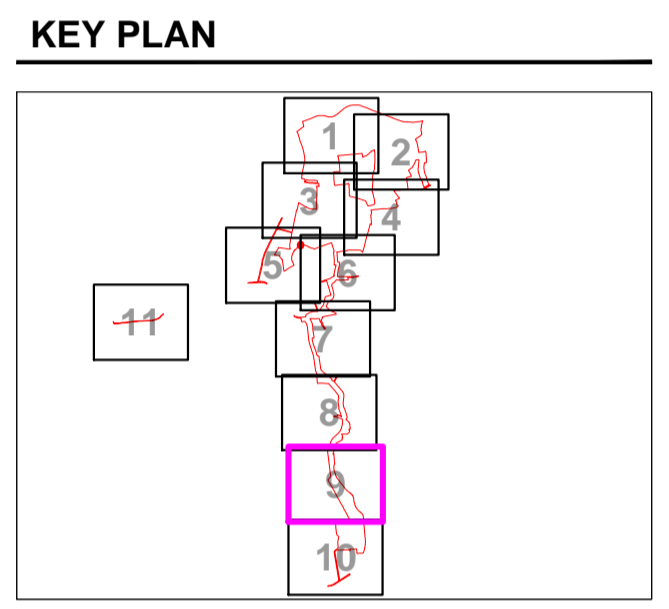

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
 - TREE PROTECTION FENCING
 - CONSTRUCTION EXCLUSION ZONE (TRACKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
 - CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORESCENTIAL IMPACT ASSESSMENT)
 - NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
 - APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CLASSIFIED AS AN AREA OF WOODLAND)
 - TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO) (CONSIDERED AN AREA OF PRIORITY HABITAT))
 - PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR		DATE DESCRIPTION

DRAWING STATUS
ISSUE


PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 9)

SHEET NUMBER **REV.**
60698207-ACM-XX-XX-AB-TPP-09 P02

Last saved by: BREWER (2024.12.05) Last Plotted: 2024.12.05
 Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
 Features National Tree Map data - © Bluesky International Limited

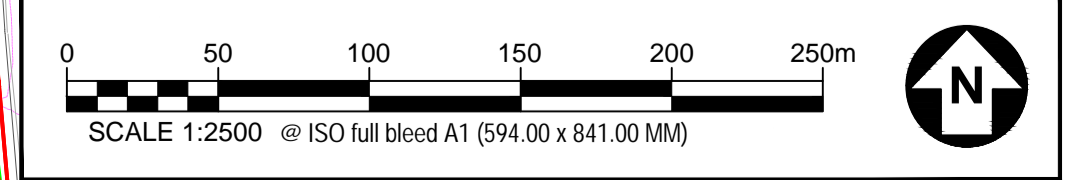


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

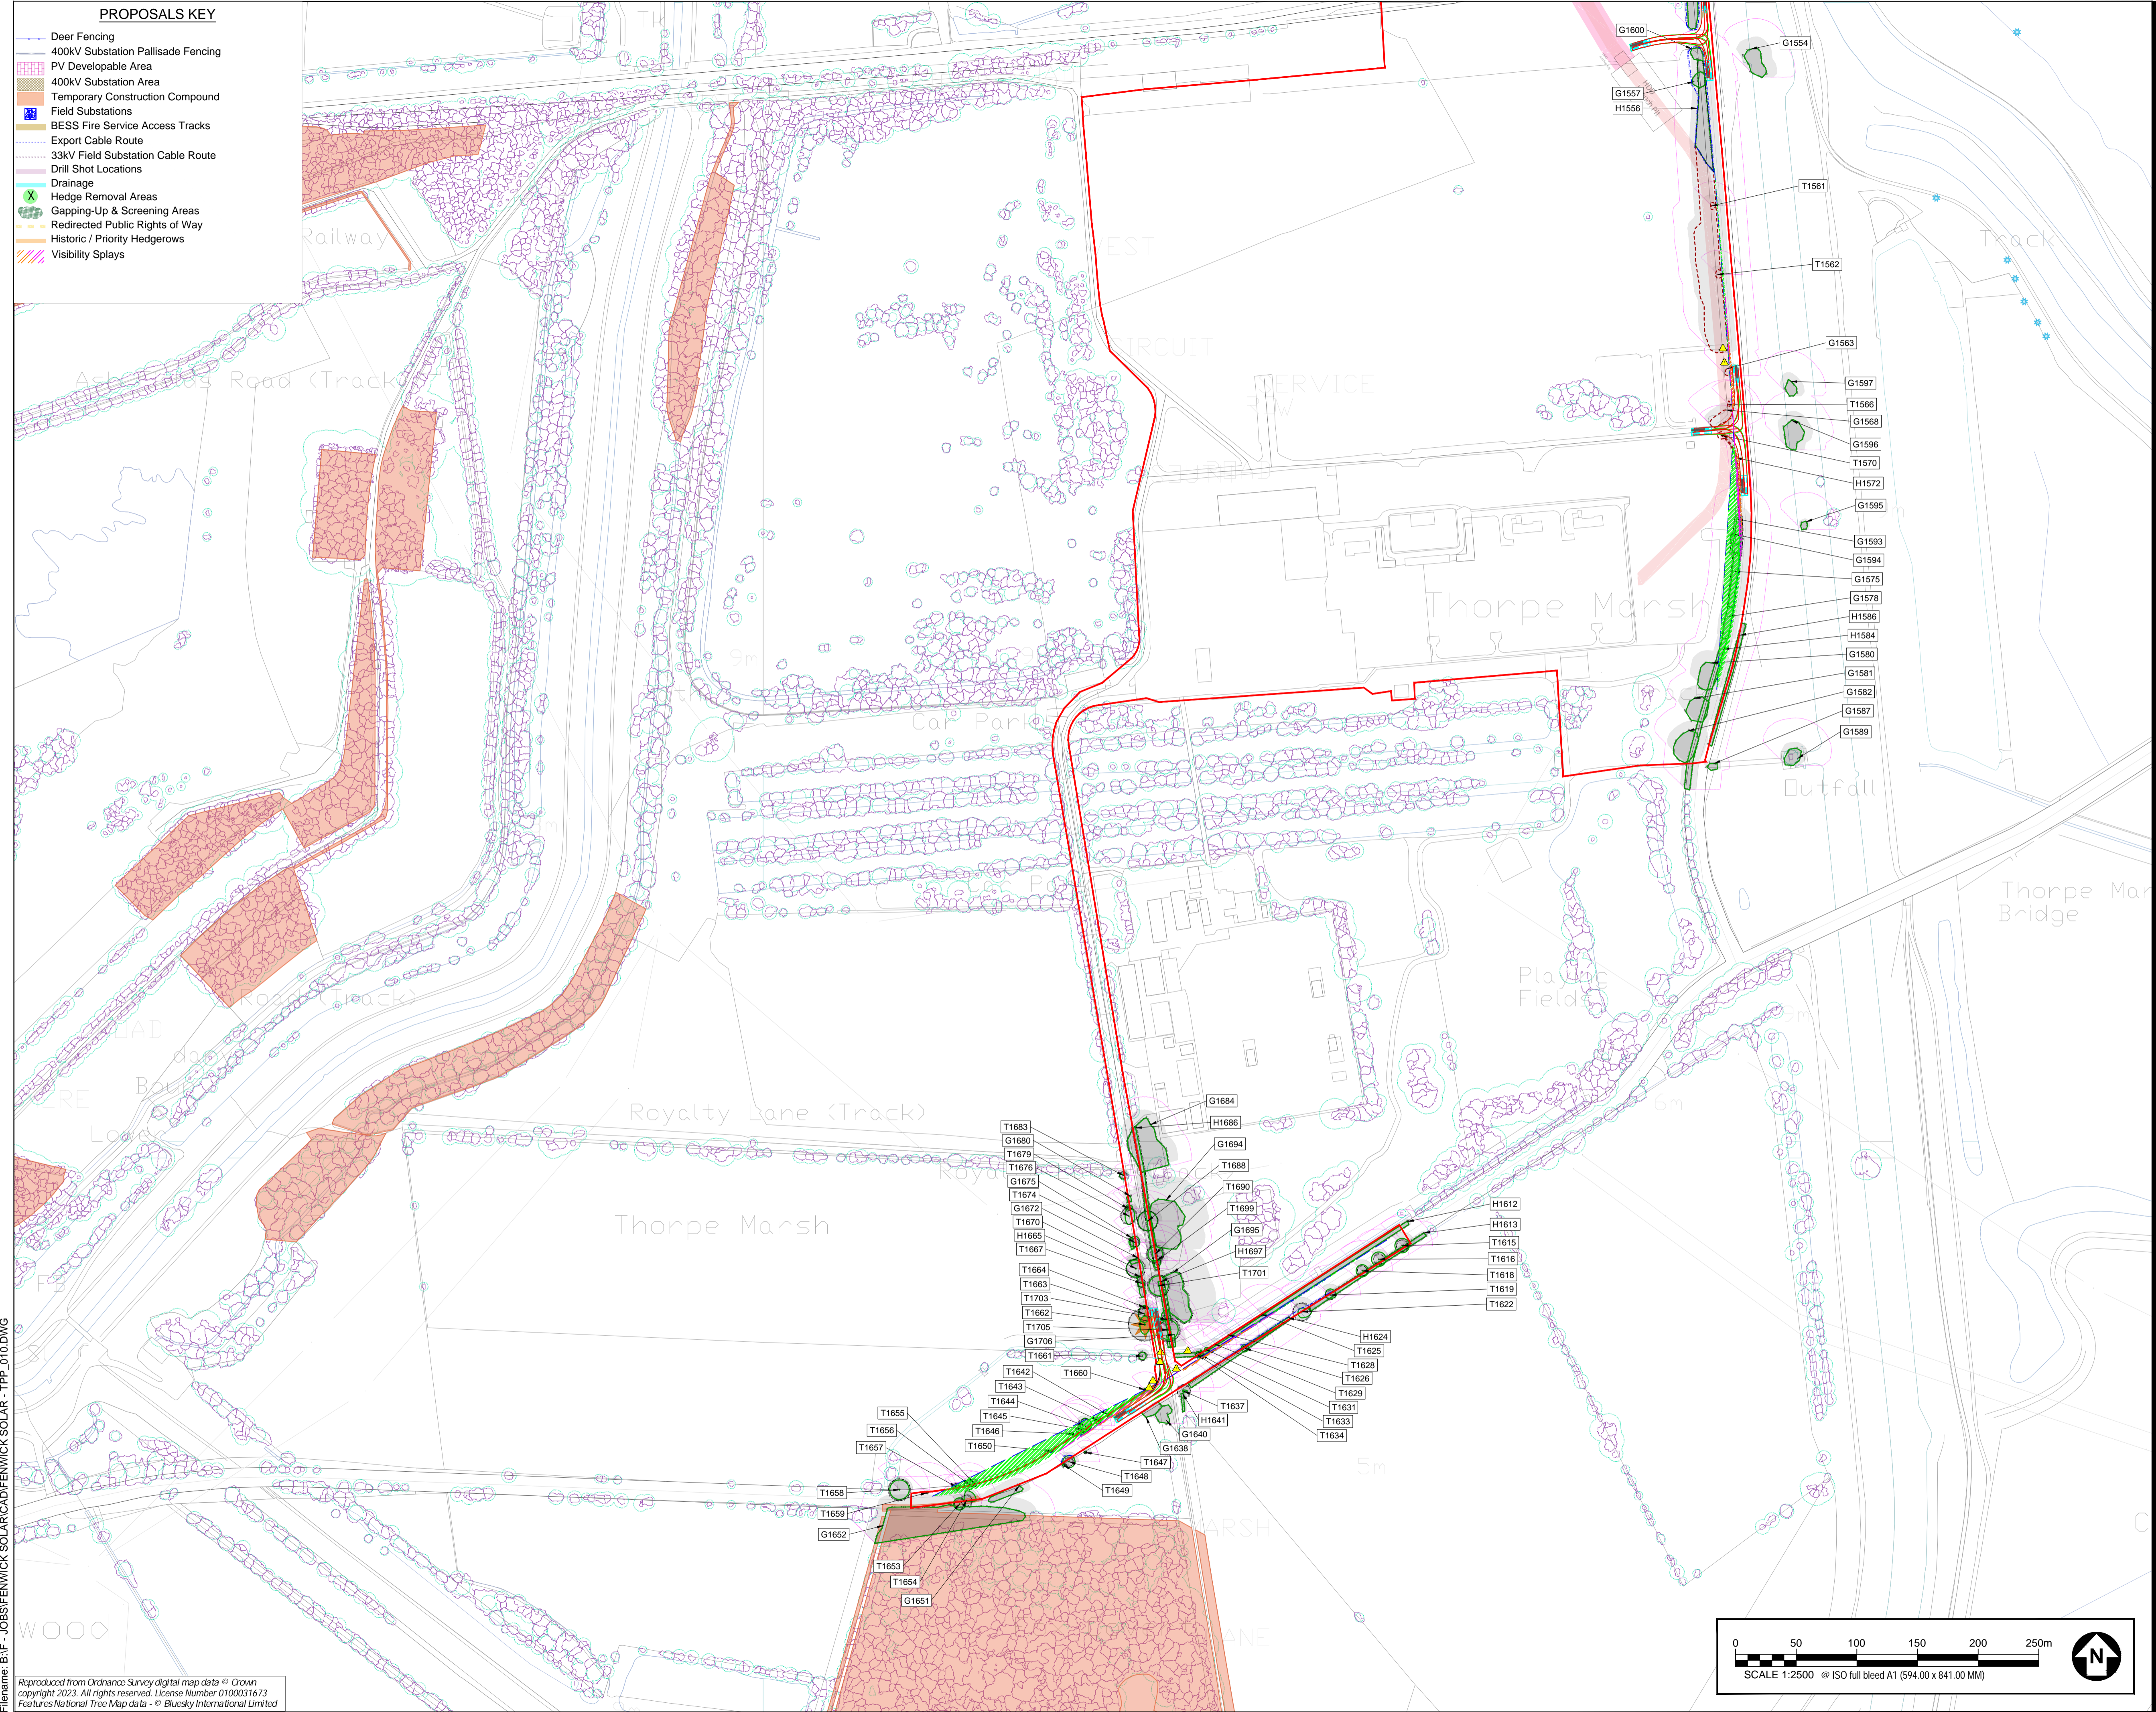


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT

AECOM
Plumfer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES**
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
 - THE ORIGINAL OF THIS DRAWING HAS BEEN PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE_CASMENT.dwg
FENW-Overall-Layout-v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

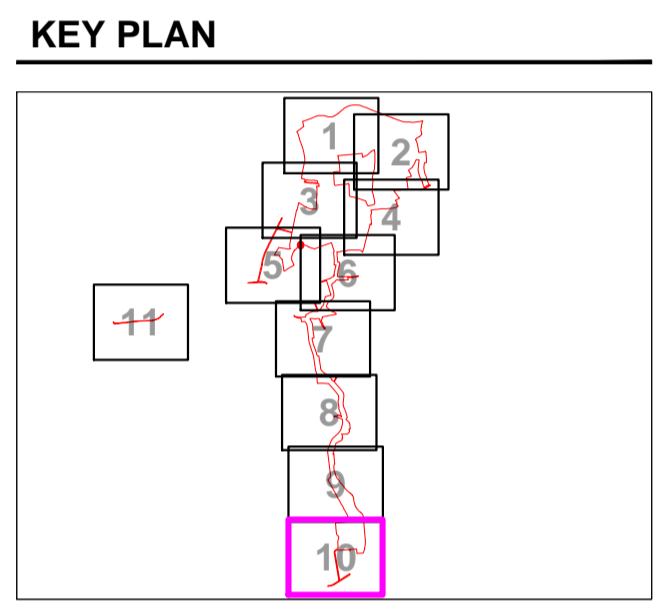

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING CONSTRUCTION EXCLUSION ZONE (WORKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CLASSIFIED AS ANCIEN BY BODENAS)
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO) (CONSIDERED AN AREA OF PRIORITY HABITAT))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION


NO	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE
LR	DATE	DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE PROTECTION PLAN
(SHEET 10)

SHEET NUMBER **REV.**
60698207-ACM-XX-XX-AB-TPP-010 P02

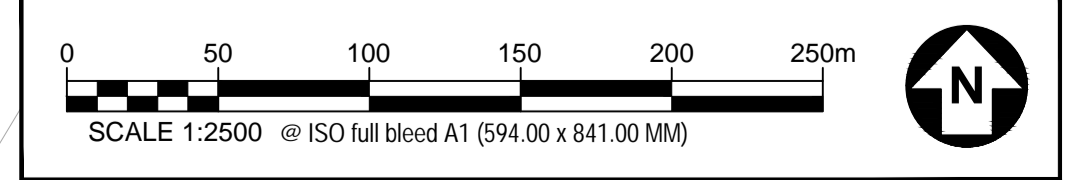

Last saved by: BREMER (2024.12.05) Last Plotted: 2024.12.05
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - TPP_010.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.


PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows
- Visibility Splays

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Option Plan v1.2_CABLE_EASMENT.dwg
FENW-Overall Layout v4.5.1_Simp3.dwg
60698207-ACM-HGN-M2-CH-0001 Access Proposal Model P01.dwg

KEY PLAN

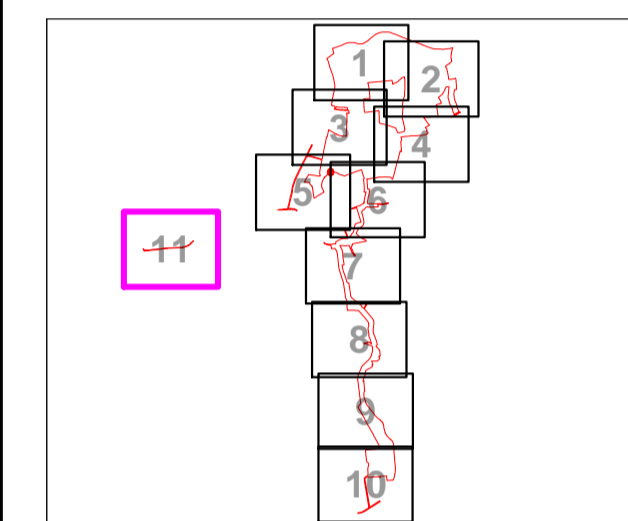

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- ROOT PROTECTION AREA OF RETAINED TREES (AS DEFINED BY BS 5837:2012)
- TREE PROTECTION FENCING
- CONSTRUCTION EXCLUSION ZONE (TRUCKING OF PLANT, MATERIALS STORAGE, EXCAVATION AND ALL OTHER CONSTRUCTION ACTIVITIES ARE EXCLUDED WITHIN THESE AREAS FOR THE PURPOSES OF PROTECTING TREE HEALTH)
- CONSTRUCTION WORKING ZONE (MANAGED CONSTRUCTION PROCESSES PERMITTED IN ACCORDANCE WITH THE PRINCIPLES SET OUT WITHIN THE ARBORICULTURAL IMPACT ASSESSMENT)
- NTM DATA PROVIDED BY BLUESKY LTD (NATIONAL TREE MAP DATA)
- APPROX NTM ROOT PROTECTION AREA (BASED ON BLUESKY LTD DATA)
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W15m BUFFER ZONE) (AREA CONSIDERED AS AN AREA OF HIGH BIODIVERSITY)
- TREE PRESERVATION ORDER (AREA COVERED BY A TREE PRESERVATION ORDER (TPO))
- PRIORITY HABITAT (CONSIDERED AN AREA OF PRIORITY HABITAT)

ISSUE/REVISION

IR	DATE	DESCRIPTION
P02	04.10.24	SECOND ISSUE
P01	16.08.24	FIRST ISSUE

DRAWING STATUS

ISSUE

PROJECT NUMBER

60698207

SHEET TITLE


TREE PROTECTION PLAN
(SHEET 11)

SHEET NUMBER

60698207-ACM-XX-XX-AB-TPP-011


REV.

P02

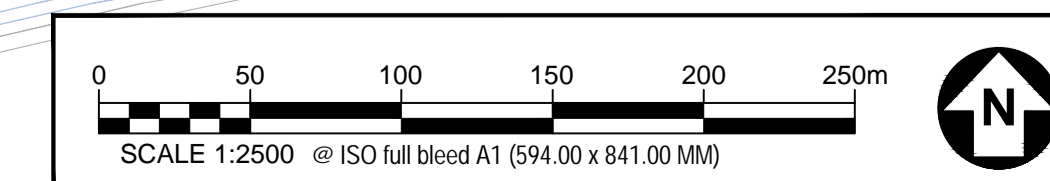

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.

Annex D Tree Shade Plan

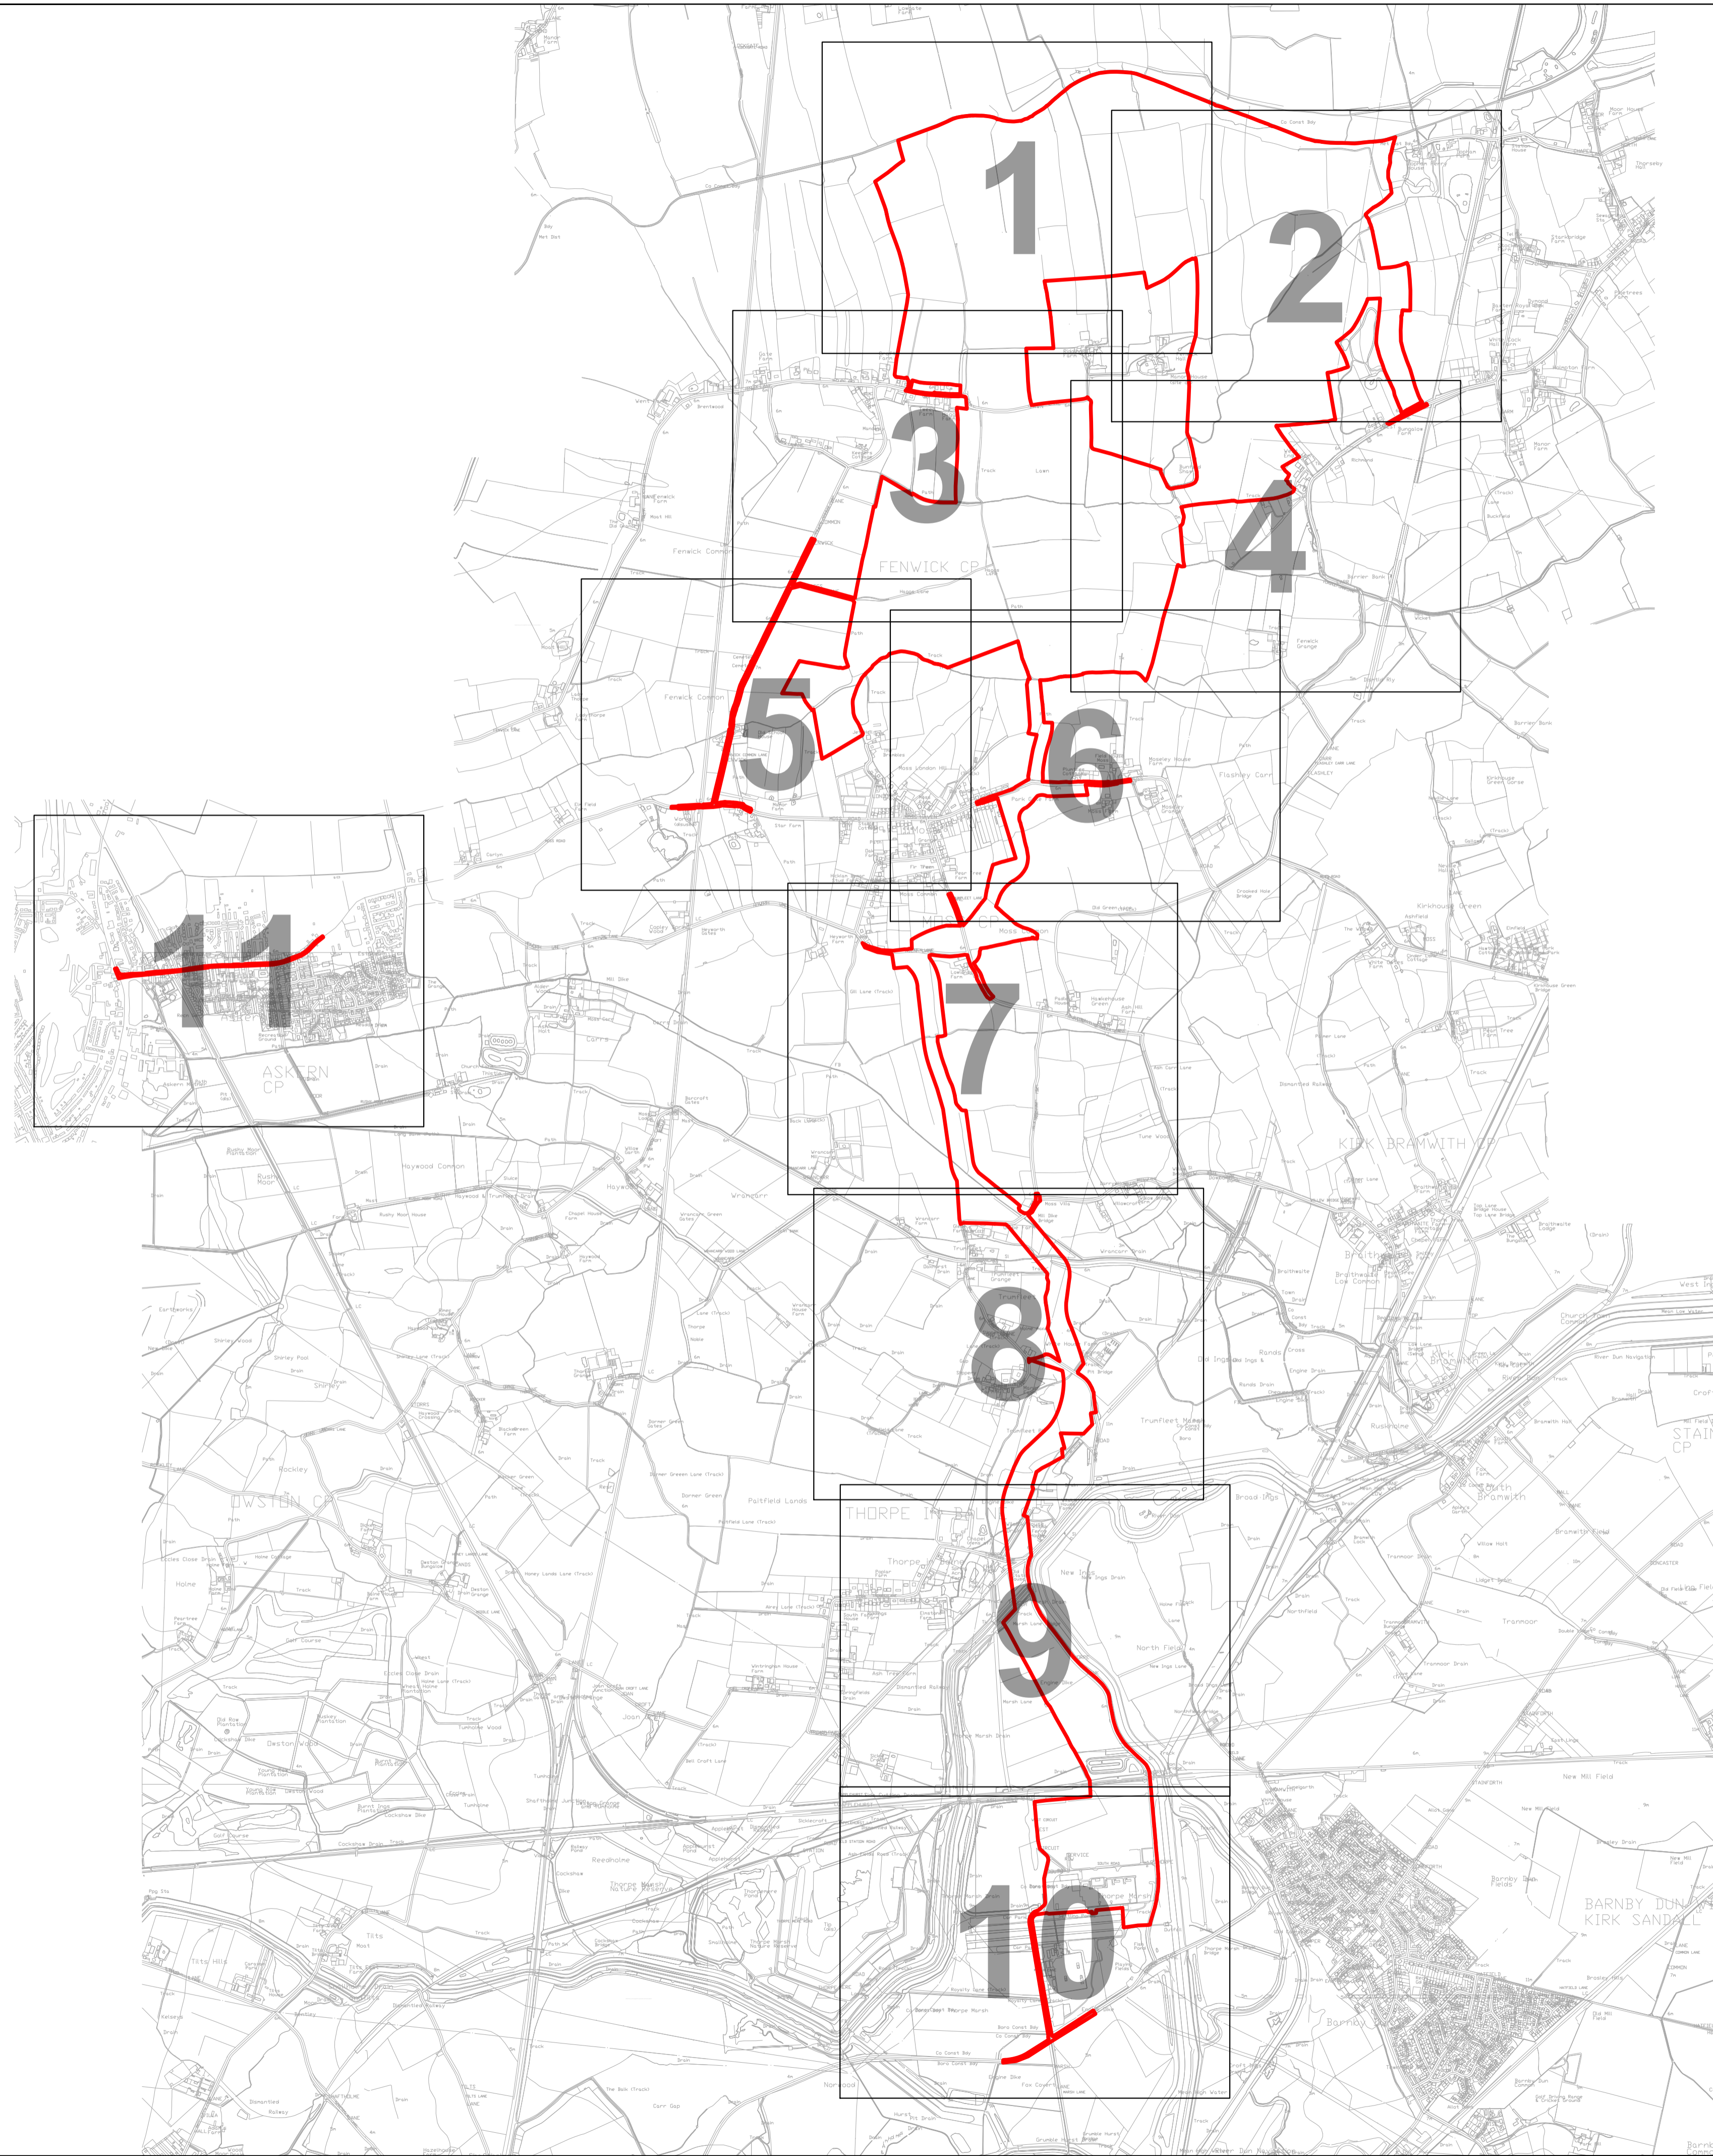

PROJECT
 FENWICK SOLAR FARM

CLIENT
 FENWICK SOLAR PROJECT LIMITED
 CONSULTANT

AECOM
 Plumer House, Third Floor,
 East Wing, Tallyour Road
 Plymouth, PL6 5DH
 Tel +44(0)1752 676700
 Fax +44(0)870 238 6023
 www.aecom.com

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
4. THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
 NTM_Data_Minus_Survey_Data.dwg
 FENW-Option Plan-v1.2-CABLE EASMENT.dwg
 60698207-ACM-HGM-M2-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
 FENW-Overall Layout-v4.5.1_Simp3.dwg

KEY PLAN



KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

IR	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE

DRAWING STATUS

ISSUE

PROJECT NUMBER

60698207

SHEET TITLE

TREE SHADING ARC PLAN (SHEET 00)

SHEET NUMBER


60698207-ACM-XX-XX-AB-TSAP-000

REV.

P01

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced, or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

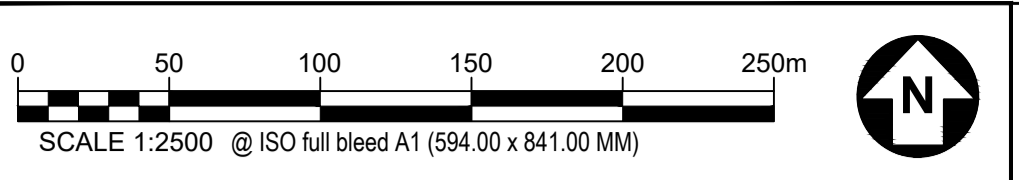


PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows

File name: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - SHADING ARC PLAN_004B.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673 Features National Tree Map data - © Bluesky International Limited

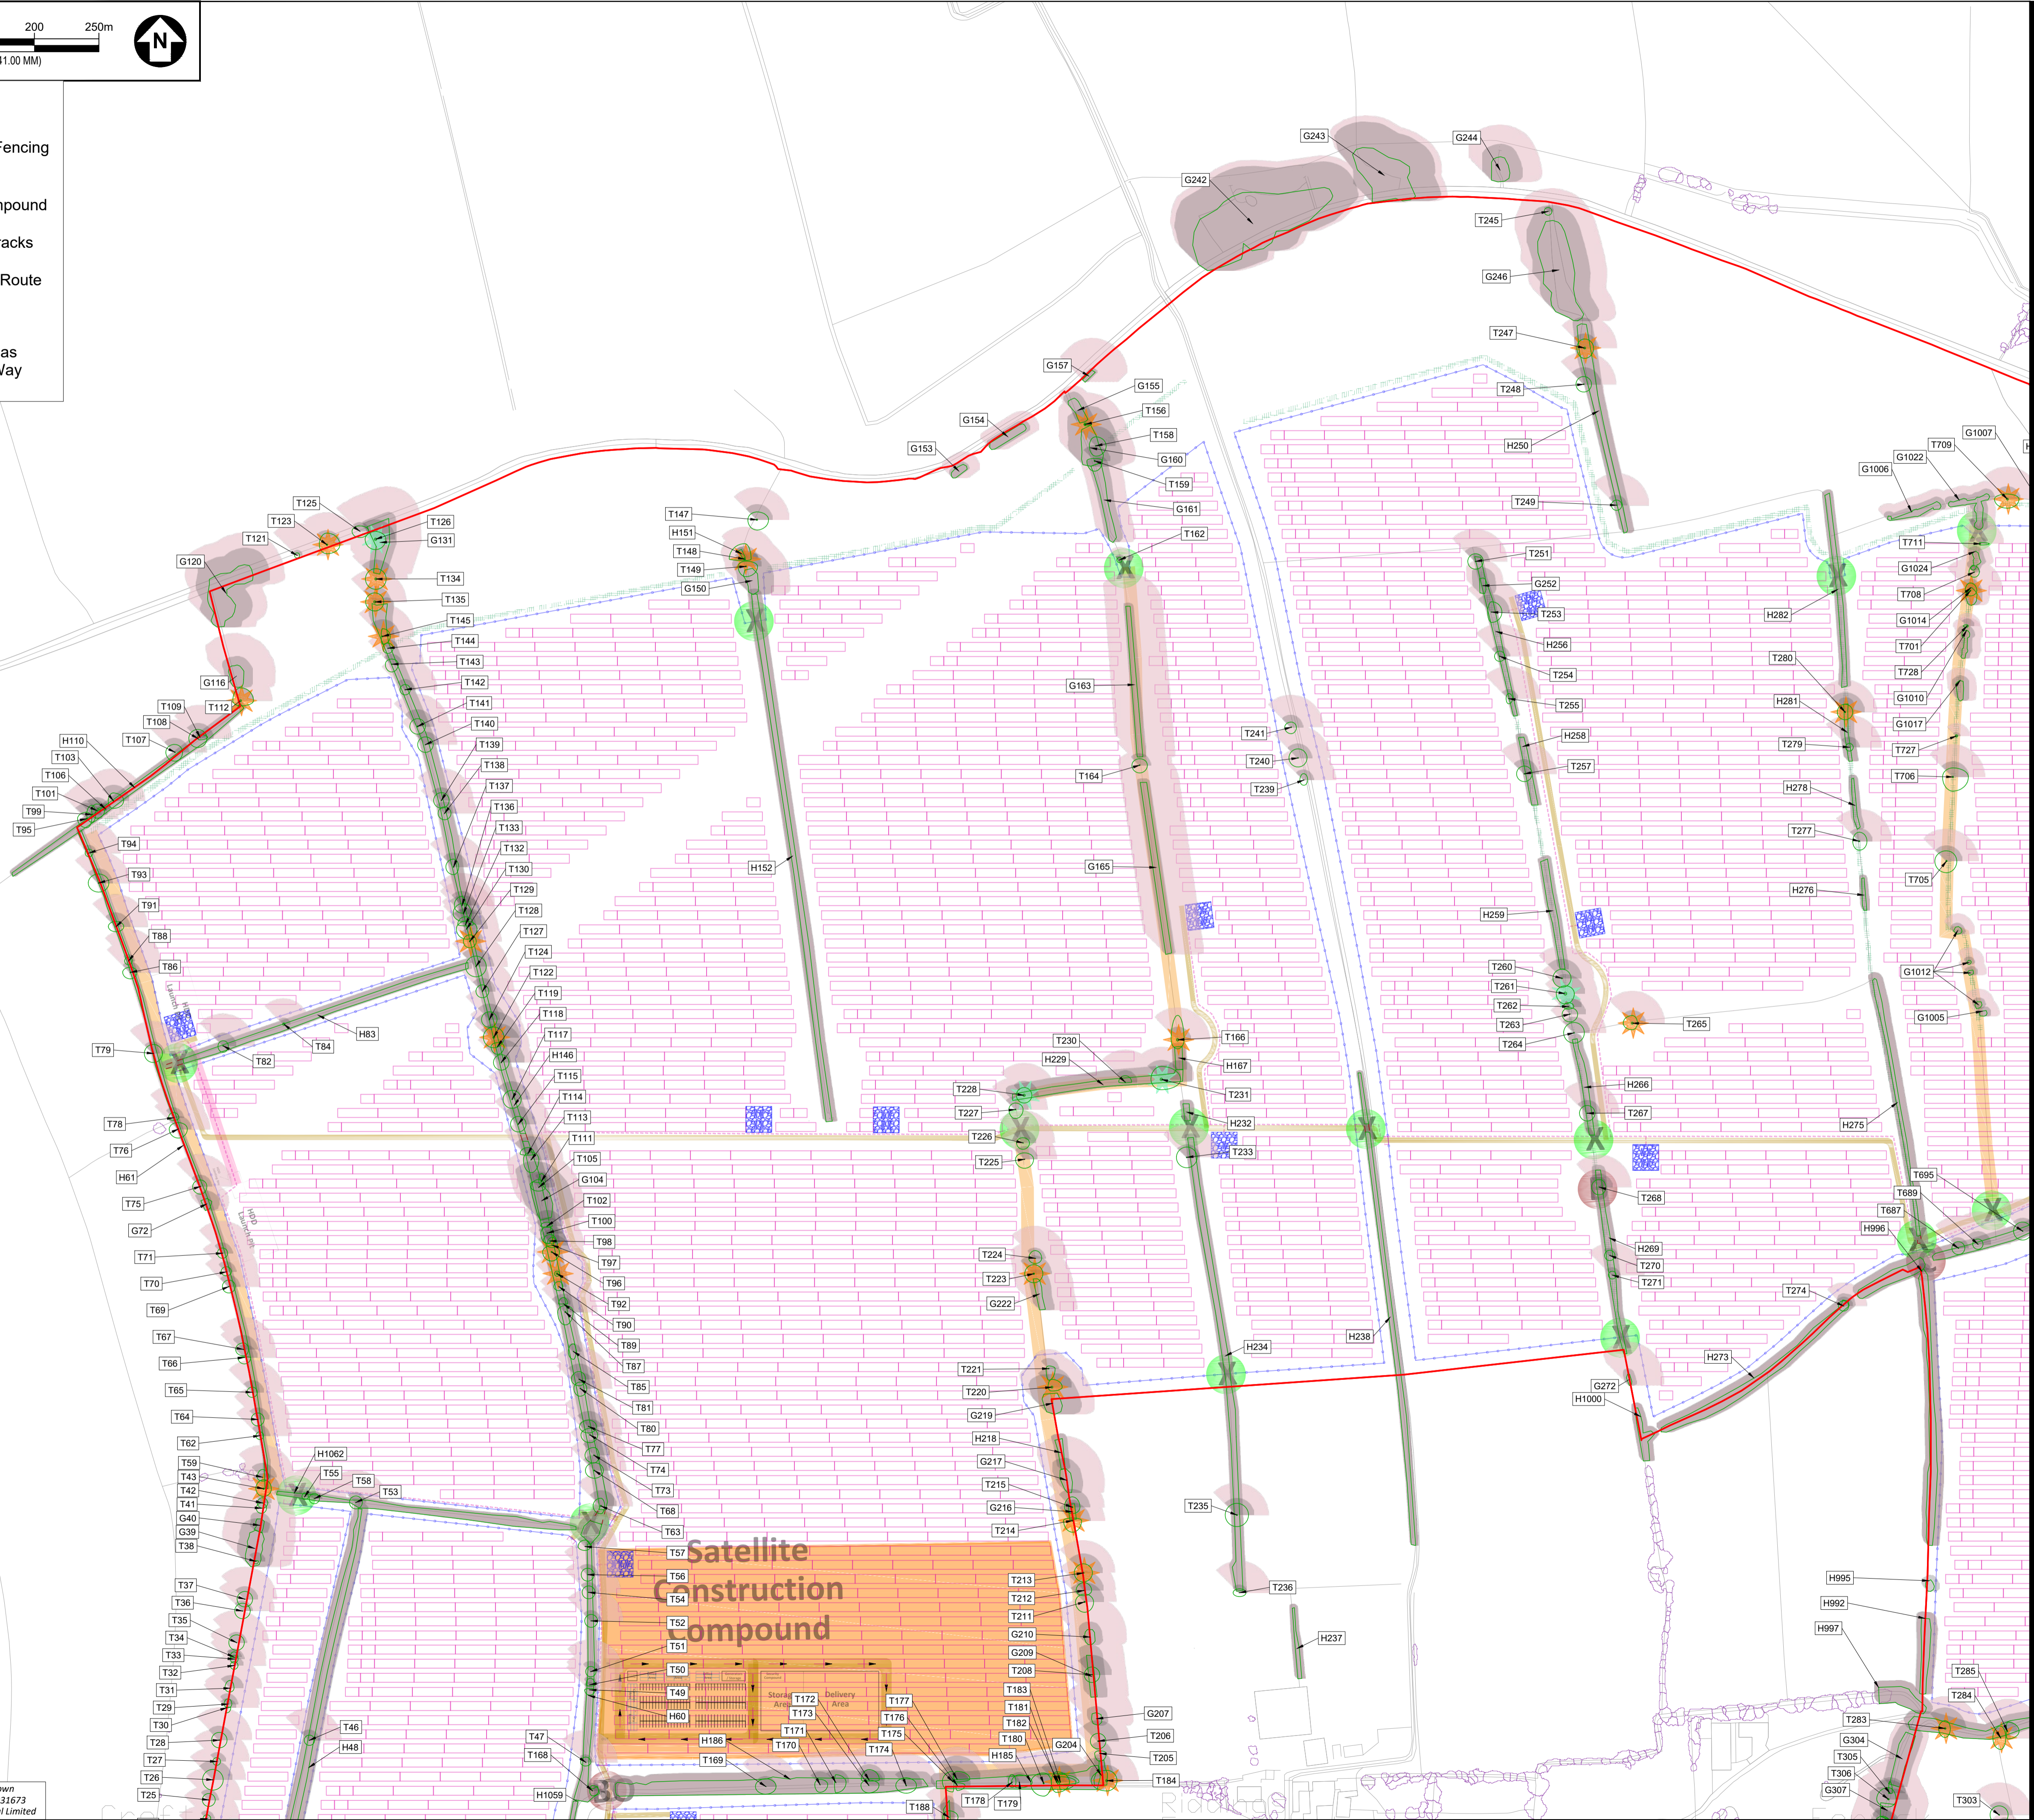


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT

AECOM
Plumer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
 - THE ORIGINAL OF THIS DRAWING HAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE EASMENT.dwg
60698207-ACM-HGM-M2-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall-Layout-v4.5.1_Smp3.dwg

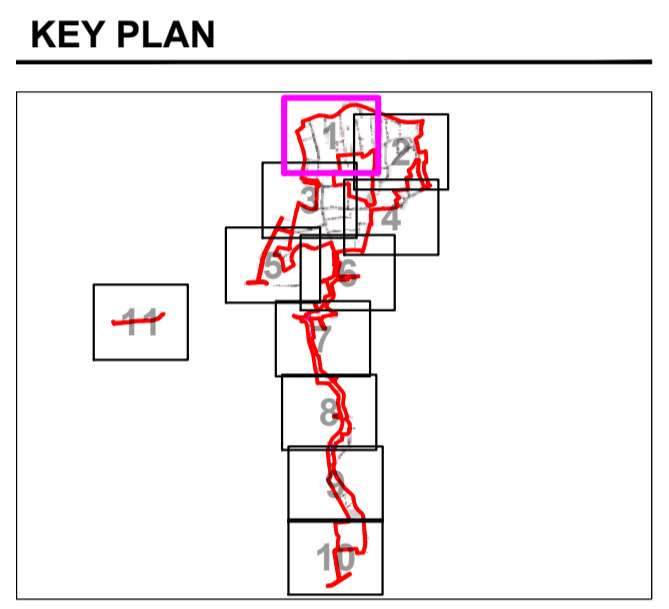

- KEY
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
I/R	DATE	DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207


SHEET TITLE
TREE SHADING ARC PLAN (SHEET 01)

SHEET NUMBER
60698207-ACM-XX-XX-AB-TSAP-001

REV.
P01


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or read upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and defines any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

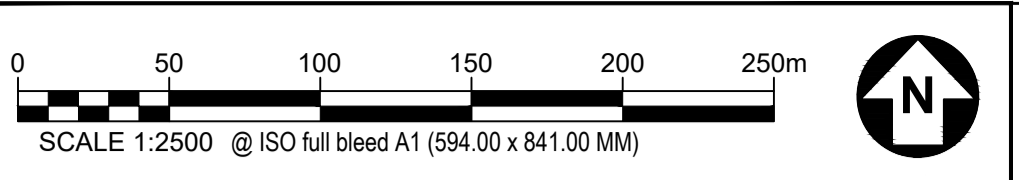

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows

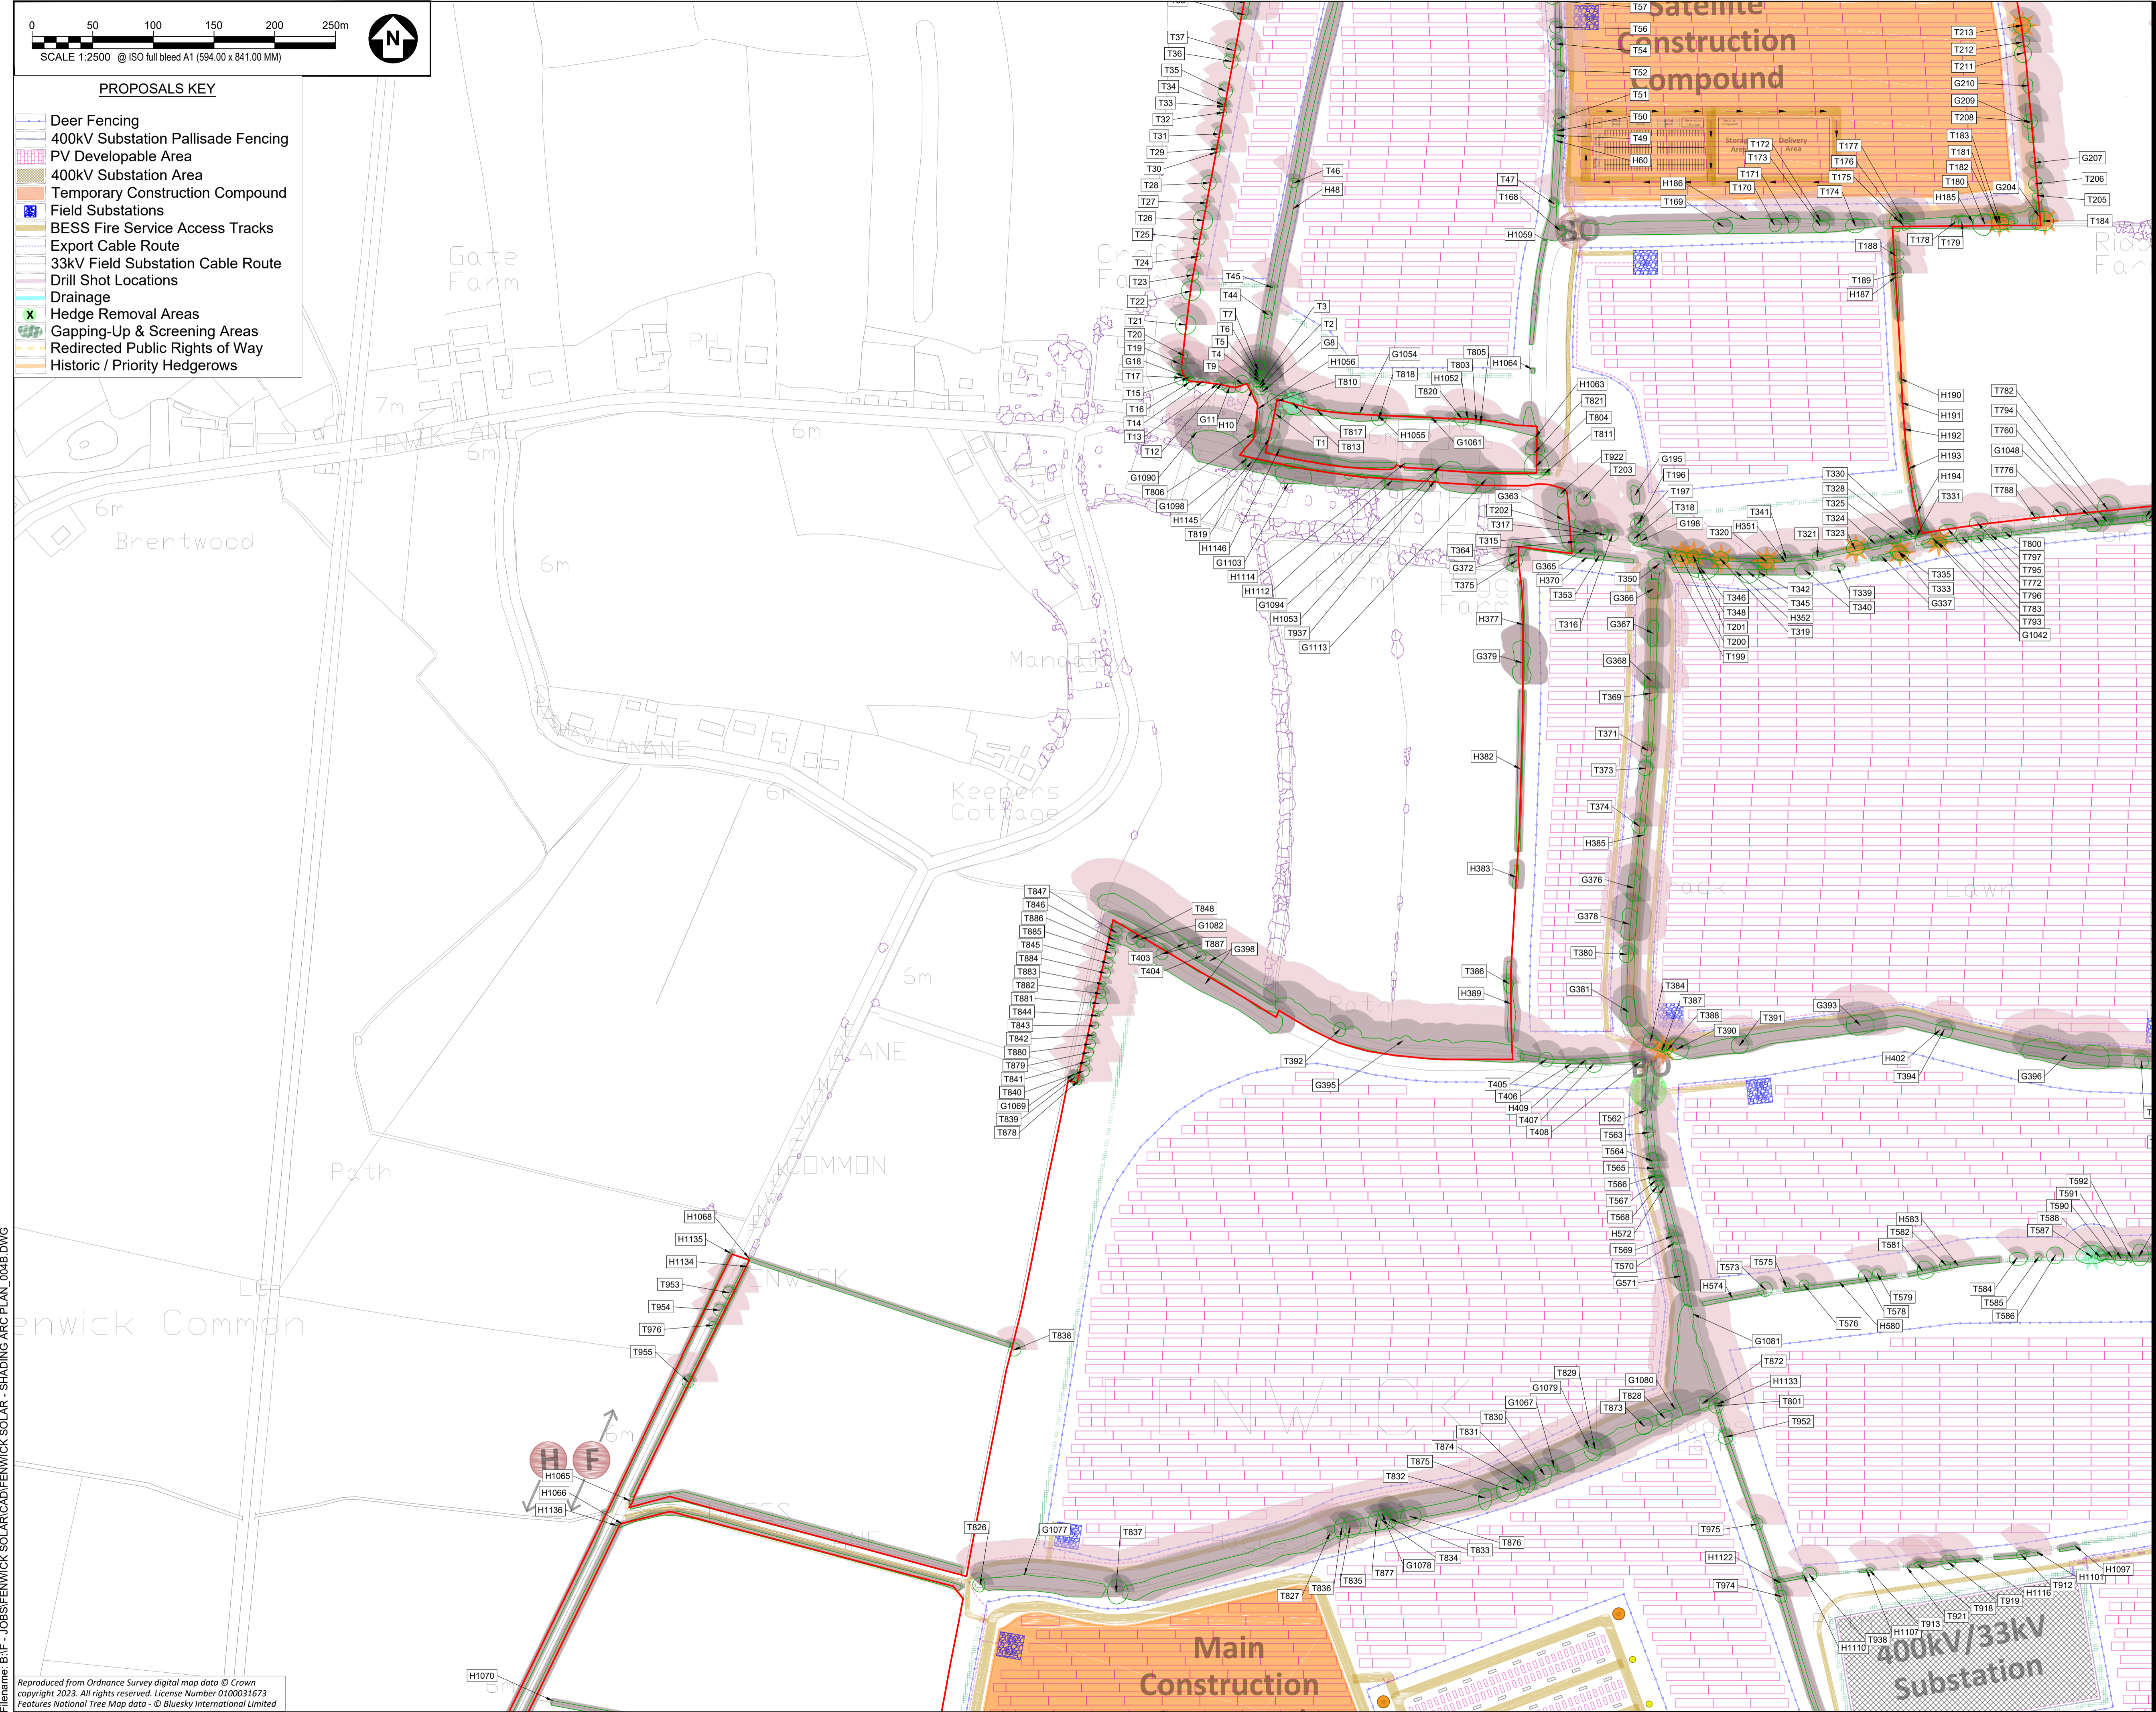

PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR
PROJECT LIMITED
CONSULTANT

AECOM
Plumber House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)1752 238 6023
www.aecom.com

- GENERAL NOTES
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
 - THE ORIGINAL OF THIS DRAWING HAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Option Plan-v1.2-CABLE EASMENT.dwg
60698207-ACM-HGM-M2-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall Layout-v4.5.1_Smp3.dwg

KEY PLAN



KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
IR		DATE DESCRIPTION

DRAWING STATUS

PROJECT NUMBER
60698207

SHEET TITLE
TREE SHADING ARC PLAN
(SHEET 03)


SHEET NUMBER
60698207-ACM-XX-XX-AB-TSAP-003


REV.
P01

List saved by: TIMD.FANLING/2024.08.14, Last Plot: 2024.08.14
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - SHADING ARC PLAN_004B.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or read upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

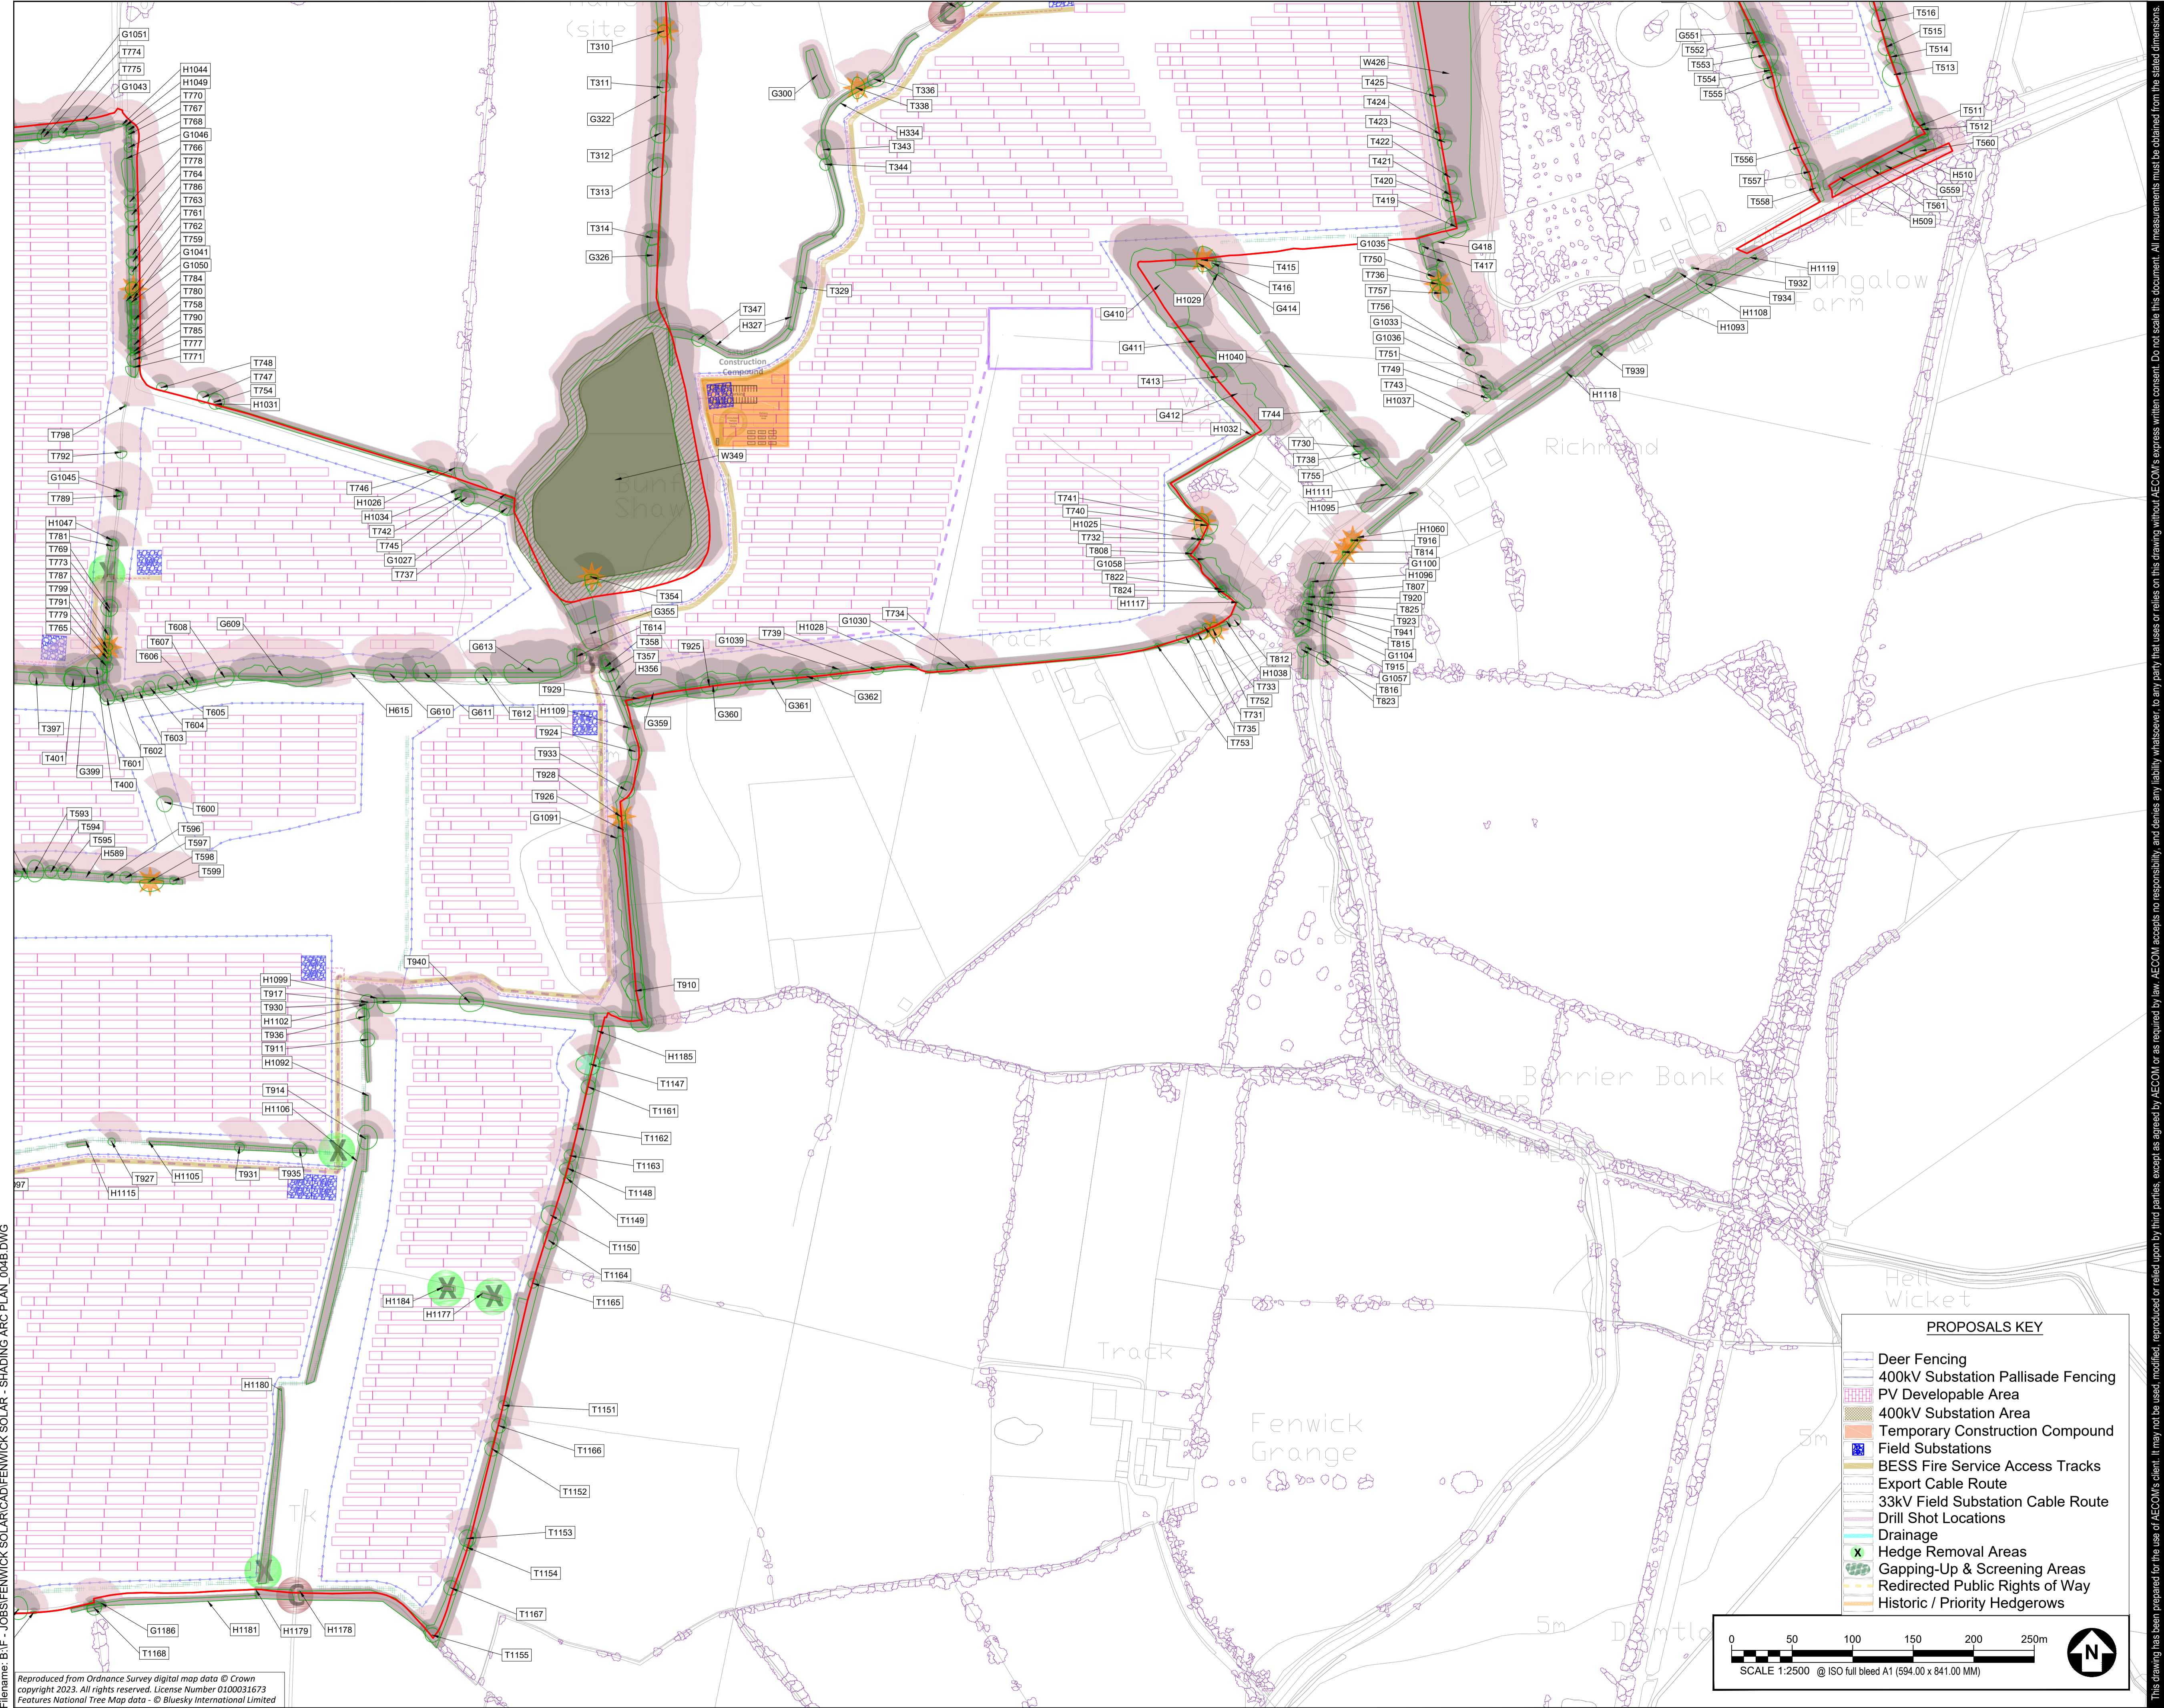

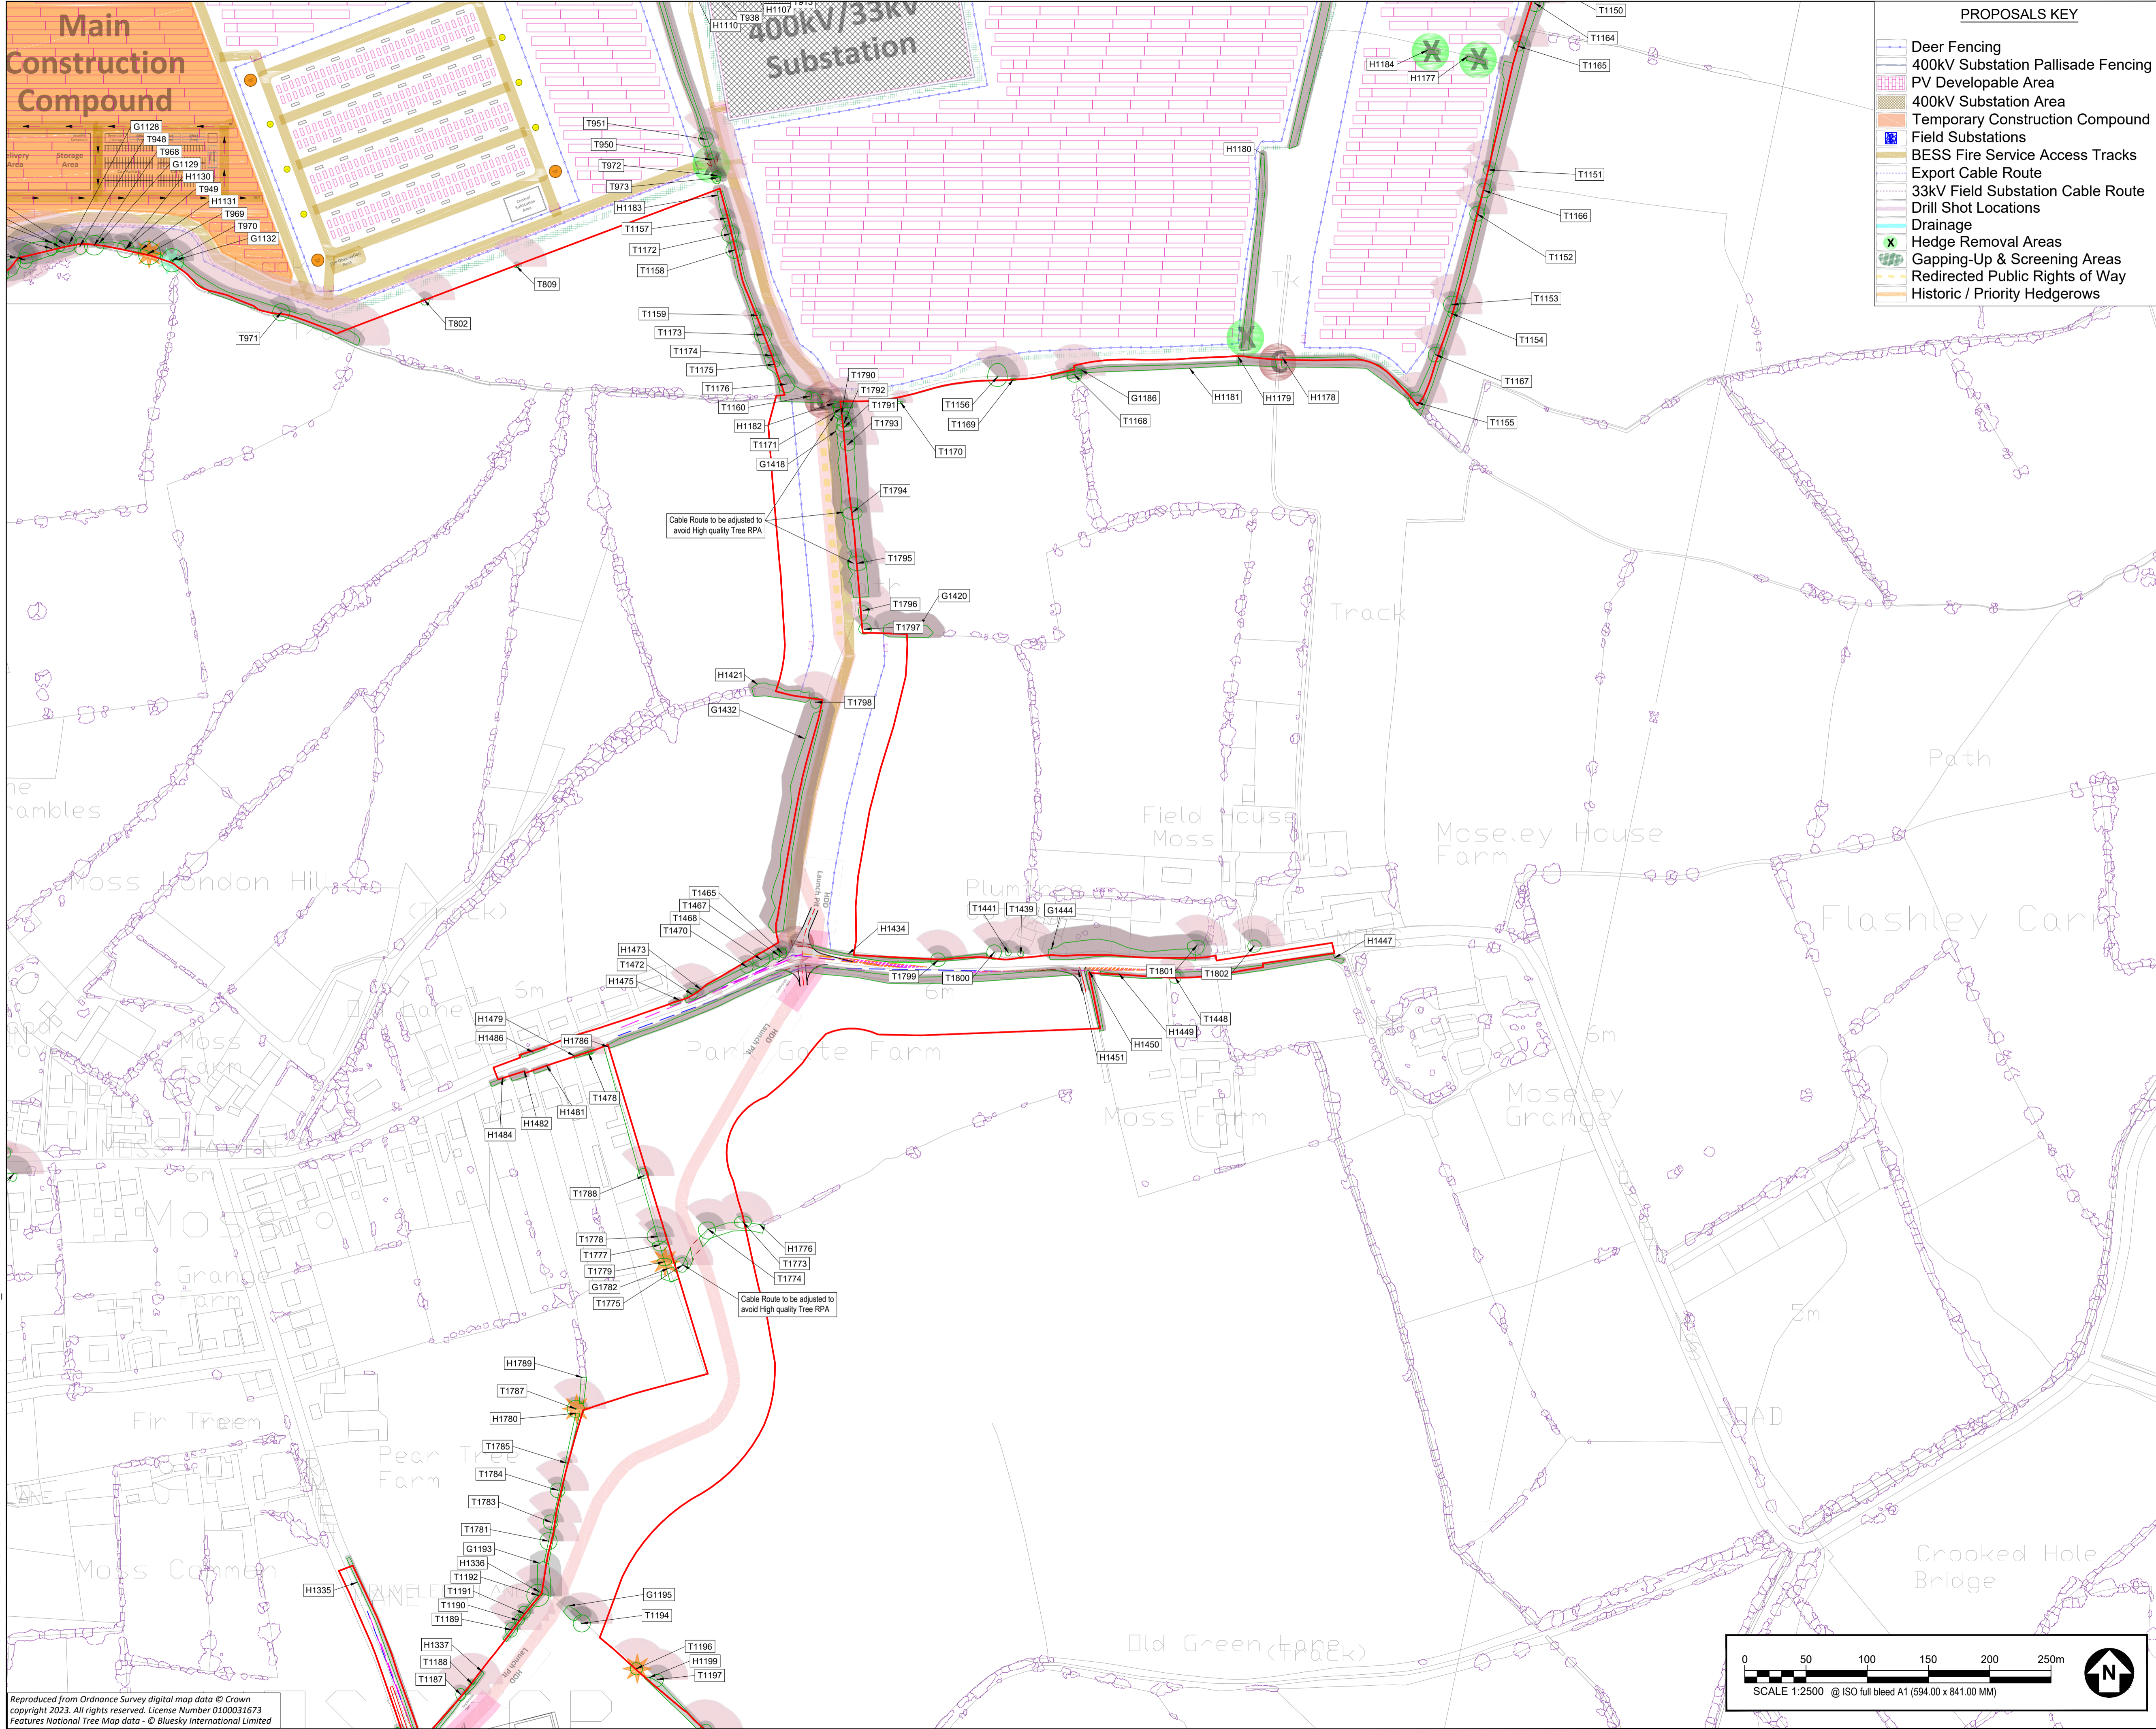

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows


AECOM

PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT

GENERAL NOTES

1. TREE CATEGORIES AS DEFINED BY BS 5837:2012
2. TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
3. PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
4. THE ORIGINAL OF THIS DRAWING HAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
5. DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Option Plan-v1.2-CABLE EASMENT.dwg
60698207-ACM-HGM-M2-CH-0001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall Layout-v4.5.1_Smp3.dwg

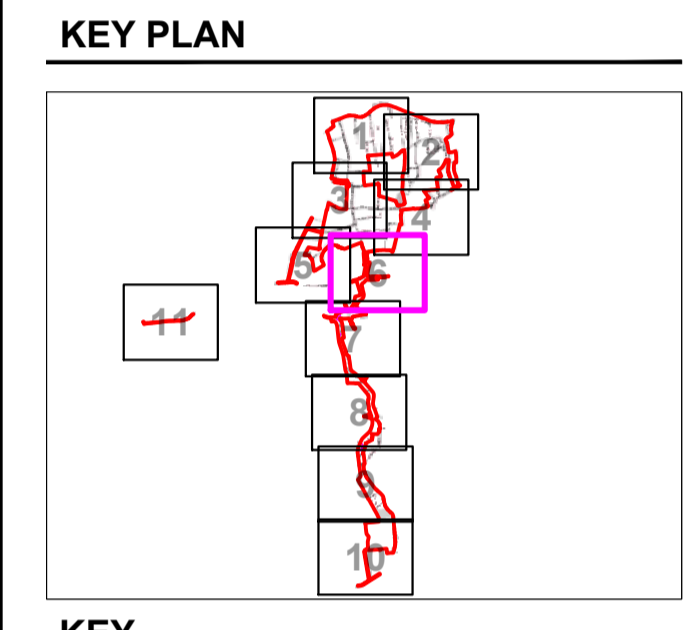

KEY

- SITE BOUNDARY
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
- EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
- VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
- ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
- APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
- APPROXIMATE MATURE TREE SHADING ARC (AS DEFINED BY BS 5837:2012)
- ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
IR	DATE	DESCRIPTION


DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE SHADING ARC PLAN (SHEET 06)

SHEET NUMBER
60698207-ACM-XX-XX-AB-TSAP-006

REV.
P01

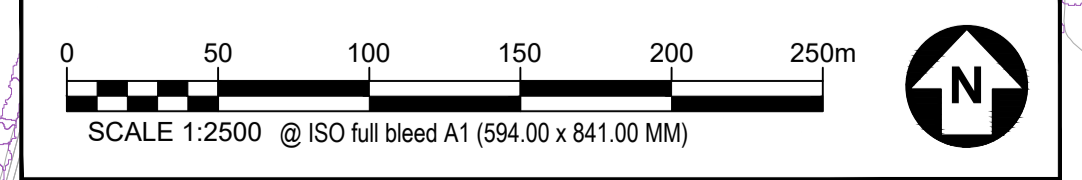


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approver: AW

PROPOSALS KEY

- Deer Fencing
- 400kV Substation Pallisade Fencing
- PV Developable Area
- 400kV Substation Area
- Temporary Construction Compound
- Field Substations
- BESS Fire Service Access Tracks
- Export Cable Route
- 33kV Field Substation Cable Route
- Drill Shot Locations
- Drainage
- Hedge Removal Areas
- Gapping-Up & Screening Areas
- Redirected Public Rights of Way
- Historic / Priority Hedgerows

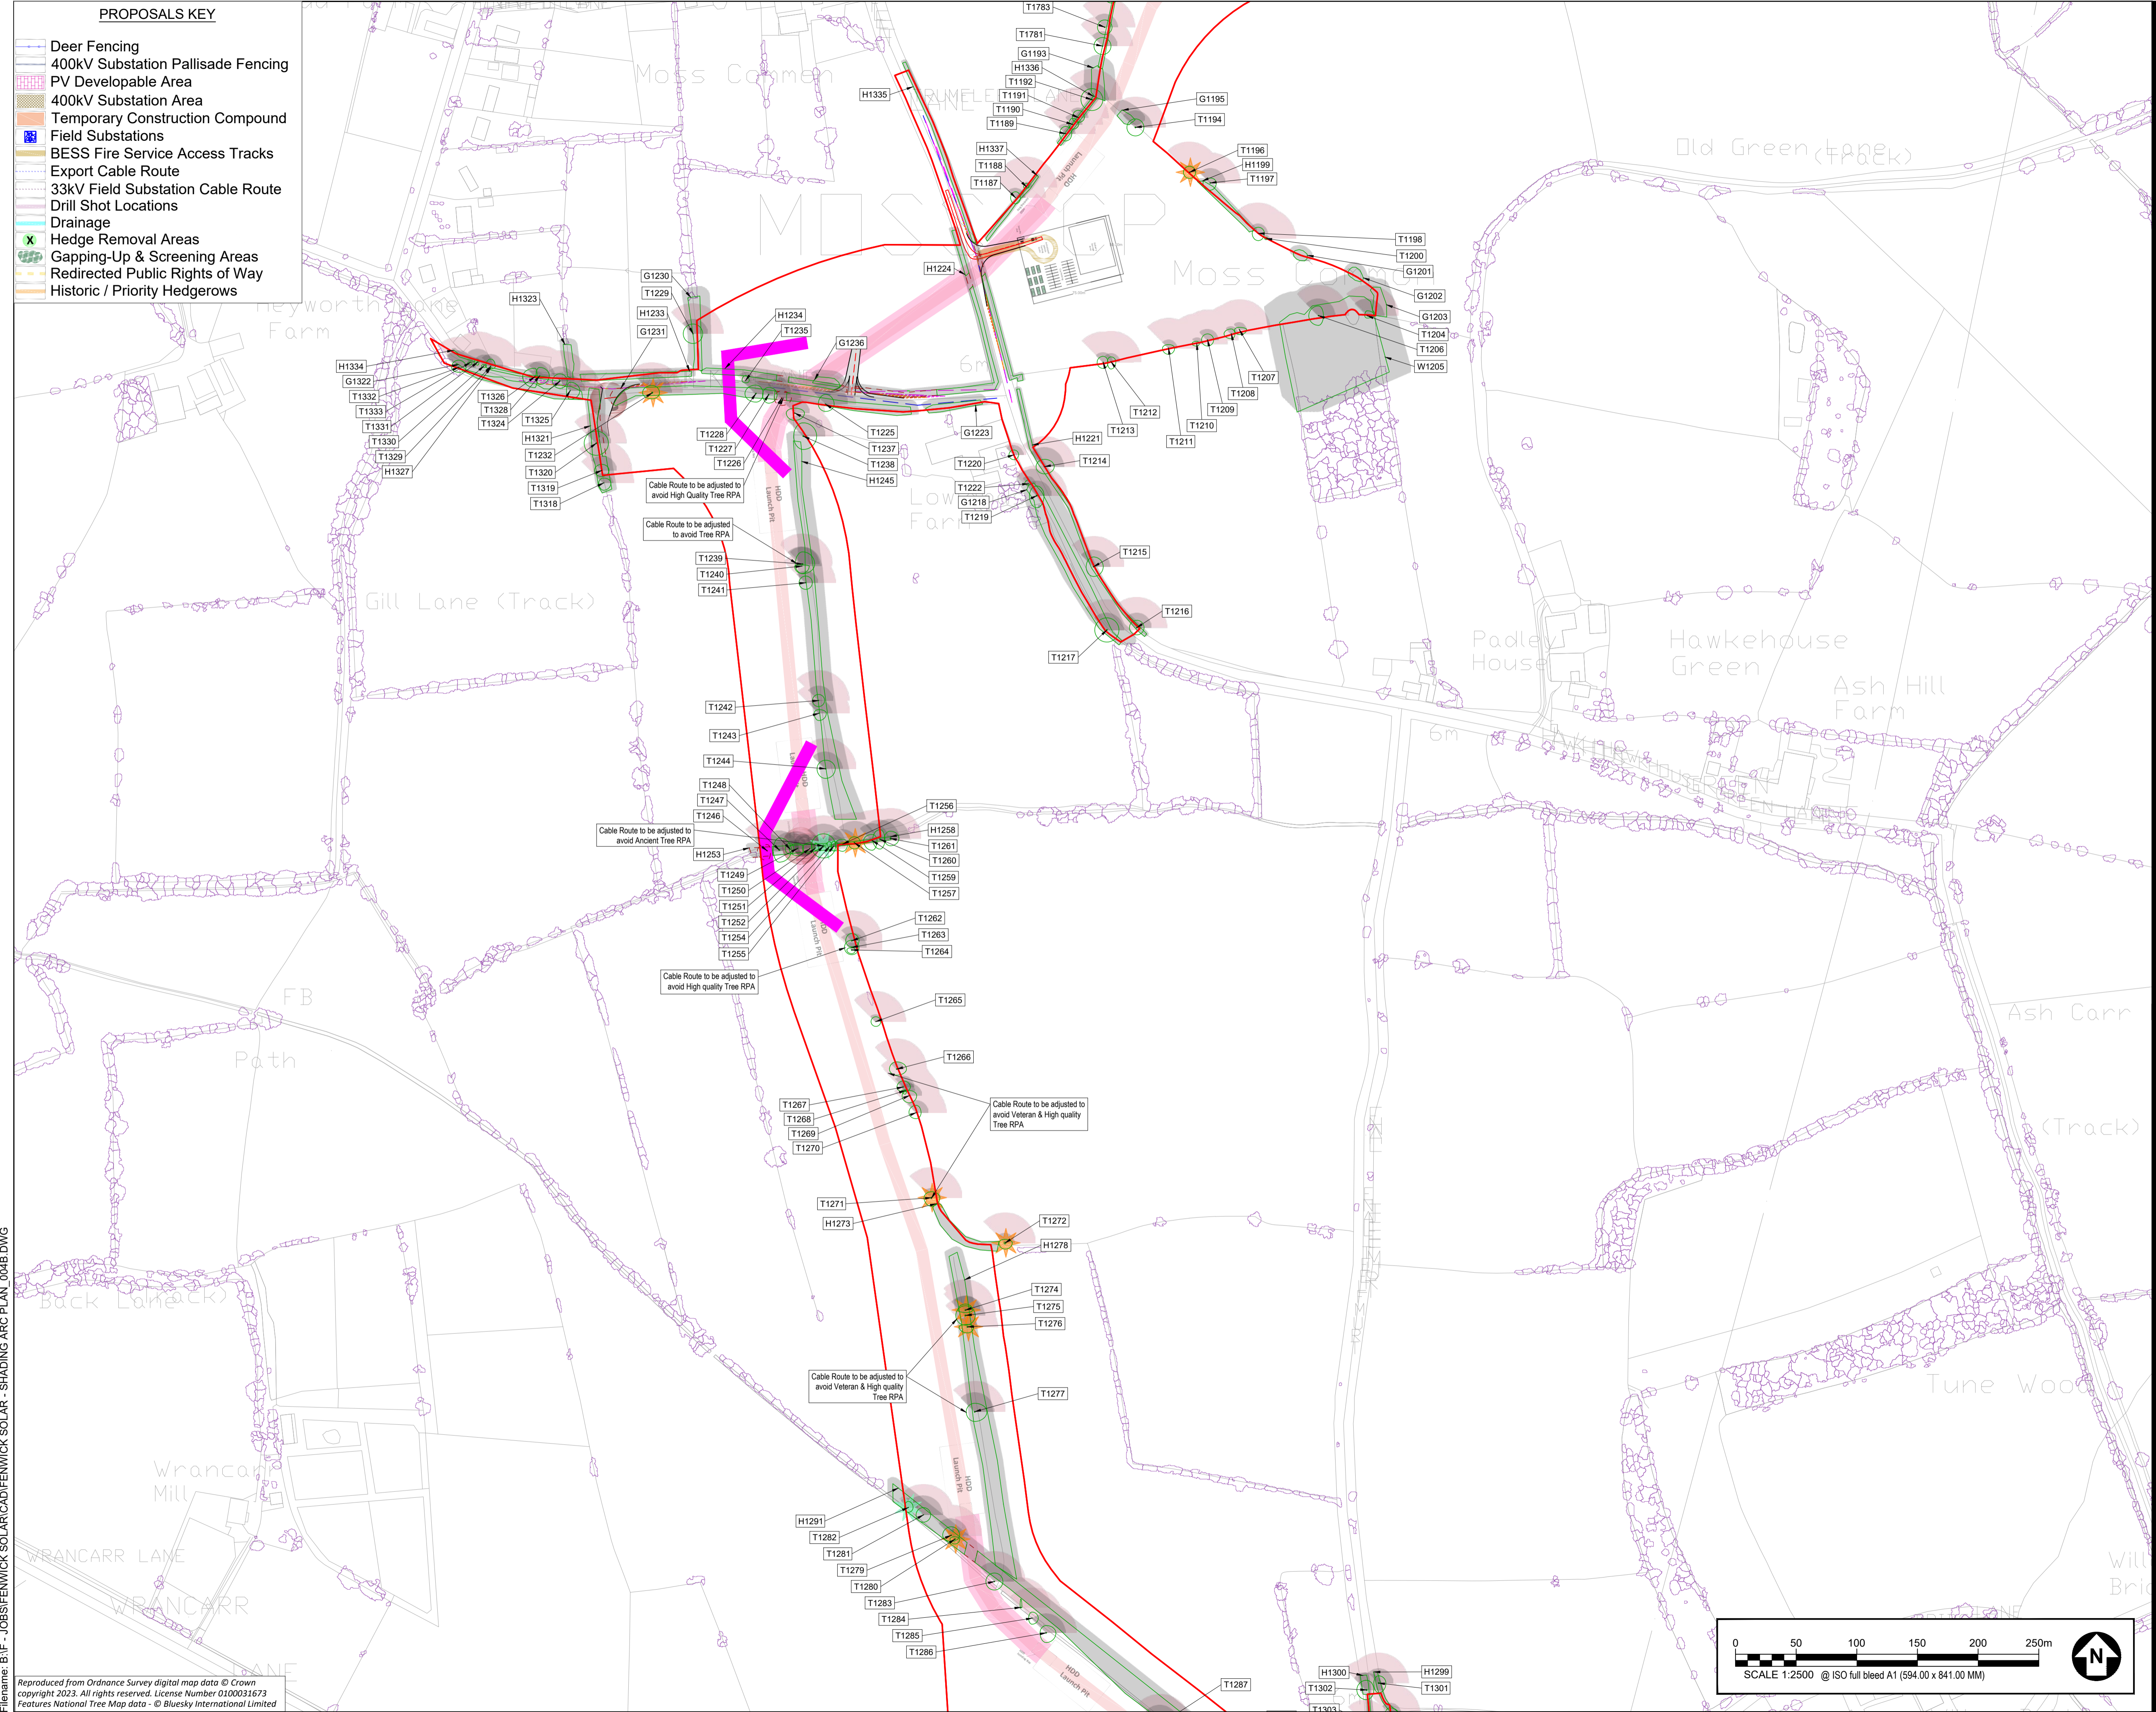


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR
PROJECT LIMITED
CONSULTANT

AECOM
Plumfer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
 - THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Option Plan-v1.2-CABLE EASMENT.dwg
60698207-ACM-HGM-M2-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall Layout-v4.5.1_Smp3.dwg

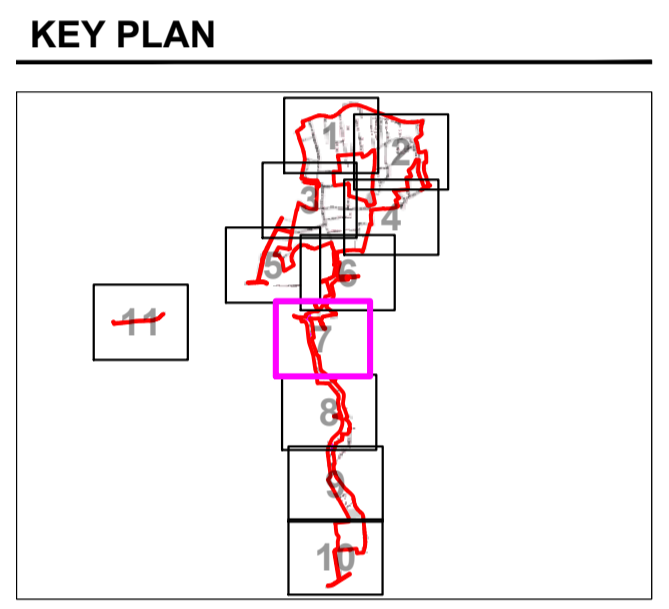

- KEY
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
IR	DATE	DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE SHADING ARC PLAN
(SHEET 07)

SHEET NUMBER
60698207-ACM-XX-XX-AB-TSAP-007

REV.
P01


List saved by: TIMD.FANLING/2024.08.14, Last Plotter: 2024.08.14
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - SHADING ARC PLAN_004B.DWG

Reproduced from Ordnance Survey digital map data © Crown
copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

- PROPOSALS KEY**
- Deer Fencing
 - 400kV Substation Pallisade Fencing
 - PV Developable Area
 - 400kV Substation Area
 - Temporary Construction Compound
 - Field Substations
 - BESS Fire Service Access Tracks
 - Export Cable Route
 - 33kV Field Substation Cable Route
 - Drill Shot Locations
 - Drainage
 - Hedge Removal Areas
 - Gapping-Up & Screening Areas
 - Redirected Public Rights of Way
 - Historic / Priority Hedgerows

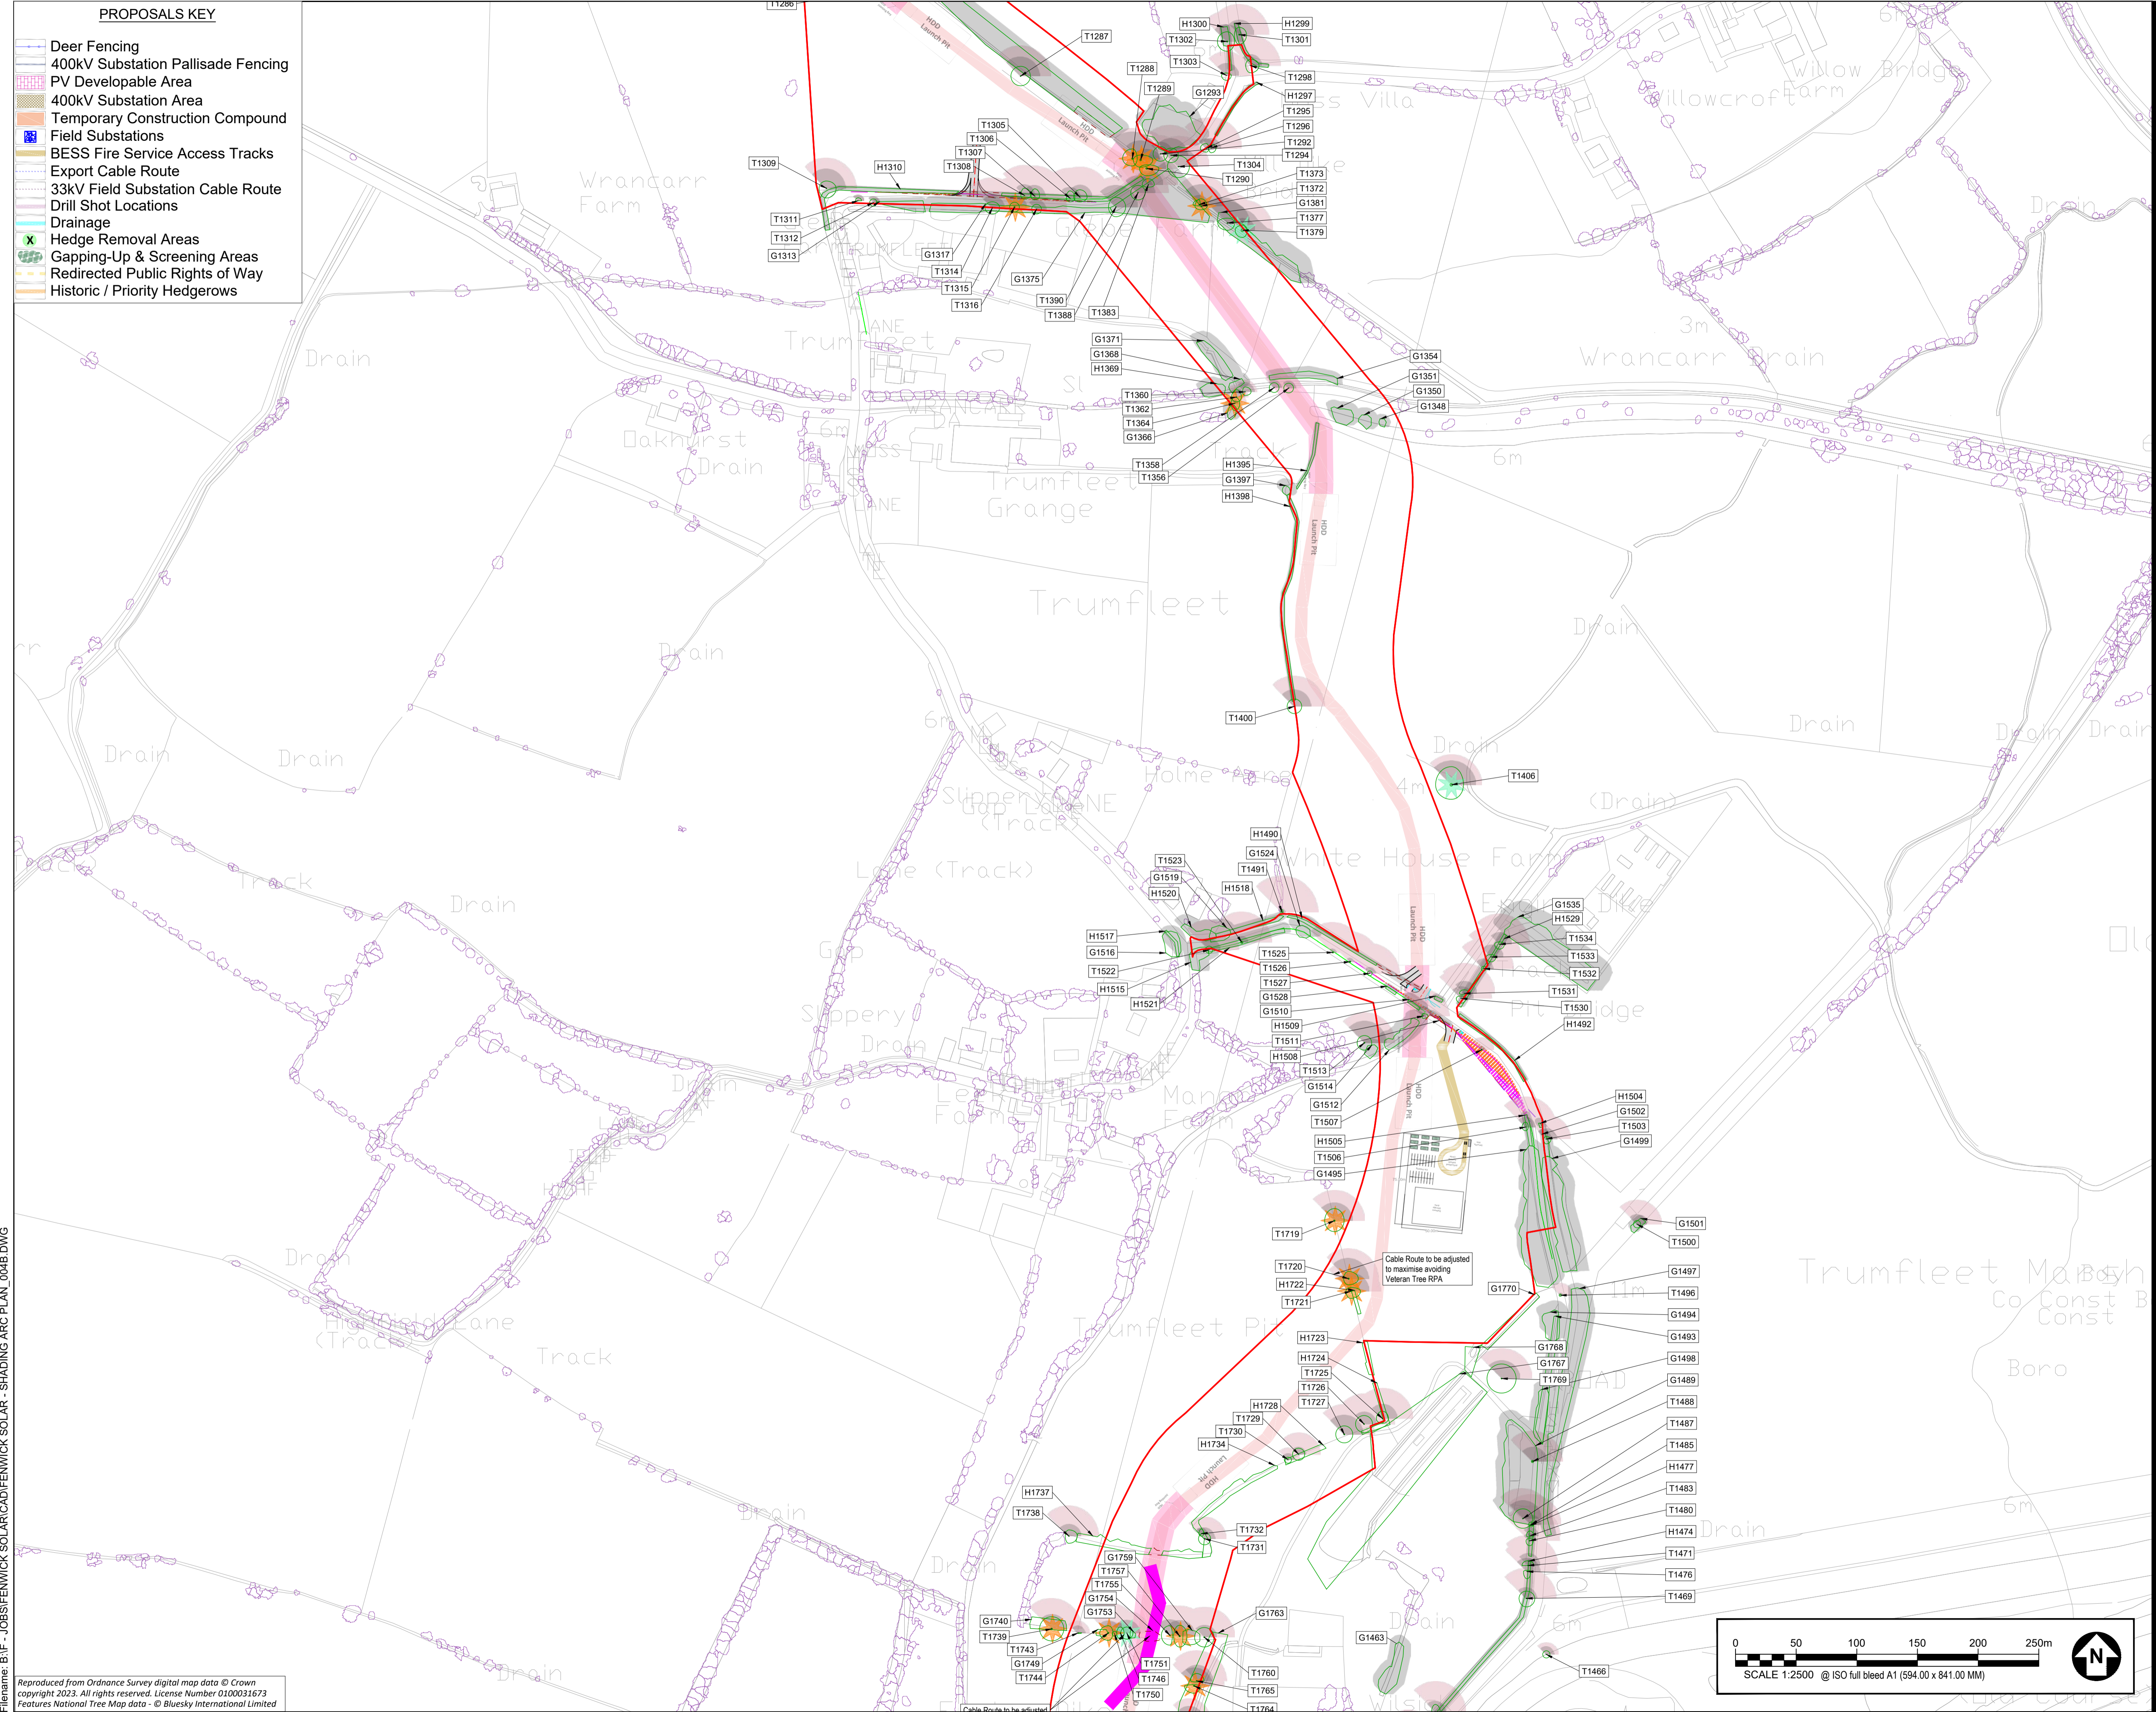


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR PROJECT LIMITED
CONSULTANT

AECOM
Plumfer House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES**
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORICULTURAL REPORT.
 - THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE_EASMENT.dwg
60698207-ACM-HGM-M2-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall-Layout-v4.5.1_Smp3.dwg

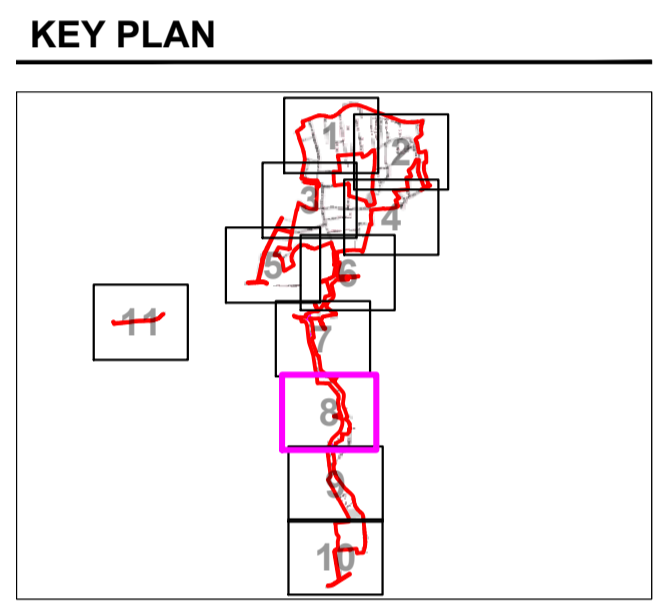

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
IR	DATE	DESCRIPTION

DRAWING STATUS
ISSUE


PROJECT NUMBER
60698207

SHEET TITLE
TREE SHADING ARC PLAN
(SHEET 08)

SHEET NUMBER 60698207-ACM-XX-XX-AB-TSAP-008
REV. P01

List saved by: TIMD.FANLING/2024.08.14, Last Plotter: 2024.08.14
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - SHADING ARC PLAN_004B.DWG


Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

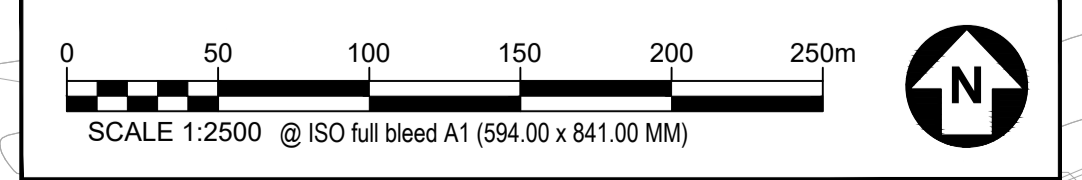

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Author: GA Designer: JB Checked: TR Approved: AW

- PROPOSALS KEY**
- Deer Fencing
 - 400kV Substation Pallisade Fencing
 - PV Developable Area
 - 400kV Substation Area
 - Temporary Construction Compound
 - Field Substations
 - BESS Fire Service Access Tracks
 - Export Cable Route
 - 33kV Field Substation Cable Route
 - Drill Shot Locations
 - Drainage
 - Hedge Removal Areas
 - Gapping-Up & Screening Areas
 - Redirected Public Rights of Way
 - Historic / Priority Hedgerows

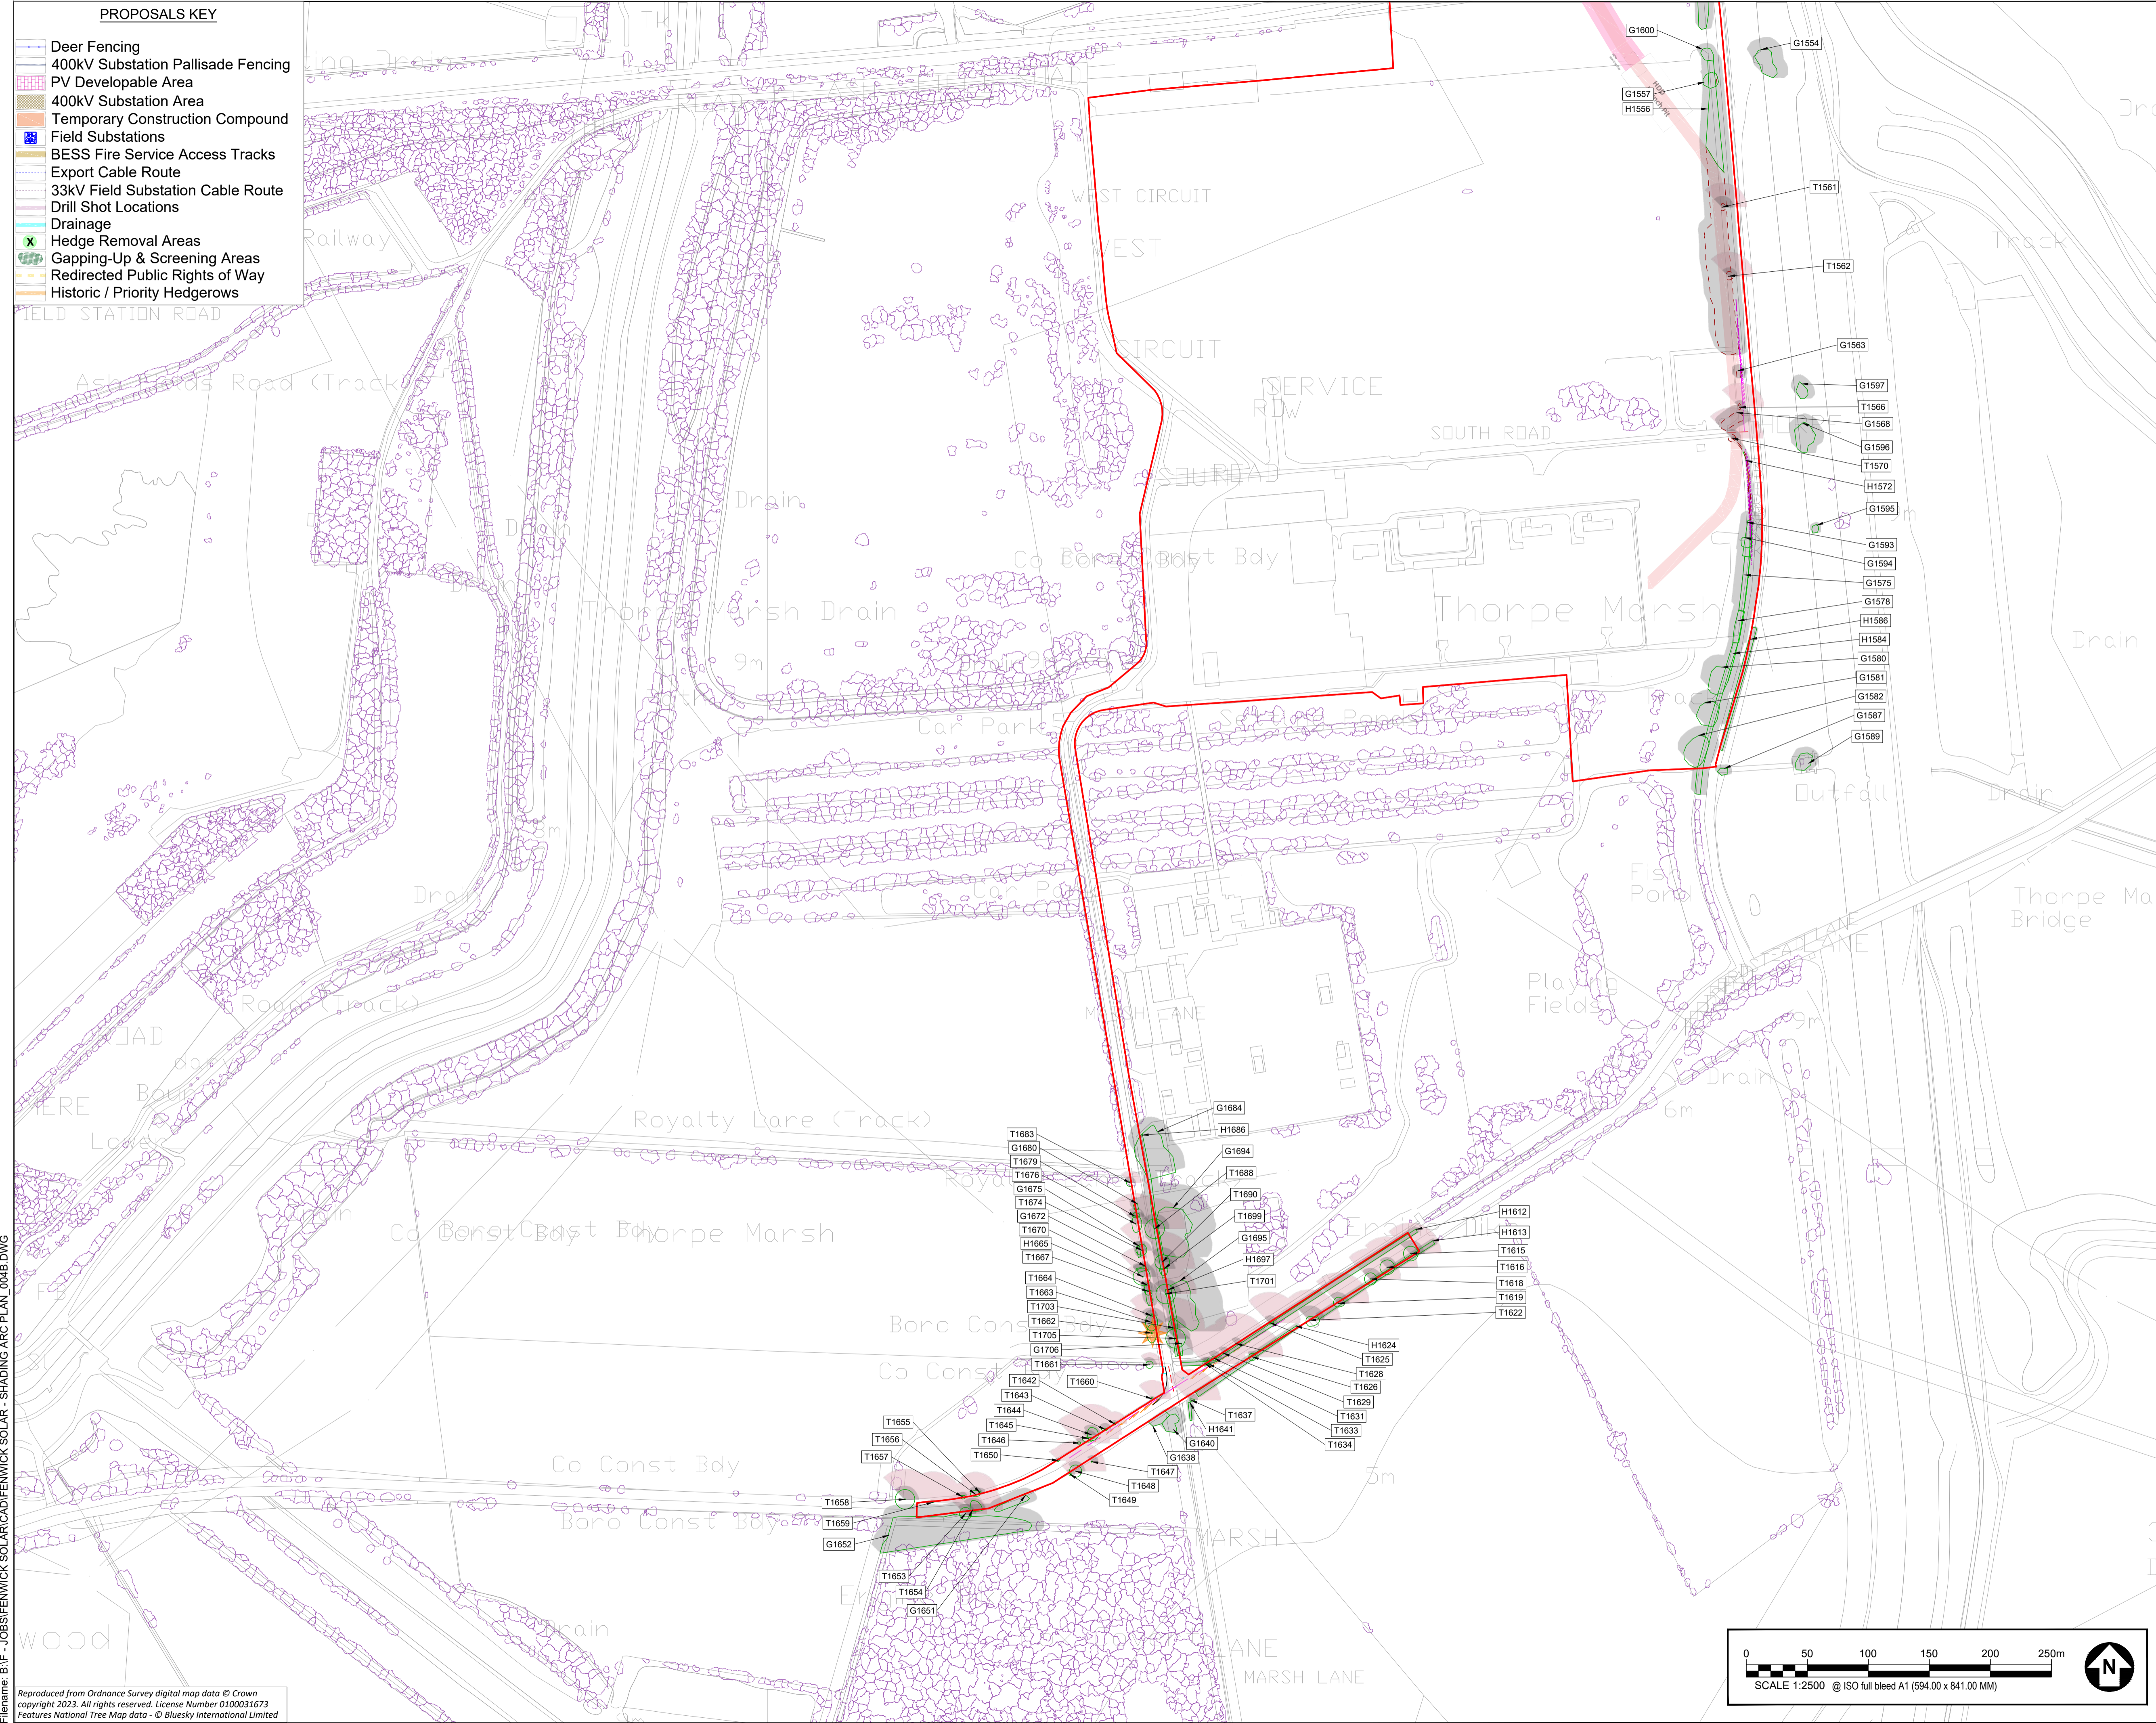


PROJECT
FENWICK SOLAR FARM

CLIENT
FENWICK SOLAR
PROJECT LIMITED
CONSULTANT

AECOM
Plumier House, Third Floor,
East Wing, Tallyour Road
Plymouth, PL6 5DH
Tel +44(0)1752 676700
Fax +44(0)870 238 6023
www.aecom.com

- GENERAL NOTES**
- TREE CATEGORIES AS DEFINED BY BS 5837:2012
 - TREE LOCATIONS ARE BASED ON AERIAL IMAGERY, AND GPS CO-ORDINATES FROM ON SITE WALKOVER.
 - PLANS SHOULD BE READ IN CONJUNCTION WITH THE AECOM ARBORETOLOGICAL REPORT.
 - THE ORIGINAL OF THIS DRAWING WAS PRODUCED IN COLOUR - A MONOCHROME COPY SHOULD NOT BE RELIED UPON.
 - DRAWING REFERENCES:
NTM_Data_Minus_Survey_Data.dwg
FENW-Cable-Plan-v1.2-CABLE_EASMENT.dwg
60698207-ACM-HGM-MZ-CH-001 (Access Model P1.3_28032024)_Simplified.dwg
FENW-Overall-Layout-v4.5.1_Smp3.dwg

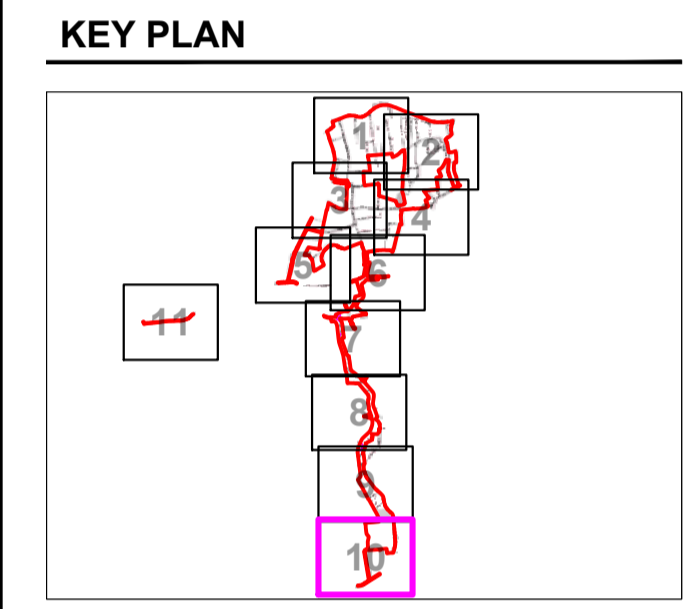

- KEY**
- SITE BOUNDARY
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE RETAINED
 - EXISTING TREE, GROUP, WOODLAND, OR HEDGE TO BE REMOVED
 - VETERAN TREE MARKER (INDICATES POSITION OF TREE OF VETERAN STATUS)
 - ANCIENT TREE MARKER (INDICATES POSITION OF TREE OF ANCIENT STATUS)
 - APPROXIMATE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - APPROXIMATE MATURE SHADING ARC (AS DEFINED BY BS 5837:2012)
 - ANCIENT WOODLAND (W/15m BUFFER ZONE) (AREA CLASSIFIED AS AN ANCIENT WOODLAND)

ISSUE/REVISION


NO	DATE	DESCRIPTION
P01	14.08.24	FIRST ISSUE
IR	DATE	DESCRIPTION

DRAWING STATUS
ISSUE

PROJECT NUMBER
60698207

SHEET TITLE
TREE SHADING ARC PLAN
(SHEET 10)

SHEET NUMBER 60698207-ACM-XX-XX-AB-TSAP-10 **REV.** P01

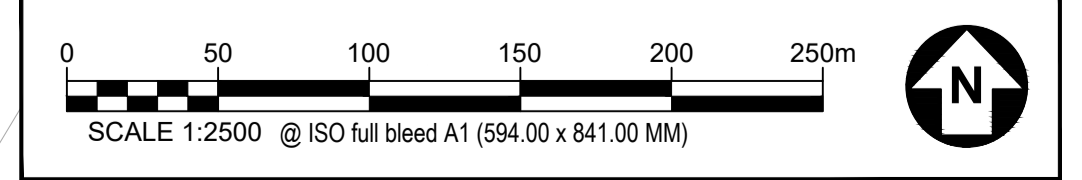

Last saved by: TIMD PANLING/2024.08.14, Last Printed: 2024.08.14
Filename: B:\FENWICK SOLAR\CAD\FENWICK SOLAR - SHADING ARC PLAN_004B.DWG

Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License Number 0100031673
Features National Tree Map data - © Bluesky International Limited

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Annex E Outline Tree Protection Measures

E.1 Tree Protection Fencing

- E.1.1 The default position as set out by BS 5837:2012 (Ref. 15) is that retained trees must be protected from construction operations with the erection of robust protective fencing positioned on the outer edge of the RPA or crown spread (whichever is greatest). All site operations will be restricted to the area outside of tree protection fencing and this area will form a Construction Exclusion Zone (CEZ) unless agreed otherwise. Protection measures will be installed as set out in the Tree Protection Plan (Annex C) of this appendix.
- E.1.2 The area inside the fence and any additional tree protection measures will be sacrosanct and must not be removed or altered without the prior approval of the City of Doncaster Council Tree Officer. Any damage to tree protection measures must be reported immediately.
- E.1.3 Fencing shall be constructed with robust vertical and horizontal scaffold framework with weldmesh panels firmly attached as per BS5837:2012 Figure 7 (Ref. 15) (included below). Vertical support poles and bracing poles must be located with care to avoid underground utility services and will be sited to avoid the structural roots of retained trees.
- E.1.4 Alternative equivalent robust and immovable fencing specification including site hoarding or site security fencing will also be appropriate.
- E.1.5 Suitable all weather signage will be fixed to fencing to notify site staff and visitors of the construction exclusion zone and its purpose (example included as Annex E).

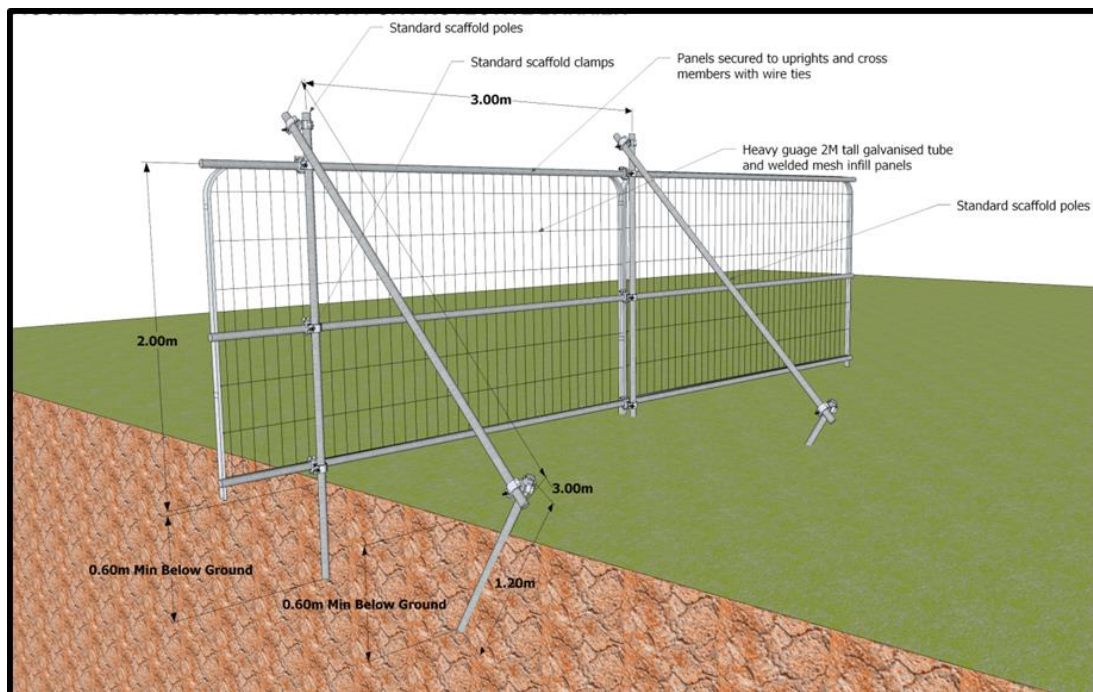


Plate 5: Default Specification for Protective Barrier

- E.1.6 When entering and exiting the Order limits, the fencing contractor must avoid the production of ruts on the unprotected surface of the ground.
- E.1.7 Protective fencing and ground protection shall stay in place until all development operations have been completed and the prior consent of the

City of Doncaster Council Tree Officer and/or an arboriculturist has been obtained.

E.2 Ground Protection

- E.2.1 Should access be unavoidable within the RPA of a retained tree, fit for purpose ground protection must be in place which is sufficient to protect the structure of the soil from damage based on the heaviest anticipated load.
- E.2.2 As set out in section 6.2.3.3 of BS5837:2012 (Ref. 15) the following ground protection measures will be appropriate:
- a. Suitable ground protection for pedestrian only access will comprise a single thickness of scaffold boards set on a compressible layer of 100mm of woodchip on a geotextile separation layer;
 - b. Pedestrian operated plant up to two tonnes in weight would require the use of a proprietary ground protection system (such as Ground Guards or Eve Trakway or equivalent) set on a minimum depth of 150mm woodchip or sharp sand; and
 - c. Heavier loads will require ground protection to an engineering specification in conjunction with arboricultural advice.
- E.2.3 As a guide the threshold beyond which root development is significantly affected is a bulk density ranging from 1.4g per cm³ for clay soils, to 1.75g per cm³ for sandy soils.
- E.2.4 Tree protective measures shall stay in place until all construction operations are completed and removal is agreed with an arboriculturist and/or the City of Doncaster Council Tree Officer as appropriate.

E.3 General Guidance for the Management of Exposed Roots

- E.3.1 Excavation must only take place within the RPA of a retained tree with the prior agreement of an arboriculturist and the City of Doncaster Council Tree Officer. All excavation must be undertaken using hand tools or compressed air (such as an air spade).
- E.3.2 The following general principles will apply:
- a. Individual or small groups of roots less than 25 mm in diameter will be retained, where practicable, but can be severed with a sharp tool such as secateurs or pruning saws to leave a clean cut end (ideally 100mm back from the face of the excavation to account for future regrowth) where they pose an obstruction;
 - b. Where roots are encountered which are larger than 25 mm in diameter or where significant groups of smaller roots are found, the advice of an arboriculturist must be sought to decide an appropriate course of action (following consultation with the Local Authority Tree Officer where appropriate); and
 - c. Roots must only be exposed for the minimum period possible. In the interim period any exposed roots must be completely covered with dampened hessian sacking (which may require ongoing re wetting) to avoid drying out and exposure to light (which can result in the death of


roots). Backfill for excavations should utilise the parent material and must not be significantly compacted.

- E.3.3 Biosecurity measures should be applied as recommended in the Arboricultural Association (2018) Guidance Note 2 Application of Biosecurity in Arboriculture (Ref. 33).

E.4 Storage, Use and Mixing of Materials

- E.4.1 The use, mixing, and washing of materials can lead to run off or inadvertent spillage into tree root zones. Many substances often used on construction sites can be toxic to tree roots (such as concrete, fuels, salts, builders sand and herbicides), can result in the death of tree roots and beneficial soil organisms; and have a significant impact on the future health and appearance of trees.
- E.4.2 The storage of materials can result in an effective raised soil level. This buries tree roots at depths where air and water are less available and can lead to the decline or death of the tree.
- E.4.3 For these reasons the storage of materials and any washing, mixing or refuelling must take place in agreed allocated areas at least 5m from the edge of the RPA of retained trees.
- E.4.4 Any slope effect must be taken into account and where there is a potential for run off, heavy duty polythene sheeting and sandbags must be in place as bunding to prevent toxic materials reaching RPAs.

Annex F Tree Protection Signage (Example)

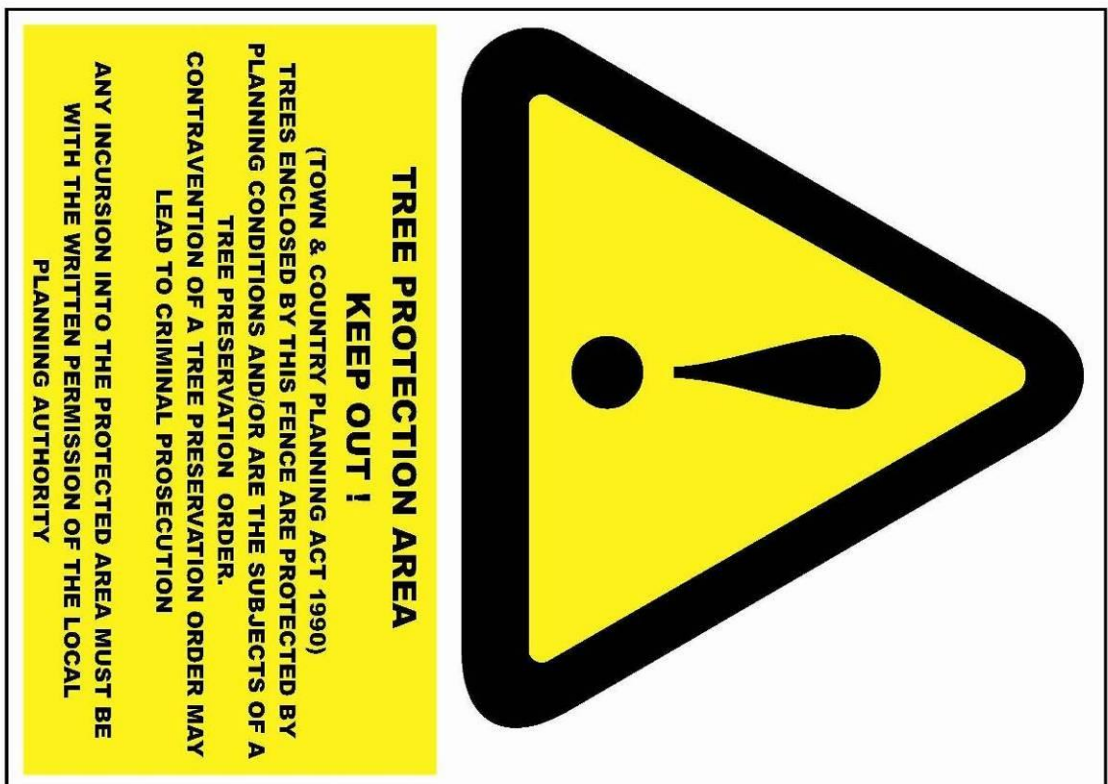



BUILD | OWN | OPERATE | MAINTAIN

BOOM-POWER.CO.UK