


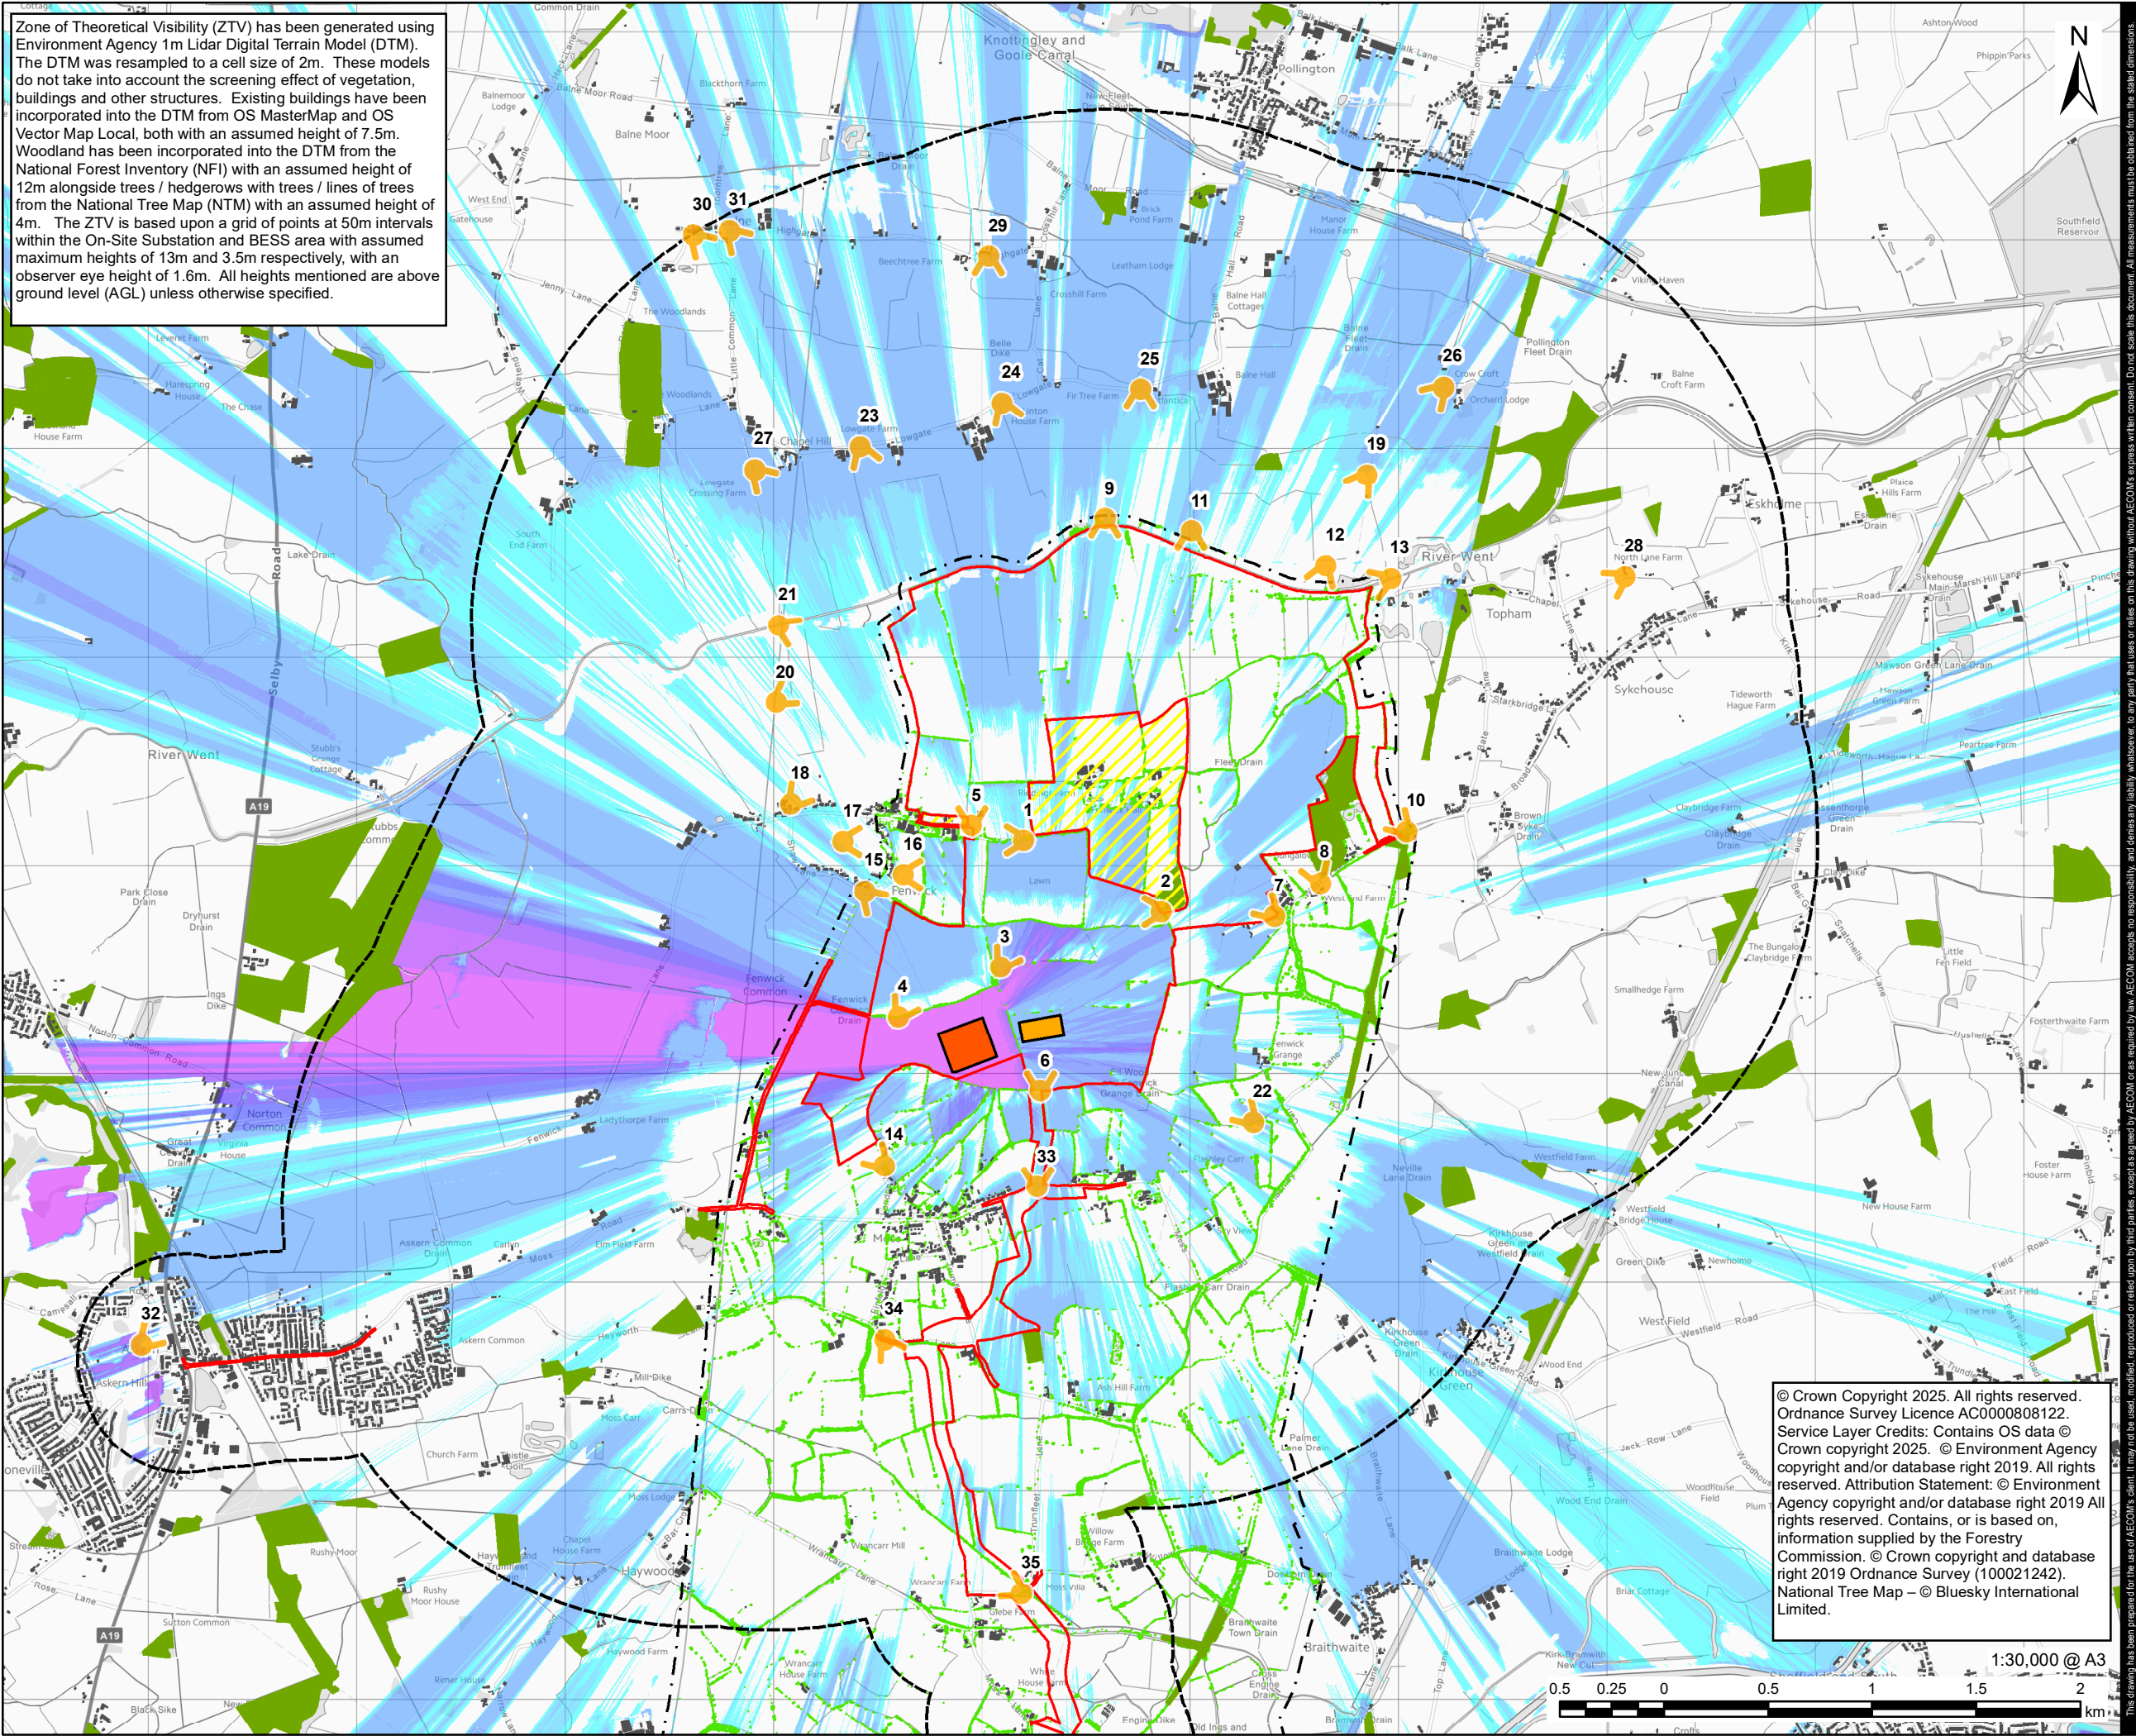

AECOM

PROJECT

Fenwick Solar Farm

CLIENT

Fenwick Solar Project Limited

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Order limits
- Land not included in the Order limits
- Landscape and Visual Amenity Study Area (2km Buffer of the Solar PV Site and 500m Buffer of the Grid Connection Corridor and Site Access)
- Viewpoint Location (rotated to indicate direction)
- On-Site Substation
- BESS Area
- National Forest Inventory (NFI) - Assumed Height 12m
- National Tree Map (NTM) - Assumed Height 4m
- Extent of NTM Data
- Existing Building / Structure - Assumed Height 7.5m
- Zone of Theoretical Visibility (ZTV) - Degree of Maximum Visibility**
 - 1 - 10%
 - 11 - 20%
 - 21 - 30%
 - 31 - 40%
 - 41 - 50%
 - 51 - 60%
 - 61 - 70%
 - 71 - 80%
 - 81 - 90%
 - 91 - 100%

ISSUE PURPOSE

Post DCO Submission

PROJECT NUMBER

60698207

FIGURE TITLE

Screened Zone of Theoretical Visibility - On-Site Substation and BESS Area

FIGURE NUMBER

Figure 10-7