


Project No: 60700987 Drawn: TG Checked: ES Approved: ES Date: 2025 02 28
Last saved by: GREENT4(2025-07-08) Last Plotted: 2025-07-08
Filename: \\NA-AECOM\NET\COM\LFSEME\AED\B\RGH-UKED\4DCS\PROJECTS\EGE\60700987_FOSSE_GREEN_ENERGY_CAD\900_CAD_GIS\910_CAD\20 - SHEETS\LAYOUT\OTHER DRAWINGS\FIGURES\FIGURE 3-6B - INDICATIVE SUBSTATION.DWG

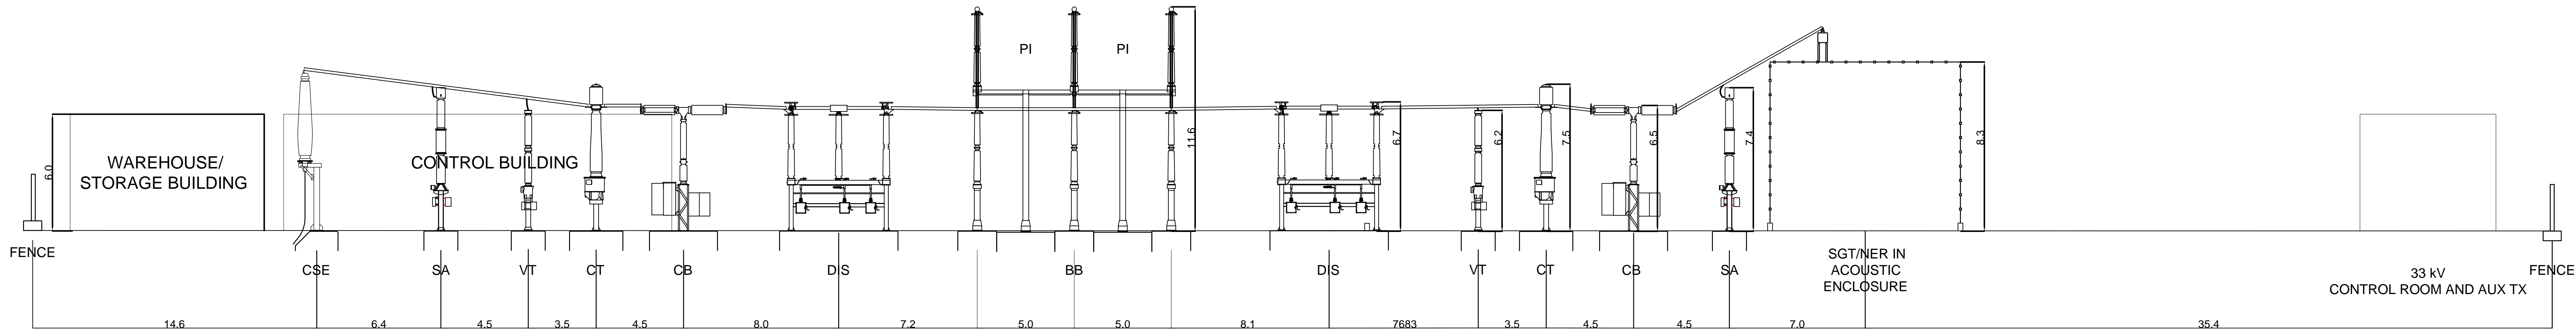

NOT FOR CONSTRUCTION

FOR INFORMATION ONLY

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.



PROJECT

Fosse Green Energy

CLIENT

Fosse Green Energy Ltd

CONSULTANT

AECOM Limited

LEGEND

- IS - DISCONNECTOR
- CB - CIRCUIT BREAKER
- CT - CURRENT TRANSFORMER
- VT - VOLTAGE TRANSFORMER
- SA - SURGE ARRESTOR
- CSE - CABLE SEALING END
- BB - BUSBAR

NOTES

- DRAWING IS FOR INDICATIVE PURPOSES ONLY.
- DRAWING IS IN METRES (m) UNLESS OTHERWISE STATED.
- INDICATIVE LAYOUT SHOWN. FINAL LAYOUT SOLUTION TO BE CONFIRMED AT DETAILED DESIGN STAGE.
- THE ARRANGEMENT OF THE PROTECTION EQUIPMENT IS SUBJECT TO CHANGE AND WILL REQUIRE CONFIRMATION AT THE DETAILED DESIGN STAGE.
- THE SPACING THAT HAS BEEN ASSUMED WILL BE SUBJECT TO CHANGE AT THE DETAILED DESIGN STAGE.

LEGISLATION

Regulation 5(2)(a) Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009.

ISSUE PURPOSE

DCO Submission

PROJECT NUMBER

60700987

FIGURE TITLE

Indicative On-Site Substation Elevation

FIGURE NUMBER

Figure 3-6B

REV.

01

DOCUMENT REFERENCE

EN010154/APP/6.2