

PROJECT
Fosse Green Energy

CLIENT
Fosse Green Energy Ltd

CONSULTANT
AECOM Limited
Sunley House
4 Bedford Park
Surrey, CR0 2AP, UK
www.aecom.com

LEGEND

- DCO Site Boundary
- Study Area
- Solar PV Area

Operational Noise Level - Operational Phase Centralised BESS (dB)

35
40
45
50
55
60
65

NOTES
GB Background: Contains OS data © Crown Copyright and database right 2025
Contains data from OS Zoomstack


LEGISLATION
Regulation 5(2)(a) Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009.

ISSUE PURPOSE
DCO Submission

FIGURE TITLE
Noise Contours - Operational Phase Centralised BESS

FIGURE NUMBER REV.
Figure 11-2 01

DOCUMENT REFERENCE
EN010154/APP/6.2

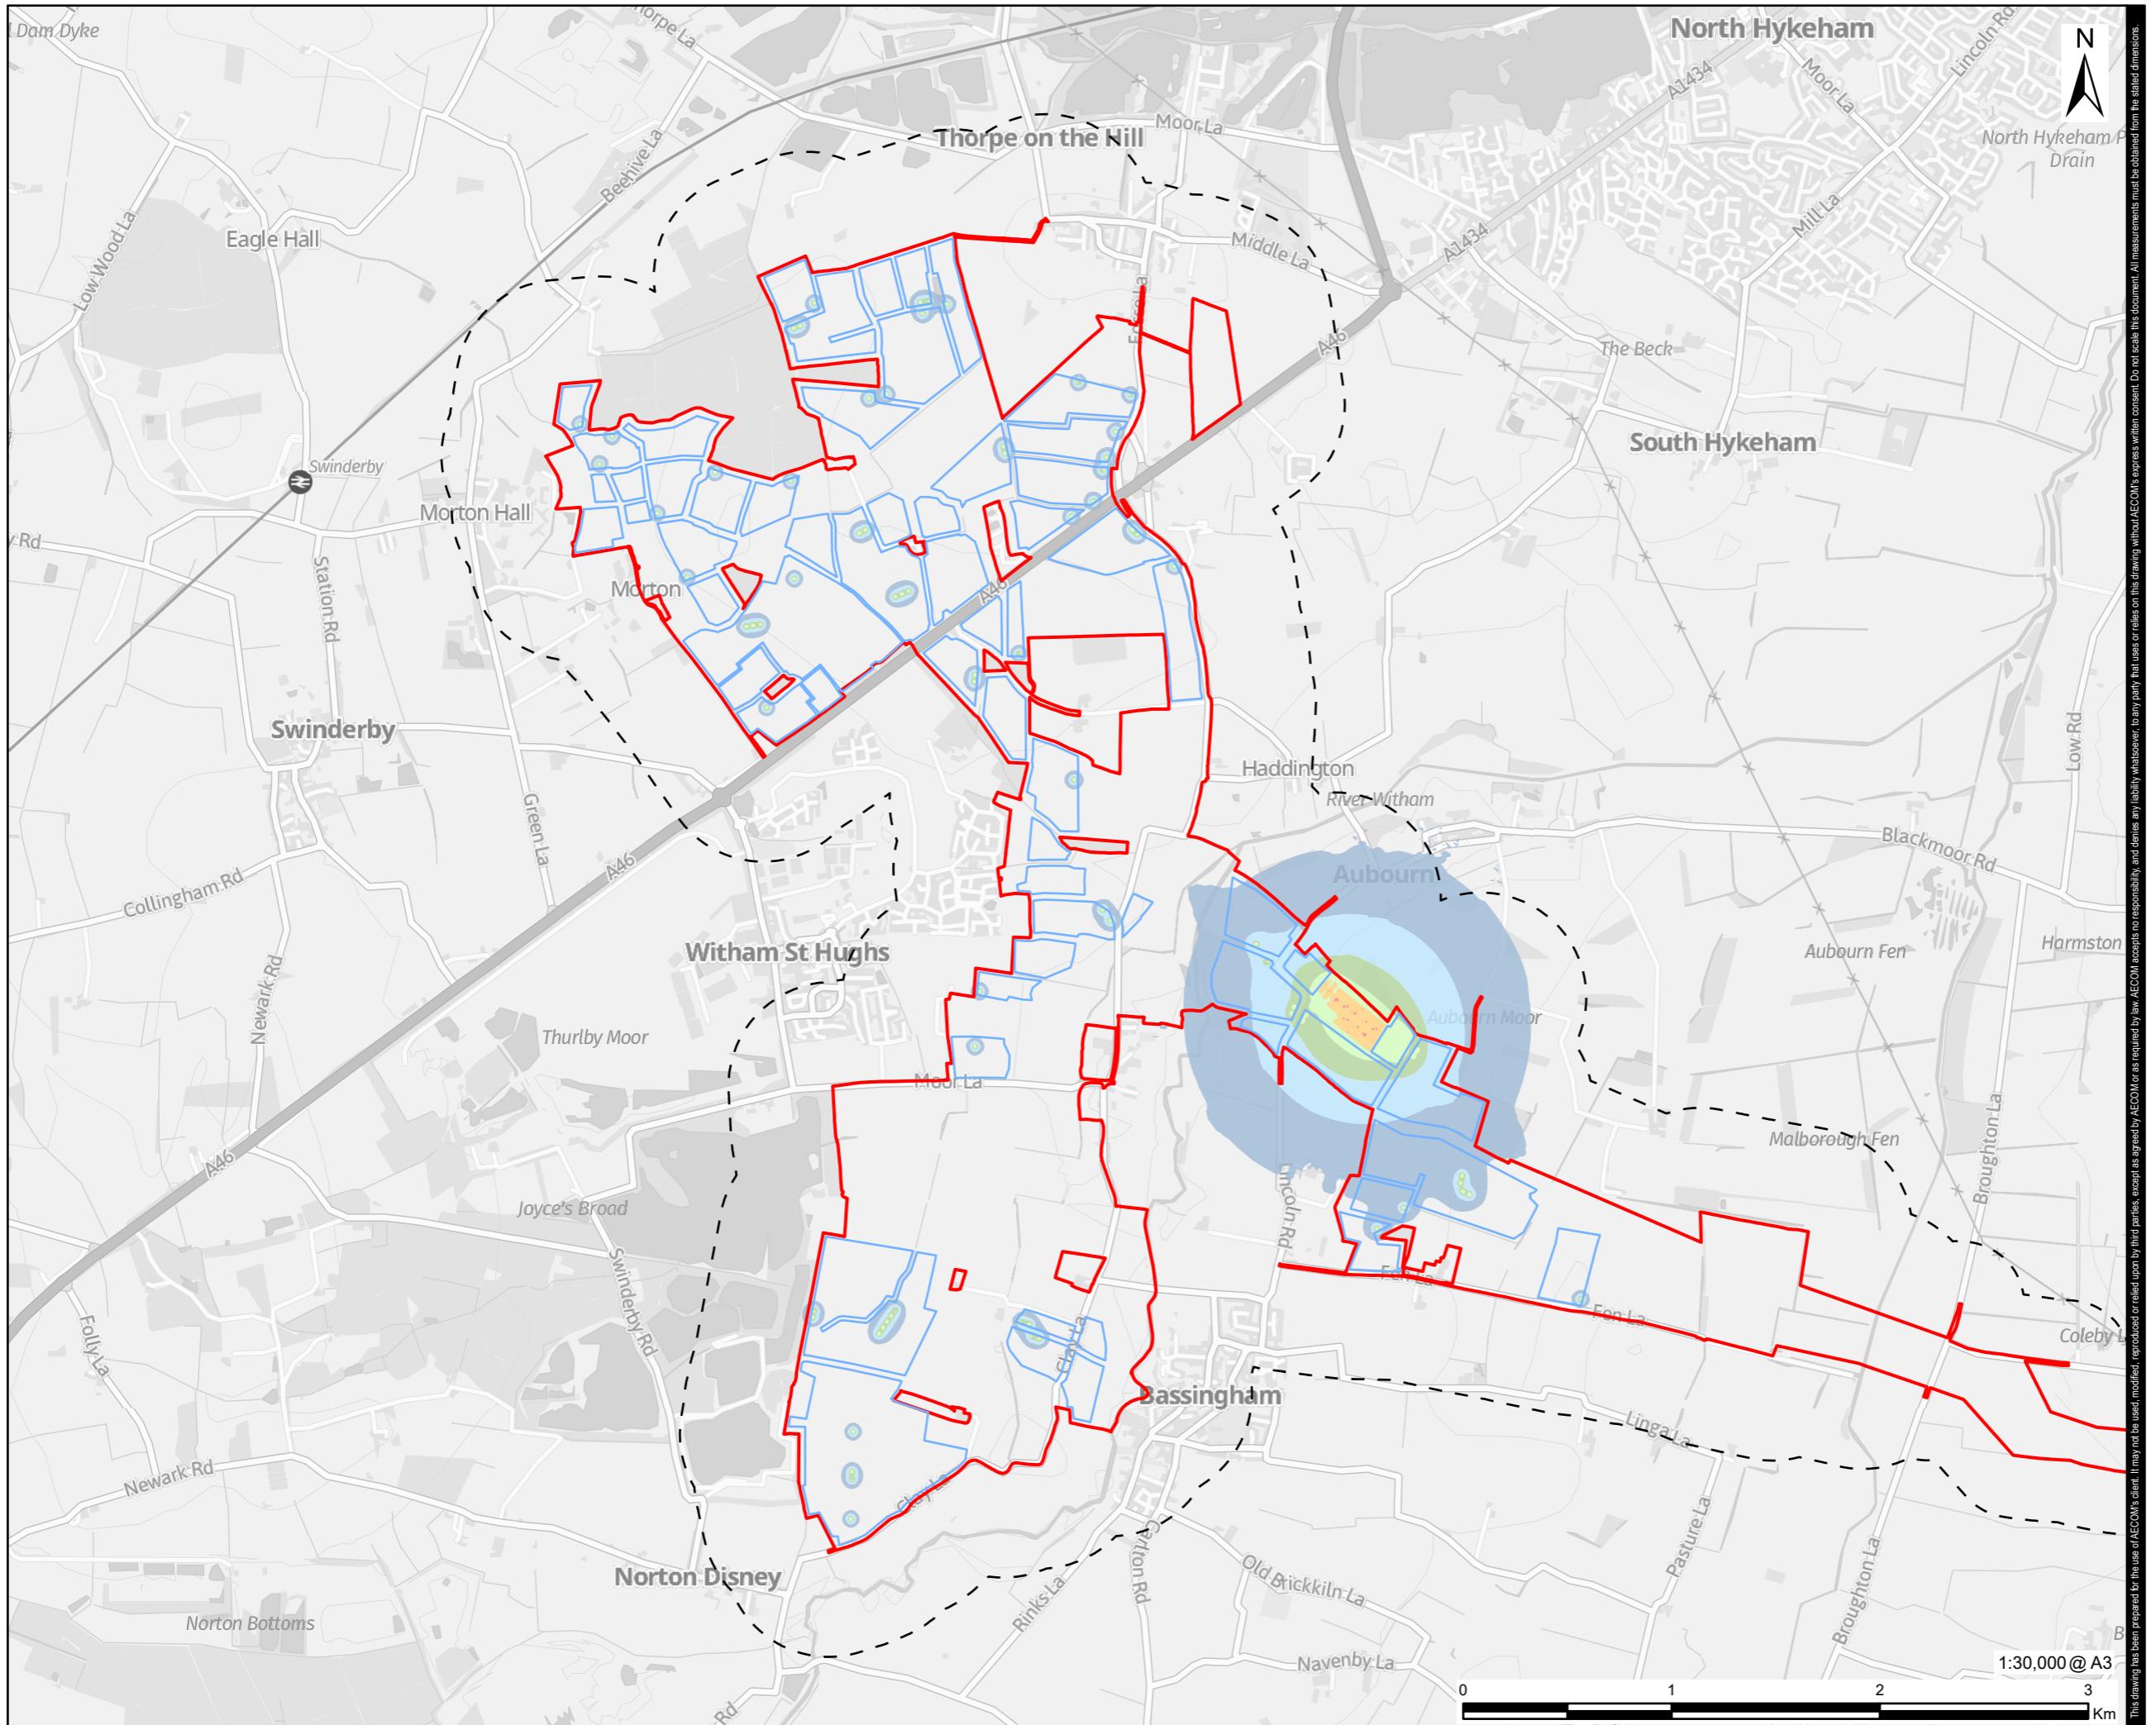

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.