


Filename: \\na.aecom\com\lifs\EMEALondon\UKLON06\Legacy\UKLON06\FPSW001\UKLON06\FPSW001_VDPEL\Library\GIS_DATA\Projects\Fosse Green Energy Park\02_Maps\Environmental Statement\Chapter 11 - Noise\ES_Chapter11_Noise_Figures.aprx

Project No.: 60700987 Drawn: HW Checked: AM Approved: LB Date: 2025-09-01



This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

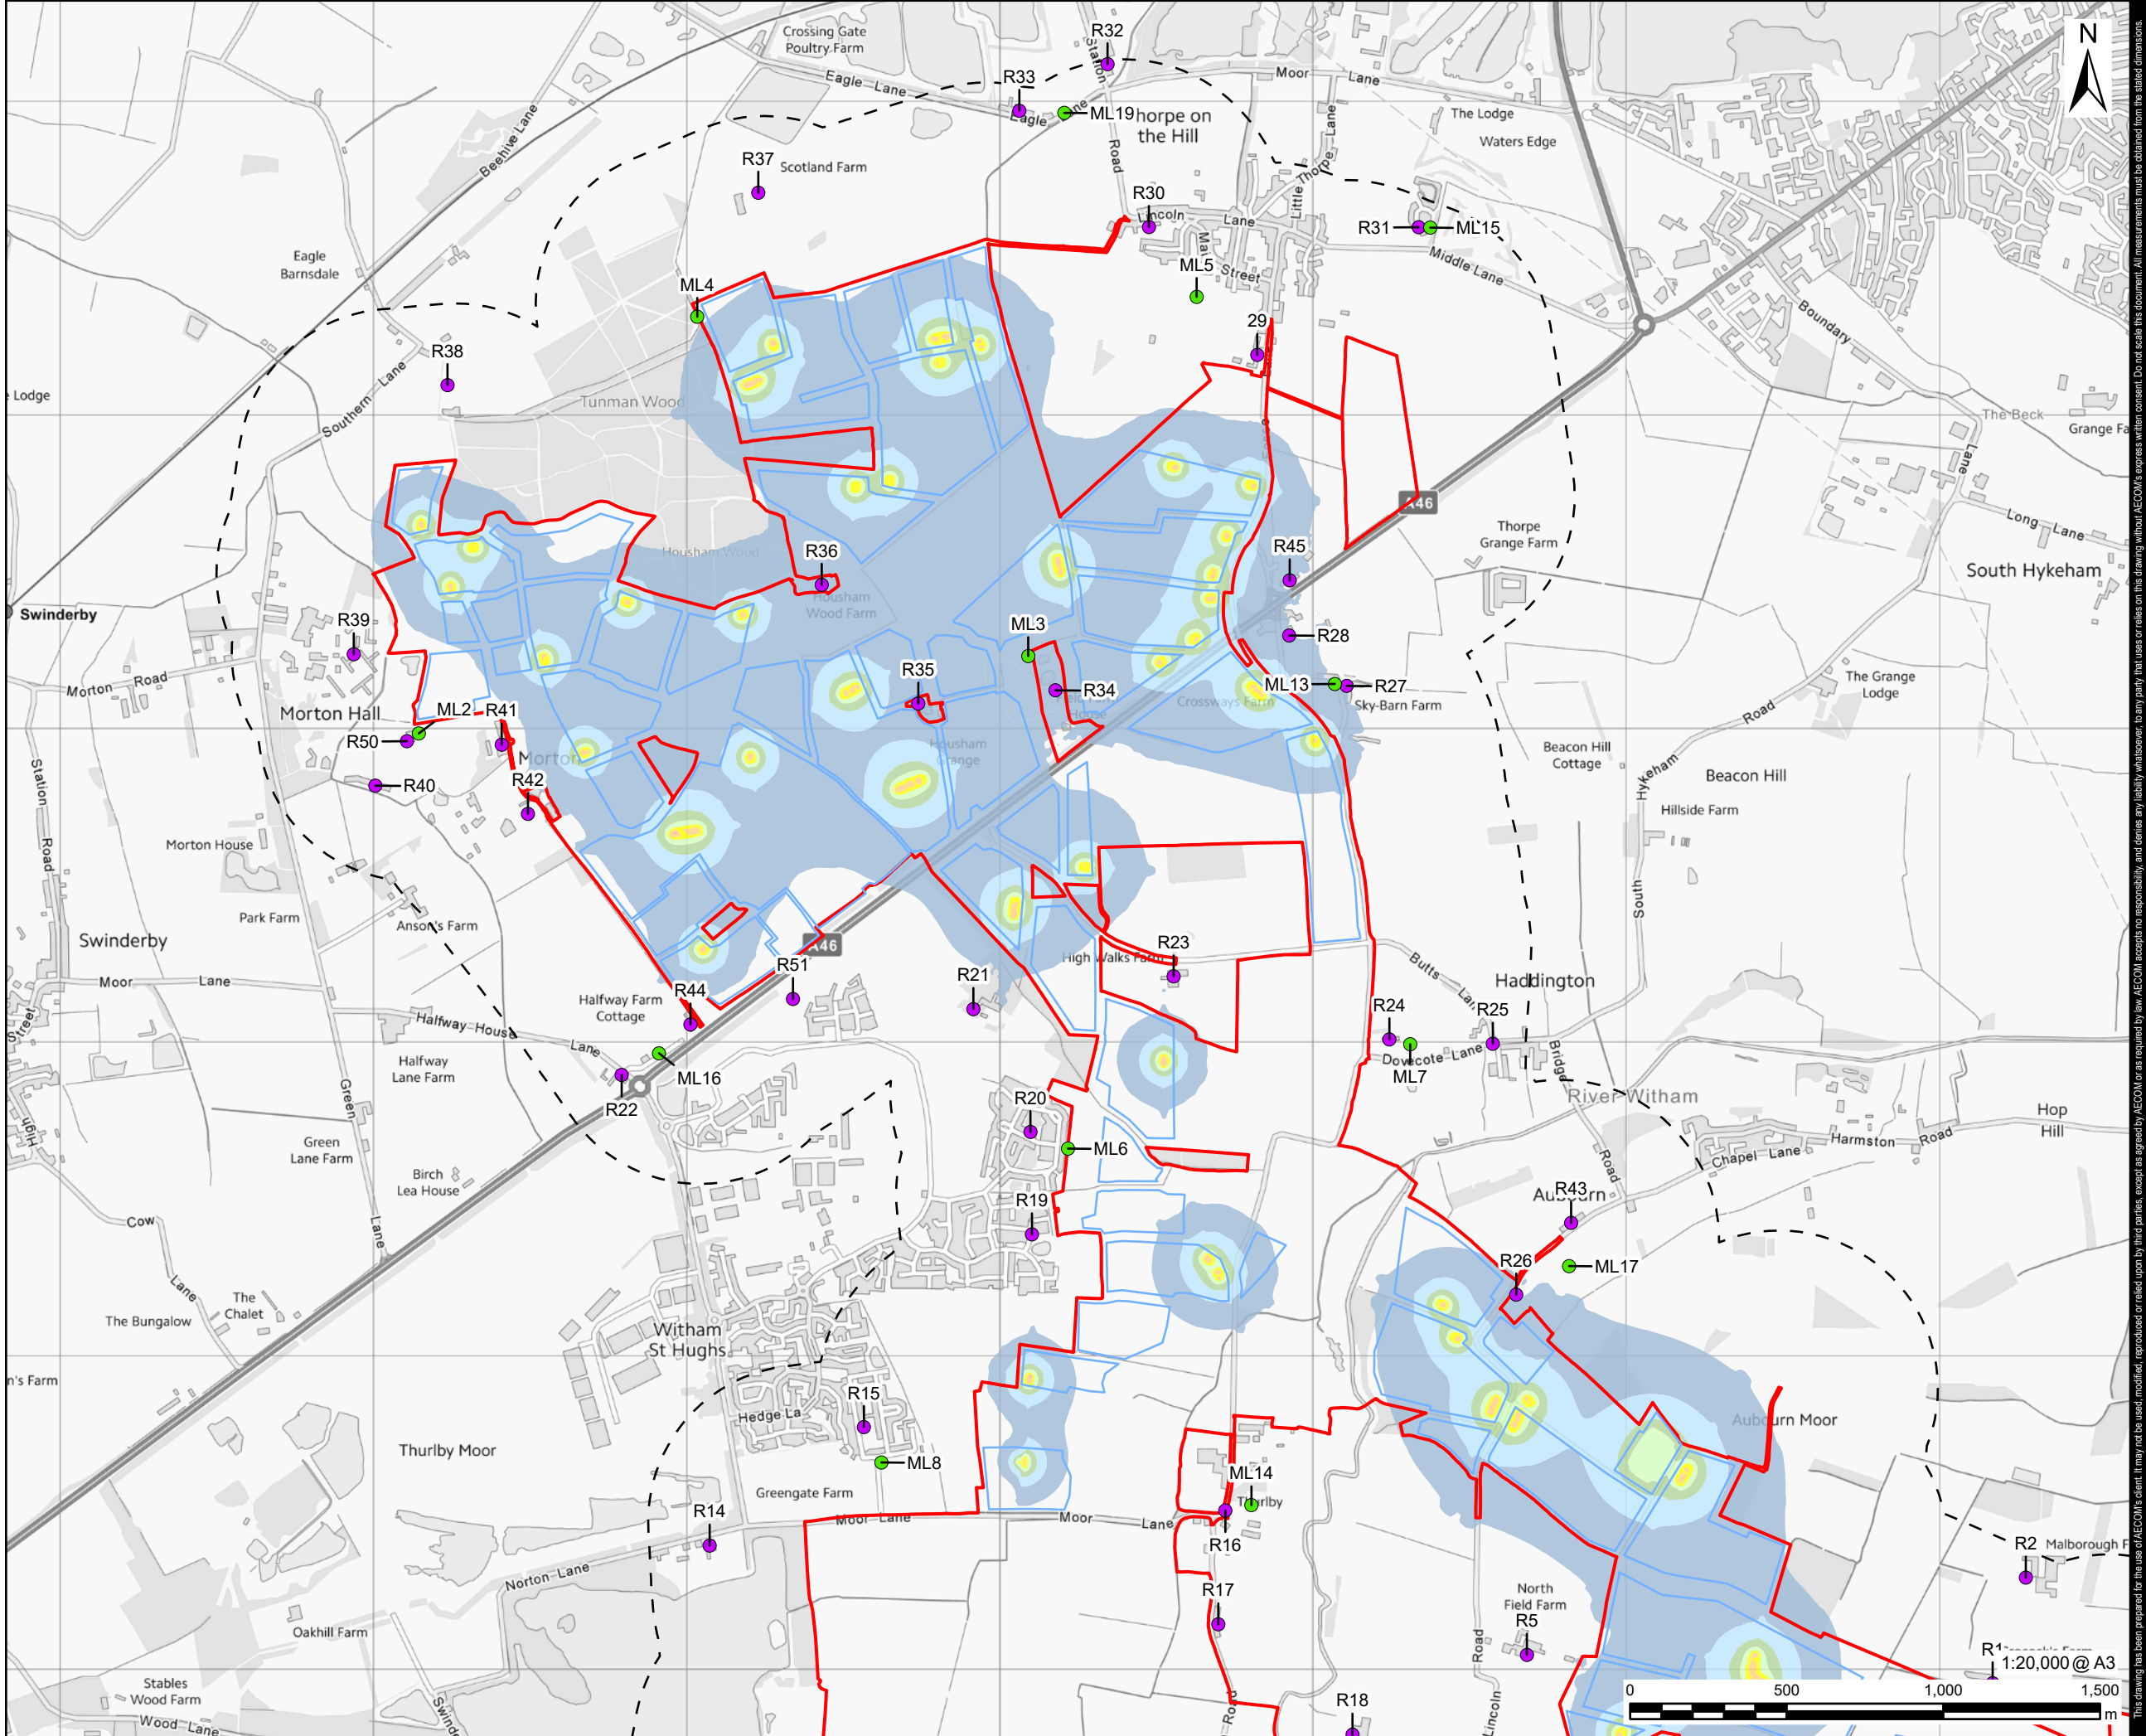

PROJECT

Fosse Green Energy

CLIENT

Fosse Green Energy Ltd

CONSULTANT

AECOM Limited
Sunley House
4 Bedford Park
Surrey, CR0 2AP, UK

LEGEND

DCO Site Boundary

Study Area


Solar PV Area

Noise Monitoring Location

Noise Receptor Location

Operational Noise Level -
Operational Phase Distributed BESS
(dB)

- 35
- 40
- 45
- 50
- 55
- 60
- 65

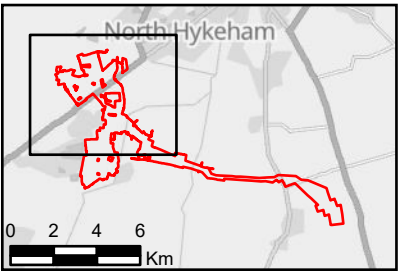

NOTES

Contains OS data © Crown Copyright and
database right 2025
Contains data from OS Zoomstack, Contains
OS data © Crown copyright 2025

LEGISLATION

Regulation 5(2)(a) Infrastructure Planning
(Applications: Prescribed Forms and
Procedure) Regulations 2009.

ISSUE PURPOSE

DCO Submission

FIGURE TITLE

Noise Contours - Operational Phase
Distributed BESS

FIGURE NUMBER

Figure 11-3 Sheet 1 of 3

REV.


02

DOCUMENT REFERENCE

EN010154/APP/6.2.

Filename: \\na.aecomnet.com\fs\EMEA\London\UK\ON06\PPSW001\UK\ON06\PPSW001\UK\ON06\PPSW001-1\VDPEL\Library\GIS_DATA\Projects\Fosse Green Energy Park\02_Maps\Environmental Statement\Chapter 11 - Noise\ES_Chapter11_Noise_Figures.aprx

Project No.: 60700987 Drawn: HW Checked: AM Approved: LB Date: 2025-09-01

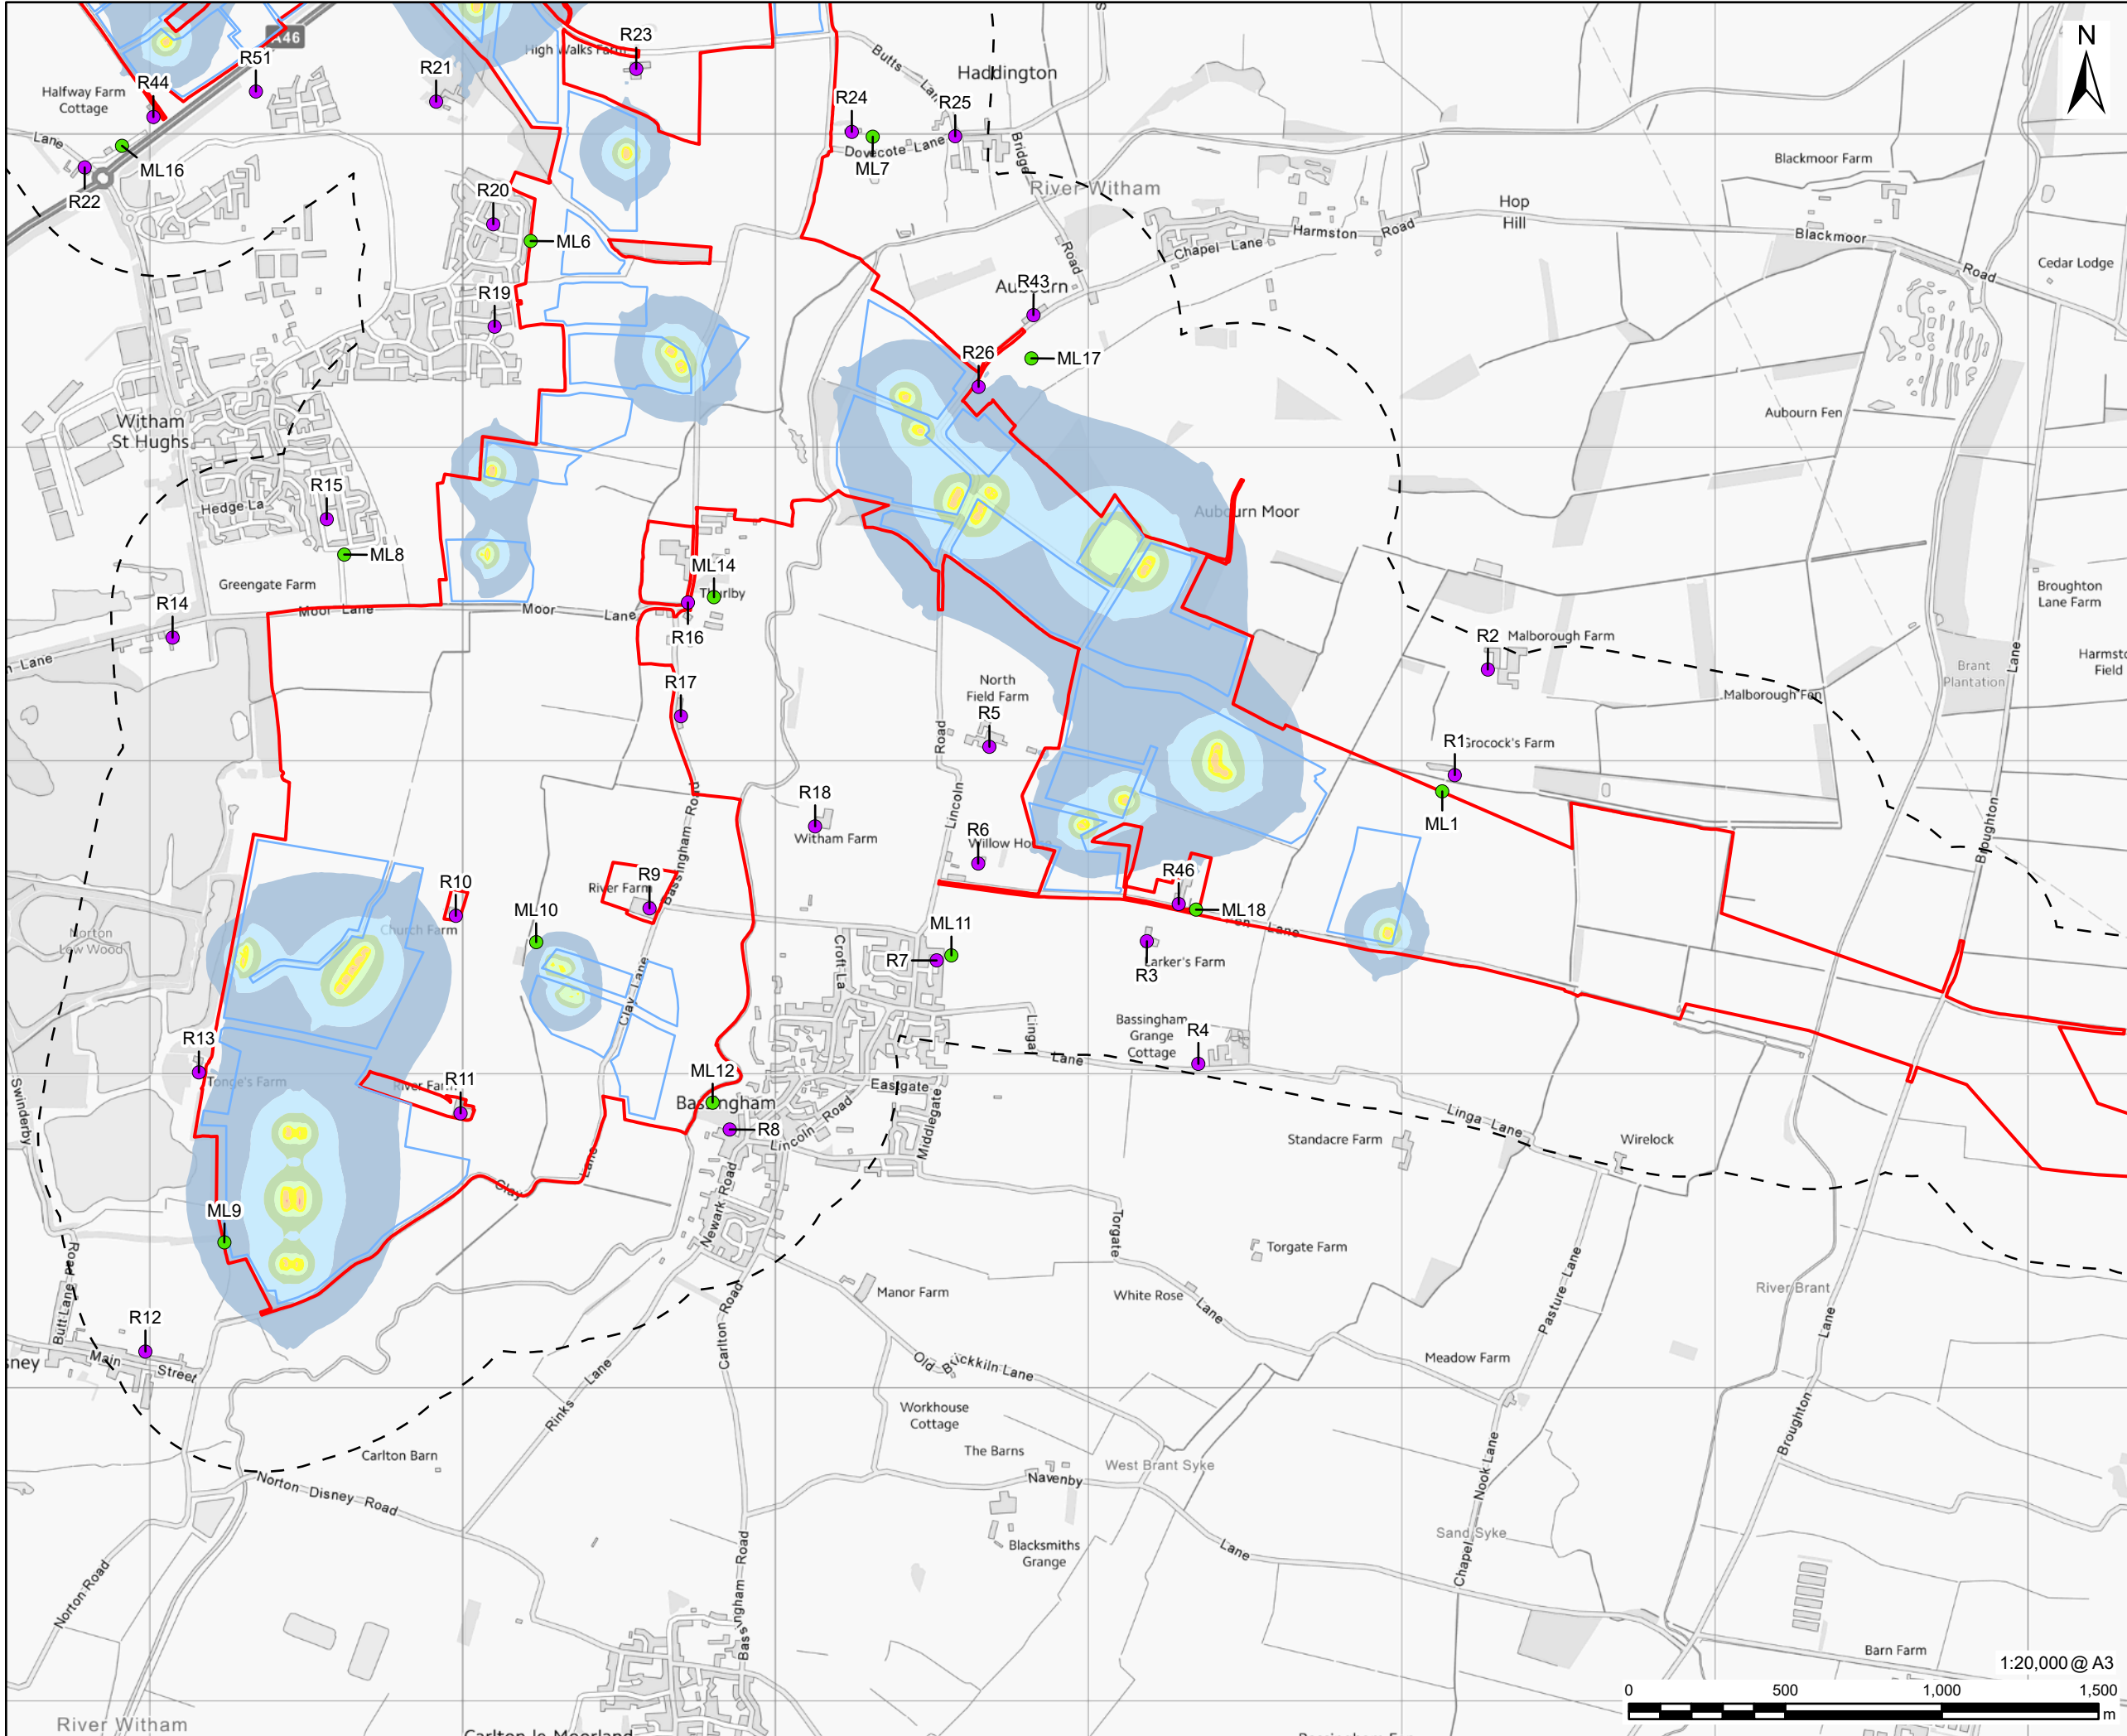

PROJECT

Fosse Green Energy

CLIENT

Fosse Green Energy Ltd

CONSULTANT


AECOM Limited
Sunley House
4 Bedford Park
Surrey, CR0 2AP, UK

LEGEND

- DCO Site Boundary
- Study Area
- Solar PV Area
- Noise Monitoring Location
- Noise Receptor Location

Operational Noise Level -
Operational Phase Distributed BESS
(dB)

- 35
- 40
- 45
- 50
- 55
- 60
- 65

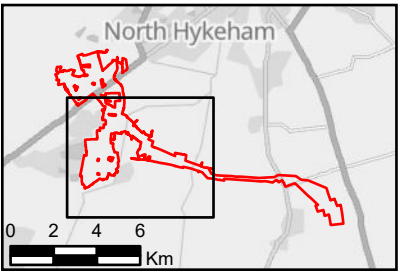

NOTES

Contains OS data © Crown Copyright and
database right 2025
Contains data from OS Zoomstack, Contains
OS data © Crown copyright 2025

LEGISLATION

Regulation 5(2)(a) Infrastructure Planning
(Applications: Prescribed Forms and
Procedure) Regulations 2009.

ISSUE PURPOSE

DCO Submission

FIGURE TITLE

Noise Contours - Operational Phase
Distributed BESS

FIGURE NUMBER

Figure 11-3 Sheet 2 of 3

REV.

02

DOCUMENT REFERENCE

EN010154/APP/6.2.

PROJECT

Fosse Green Energy

CLIENT

Fosse Green Energy Ltd

CONSULTANT

AECOM Limited
Sunley House
4 Bedford Park
Surrey, CR0 2AP, UK

LEGEND

 DCO Site Boundary

Study Area


☐ Solar PV Area

● Noise Monitoring Location

● Noise Receptor Location

**Operational Noise Level -
Operational Phase Distributed BESS
(dB)**

35
40
45
50
55
60
65

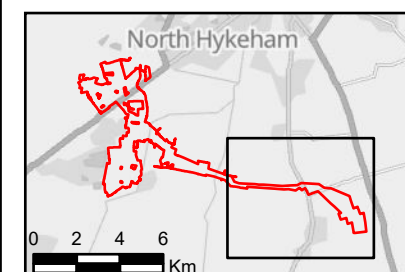

NOTES

Contains OS data © Crown Copyright and
database right 2025
Contains data from OS Zoomstack, Contains
OS data © Crown copyright 2025

LEGISLATION

Regulation 5(2)(a) Infrastructure Planning
(Applications: Prescribed Forms and
Procedure) Regulations 2009.

ISSUE PURPOSE

DCO Submission

FIGURE TITLE

Noise Contours - Operational Phase Distributed BESS

FIGURE NUMBER		REV
Figure 11-3	Sheet 3 of 3	02

DOCUMENT REFERENCE

EN010154/APP/6.2.

