



Dean Moor Solar Farm

Environmental Statement: Chapter 3 – Figure 3.5 Exclusion Areas



on behalf of **FVS Dean Moor Limited**

March 2025
Prepared by: Stantec UK Ltd
PINS Ref: EN010155
Document Ref: 6.2
Revision: 1



Firma Energy

 **ib vogt**

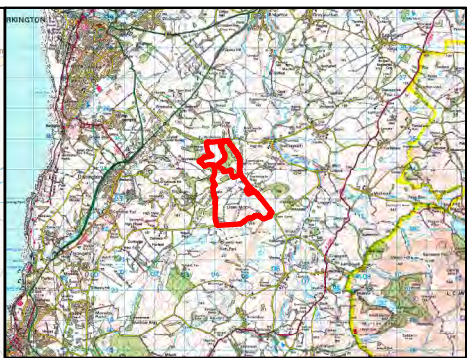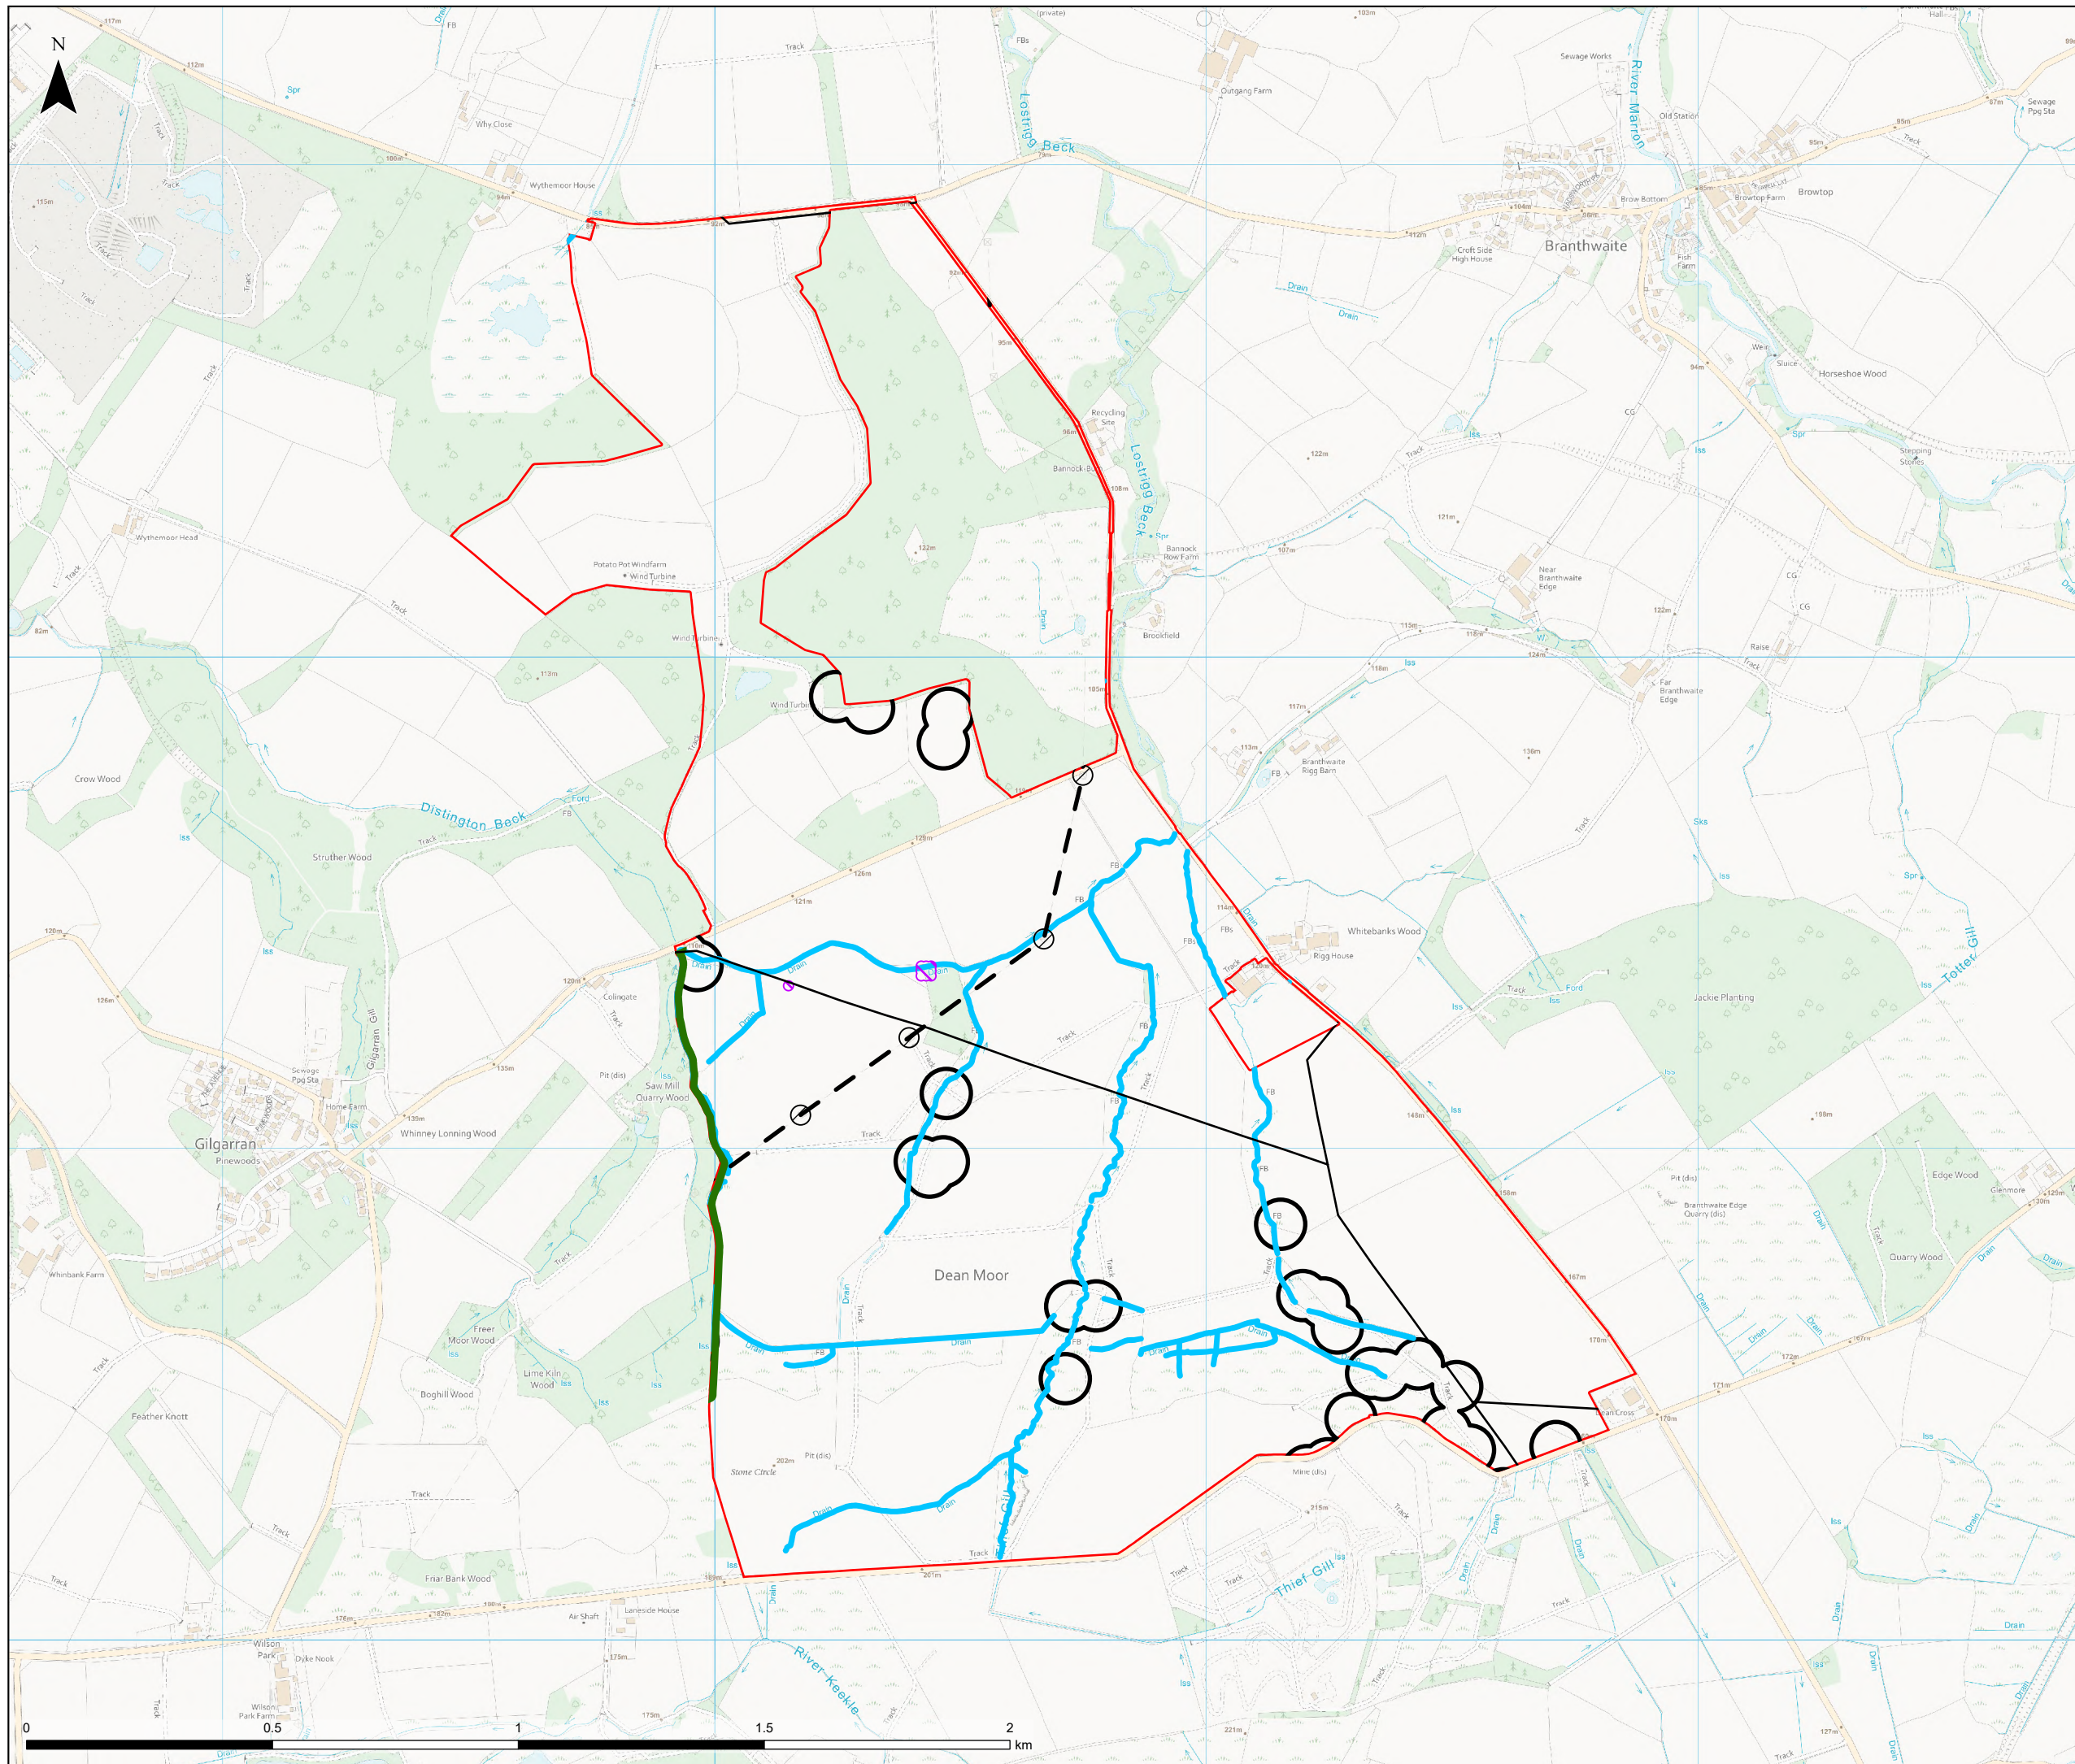

Legend

- Order Limits
- Existing 132 kV Overhead Line (Indicative)
- 11kV Overhead Line Exclusion Area
- Ancient Woodland Exclusion Area
- Potential Mine Entry Exclusion Area
- Peat Exclusion Area
- 132kV Pylon Exclusion Area
- Watercourse Exclusion Area

© Crown copyright and database rights [2024] Ordnance Survey AC0000808122 © National Grid 2023; © 2023 Landmark Information Group Limited.

Project Title	
Client	
FVS Dean Moor Limited	
Title	
DEAN MOOR SOLAR FARM DEVELOPMENT CONSENT ORDER Exclusion Areas	
Scale: 1:12,500 @ A3	Date: 10/03/2025
Drawn: TL	Checked: JL
Figure: 3.5	Rev: A