



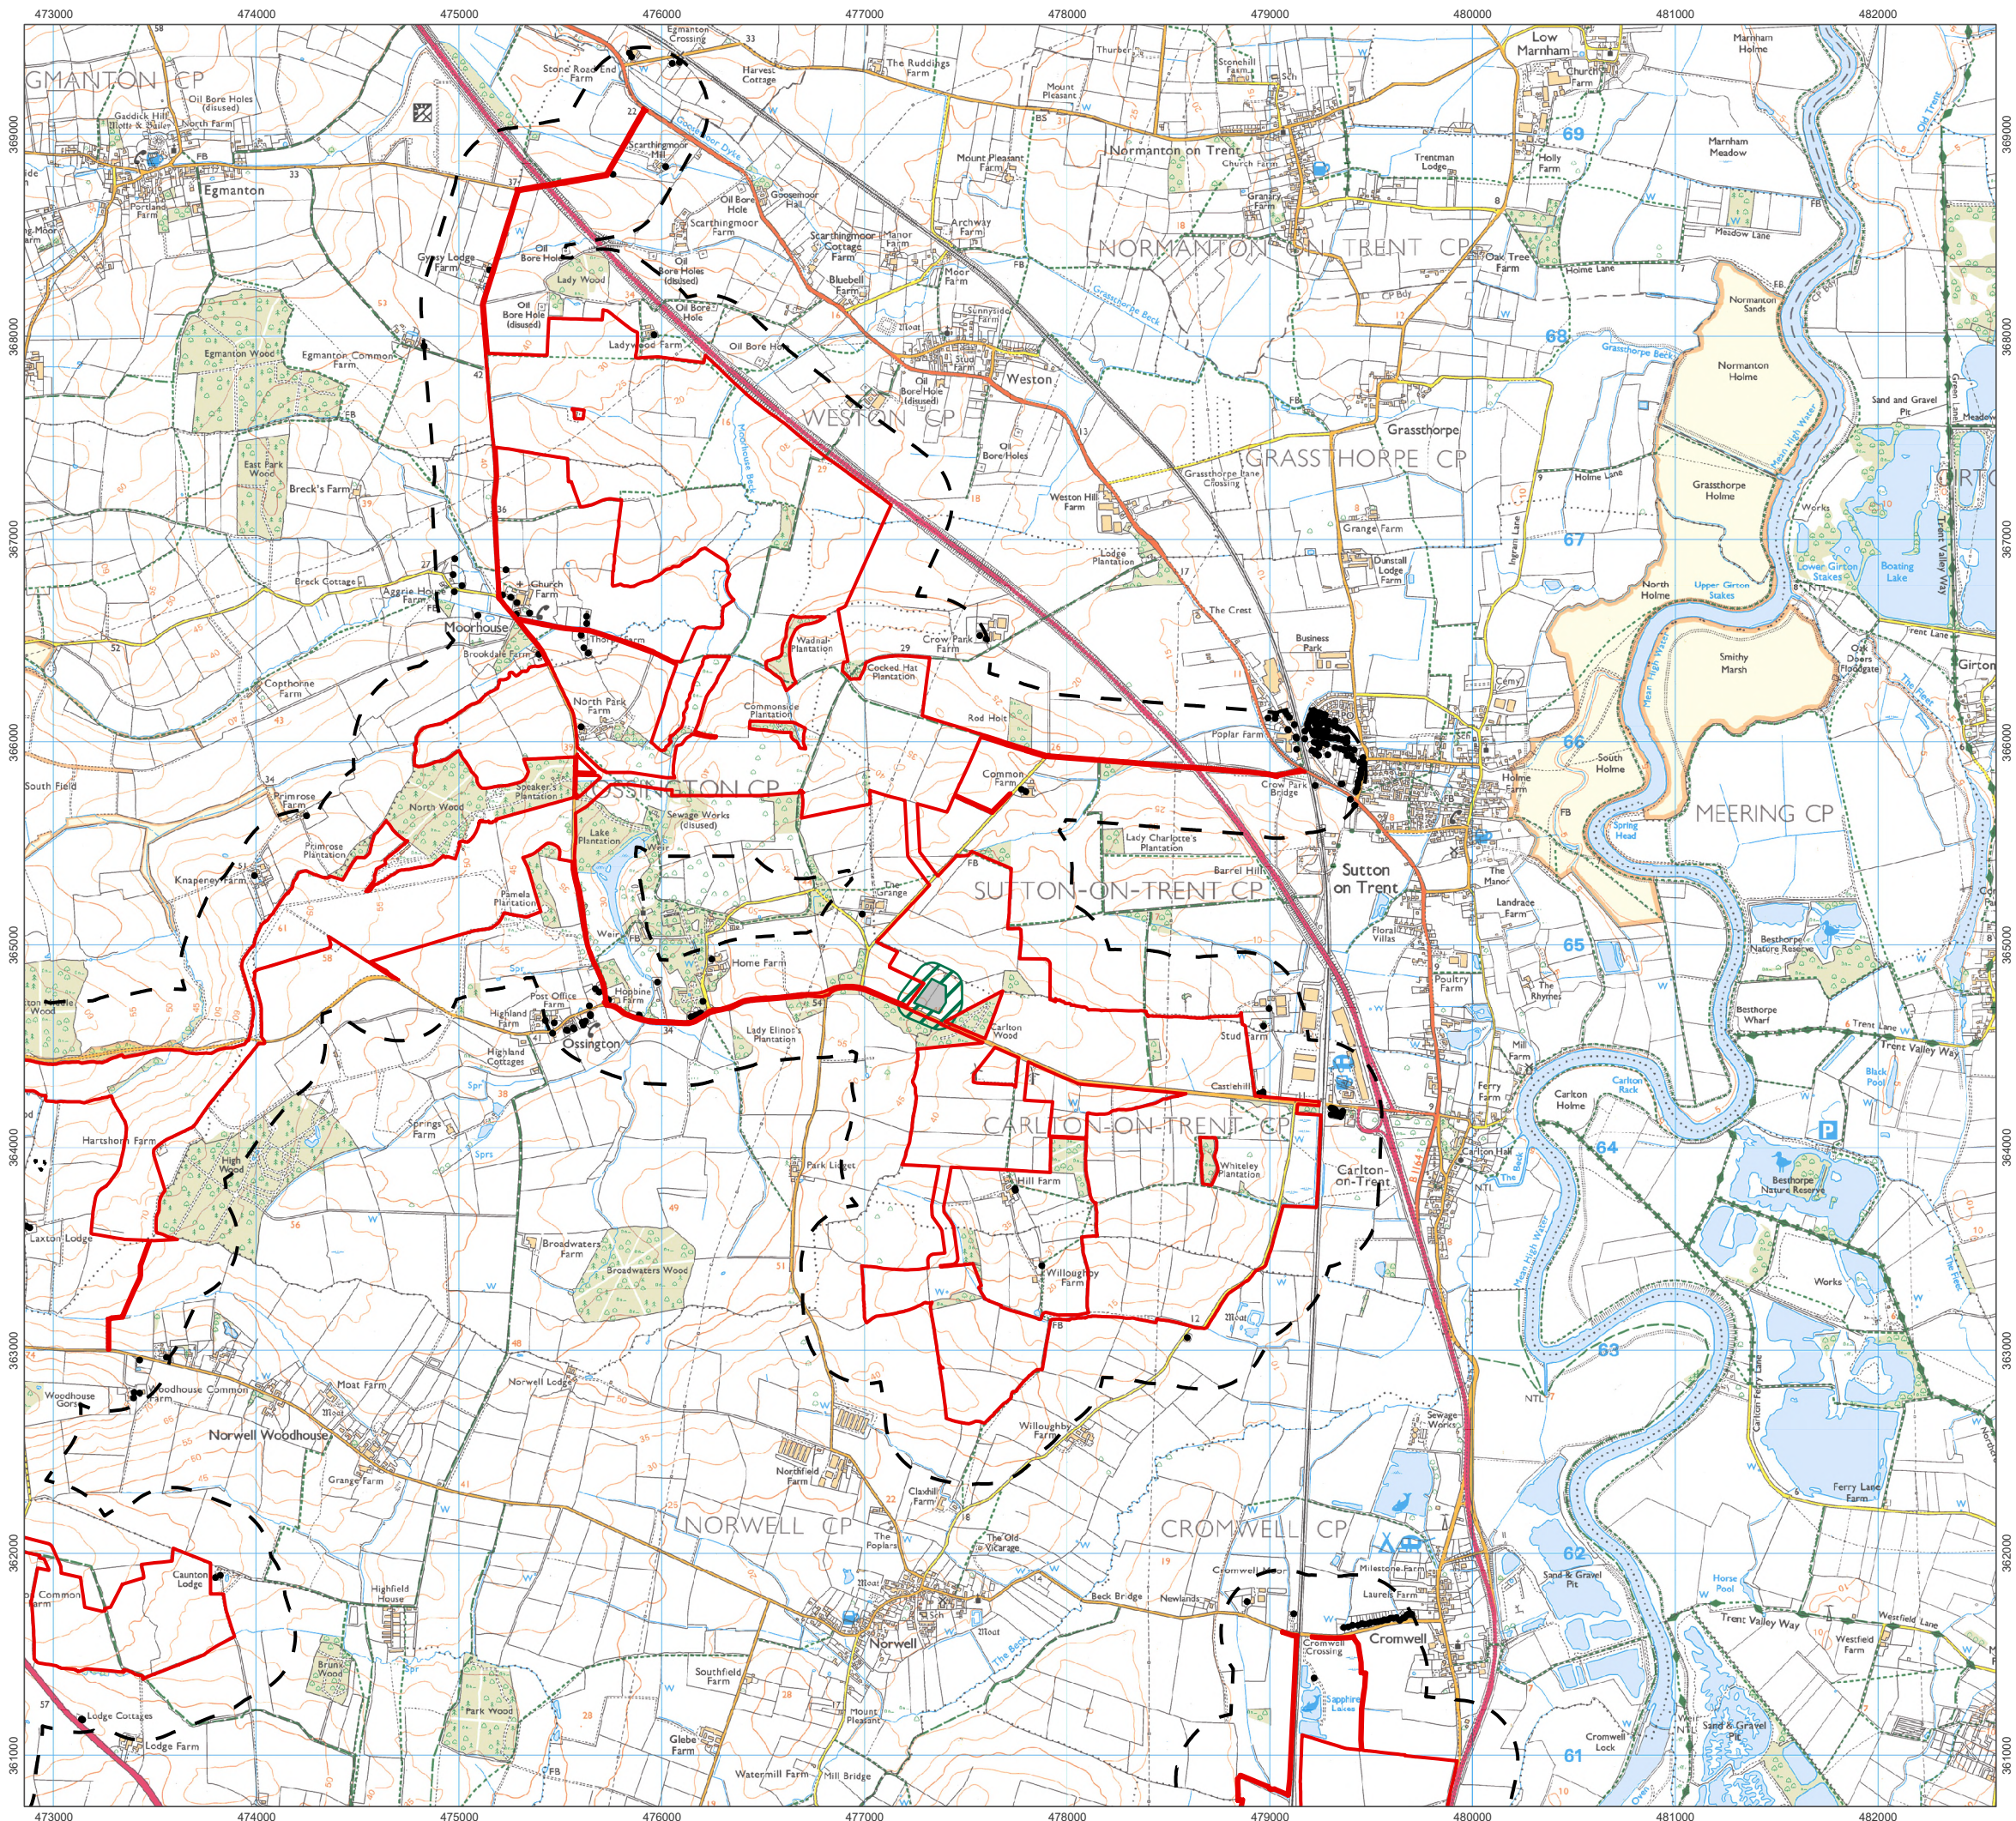


- Order Limits
- 300 m Construction Noise Study Area
- Area exceeding 65 dB LAeq,t during substation and BESS installation
- Noise Sensitive Receptors within 300 m of the Order Limits
- Works Numbers**
 - Works No. 4 Substations
 - Works No. 5A BESS
 - Works No. 5B 400kV Substation
 - Works No. 6 National Grid Substation
 - Works No. 7 Staythorpe BESS Connection



Ref: 026-ES-12.4 Date: 20/06/2025

Assessment of Noise during Installation of Substations and BESS Construction Activities
Figure 12.4NE

Great North Road Solar and Biodiversity Park
Environmental Statement

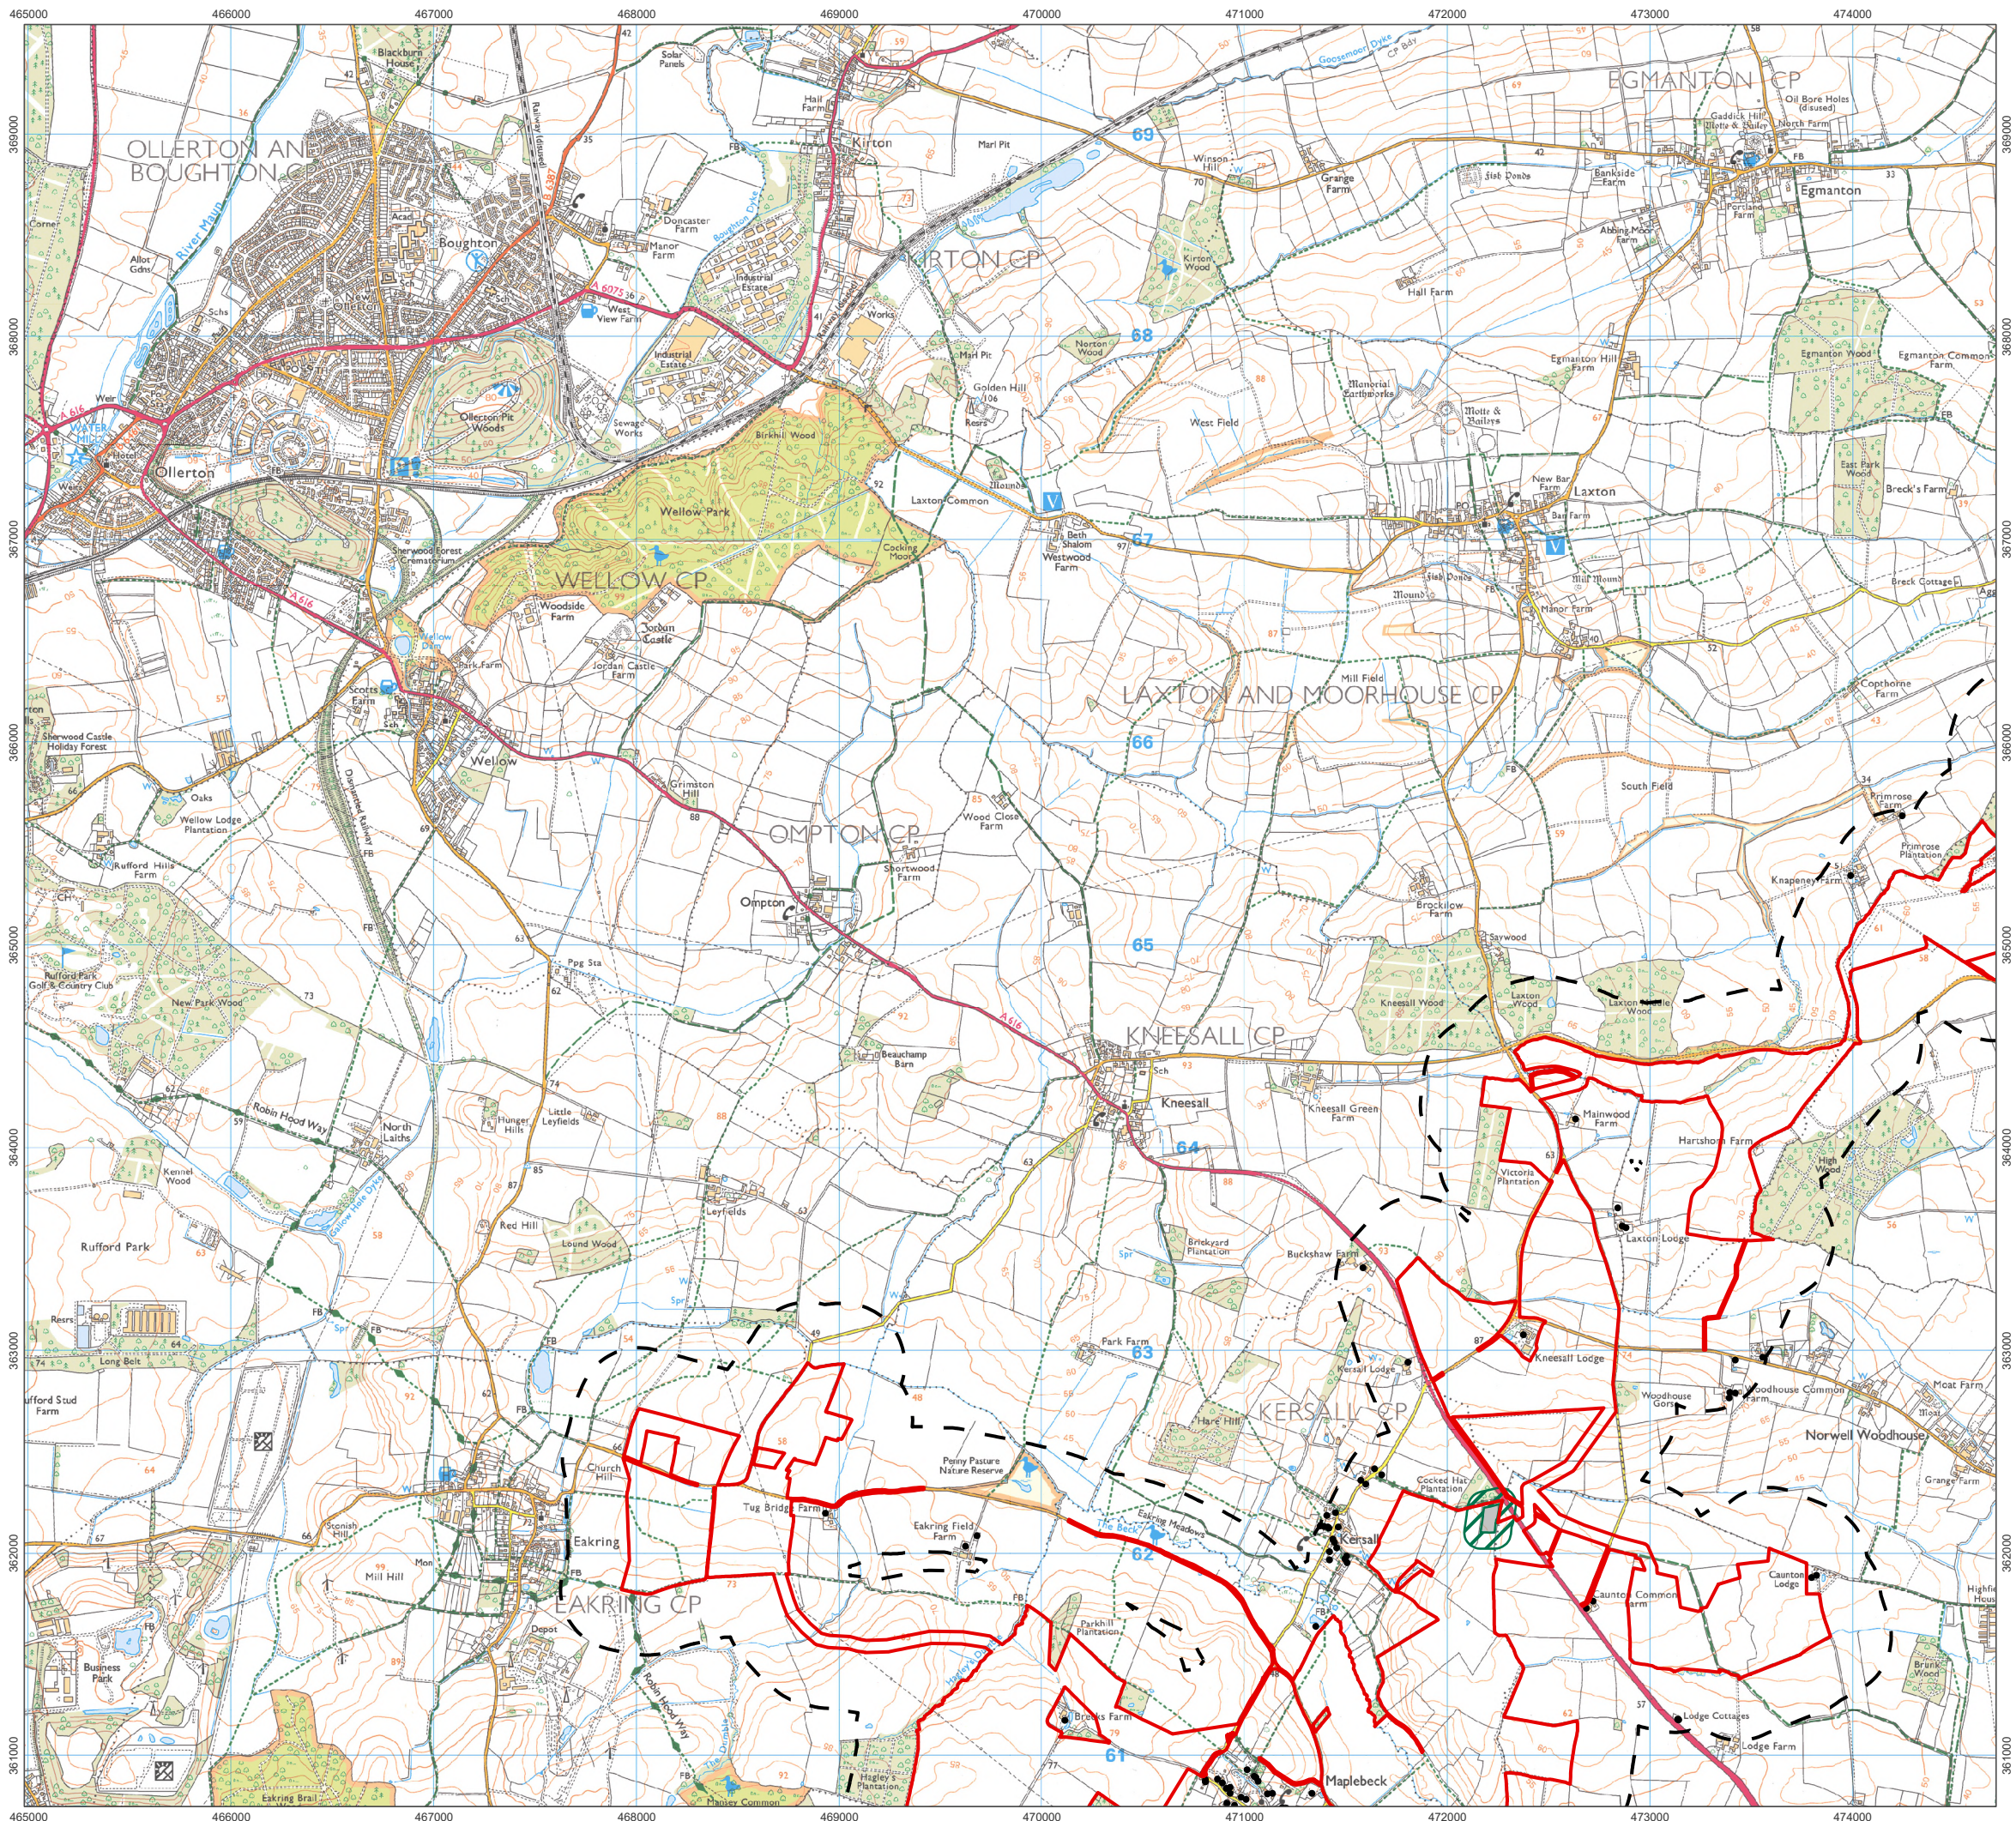


- Order Limits
- 300 m Construction Noise Study Area
- Area exceeding 65 dB LAeq,t during substation and BESS installation
- Noise Sensitive Receptors within 300 m of the Order Limits
- Works Numbers**
 - Works No. 4 Substations
 - Works No. 5A BESS
 - Works No. 5B 400kV Substation
 - Works No. 6 National Grid Substation
 - Works No. 7 Staythorpe BESS Connection




Ref: 026-ES-12.4 Date: 20/06/2025

Assessment of Noise during Installation of Substations and BESS Construction Activities
Figure 12.4NW

Great North Road Solar and Biodiversity Park
Environmental Statement

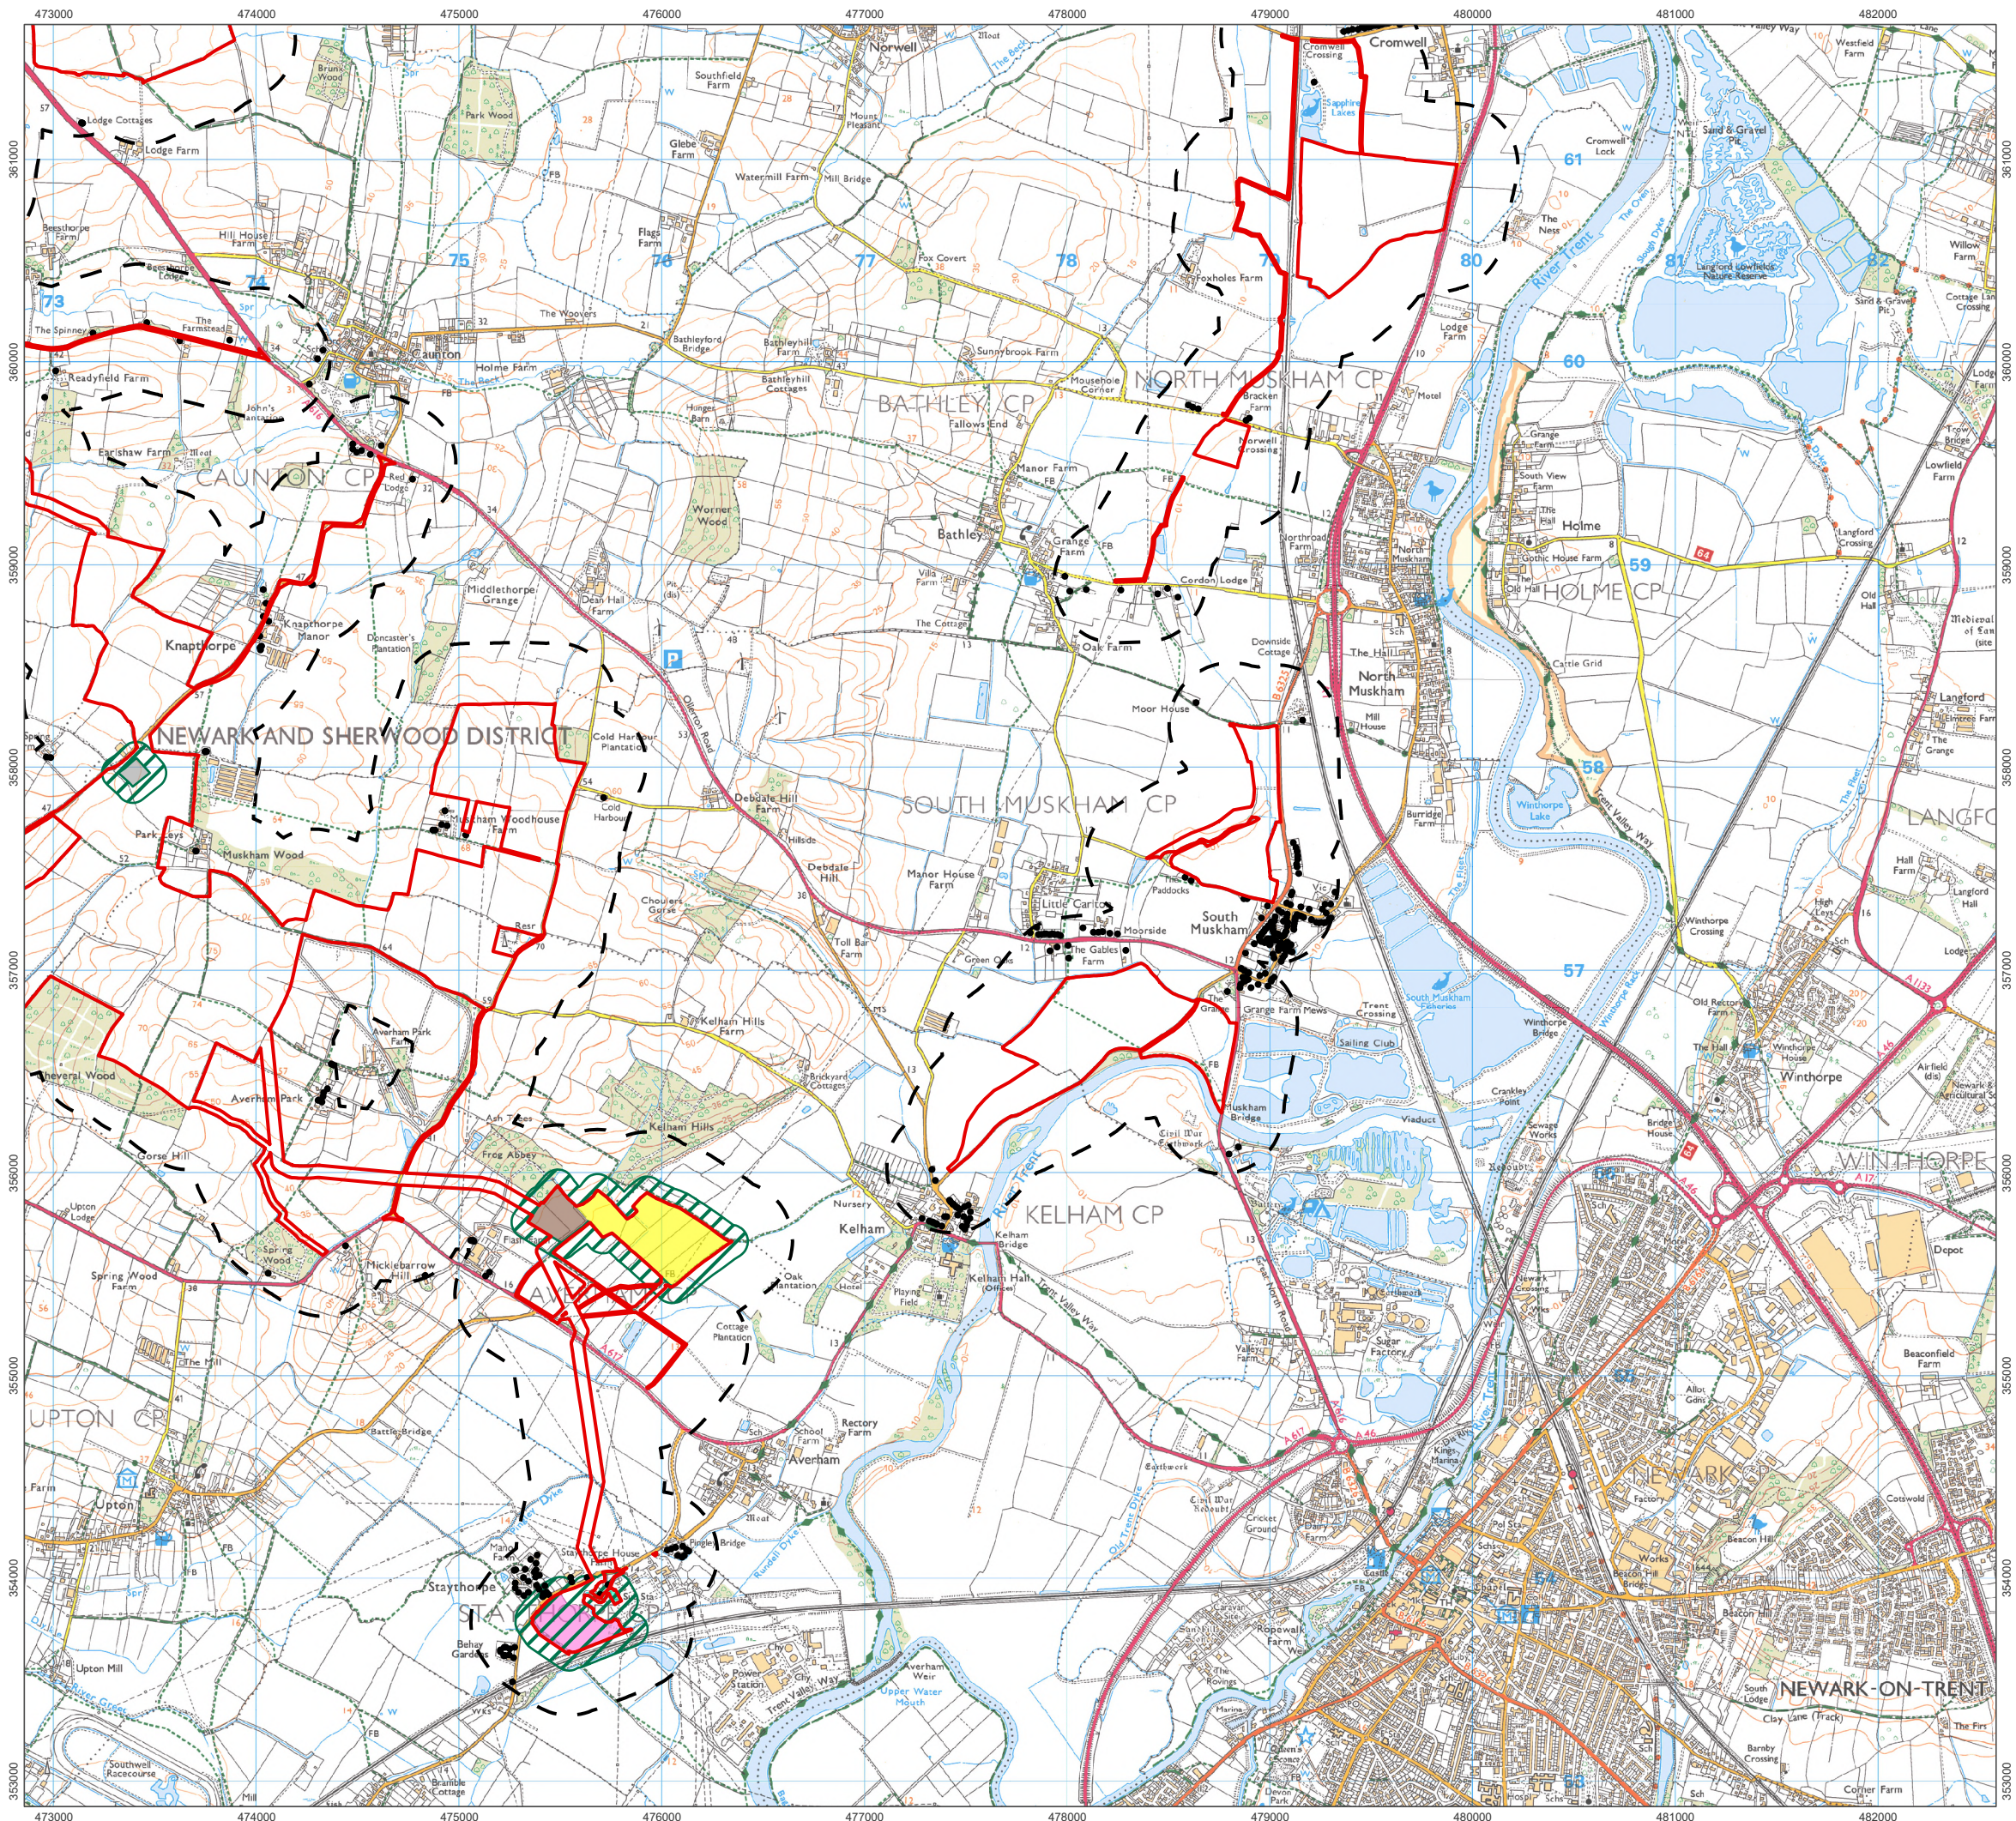

- Order Limits
- 300 m Construction Noise Study Area
- Area exceeding 65 dB LAeq,t during substation and BESS installation
- Noise Sensitive Receptors within 300 m of the Order Limits
- Works Numbers**
 - Works No. 4 Substations
 - Works No. 5A BESS
 - Works No. 5B 400kV Substation
 - Works No. 6 National Grid Substation
 - Works No. 7 Staythorpe BESS Connection




1:32,000 Scale @ A3
0 0.25 0.5 1 km


Ref: 026-ES-12.4 Date: 20/06/2025

Assessment of Noise during Installation of Substations and BESS Construction Activities
Figure 12.4SE

Great North Road Solar and Biodiversity Park
Environmental Statement

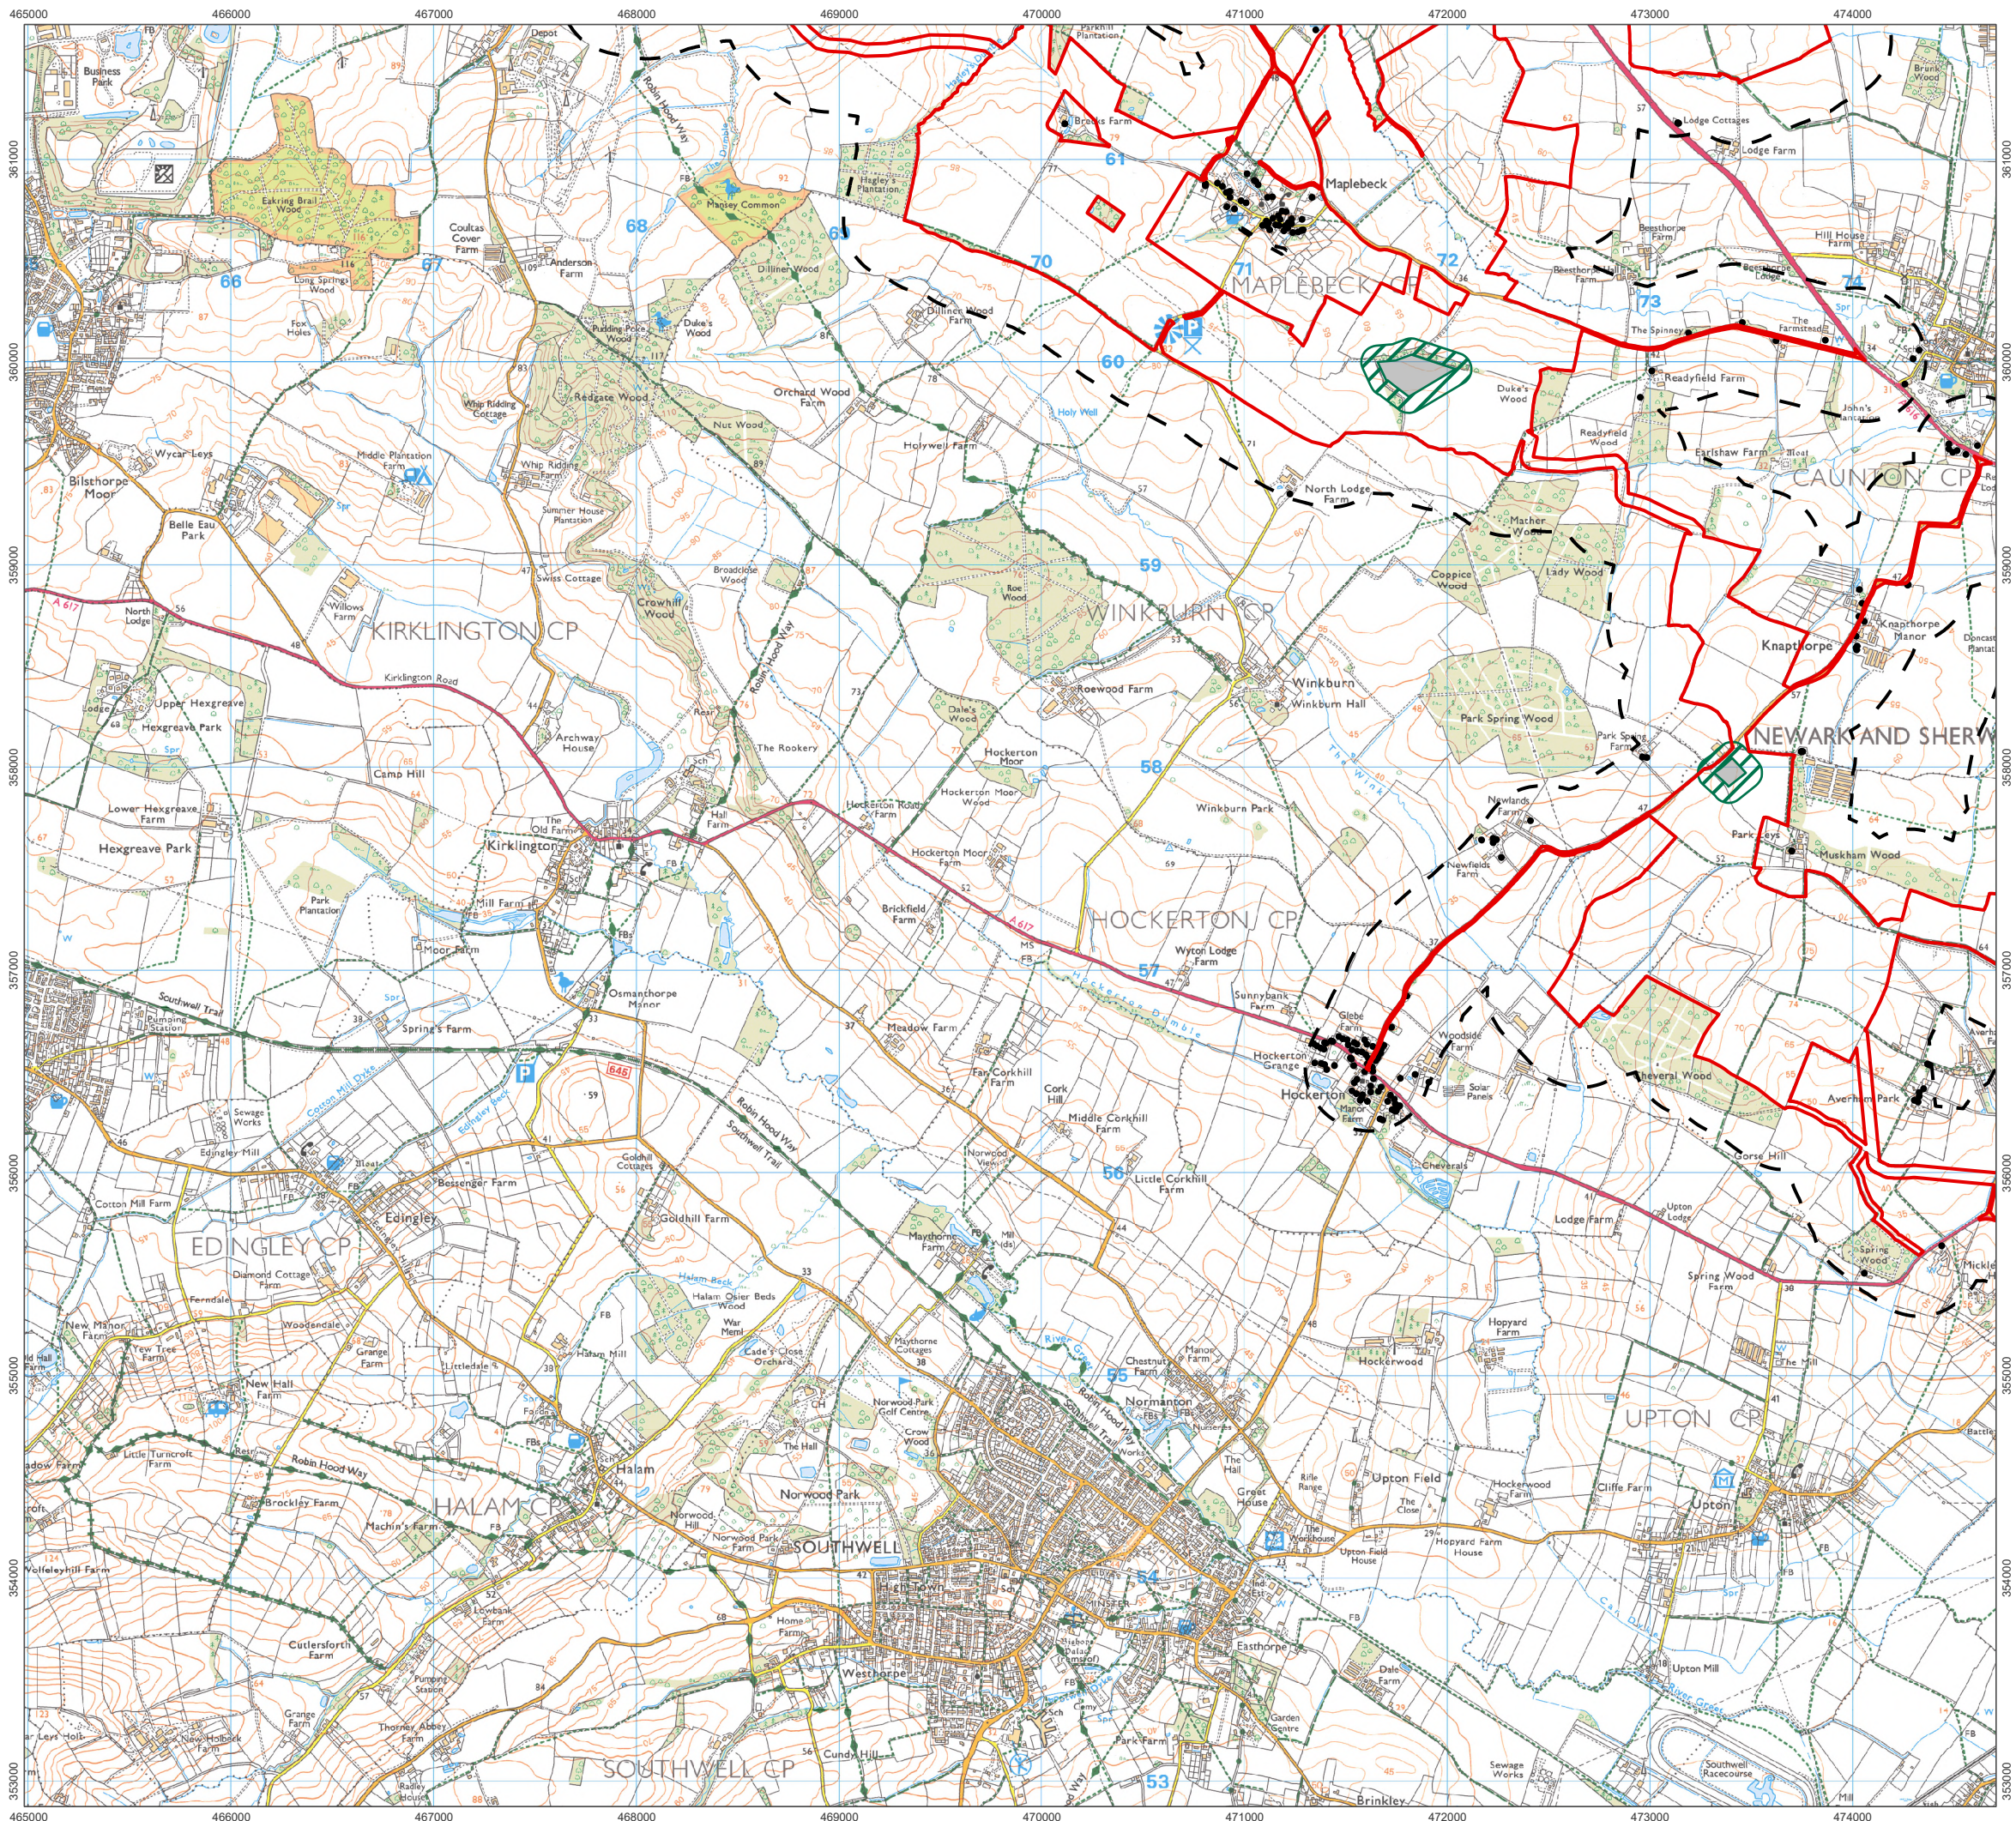

- Order Limits
- 300 m Construction Noise Study Area
- Area exceeding 65 dB LAeq,t during substation and BESS installation
- Noise Sensitive Receptors within 300 m of the Order Limits
- Works Numbers**
 - Works No. 4 Substations
 - Works No. 5A BESS
 - Works No. 5B 400kV Substation
 - Works No. 6 National Grid Substation
 - Works No. 7 Staythorpe BESS Connection



1:32,000 Scale @ A3

0 0.25 0.5 1 km

Ref: 026-ES-12.4 Date: 20/06/2025

Assessment of Noise during Installation of Substations and BESS Construction Activities

Figure 12.4SW

Great North Road Solar and Biodiversity Park Environmental Statement