


- KEY (BESS LAYOUT):**
- ORDER LIMIT (OUTSIDE EDGE OF LINE DENOTES BOUNDARY)
 - PALISADE / WELDMESH OR ACOUSTIC FENCE
 - BATTERY STORAGE ENCLOSURE (BSE)
 - POWER CONVERSION SYSTEM (PCS) WITH SINGLE MV SKID AND APRON SLAB
 - BESS SUBSTATION BUILDING
 - AUXILIARY TRANSFORMER
 - LV SWITCHGEAR ROOM
 - AGGREGATION PANEL WITH LV PILLAR
 - SPARES CONTAINER
 - LIGHTING / CCTV COLUMN
 - GRAVEL FINISH
 - ACCESS TRACK
 - ← SITE ENTRANCE


- KEY (SOLAR LAYOUT):**
- HARDSTAND
 - INVERTER AREA
 - SUBSTATION
 - FENCE
 - SOLAR PANELS
 - GATE

SITE WIND FREQUENCY ROSE

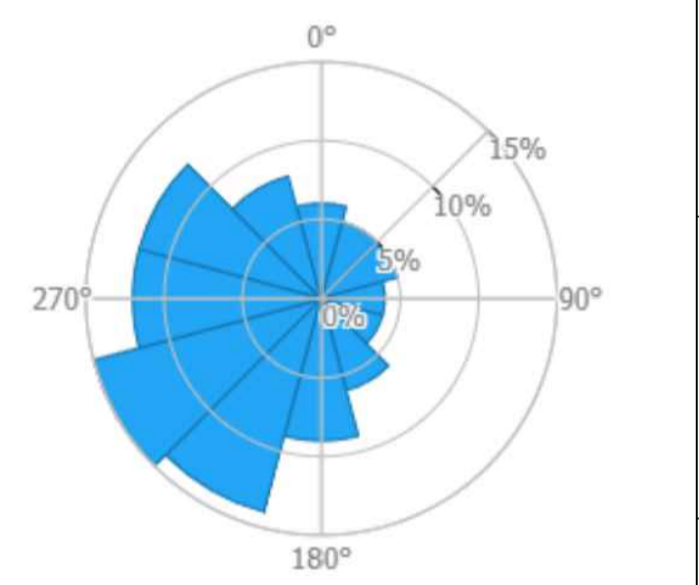


NOTES:

1. EQUIPMENT DETAILS, CONFIGURATION AND DIMENSIONS WITHIN BATTERY STORAGE COMPOUND ARE INDICATIVE AND SUBJECT TO PRELIMINARY DESIGN.

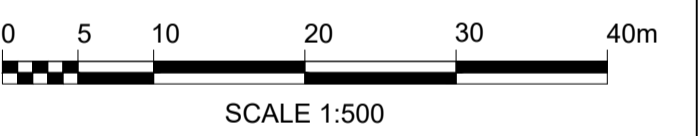

SHEET 1 OF 2




4	BM	DC	CH	2025-03-03	Updated existing water infrastructure	
3	BM	DC	CH	2025-12-19	General Amendments	
2	FC	AP	CH	2025-05-02	Scale bar added	
1	AL	AP	CH	2025-04-11	Final Issue	
ISSUE		DRAWN	CHKD	APPD	DATE	REVISION NOTES
PURPOSE		PRELIMINARY			OSGB 1936	
SCALE		1:500 @ A1		DATUM N/A		
LAYOUT DWG		N/A		T.LAYOUT NO. N/A		

PROJECT TITLE
**STEEPLE RENEWABLES PROJECT
EN010163**

DRAWING TITLE
**2.25 - OUTLINE FIRE RISK
MANAGEMENT LAYOUT
APFP REG 5(2)(O)**

RES DRAWING NUMBER
04954-RES-LAY-DR-PE-012 REV **4**


THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LIMITED AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION

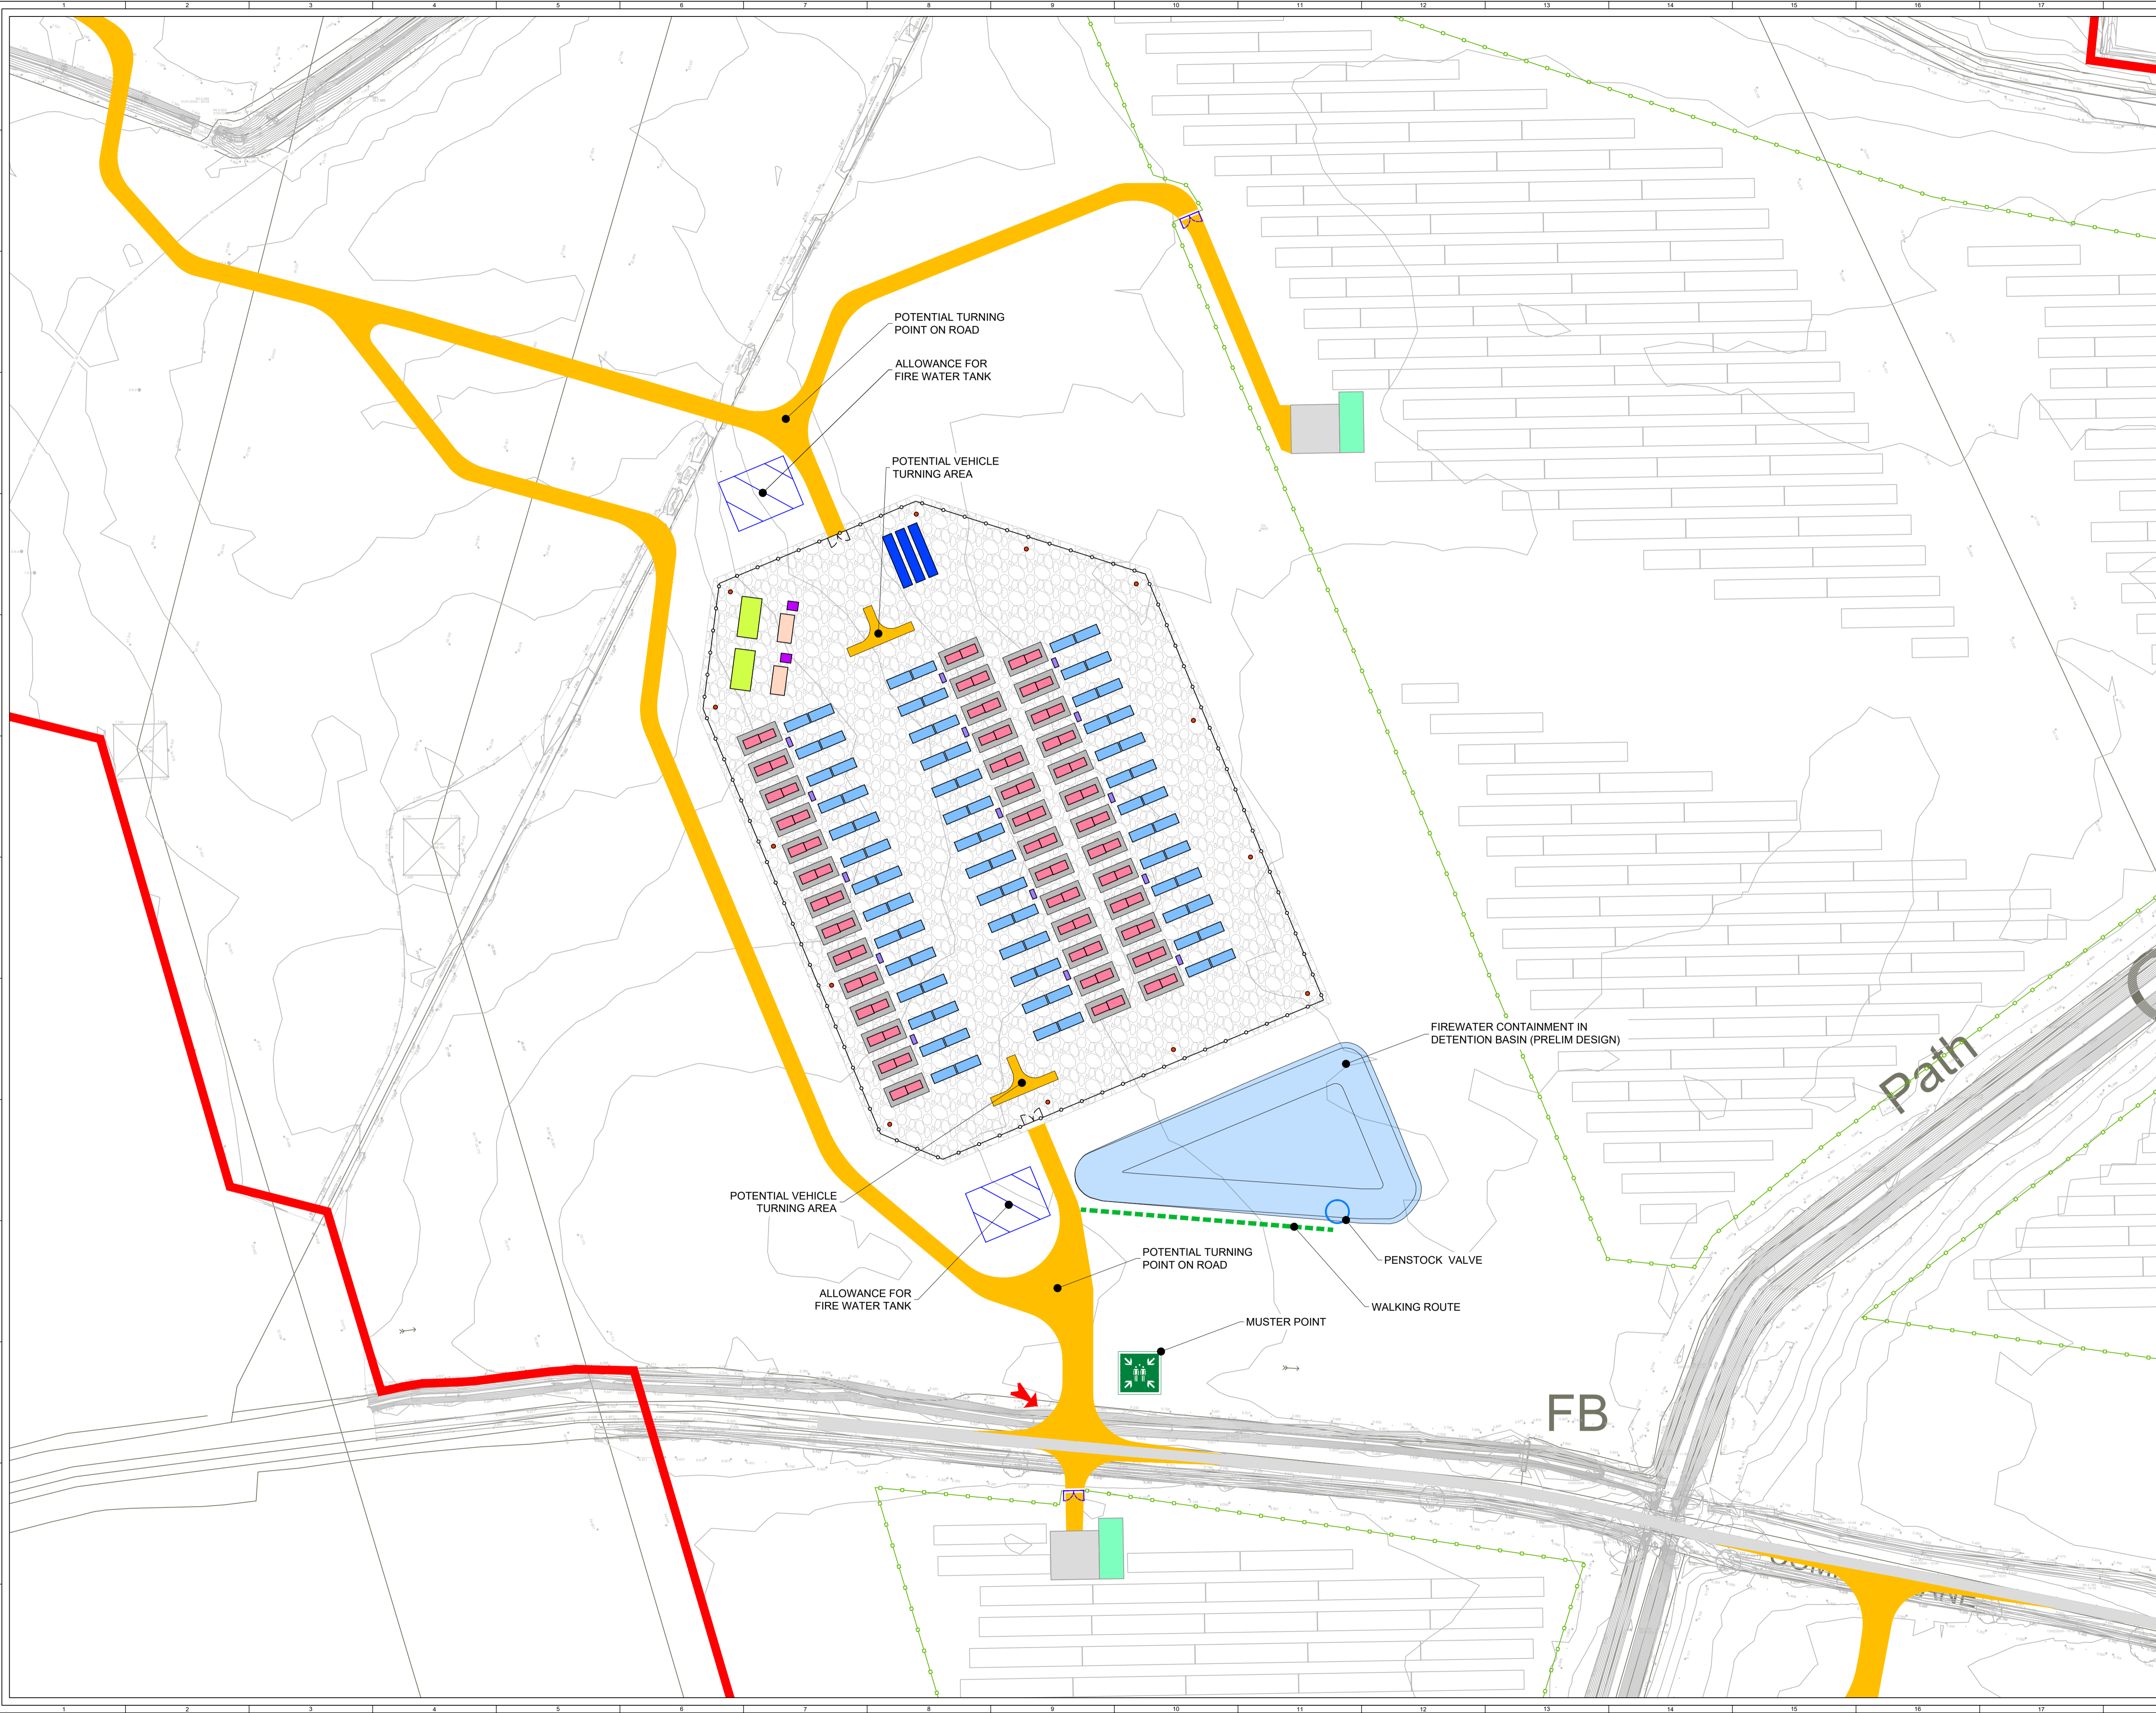


- KEY (BESS LAYOUT):**
- ORDER LIMIT (OUTSIDE EDGE OF LINE DENOTES BOUNDARY)
 - PALISADE / WELDMESH OR ACOUSTIC FENCE
 - BATTERY STORAGE ENCLOSURE (BSE)
 - POWER CONVERSION SYSTEM (PCS) WITH SINGLE MV SKID AND APRON SLAB
 - BESS SUBSTATION BUILDING
 - AUXILIARY TRANSFORMER
 - LV SWITCHGEAR ROOM
 - AGGREGATION PANEL WITH LV PILLAR
 - SPARES CONTAINER
 - LIGHTING / CCTV COLUMN
 - GRAVEL FINISH
 - ACCESS TRACK
 - ← SITE ENTRANCE
 - (WAT) WATER MAINS (ANGLIAN WATER RECORD)

- KEY (SOLAR LAYOUT):**
- HARDSTAND
 - INVERTER AREA
 - SUBSTATION
 - FENCE
 - SOLAR PANELS
 - GATE


SITE WIND FREQUENCY ROSE

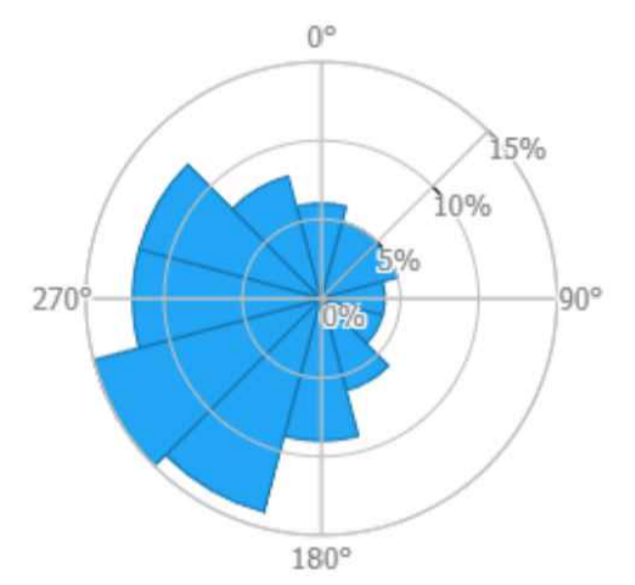

- NOTES:**
1. EQUIPMENT DETAILS, CONFIGURATION AND DIMENSIONS WITHIN BATTERY STORAGE COMPOUND ARE INDICATIVE AND SUBJECT TO PRELIMINARY DESIGN.

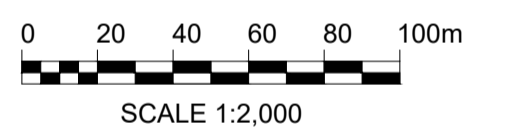

SHEET 2 OF 2



4	BM	DC	CH	2025-03-03	Updated existing water infrastructure
3	BM	DC	CH	2025-12-19	General Amendments
2	FC	AP	CH	2025-05-02	Scale bar added
1	AL	AP	CH	2025-04-11	Final Issue
ISSUE (DRAWN)		CHD	APPD	DATE	REVISION NOTES
PURPOSE		PRELIMINARY		COORDINATES OSGB 1936	
SCALE		1:2,000 @ A1		DATUM N/A	
LAYOUT DWG		N/A		T-LAYOUT NO. N/A	

PROJECT TITLE
STEPPLE RENEWABLES PROJECT EN010163

DRAWING TITLE
2.25 - OUTLINE FIRE RISK MANAGEMENT LAYOUT APFP REG 5(2)(O)

RES DRAWING NUMBER
04954-RES-LAY-DR-PE-012 REV **4**

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LIMITED AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION

BEAUFORT COURT,
EGG FARM LANE,
KINGS LANGLEY,
HERTS WD4 8LR, UK
TEL: +44 (0) 1923 290200
WWW.RES-GROUP.COM

