



- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Temporary Highway Improvement Area
 - Solar PV Sites
 - 400kV Substation
 - 132kV Substation
 - BESS Area
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only
 - Solar PV Crossing Location

For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan

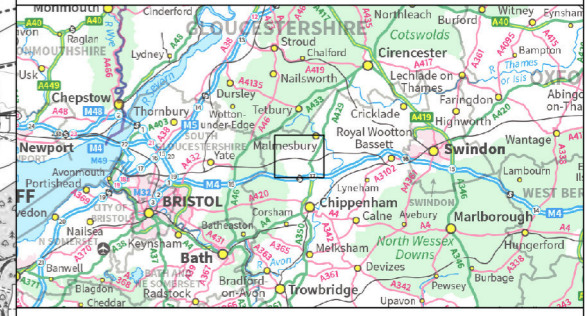

APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0199

Coordinate system: British National Grid
Scale: 1:30,000 @ A3



385000


386000

387000

186000

185000

184000

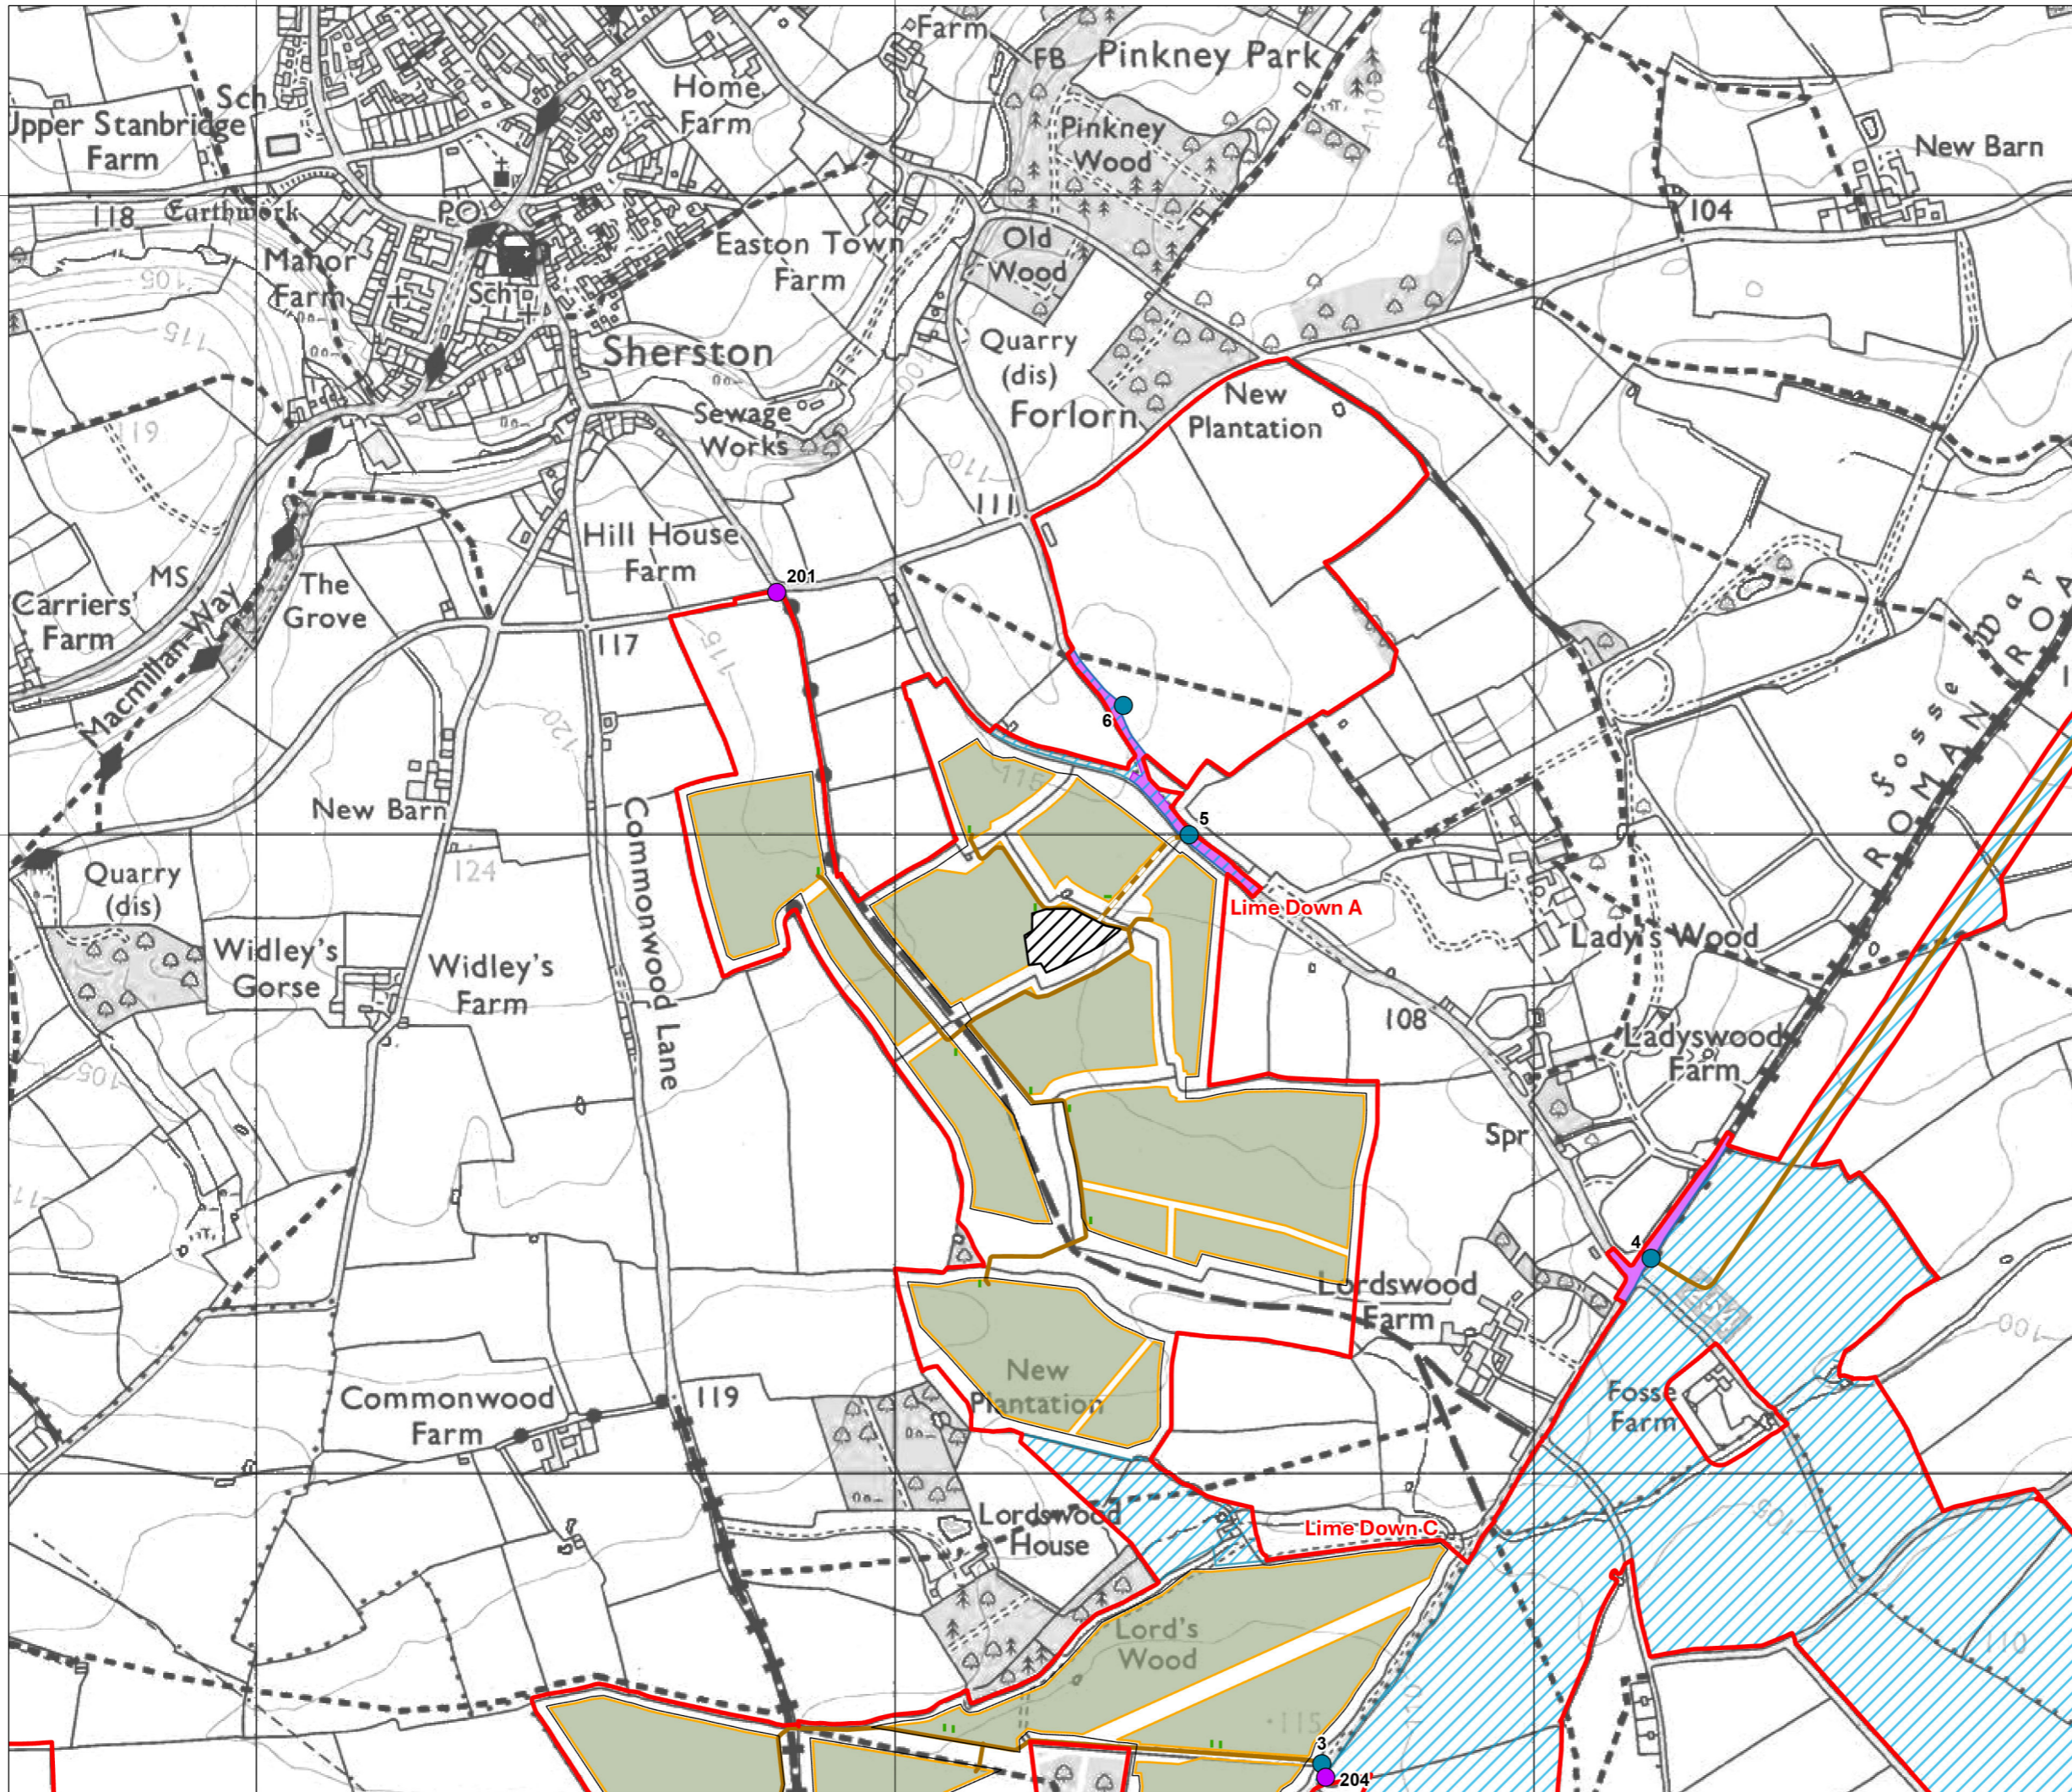

Title:
Figure 3-1-1: Indicative Site Layout Plan
Lime Down A

Document:
Volume 2
The Scheme
Environmental Statement (ES)


- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Solar PV Sites
 - 132kV Substation
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only
 - Solar PV Crossing Location

For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan

Data: IGP, 2026
Base map: © Crown copyright and database rights 2026 Ordnance Survey 0100031673.




APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0233

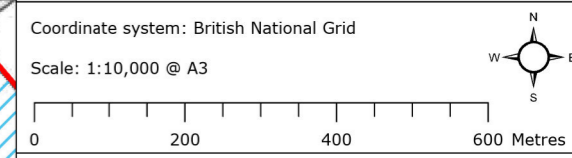

- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Solar PV Sites
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only
 - Solar PV Crossing Location

For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan



Data: IGP, 2026
Base map: © Crown copyright and database rights 2026 Ordnance Survey 0100031673.

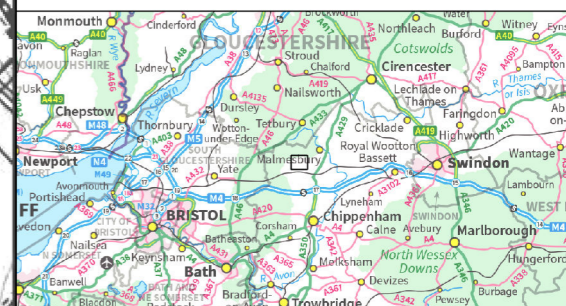

APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0233

Coordinate system: British National Grid

Scale: 1:10,000 @ A3

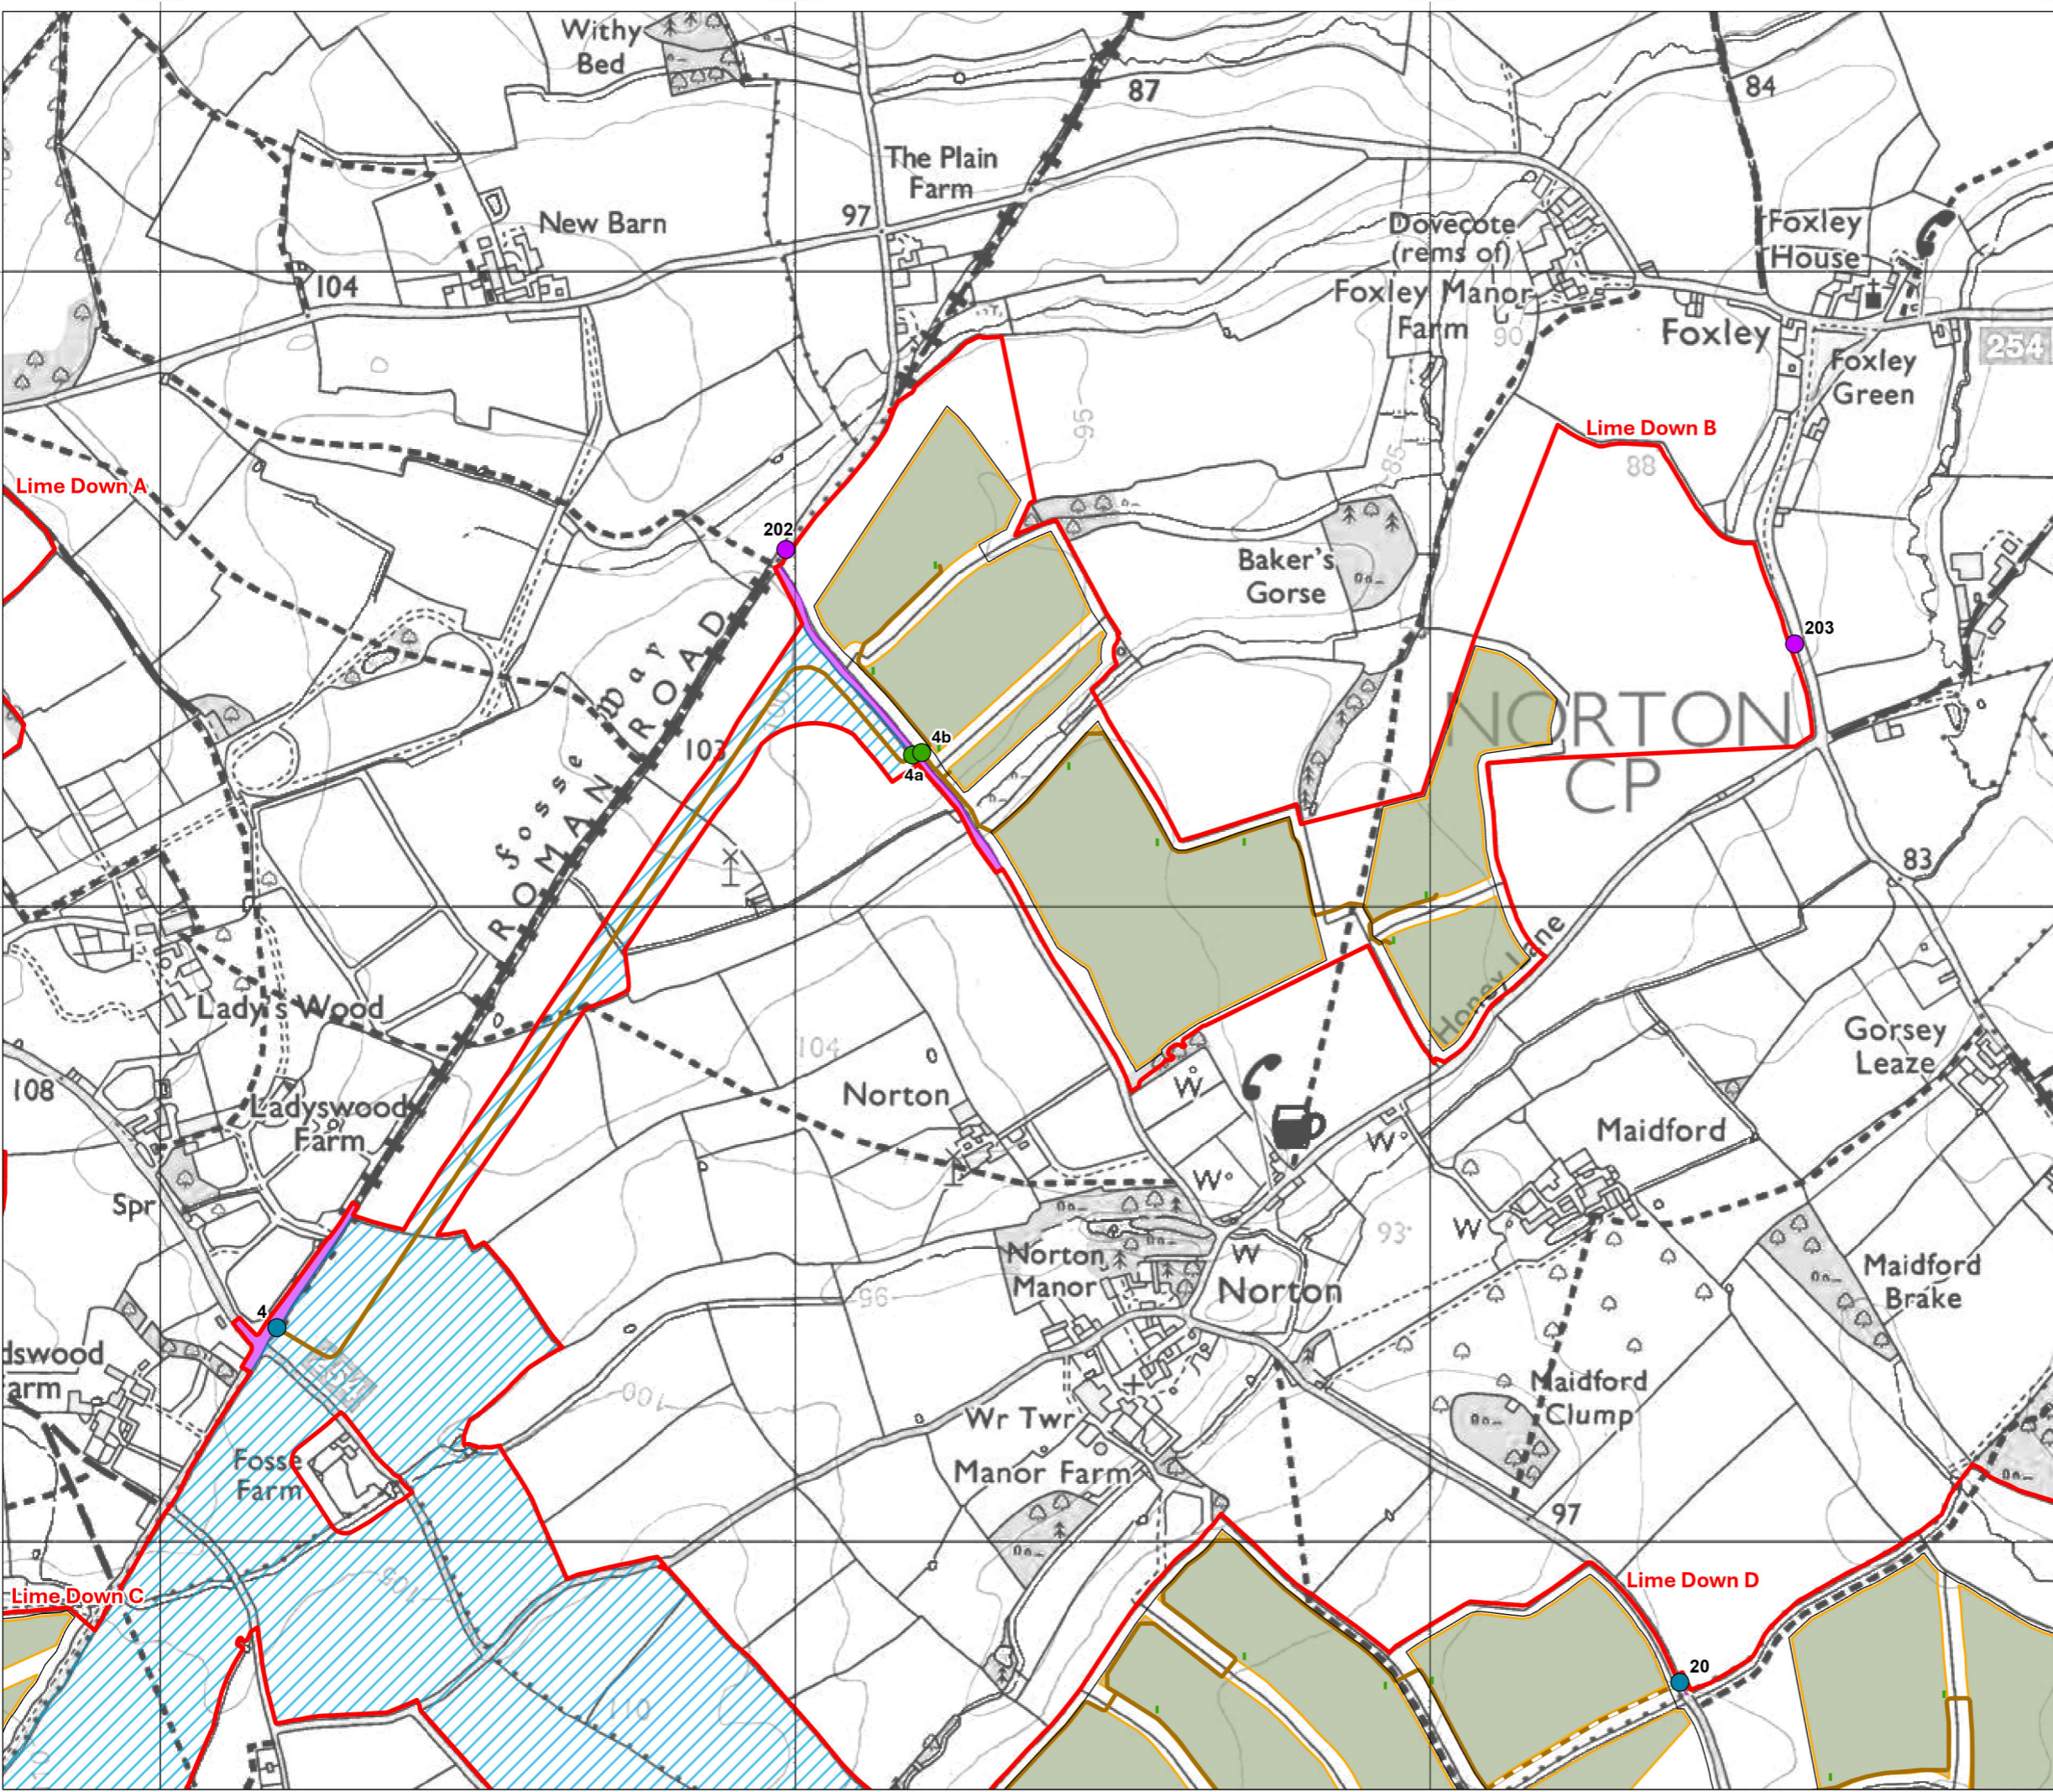

385000

386000

387000

388000



Title: Figure 3-1-3: Indicative Site Layout Plan Lime Down C

Document: Volume 2 The Scheme Environmental Statement (ES)

- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Temporary Highway Improvement Area
 - Solar PV Sites
 - 400kV Substation
 - 132kV Substation
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only


For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan

Data: IGP, 2026
Base map: © Crown copyright and database rights 2026 Ordnance Survey 0100031673.



APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0233


Coordinate system: British National Grid
Scale: 1:12,500 @ A3

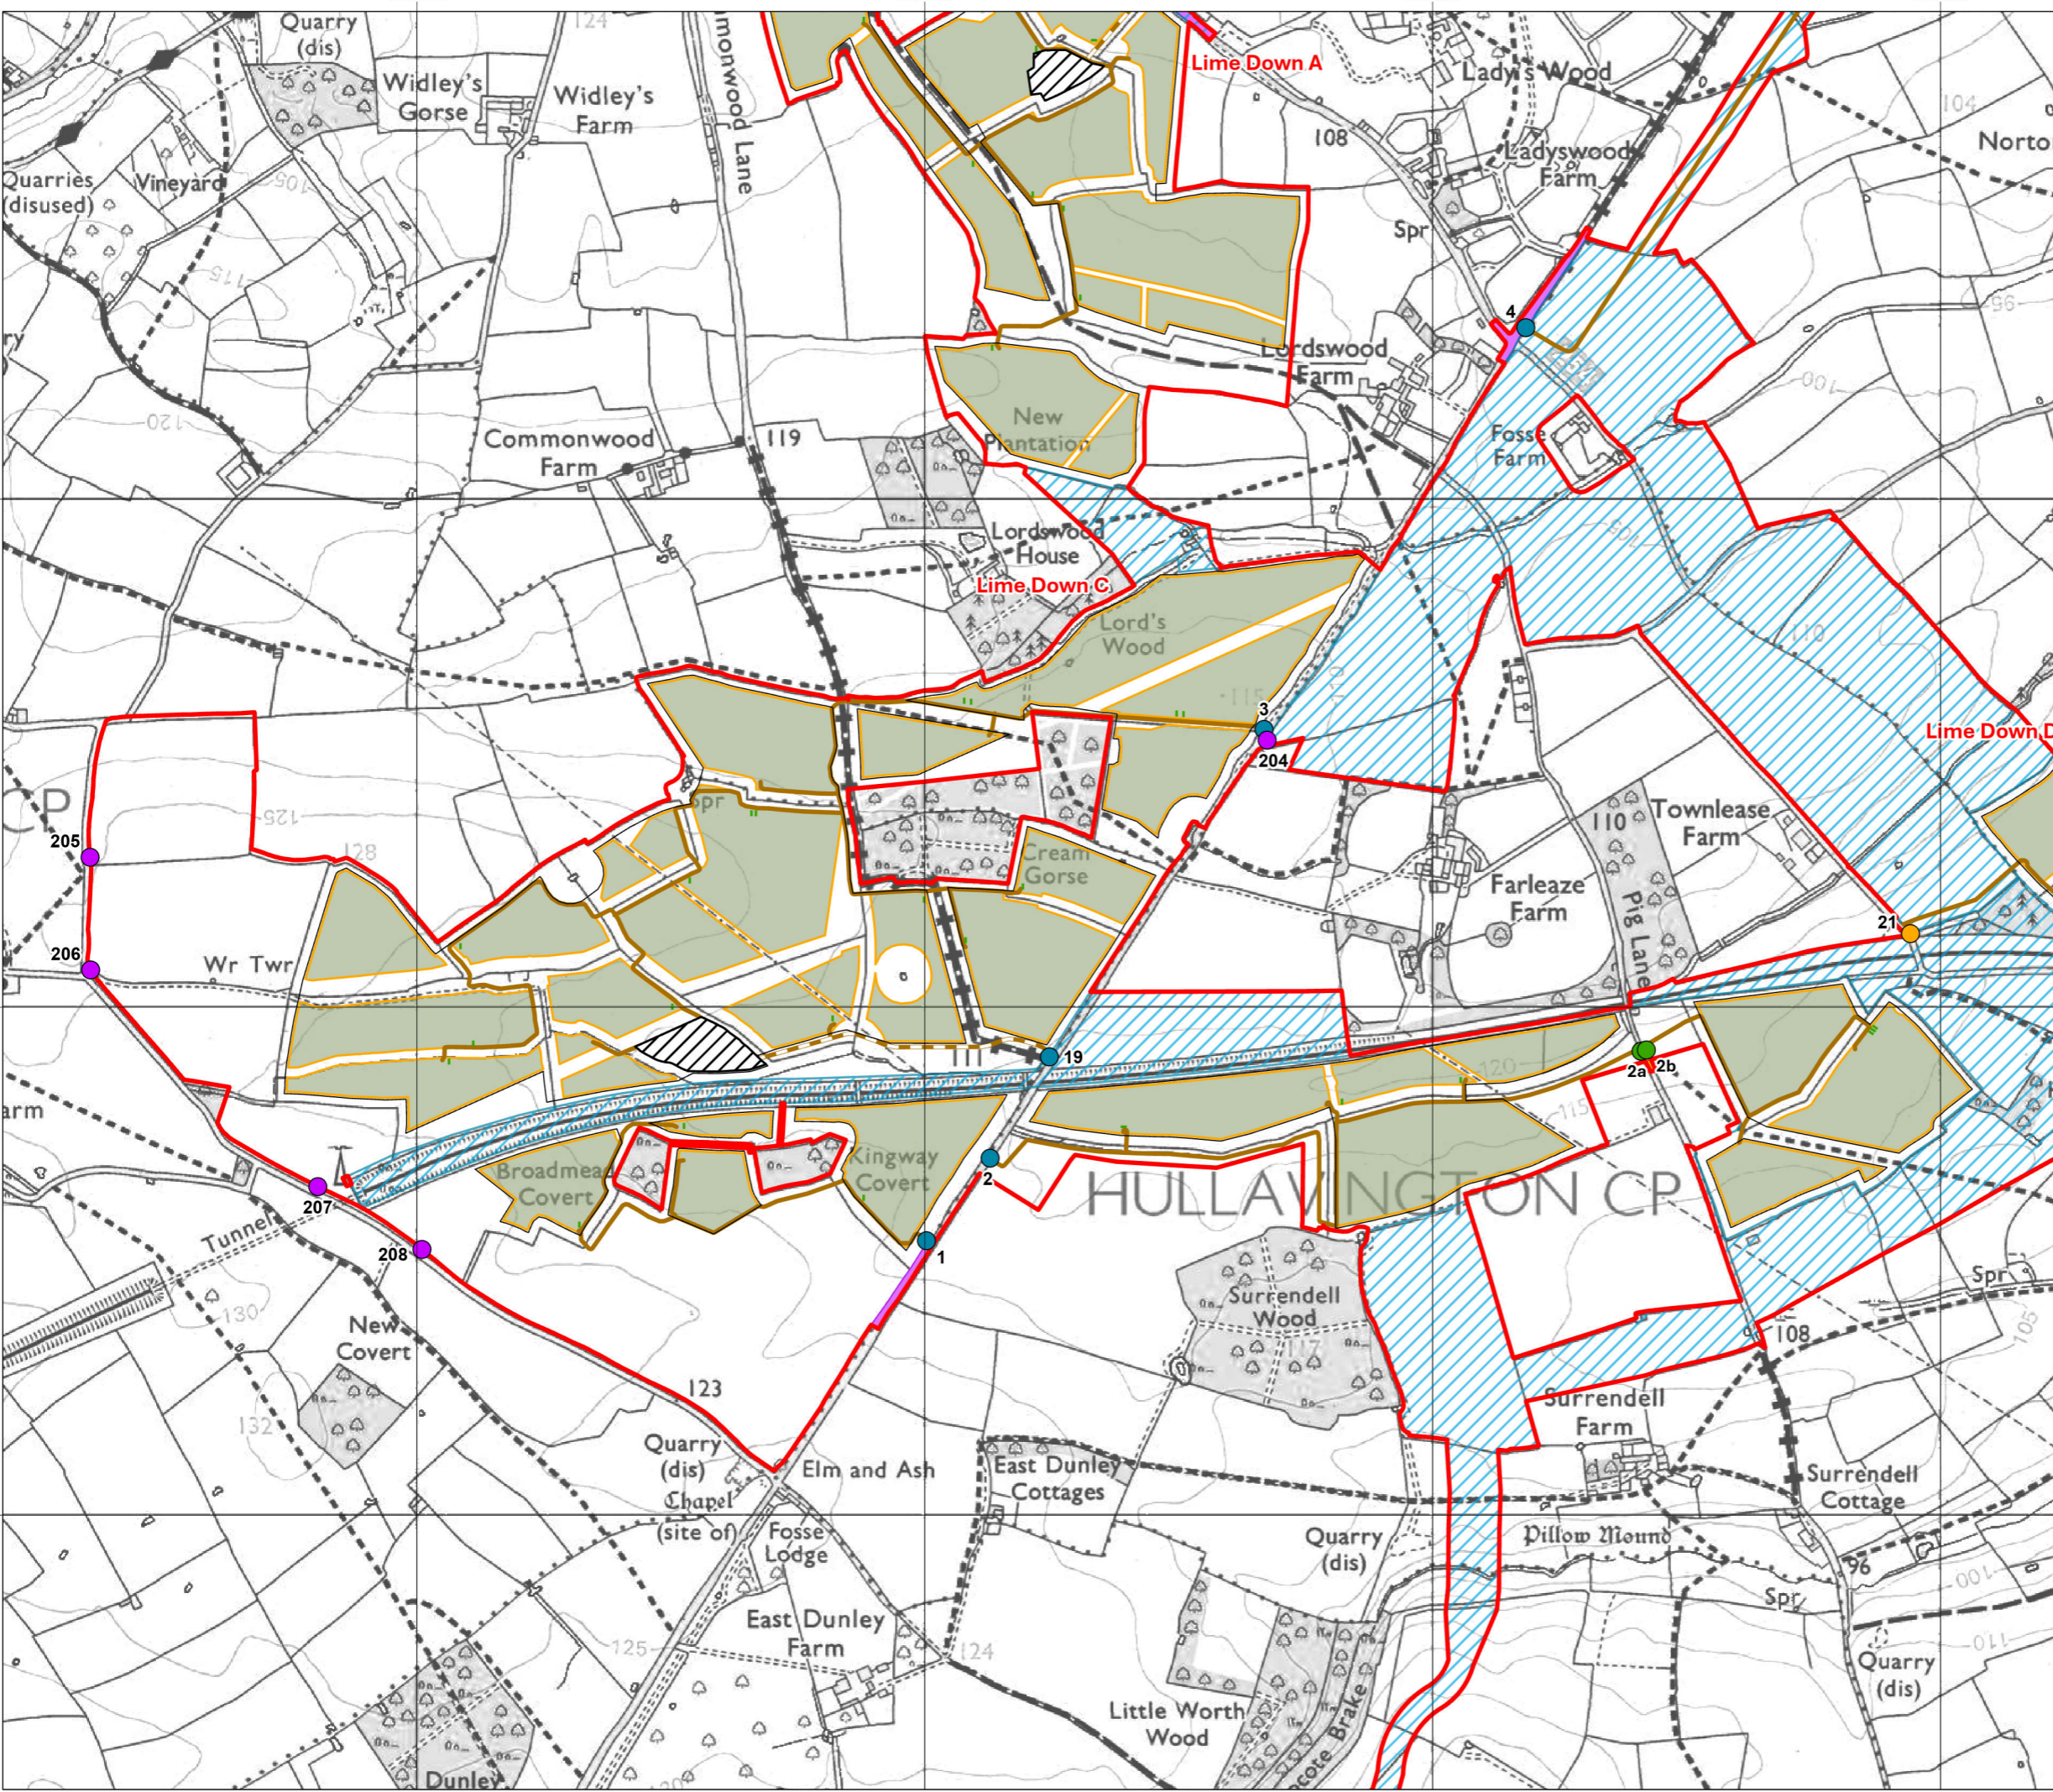

184000

183000


182000

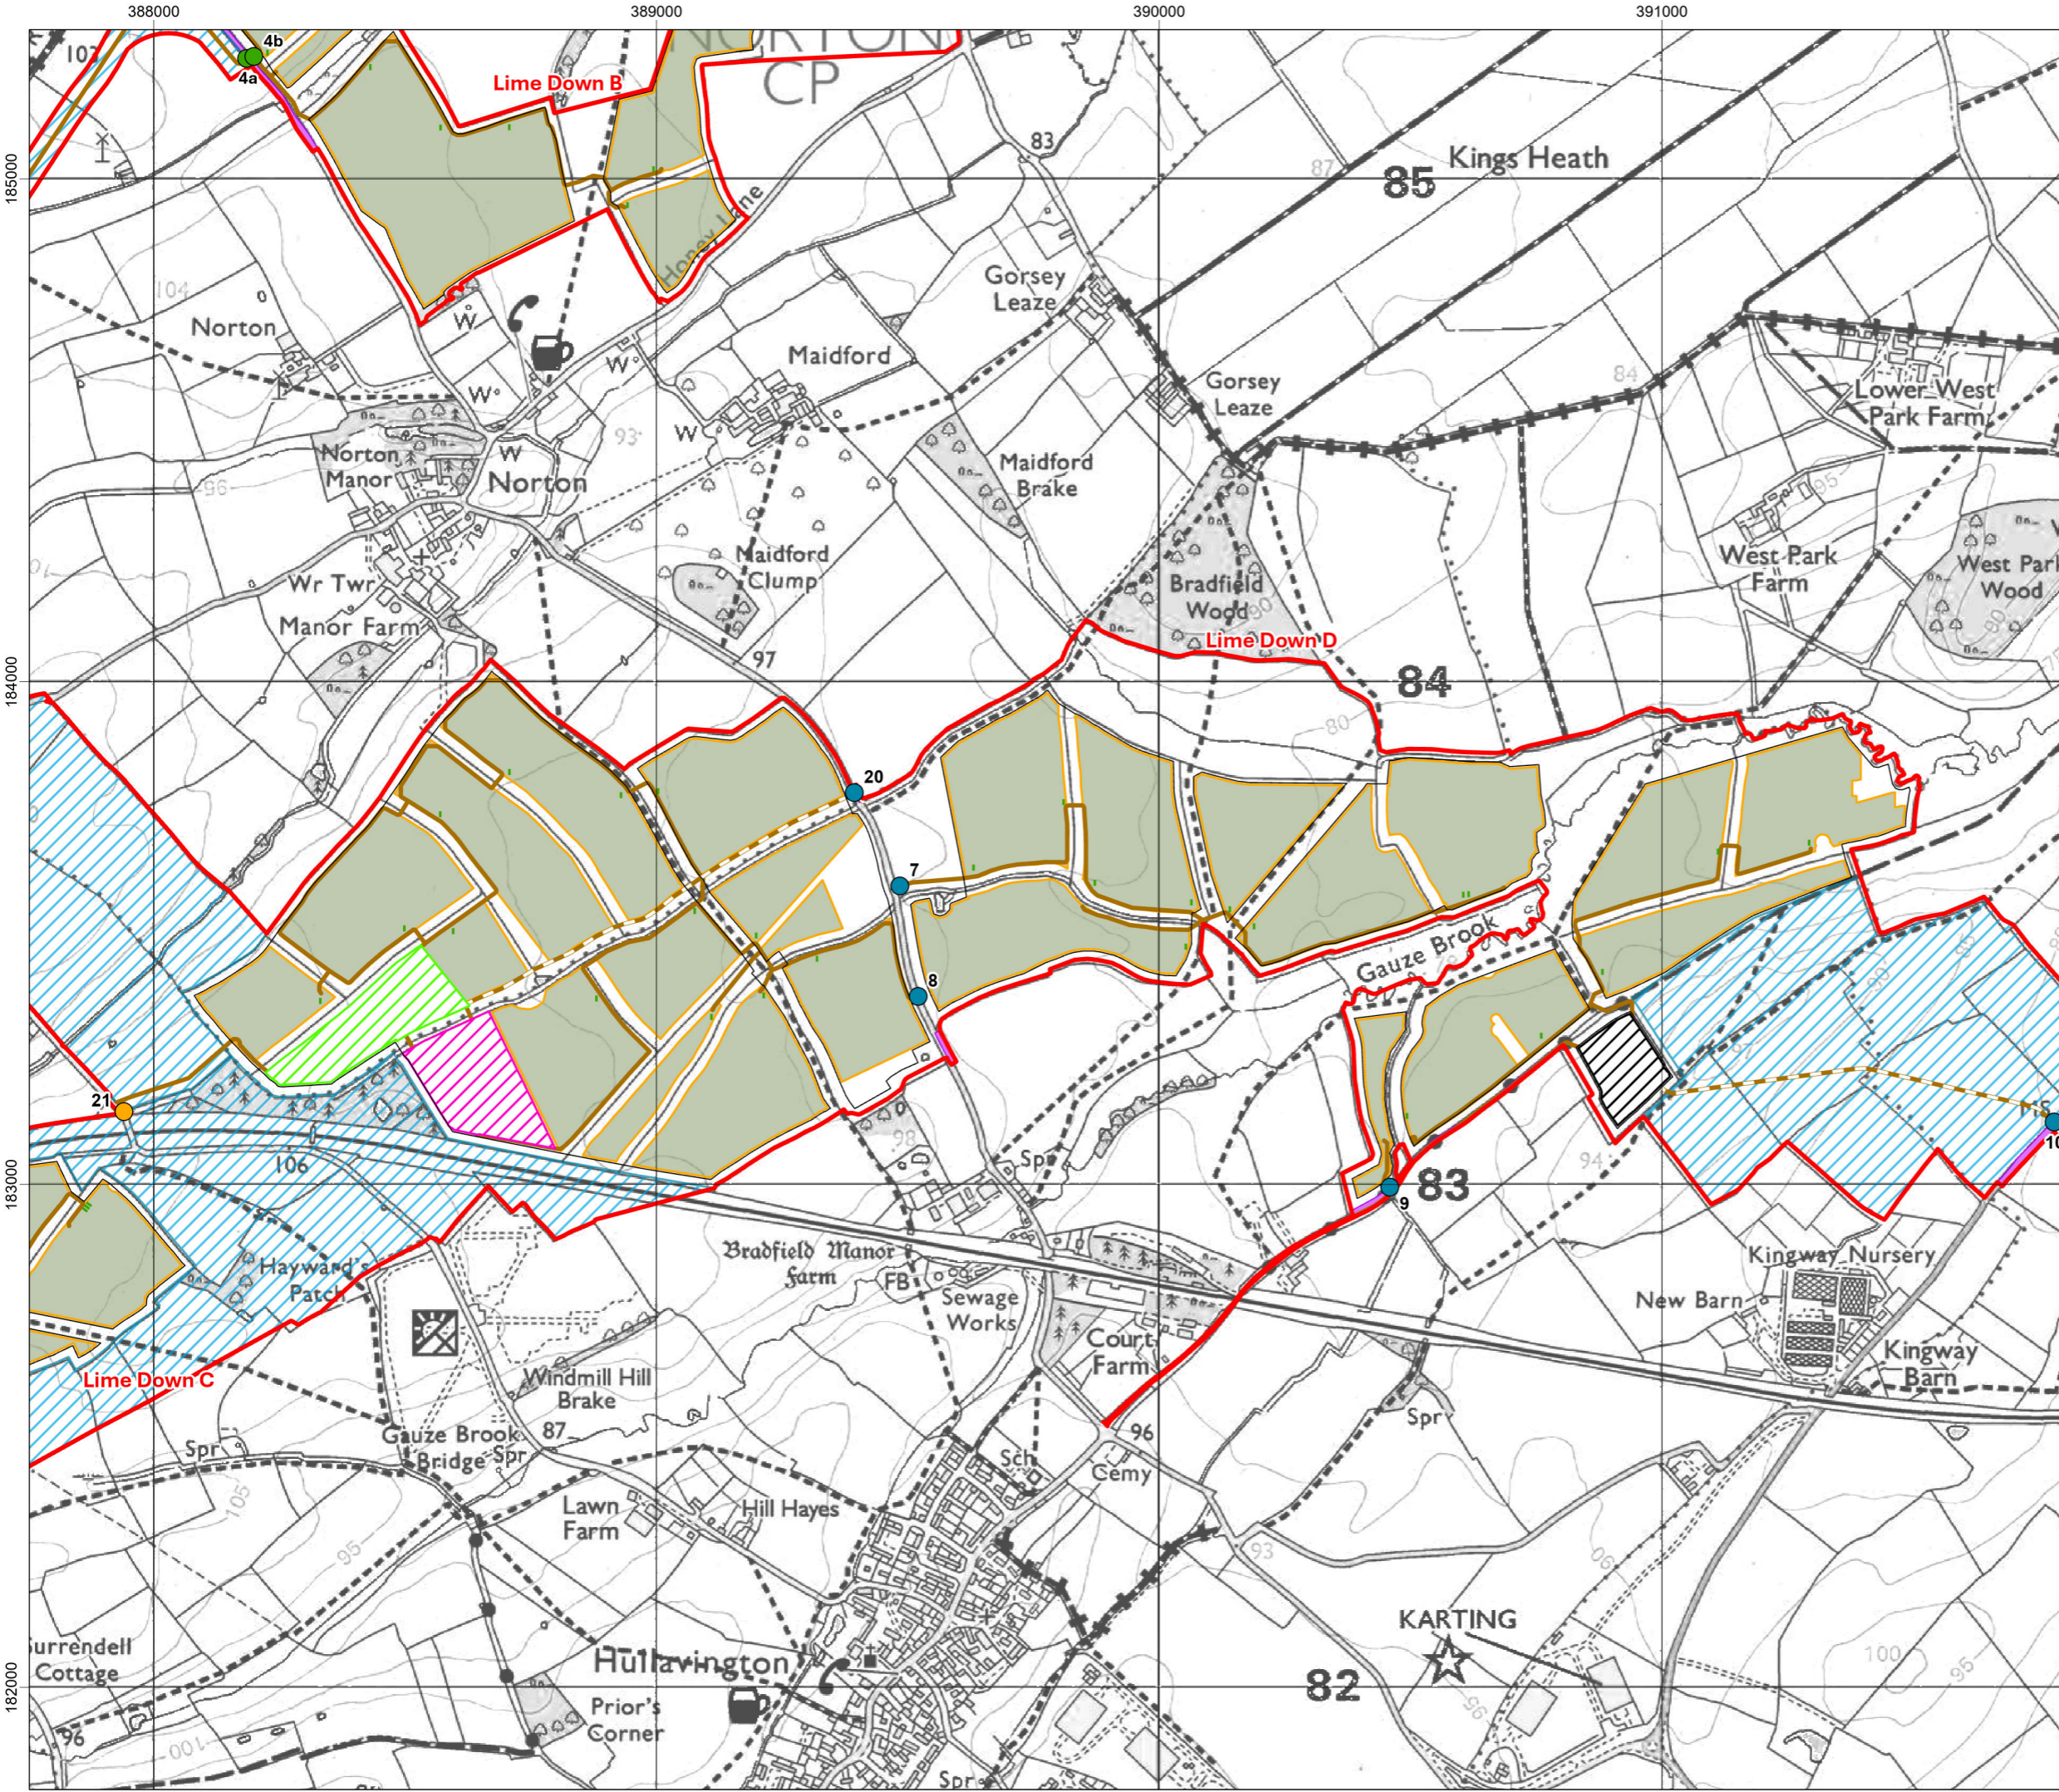

- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Solar PV Sites
 - 400kV Substation
 - 132kV Substation
 - BESS Area
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only



For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan

Data: IGP, 2026
Base map: © Crown copyright and database rights 2026 Ordnance Survey 0100031673.

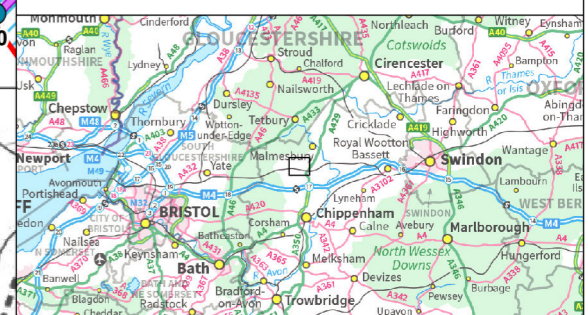

APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0233

Coordinate system: British National Grid
Scale: 1:12,500 @ A3



392000

393000

394000




Title: Figure 3-1-5: Indicative Site Layout Plan Lime Down E

Document: Volume 2 The Scheme Environmental Statement (ES)

- Legend:
- Order Limits
 - Cable Route Corridor
 - Permanent Highway Improvement Area
 - Solar PV Sites
 - 132kV Substation
 - Conversion Unit / 33kV sub distribution switch room
 - Access track
 - Substation and BESS Access Track
 - Fence
 - Solar PV Access Location
 - Solar PV Emergency Access Location
 - Existing Access for Operational Maintenance Only
 - Solar PV Crossing Location


For further detail in relation to the proposed hedgerow and woodland planting, green corridors, mitigation areas and roadside and riparian planting, refer to the ES Figure 3-4 Landscape and Ecology Mitigation Plan

Data: IGP, 2026
Base map: © Crown copyright and database rights 2026 Ordnance Survey 0100031673.

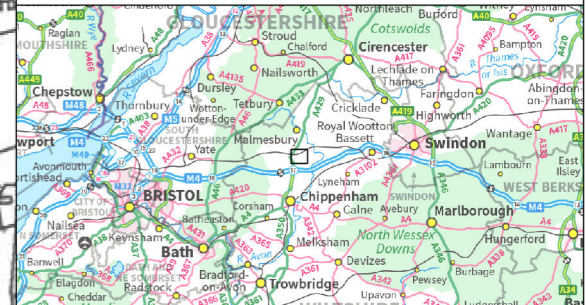

APFP Regulation: 5(2)(a)
Application Doc No.: EN010168/APP/6.2
Drawing no.: P4443_LPR_ZZ_XX_DR_Z_SCH_0233

Coordinate system: British National Grid
Scale: 1:10,000 @ A3

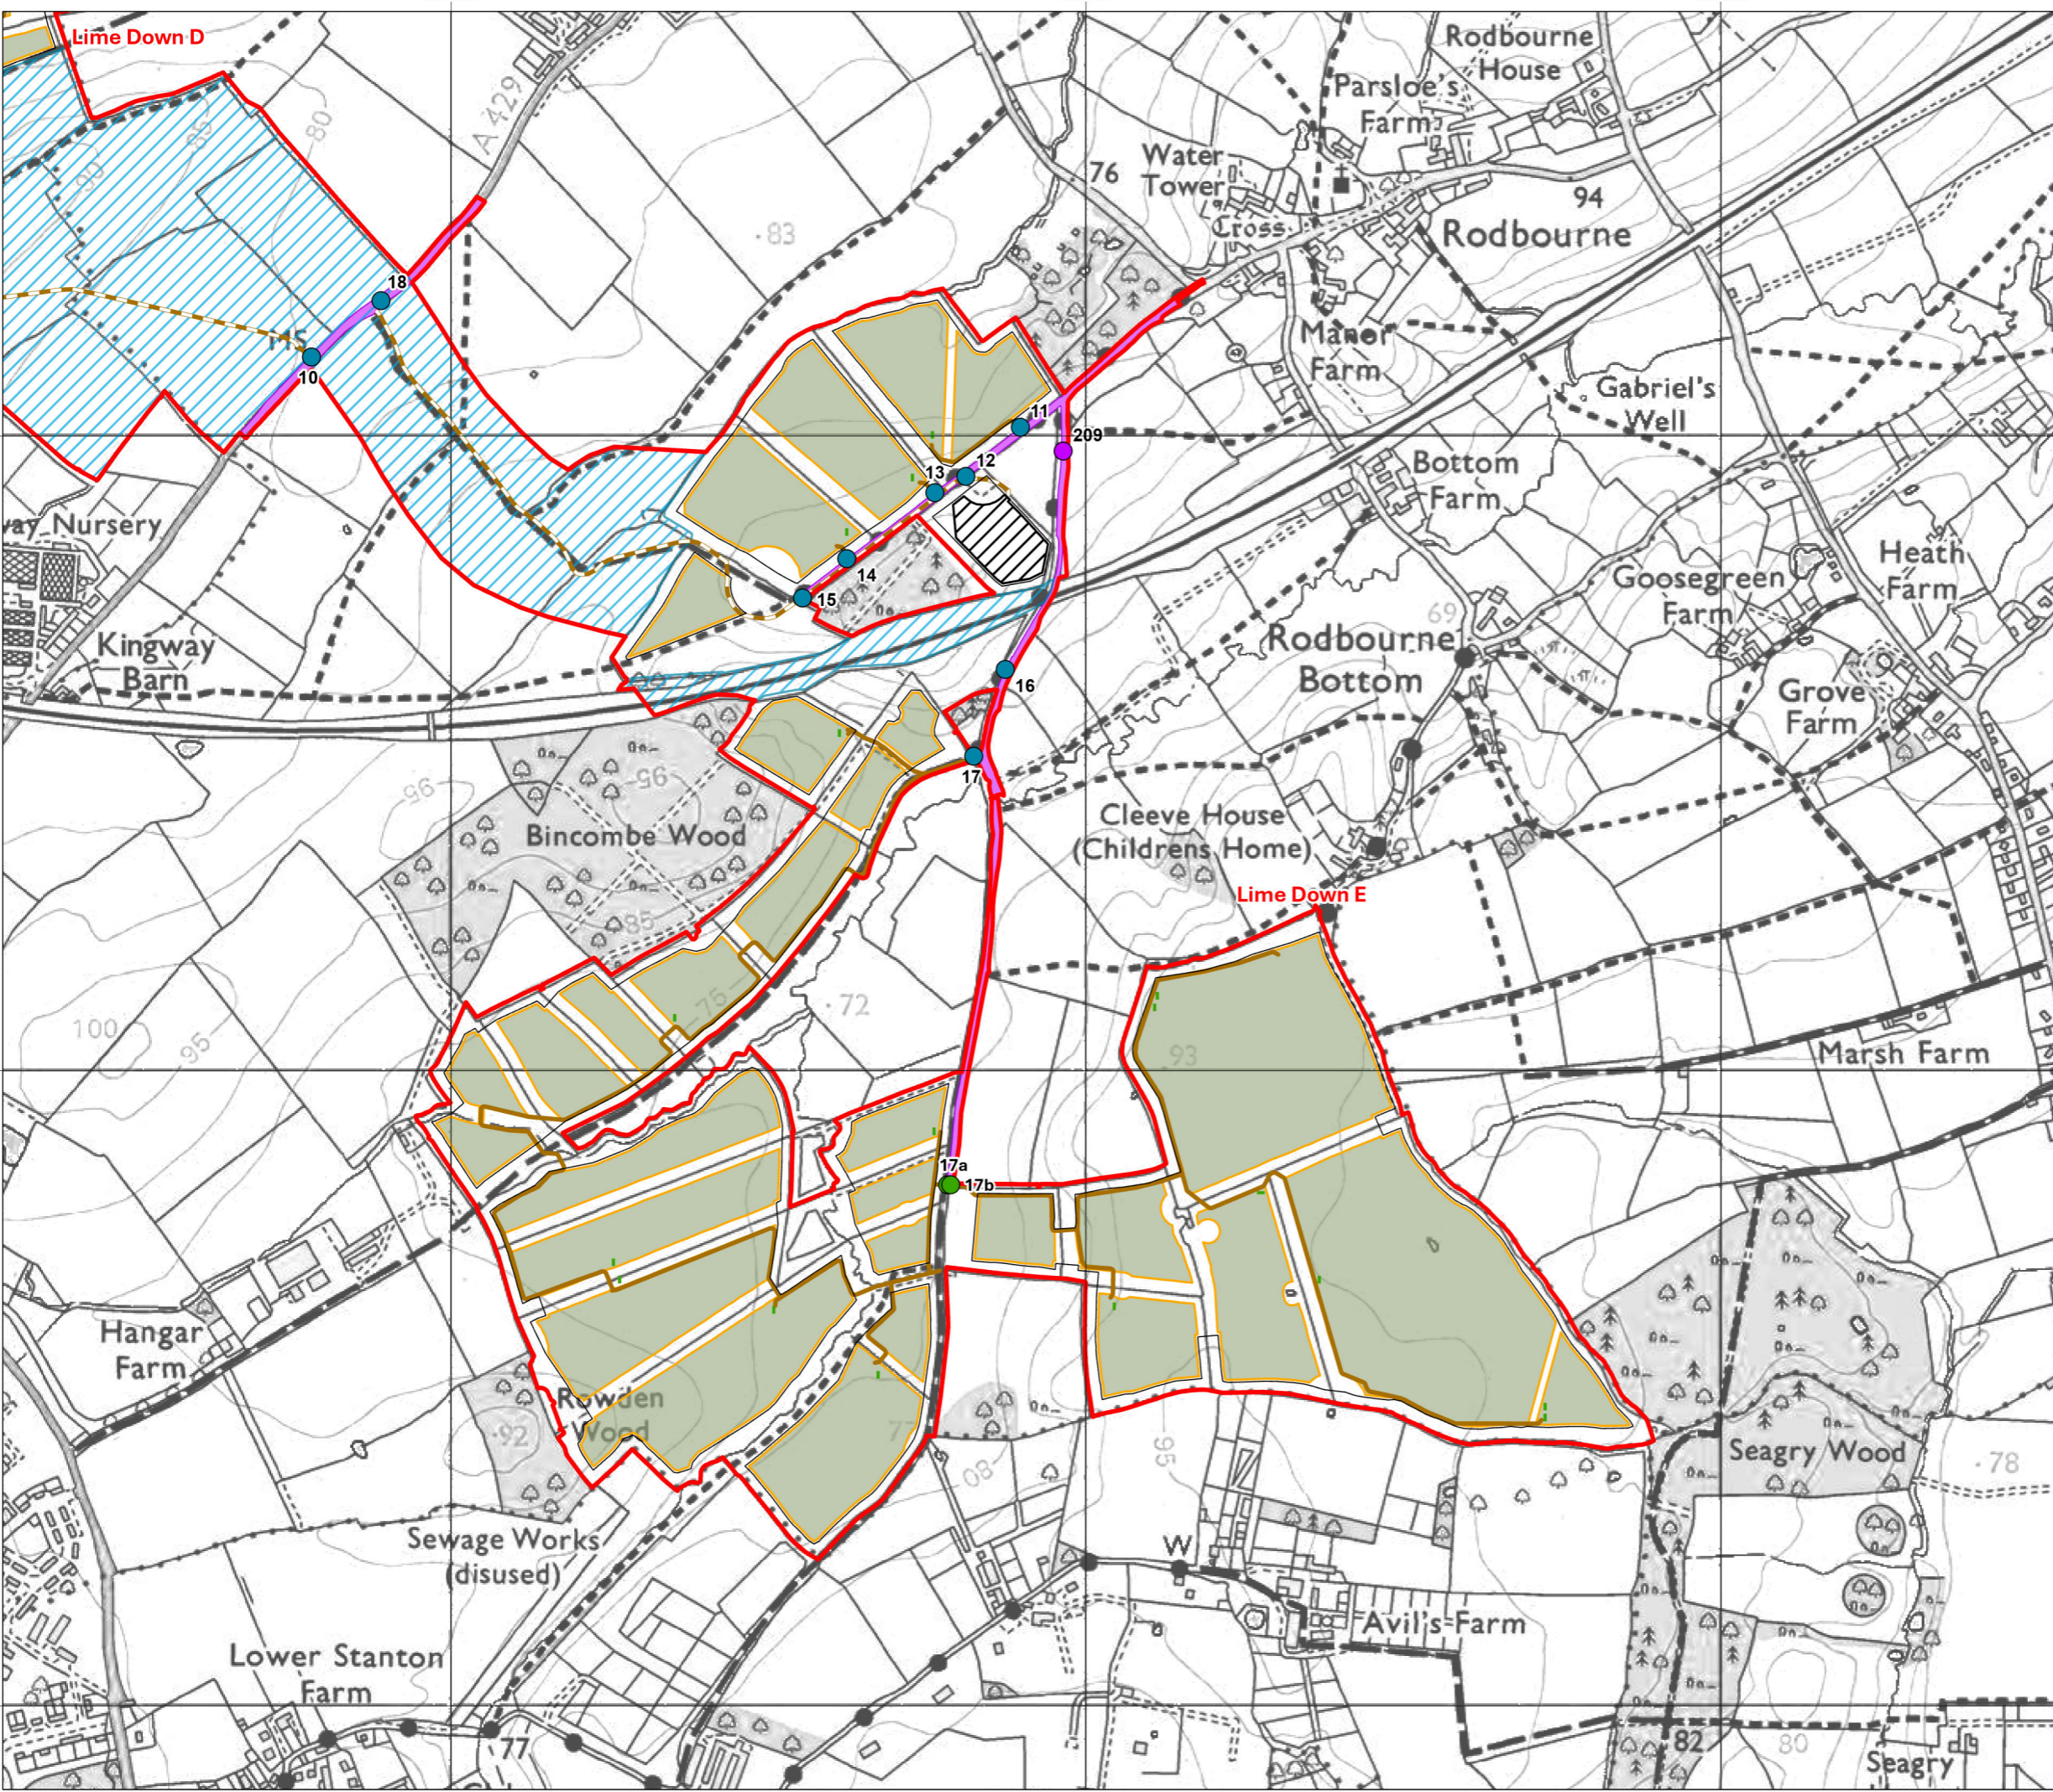

183000

182000

181000