


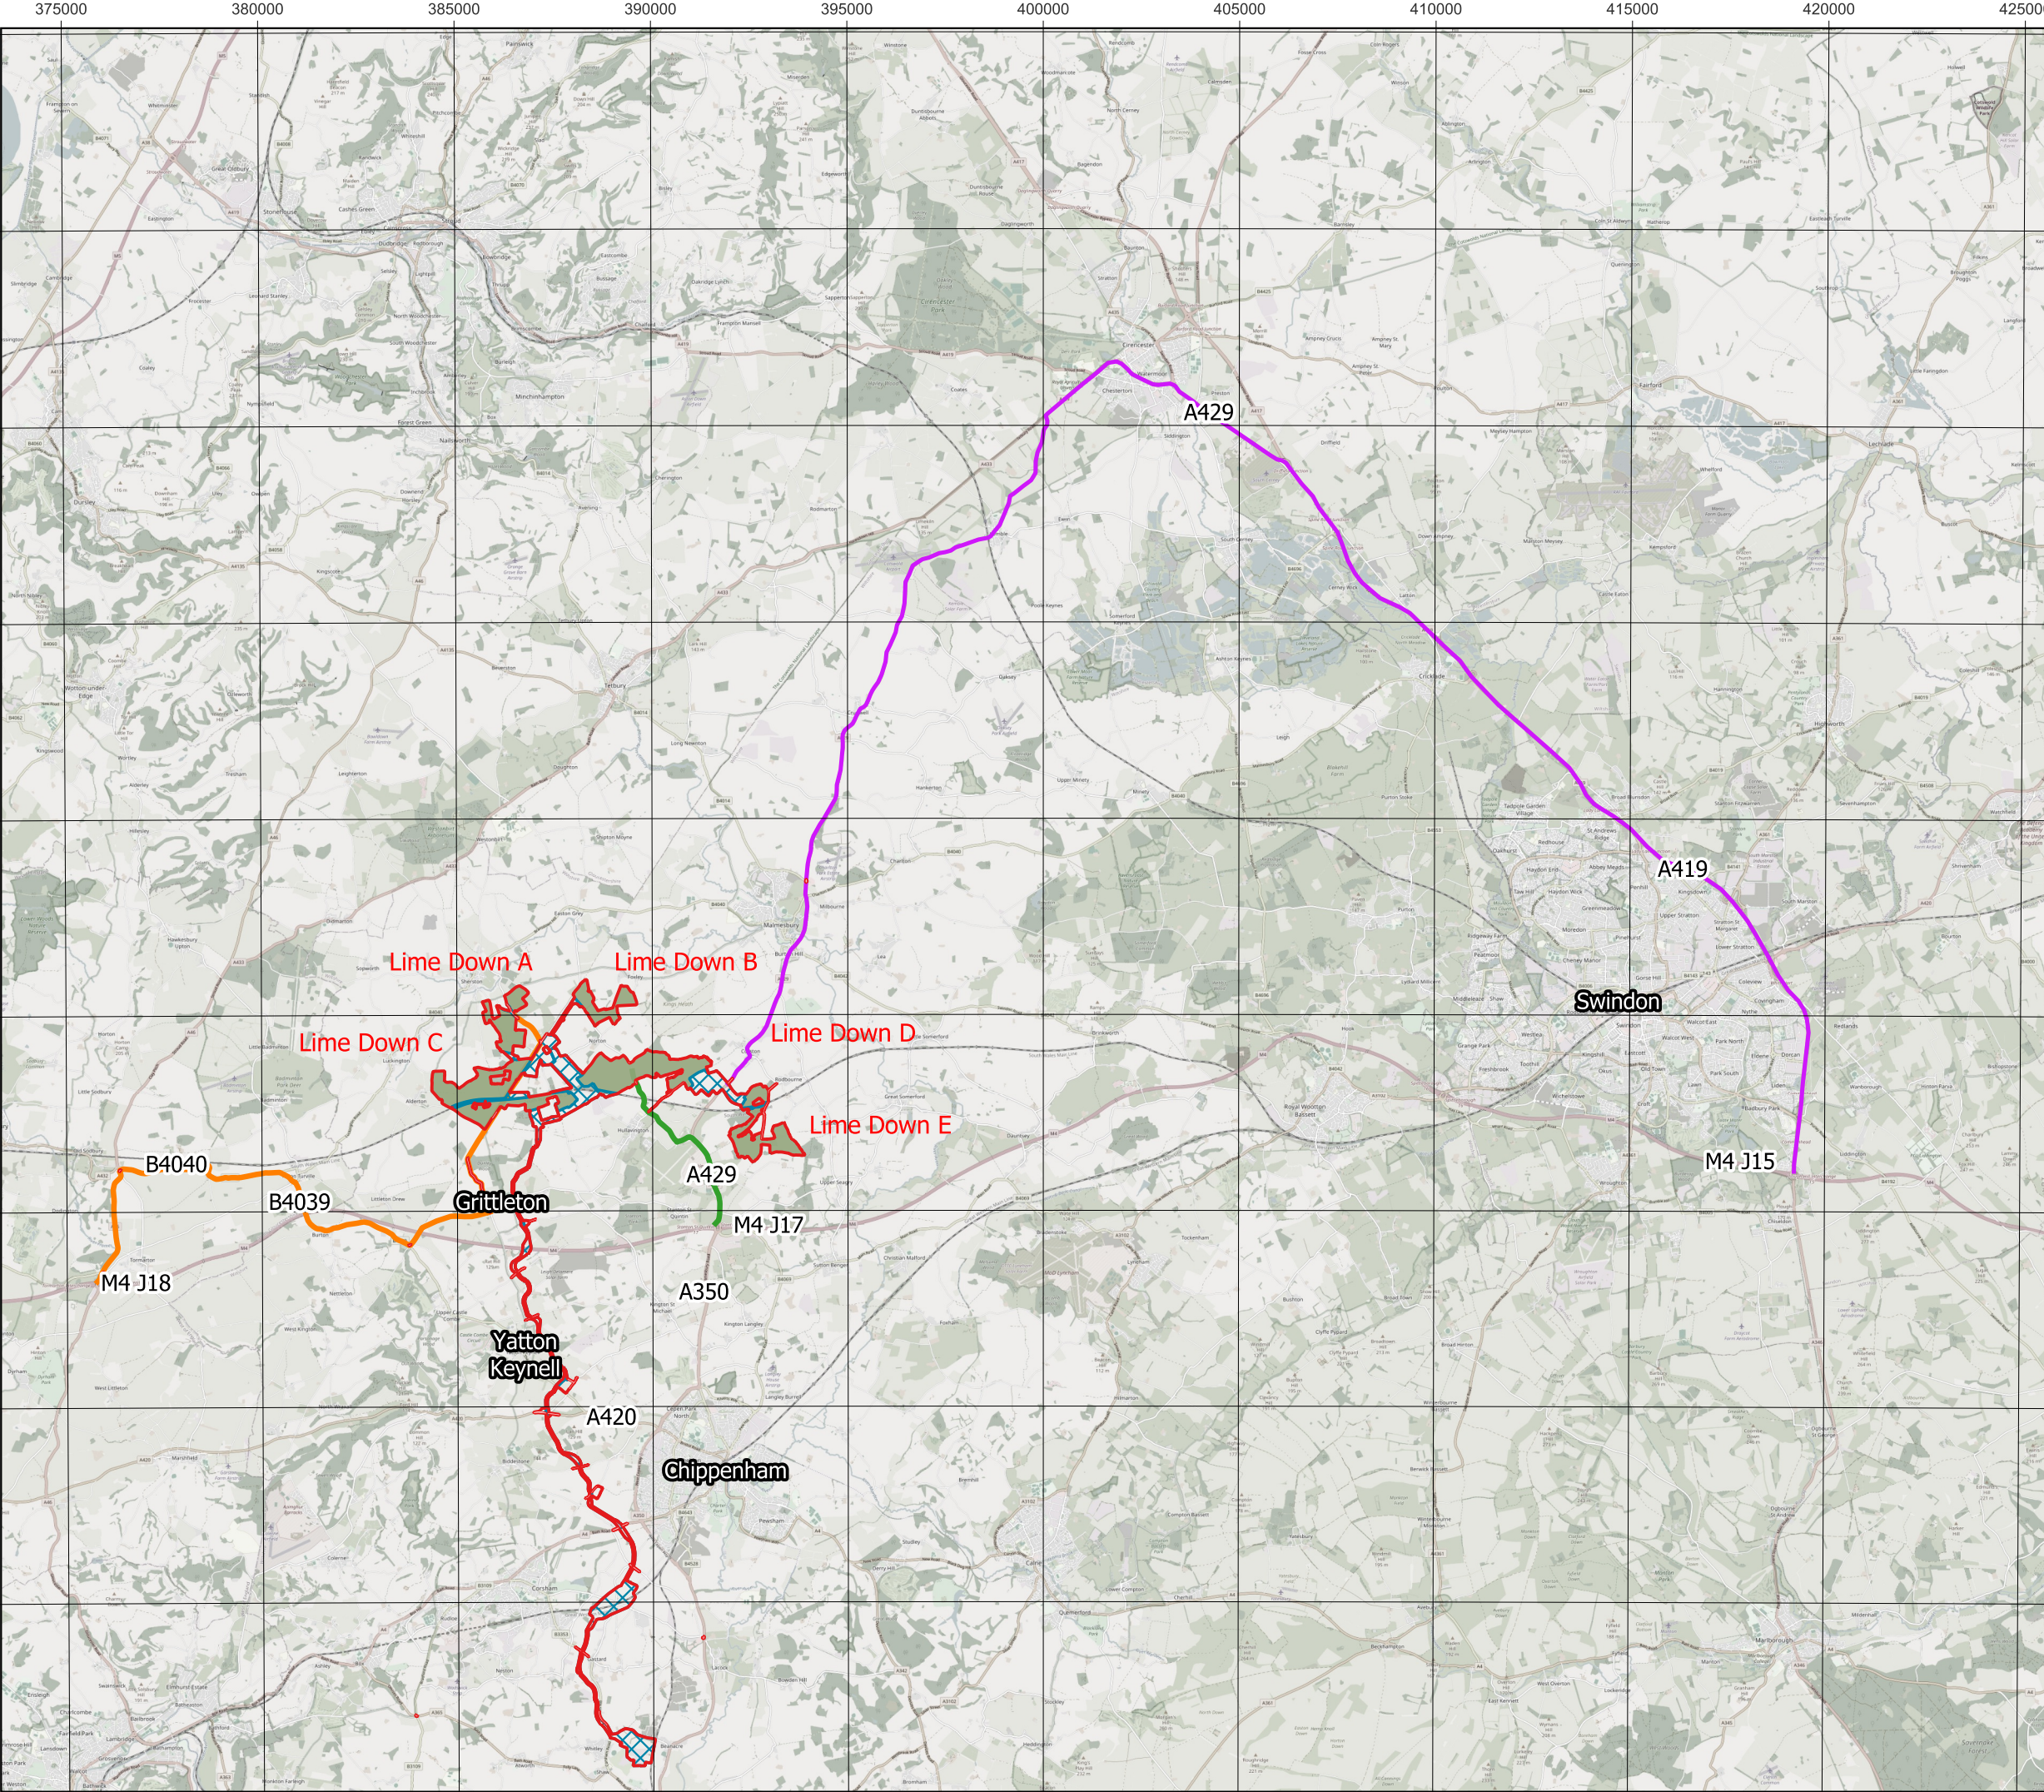


Title:
Figure 13-5: Abnormal Load Routes: Solar PV Sites

Document:
Volume 2
Transport and Access
Environmental Statement

- Legend:
- Order Limits
 - Solar PV Sites
 - Cable Route Corridor
 - Highway Improvement Areas
- Abnormal Load Routes**
- Solar PV Route 1:
Lime Down A and C
Substation AIL Route
 - Solar PV Route 2:
Lime Down D (West)
BESS and Substation AIL Route
 - Solar PV Route 3:
Lime Down D (East) and E
Substation AIL Route

Data: IGP 2026 © Crown copyright and database rights 2026 OSM Standard

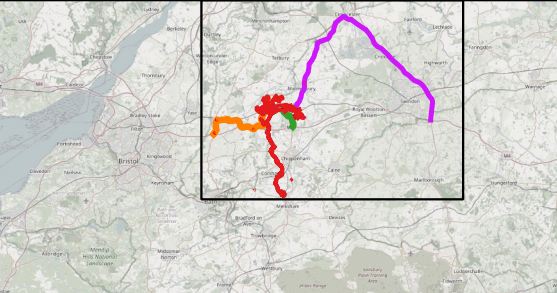

APFP Regulation: 5(2)(a)
Application Doc no.: APP / 6.2
Drawing no.: Figure 13-5

Co-ordinate system: British National Grid
Scale: 1:258573 @ A3

