




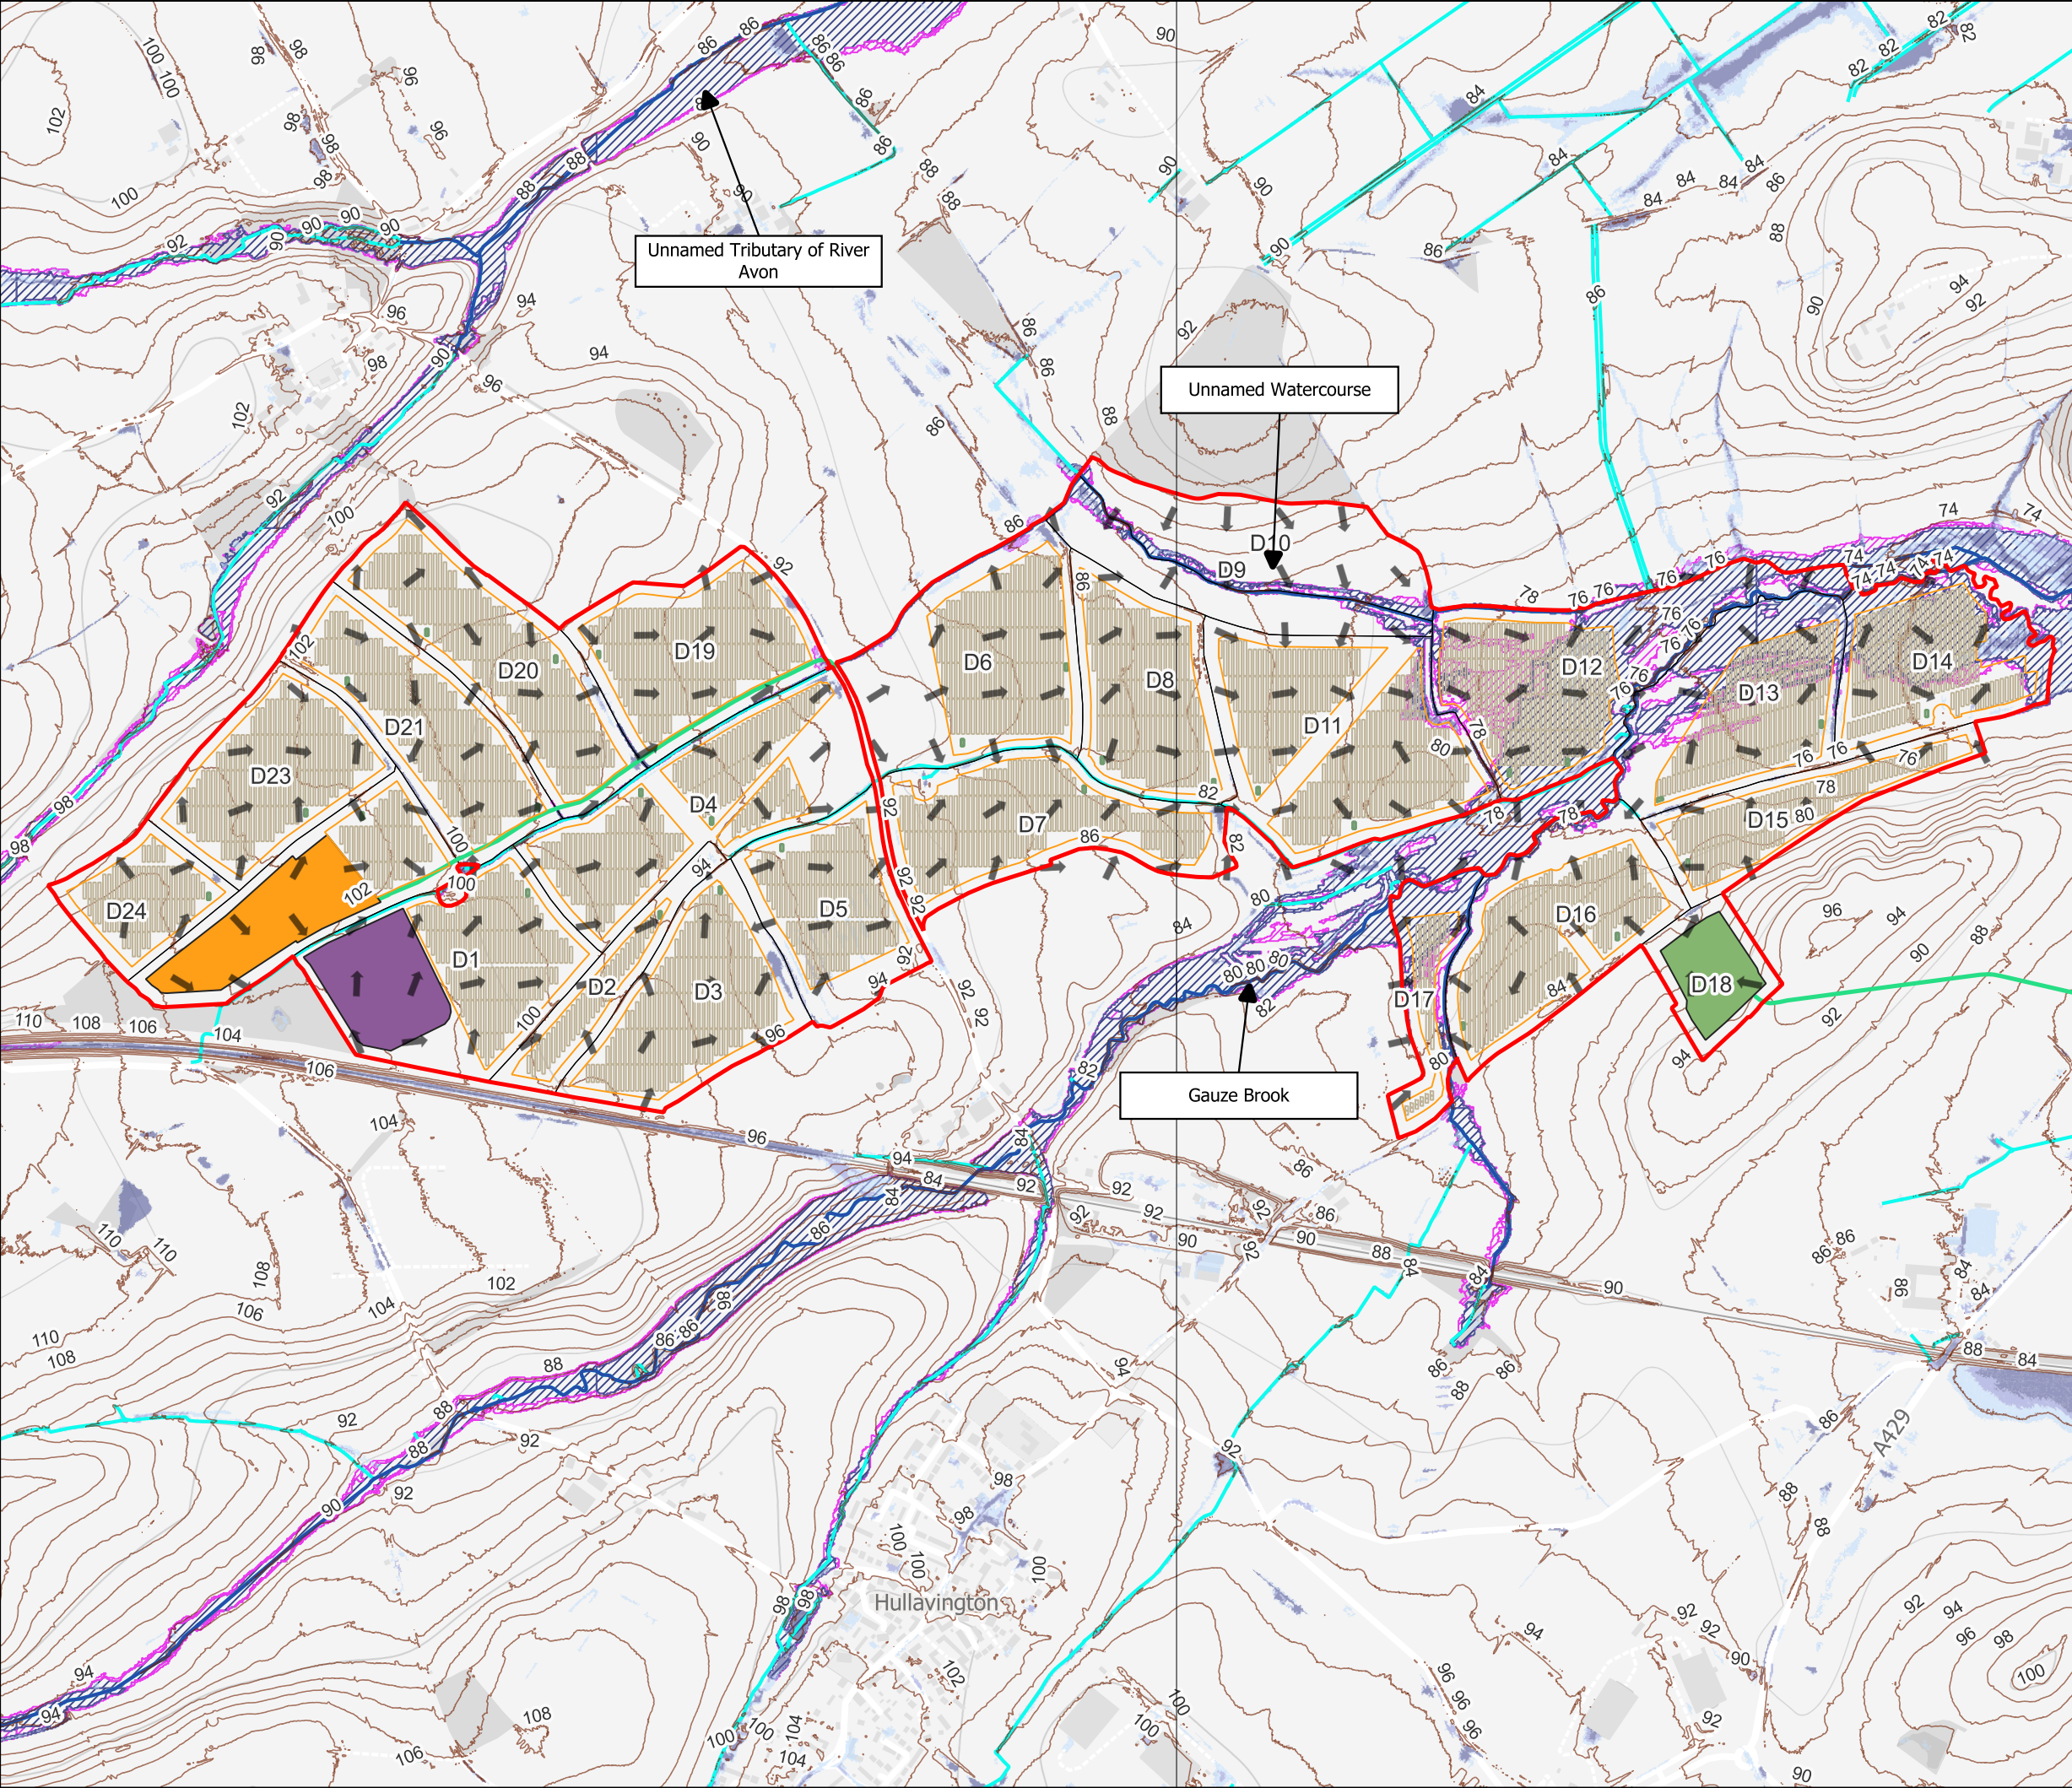

Title:
Figure 11.5 Rev 4: Lime Down D (BESS)
Fluvial and Surface Water Flood Risk Map

Document:
Volume 2
Hydrology, Flood Risk and Drainage
Environmental Statement (ES)

Legend:

- Solar PV Site
- 132kv Substation
- 400kv Substation
- Conversion Units / 33kv sub distribution switch room
- BESS
- Solar PV Panels
- Solar PV Panels Areas
- 2m Contours
- Access to Substation
- Access Track

Hydrological Features

- EA Main River
- Ordinary Watercourse

EA Flood Zones

- Flood Zone 3
- Flood Zone 2

Surface Water Features

- Overland Flow Routes
- High Likelihood (>3.3% AEP)
- Medium Likelihood (1%-3.3% AEP)
- Low Likelihood (0.1%-1% AEP)
- Very Low Likelihood (<0.1% AEP)

APFP Regulation: 5(2)(a)
Application Doc no.: EN010168/APP.6.2
Drawing no.: 317212/11.5.2

Co-ordinate system: OSGB36 / British National Grid

Scale: 1:11000 @ A3



0 0.5 km

