



# Meridian Solar Farm

EN010169

Volume 2


Plans

2.3 Works Plans – Section B  
Grid Connection

APFP Regulation 5(2)(i)(i)&(ii)



Infrastructure Planning (Applications:  
Prescribed Forms and Procedure)  
Regulations 2009

March 2026

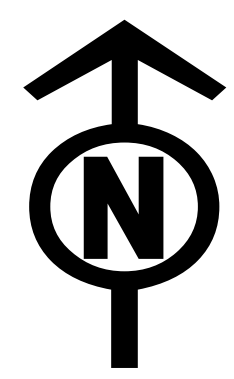

MERIDIAN SOLAR FARM  
WORKS KEY PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 1 OF 1

SITE MAP

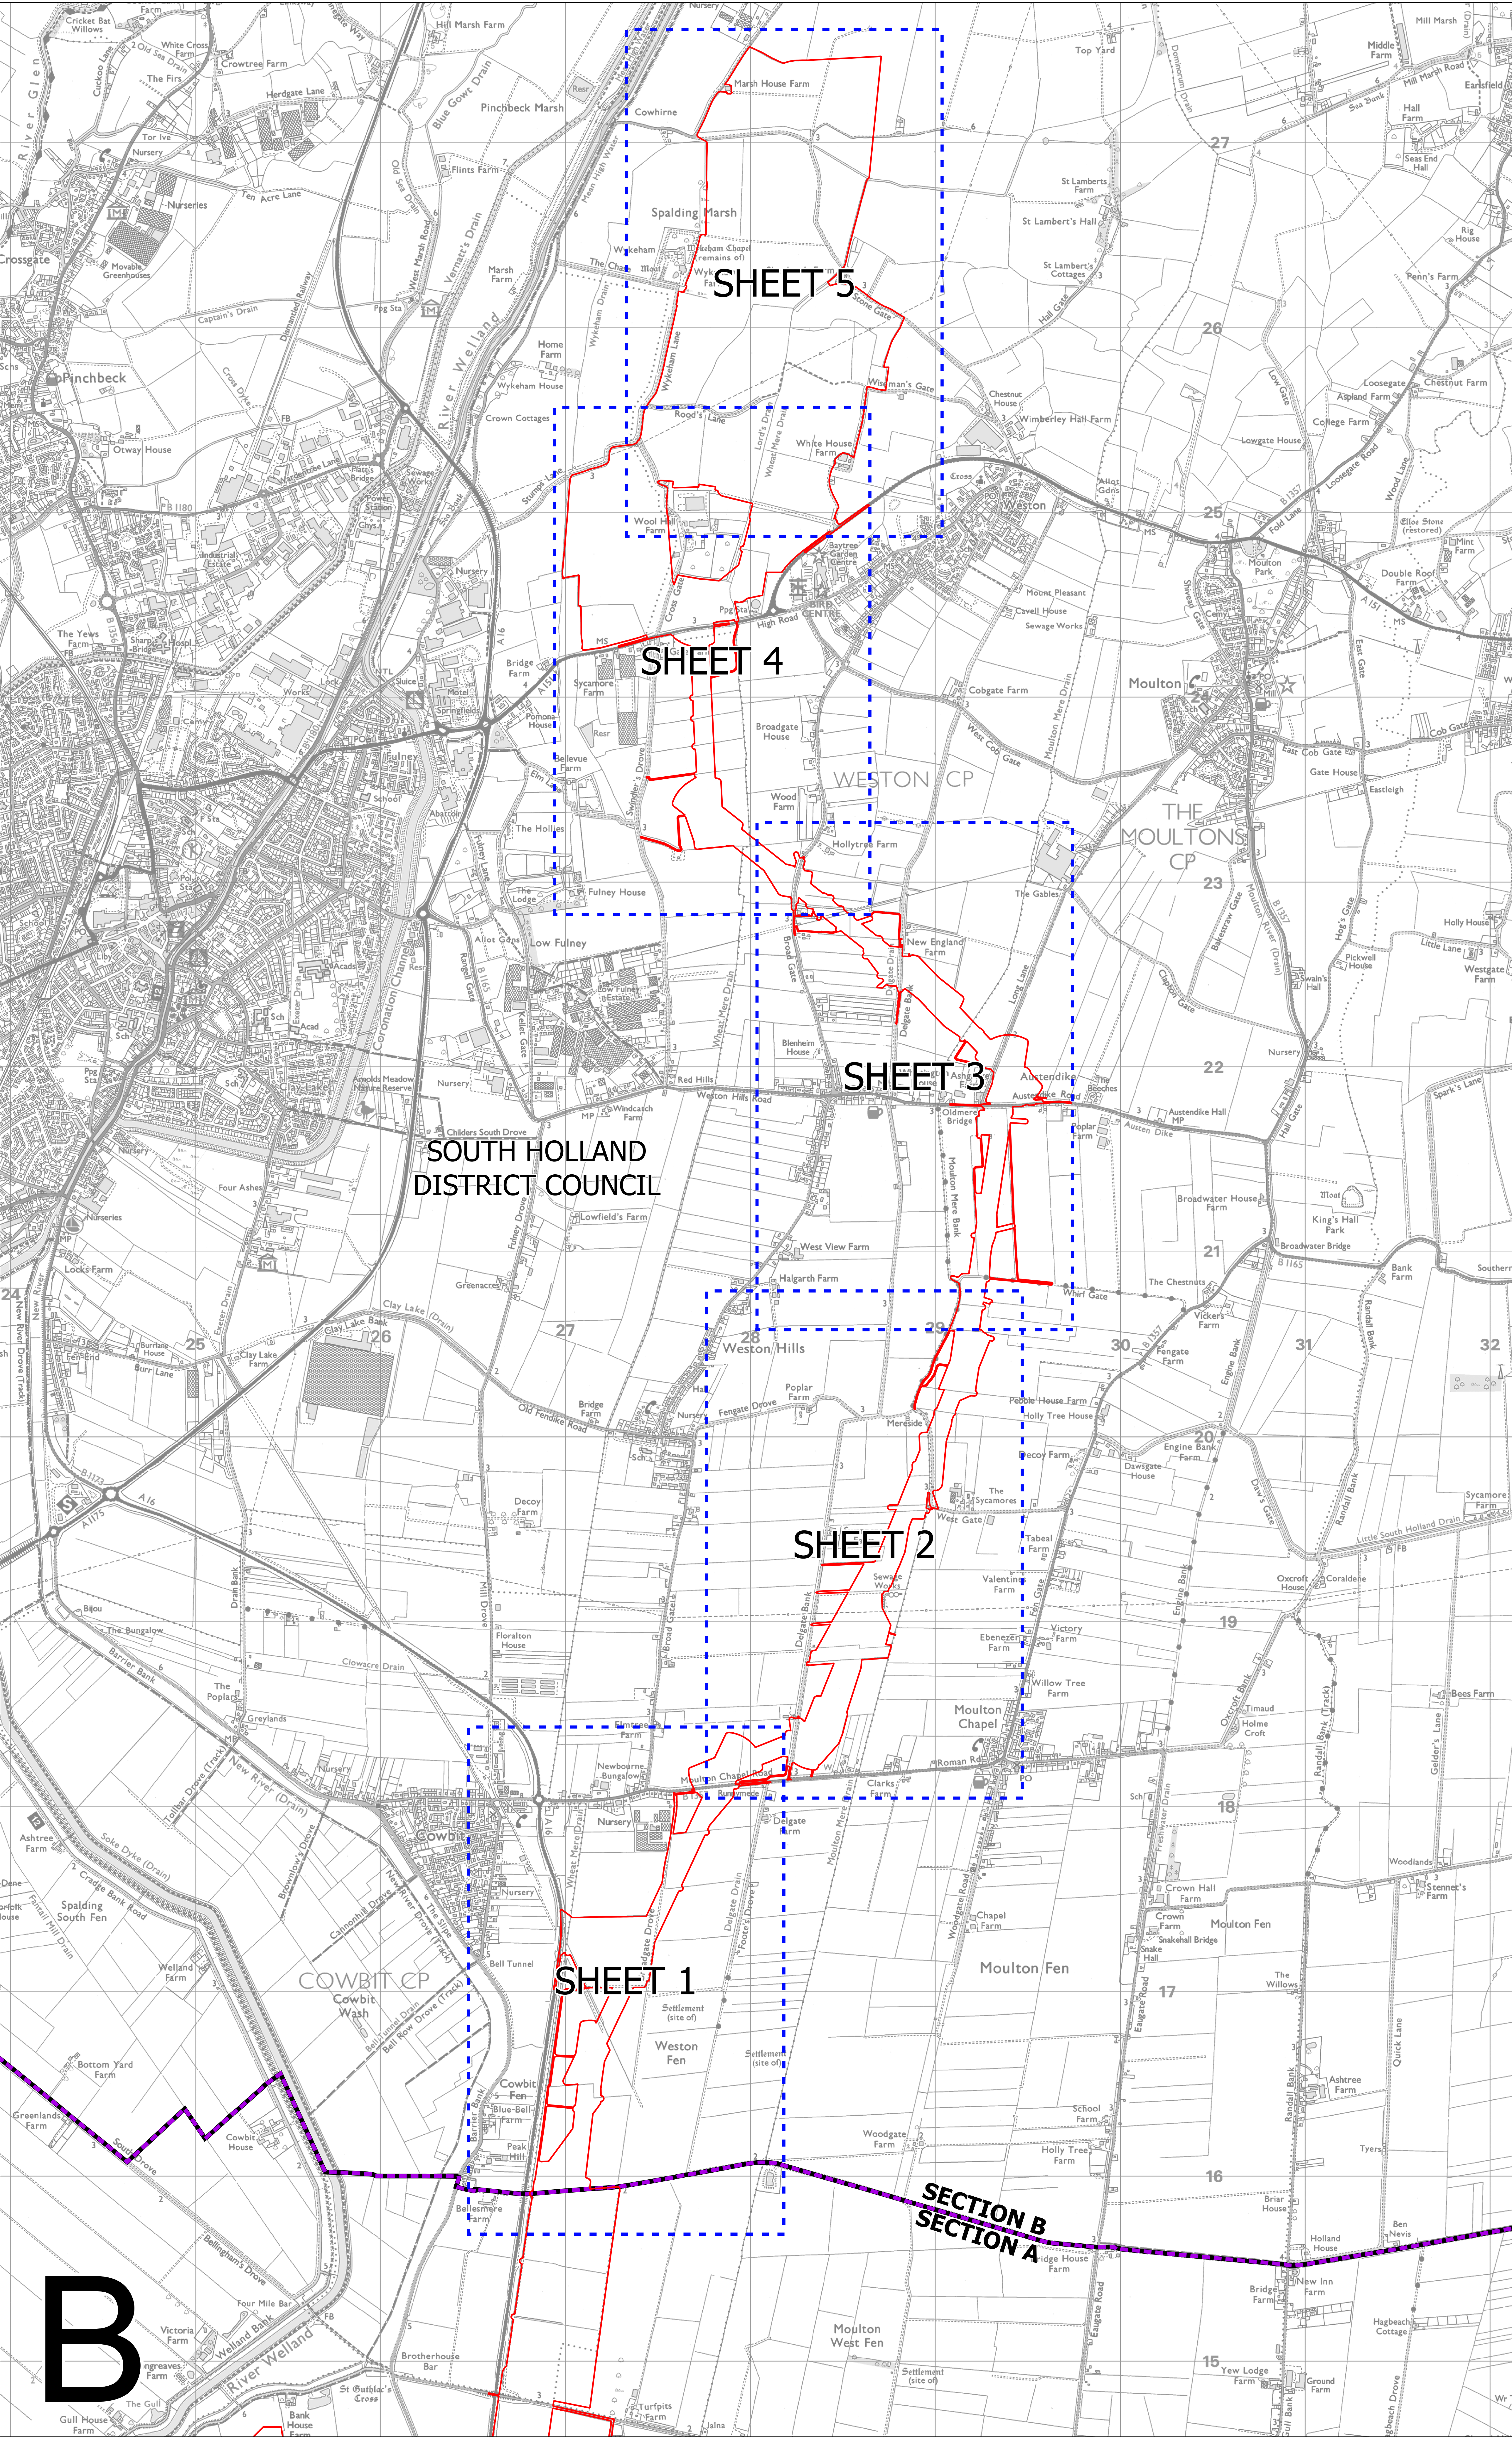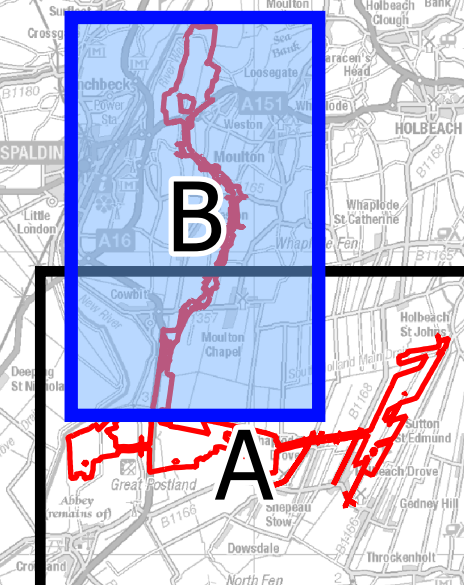

- LEGEND**
- Section boundary
  - Sheet index
  - Order Limits

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 528035 Sheet Y Centroid Coordinate: 321176  
0 300 600 900 1,200 Metres


BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025). ORDNANCE SURVEY AC0000808122. BLUESKY INTERNATIONAL LTD ©

Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK



Title  
MERIDIAN SOLAR FARM  
WORKS KEY PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 1 OF 1

Application Number	EN010169
Meridian Drawing Reference	DCO_B/WO/KP/01
Scale	1:12,000
Sheet Size	A0
Sheet	SHEET 1 OF 1
Issue	0

**B**

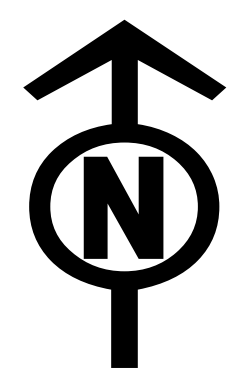

MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 1 OF 5

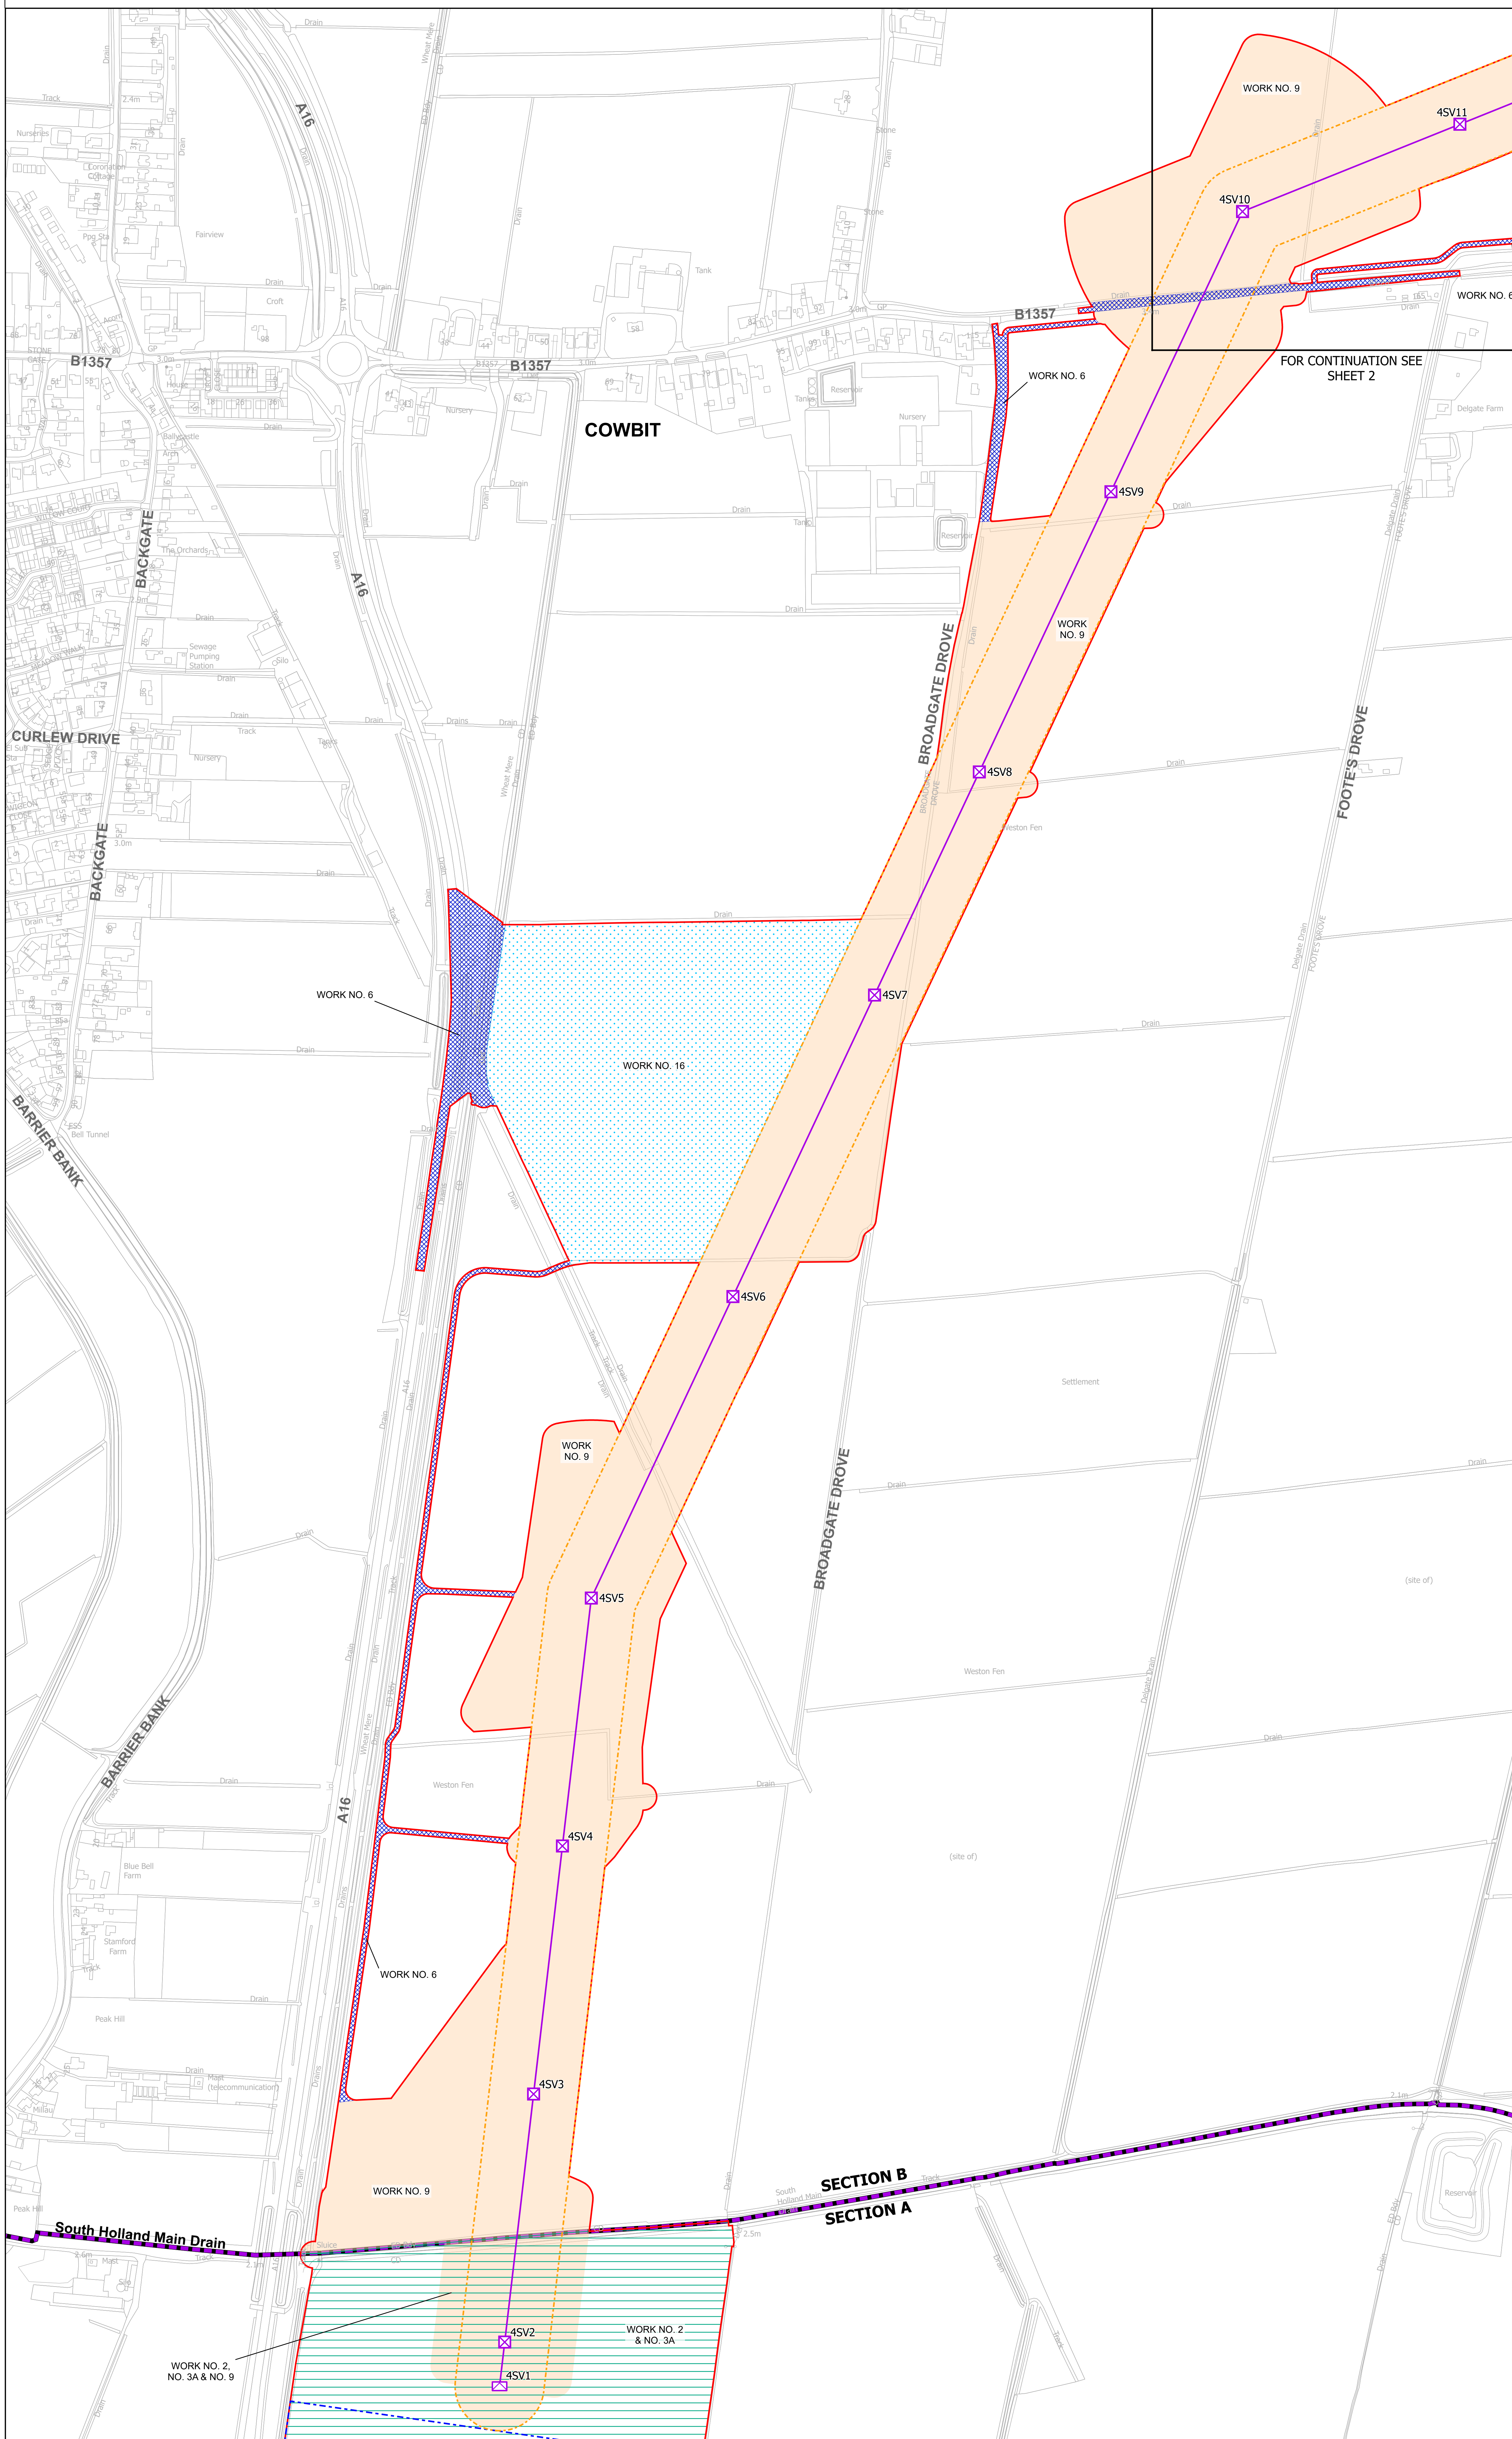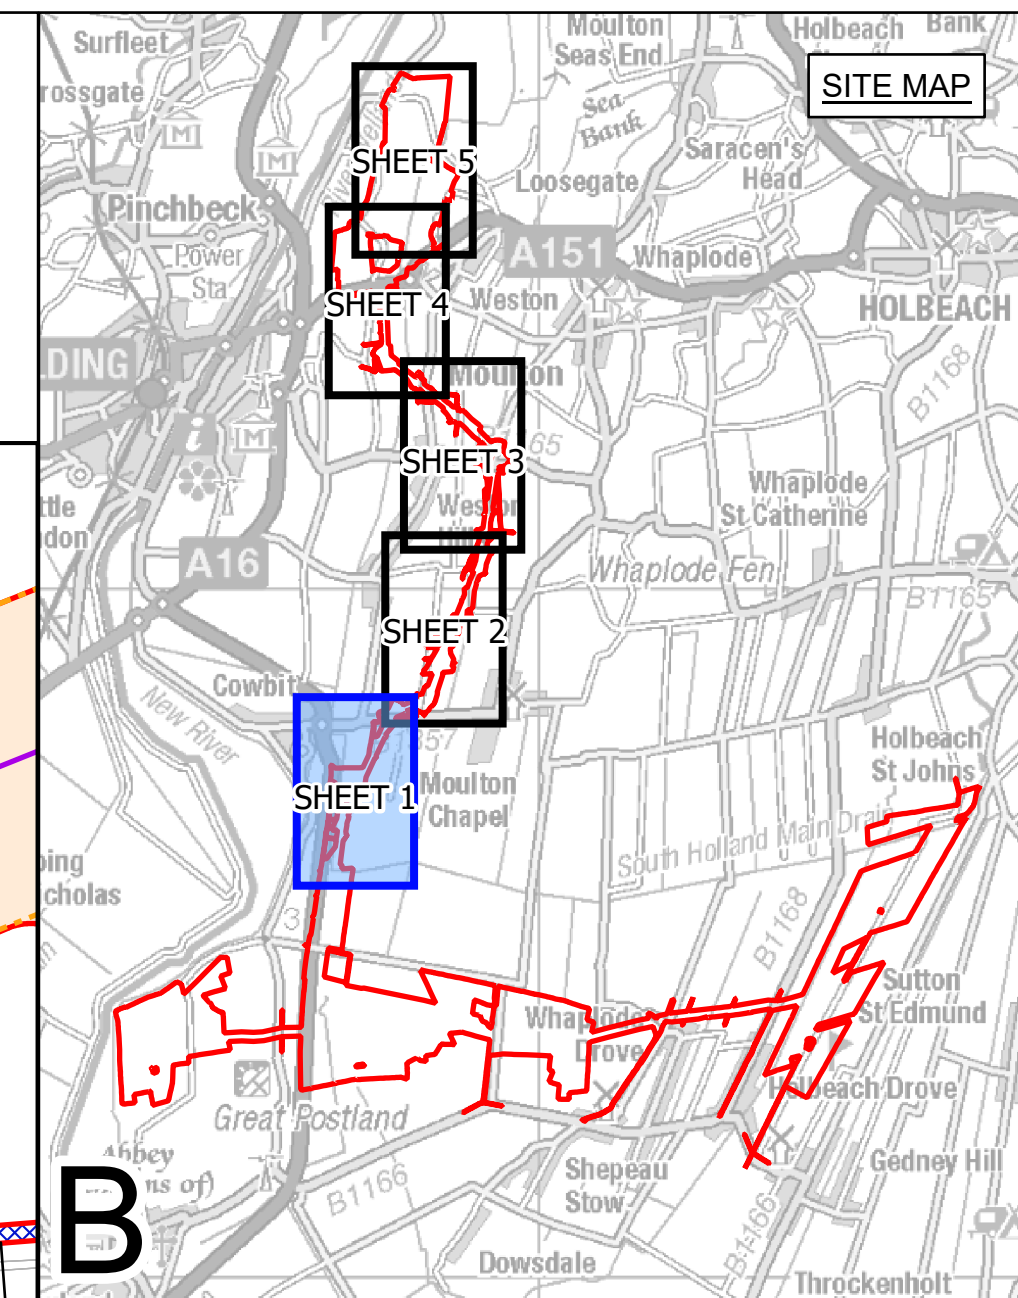

**LEGEND**

- Section boundary
- Sheet index outlines
- Order Limits
- Limits of deviation: 400kV overhead line
- Limits of deviation: 400kV underground cable
- Limits of deviation: non-linear works
- Indicative location of the proposed Weston Marsh B Substation
- Proposed 400kV lattice pylon (not to scale)
- Proposed 400kV full line tension gantry (not to scale)
- Proposed 400kV overhead line
- Proposed 400kV underground cable centreline
- Work no. 2 and 3A
- Work no. 4
- Work no. 6
- Work no. 9
- Work no. 10
- Work no. 11
- Work no. 12
- Work no. 13
- Work no. 14
- Work no. 15
- Work no. 16

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 527328 Sheet Y Centroid Coordinate: 317060



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025) ORDNANCE SURVEY AC000080122. BLUESKY INTERNATIONAL LTD ©

Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK


**Title**

MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 1 OF 5


**Application Number**  
EN010169

**Meridian Drawing Reference**  
DCO\_B/WO/PS/01

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 1 OF 5	0

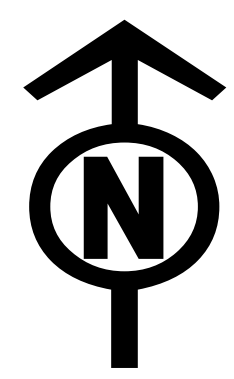

MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 2 OF 5

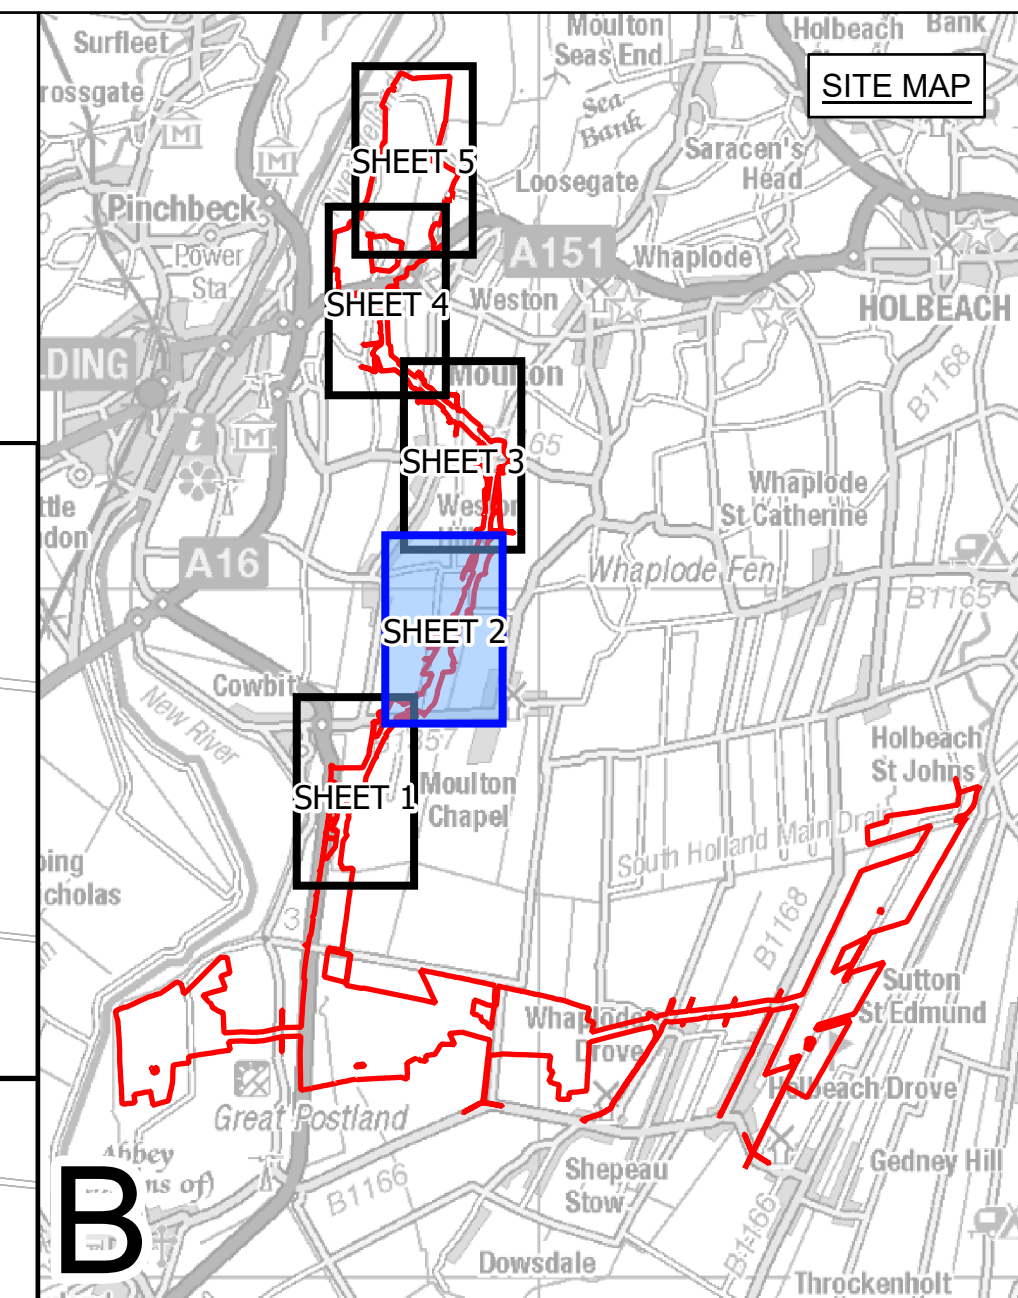

FOR CONTINUATION SEE SHEET 3



FOR CONTINUATION SEE SHEET 1

**LEGEND**

- Section boundary
- Sheet index outlines
- Order Limits
- Limits of deviation: 400kV overhead line
- Limits of deviation: 400kV underground cable
- Limits of deviation: non-linear works
- Indicative location of the proposed Weston Marsh B Substation
- Proposed 400kV lattice pylon (not to scale)
- Proposed 400kV full line tension gantry (not to scale)
- Proposed 400kV overhead line
- Proposed 400kV underground cable centreline
- Work no. 2 and 3A
- Work no. 4
- Work no. 6
- Work no. 9
- Work no. 10
- Work no. 11
- Work no. 12
- Work no. 13
- Work no. 14
- Work no. 15
- Work no. 16

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 528617 Sheet Y Centroid Coordinate: 319419



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025) ORDNANCE SURVEY AC0000808122. BLUESKY INTERNATIONAL LTD ©


Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK

Title  
**MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 2 OF 5**




Application Number: EN010169  
Meridian Drawing Reference: DCO\_B/WO/PS/02

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 2 OF 5	0

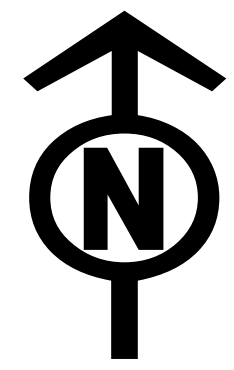


MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 3 OF 5

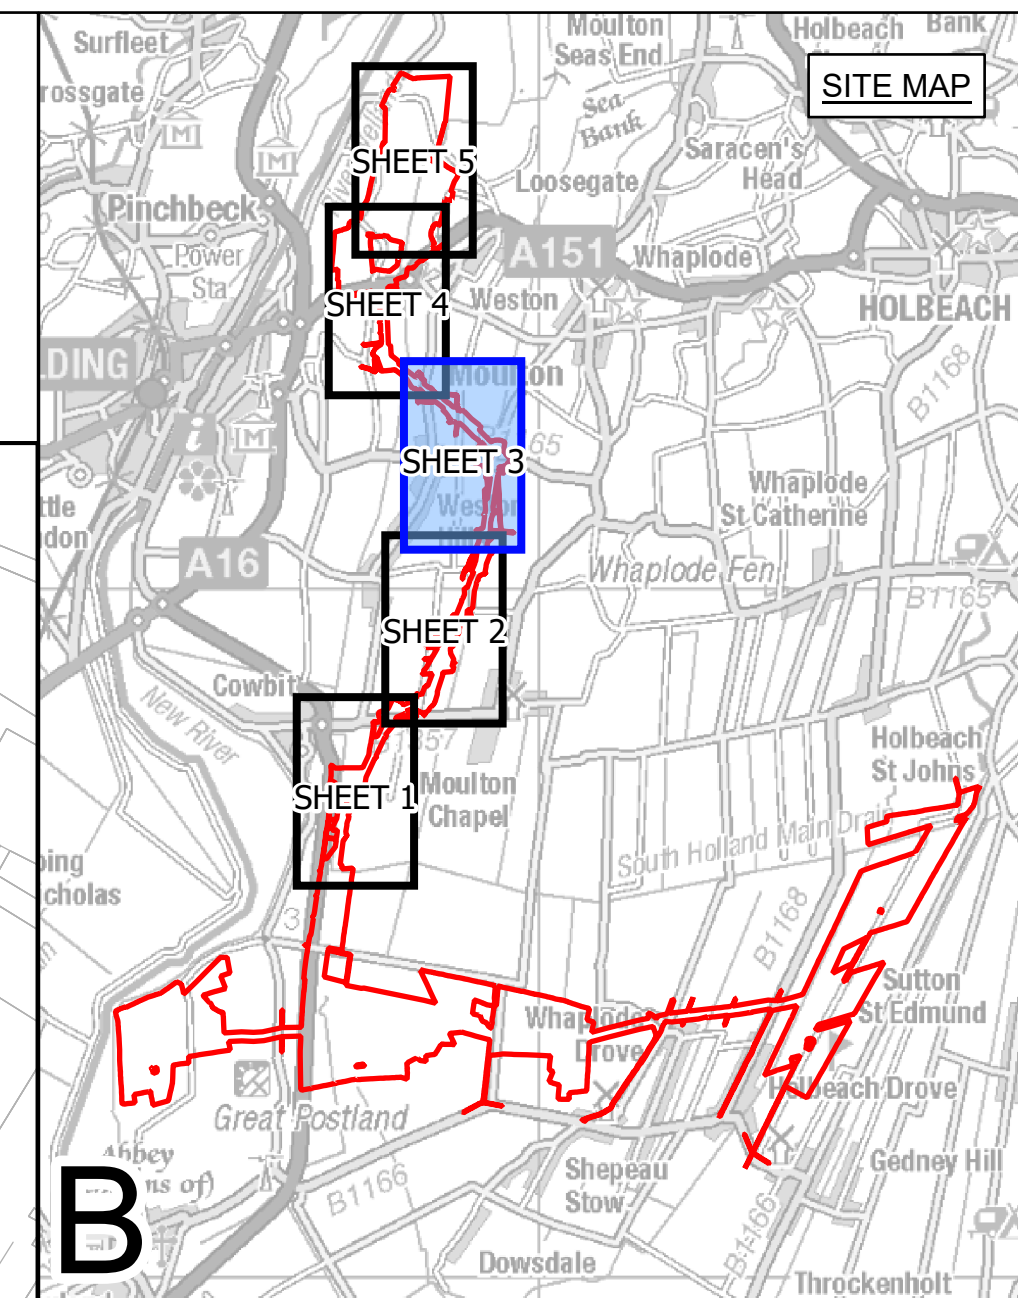

**LEGEND**

- Section boundary
- Sheet index outlines
- Order Limits
- Limits of deviation: 400kV overhead line
- Limits of deviation: 400kV underground cable
- Limits of deviation: non-linear works
- Indicative location of the proposed Weston Marsh B Substation
- Proposed 400kV lattice pylon (not to scale)
- Proposed 400kV full line tension gantry (not to scale)
- Proposed 400kV overhead line
- Proposed 400kV underground cable centreline
- Work no. 2 and 3A
- Work no. 4
- Work no. 6
- Work no. 9
- Work no. 10
- Work no. 11
- Work no. 12
- Work no. 13
- Work no. 14
- Work no. 15
- Work no. 16

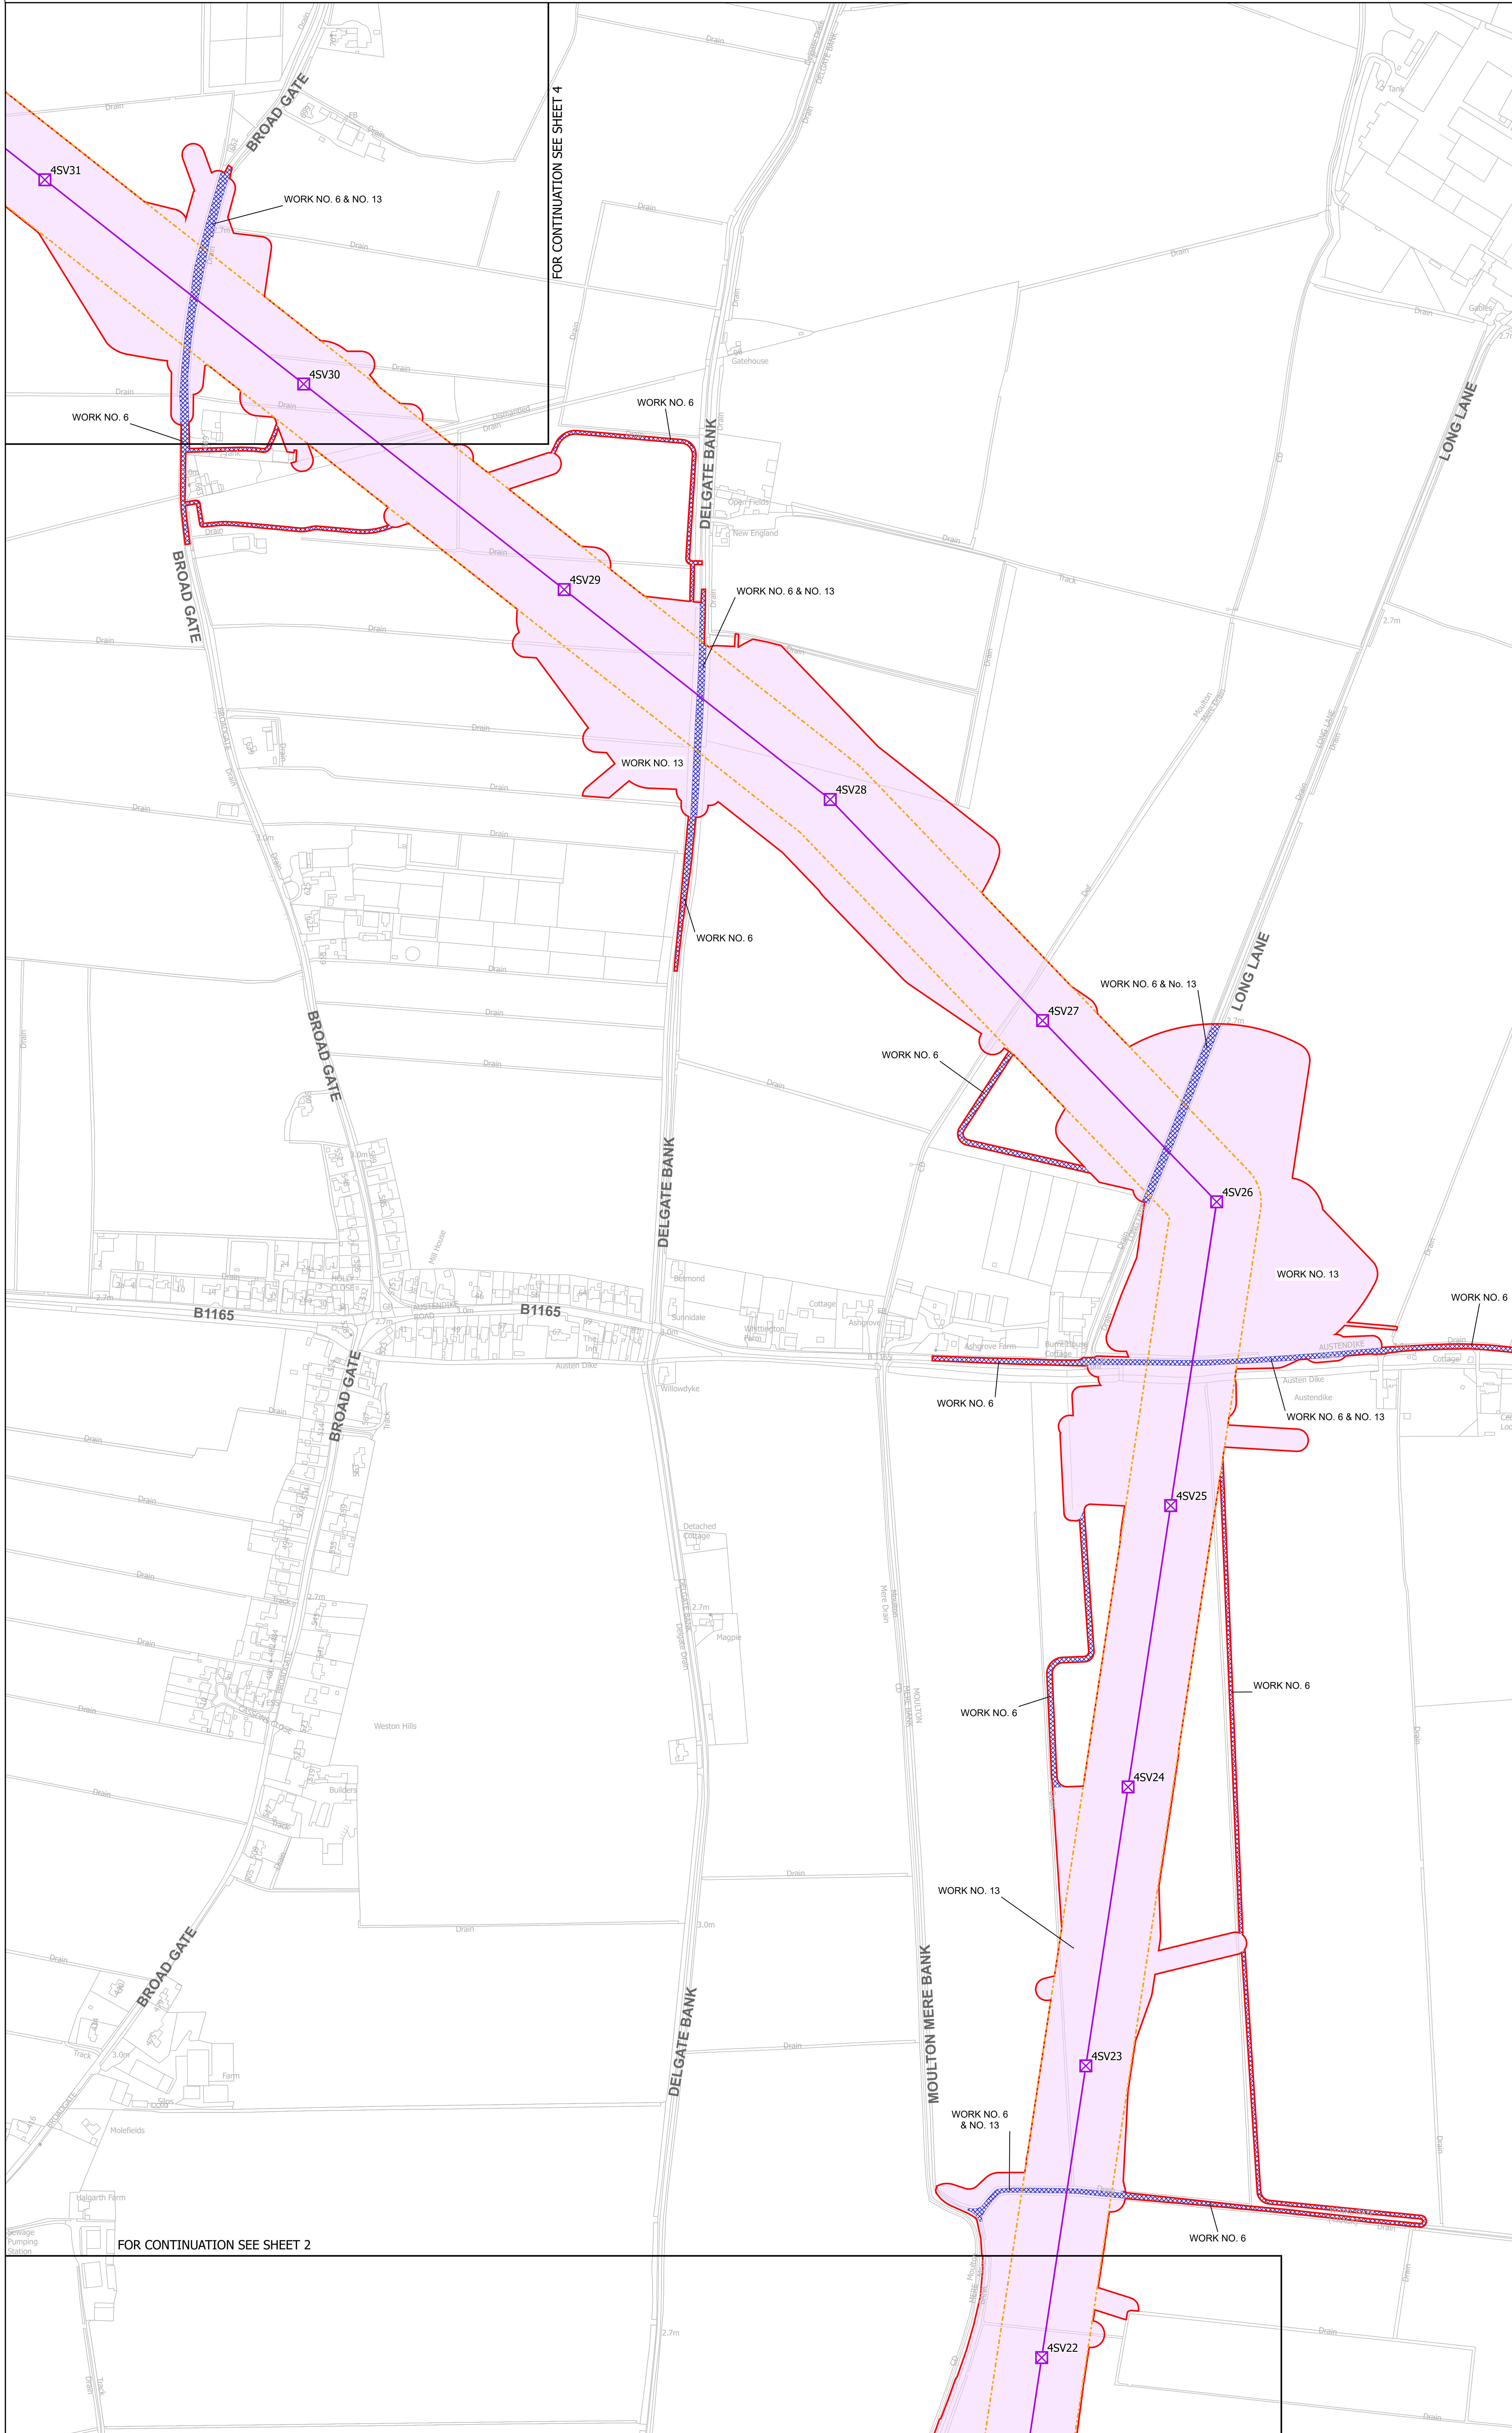

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 528888 Sheet Y Centroid Coordinate: 321951



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025) ORDNANCE SURVEY AC000808122. BLUESKY INTERNATIONAL LTD ©

Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK


**Title**  
MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 3 OF 5




Application Number: EN010169

Meridian Drawing Reference: DCO\_B/WO/PS/03

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 3 OF 5	0

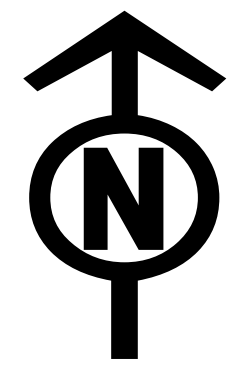


MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 4 OF 5

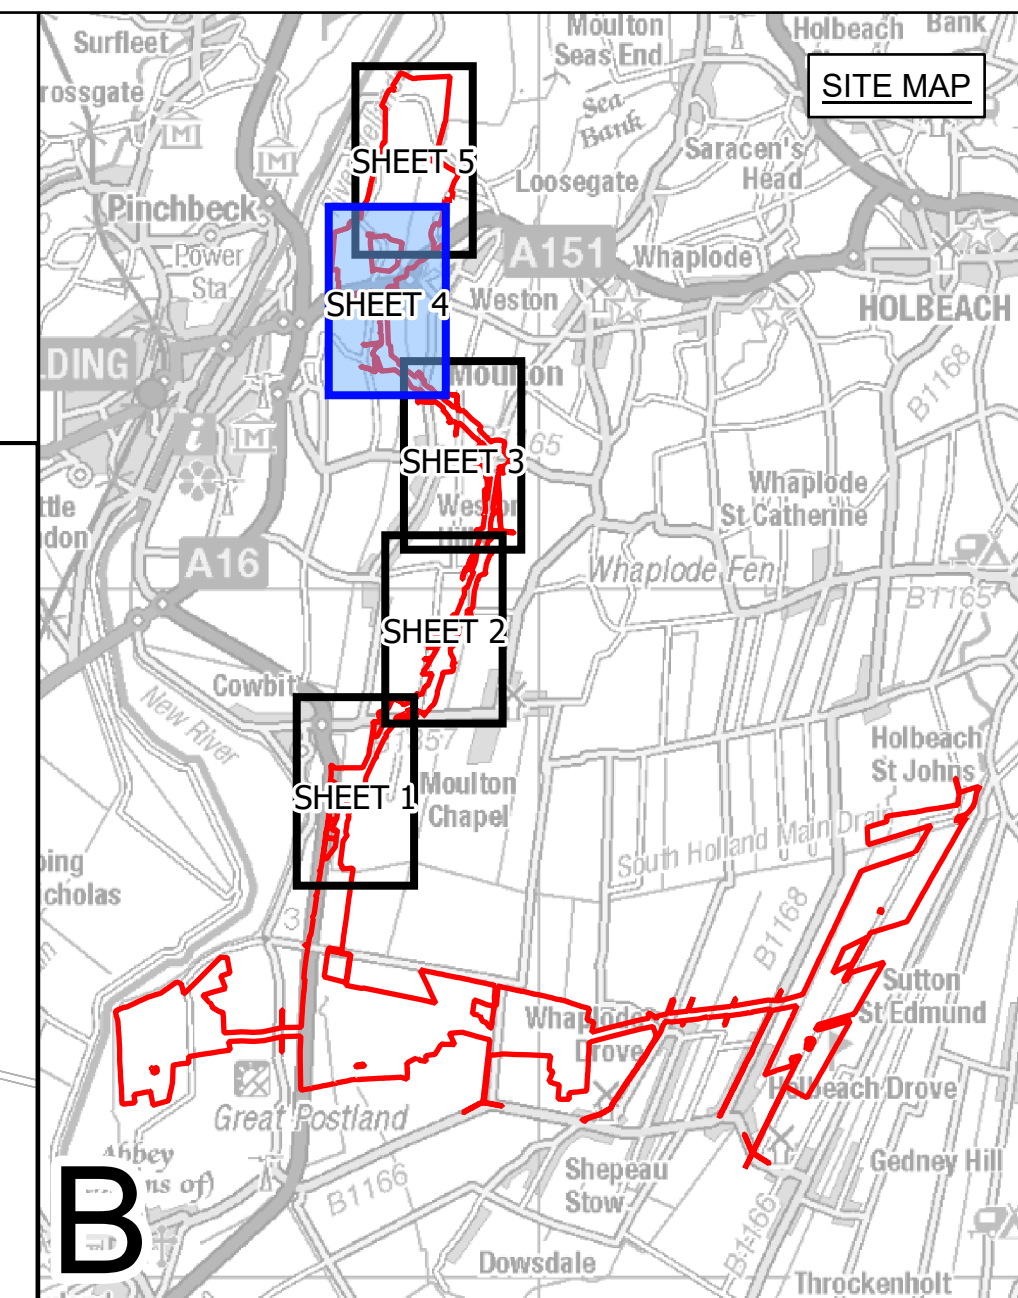

**B**

**LEGEND**

- Section boundary
- Sheet index outlines
- Order Limits
- Limits of deviation: 400kV overhead line
- Limits of deviation: 400kV underground cable
- Limits of deviation: non-linear works
- Indicative location of the proposed Weston Marsh B Substation
- Proposed 400kV lattice pylon (not to scale)
- Proposed 400kV full line tension gantry (not to scale)
- Proposed 400kV overhead line
- Proposed 400kV underground cable centreline
- Work no. 2 and 3A
- Work no. 4
- Work no. 6
- Work no. 9
- Work no. 10
- Work no. 11
- Work no. 12
- Work no. 13
- Work no. 14
- Work no. 15
- Work no. 16

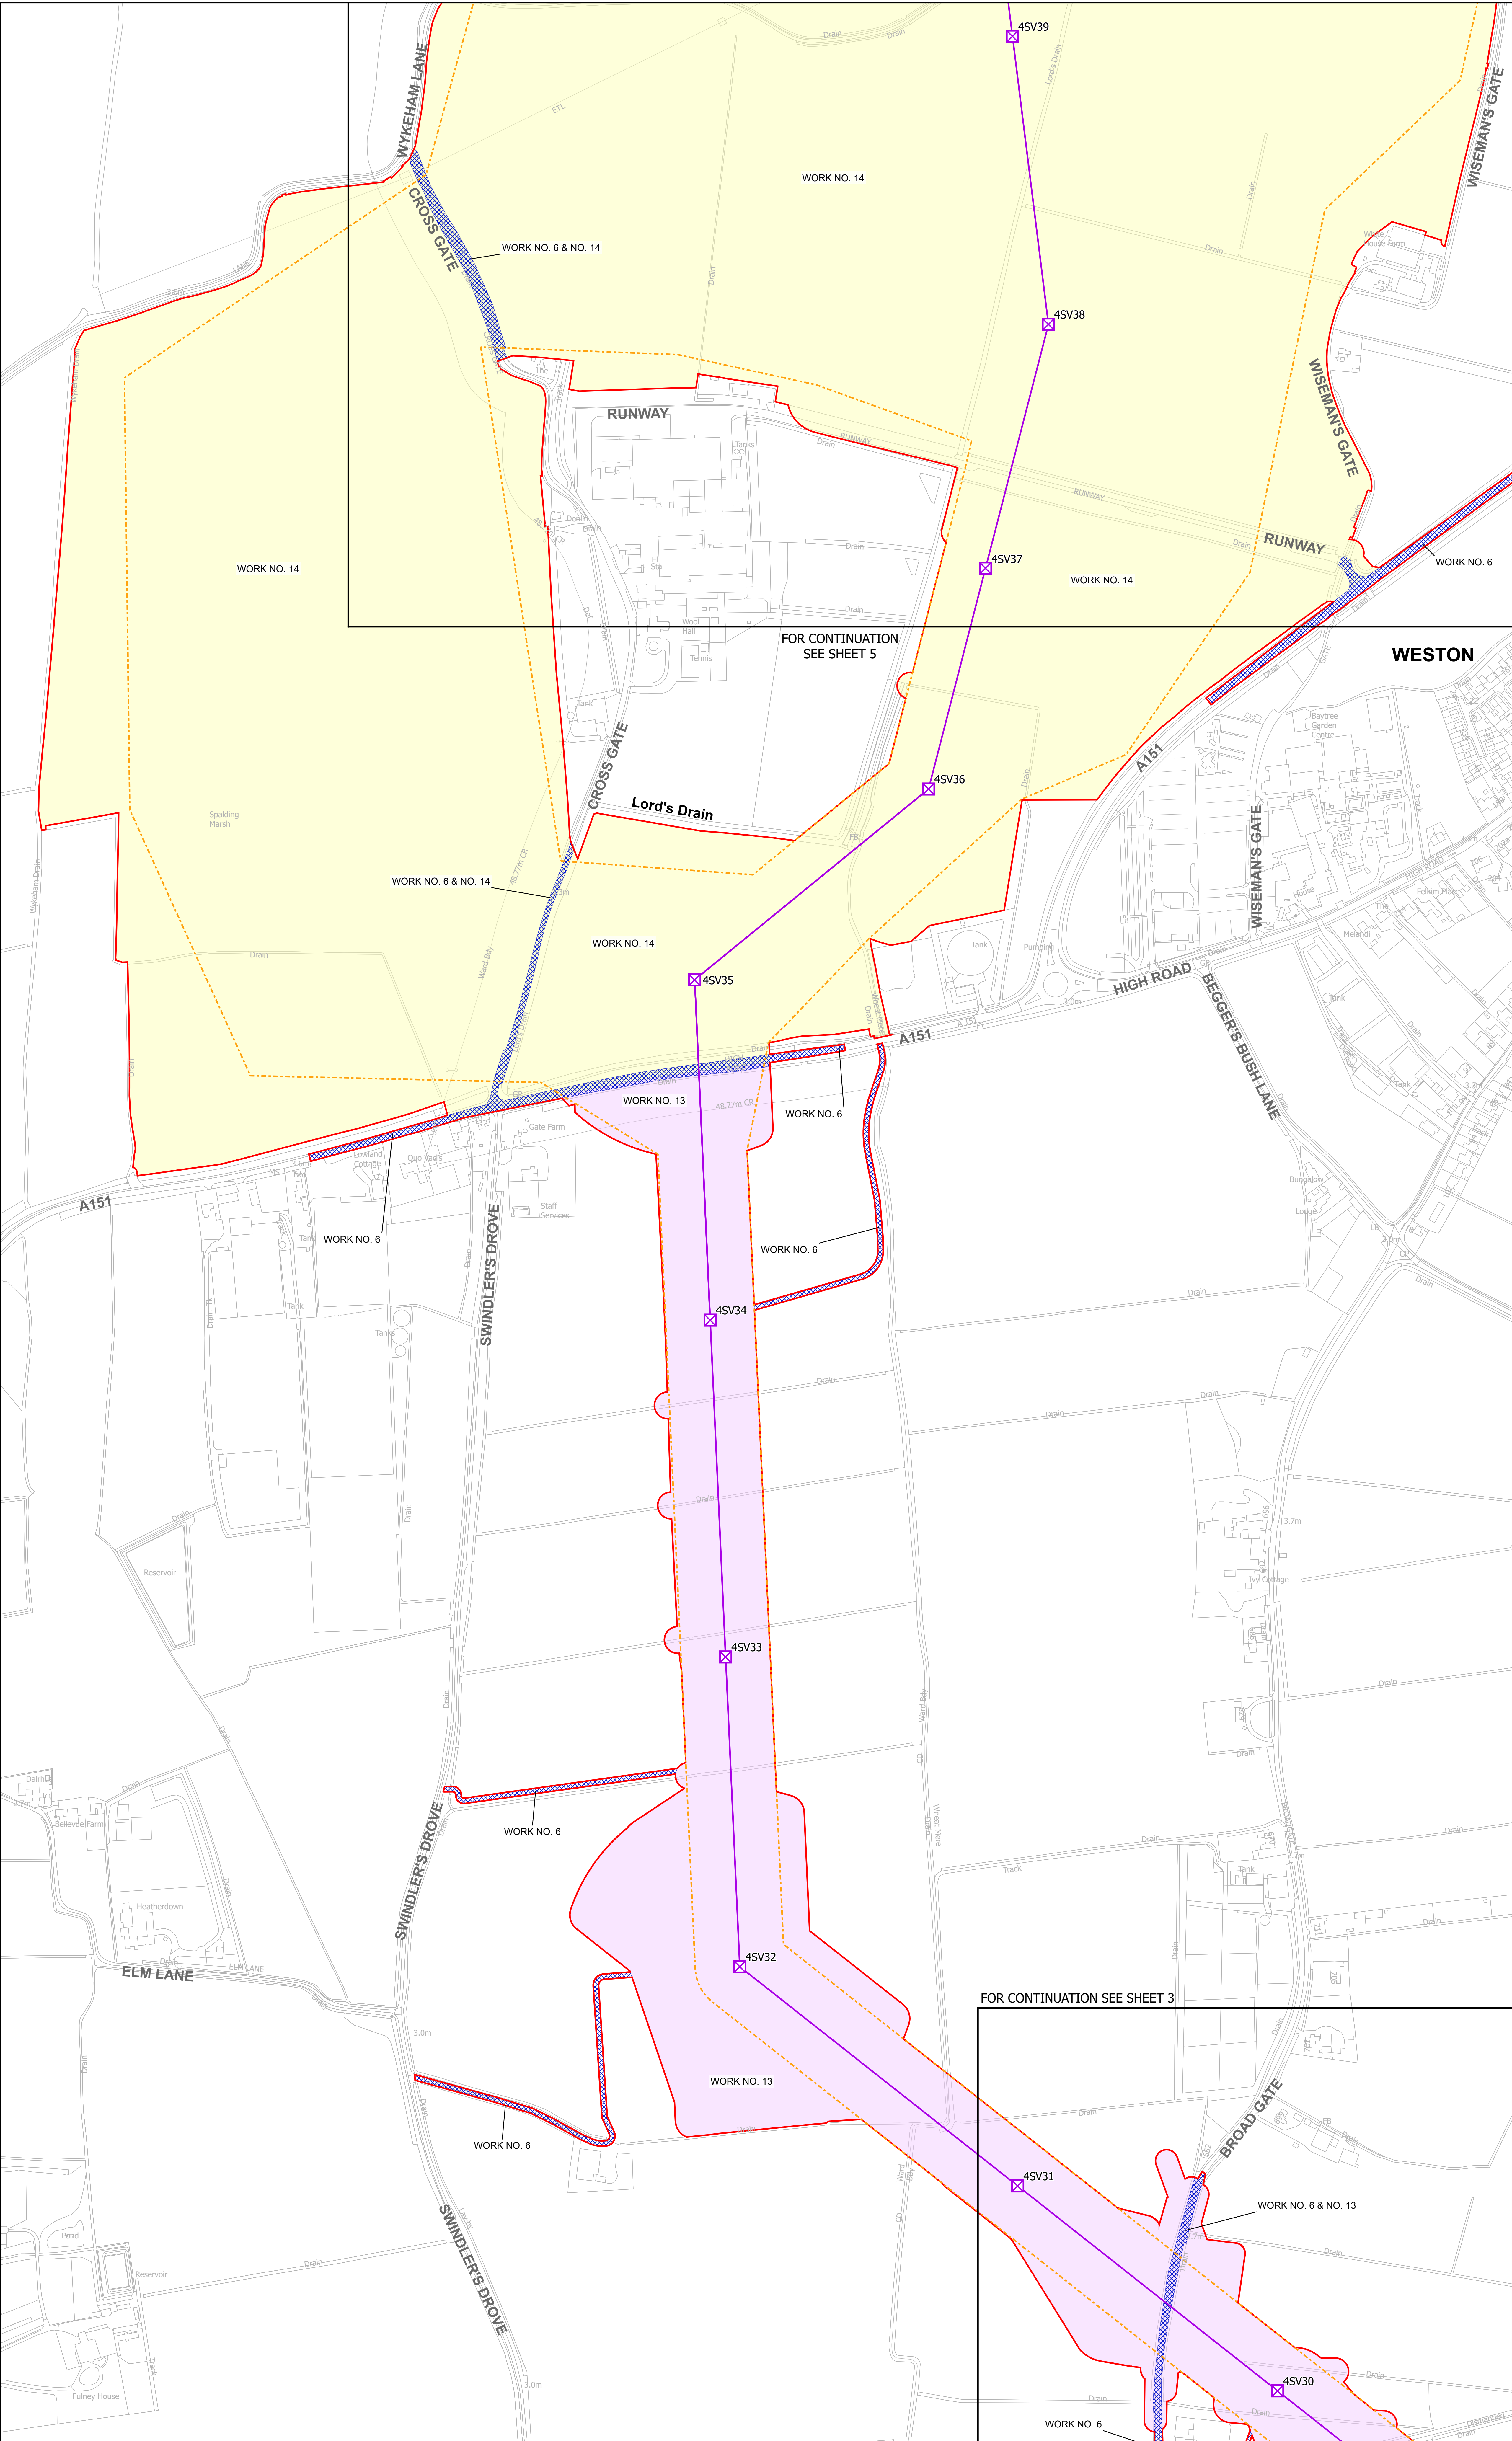

FOR CONTINUATION  
SEE SHEET 5

WESTON

FOR CONTINUATION  
SEE SHEET 3

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 527450 Sheet Y Centroid Coordinate: 324189

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025) ORDNANCE SURVEY AC0000808122. BLUESKY INTERNATIONAL LTD ©


Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK

Title  
**MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 4 OF 5**


Application Number  
EN010169

Meridian Drawing Reference  
DCO\_B/WO/PS/04


Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 4 OF 5	0

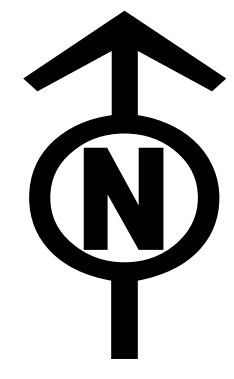

MERIDIAN SOLAR FARM  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 5 OF 5

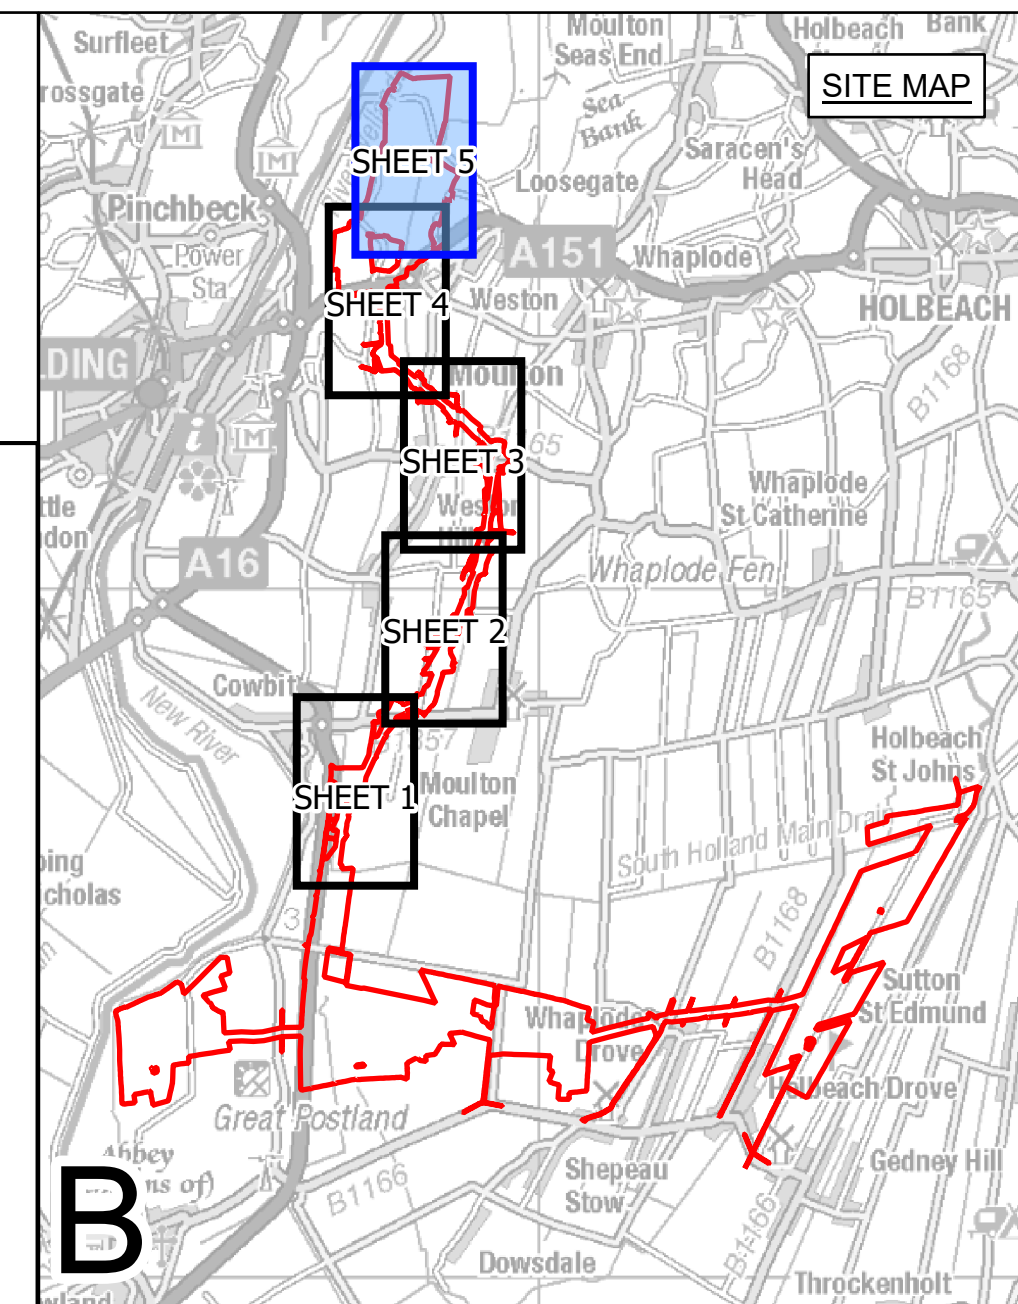

- LEGEND**
- Section boundary
  - Sheet index outlines
  - Order Limits
  - Limits of deviation: 400kV overhead line
  - Limits of deviation: 400kV underground cable
  - Limits of deviation: non-linear works
  - Indicative location of the proposed Weston Marsh B Substation
  - Proposed 400kV lattice pylon (not to scale)
  - Proposed 400kV full line tension gantry (not to scale)
  - Proposed 400kV overhead line
  - Proposed 400kV underground cable centreline
  - Work no. 2 and 3A
  - Work no. 4
  - Work no. 6
  - Work no. 9
  - Work no. 10
  - Work no. 11
  - Work no. 12
  - Work no. 13
  - Work no. 14
  - Work no. 15
  - Work no. 16

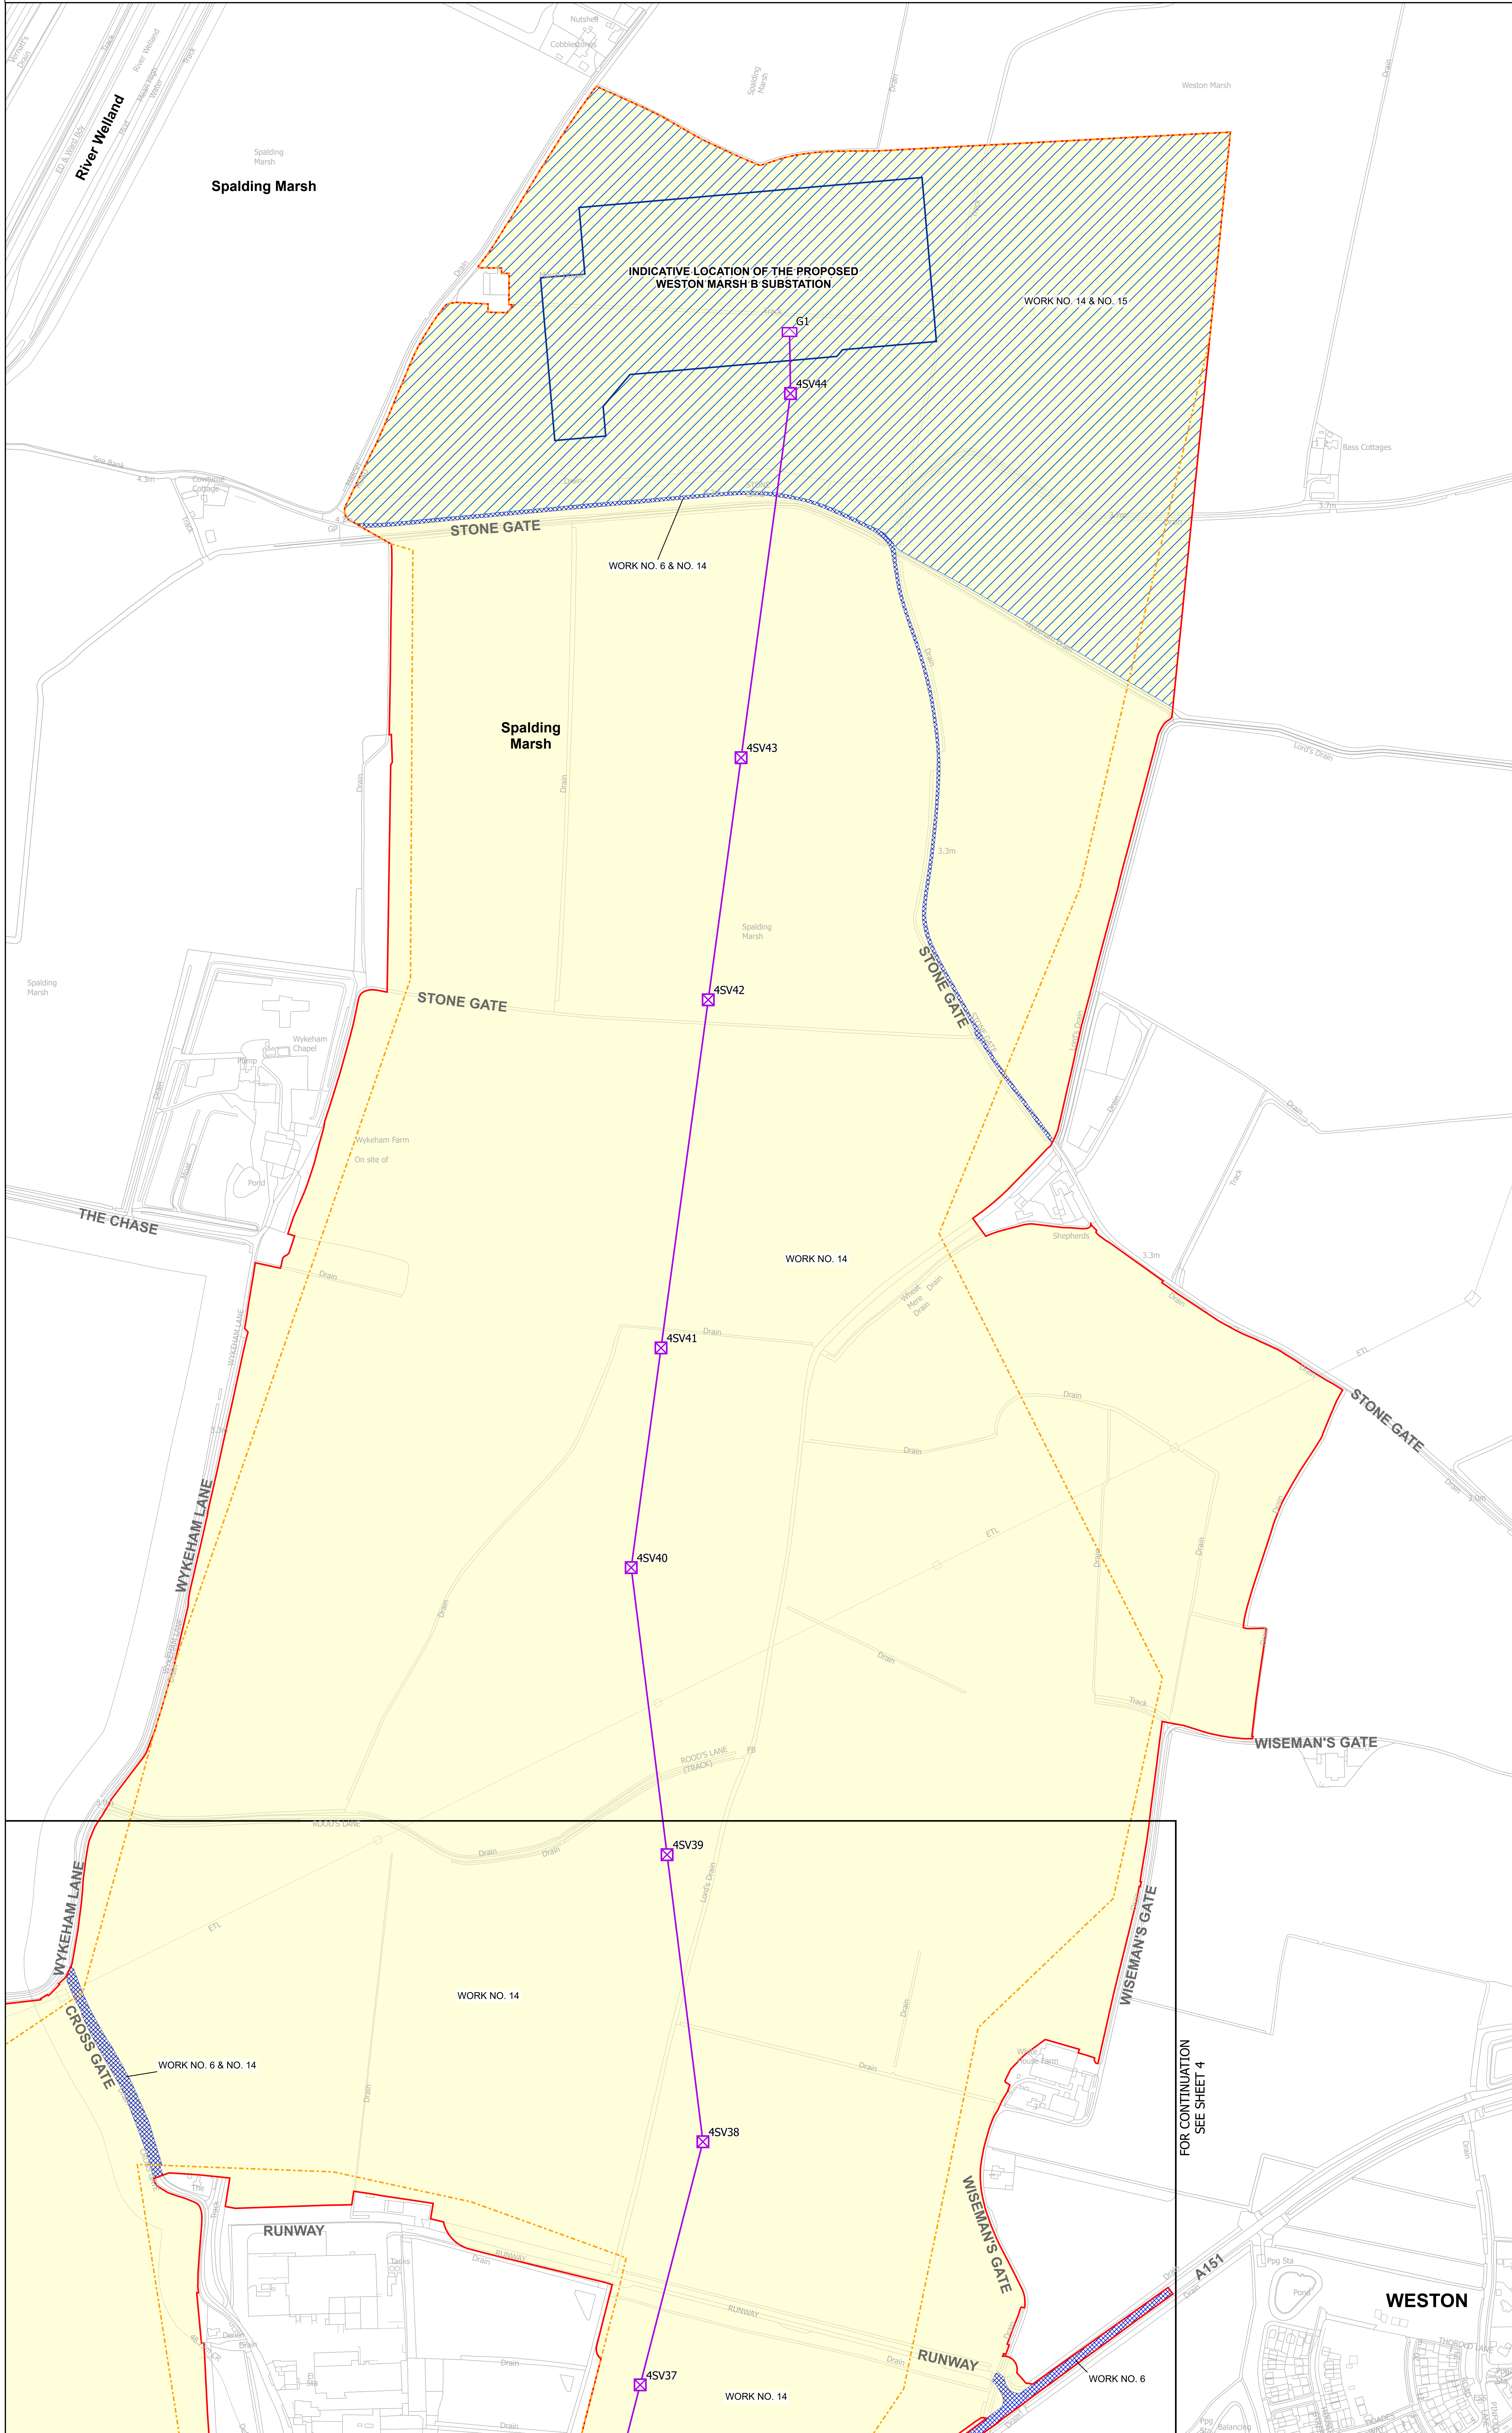

**Notes**  
This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 528200 Sheet Y Centroid Coordinate: 325575

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS (2025) ORDNANCE SURVEY AC0000808122. BLUESKY INTERNATIONAL LTD ©

Issue	Date	Remarks	Drawn	Checked	Approved
0	MAR 2026	FOR DCO SUBMISSION	EB	JPC	AK

**Meridian Solar Farm**  
WORKS PLAN  
REGULATION 5(2)(j)  
SECTION B SHEET 5 OF 5

**Meridian Solar**  
Application Number: EN010169

Meridian Drawing Reference: DCO\_B/WO/PS/05

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 5 OF 5	0