


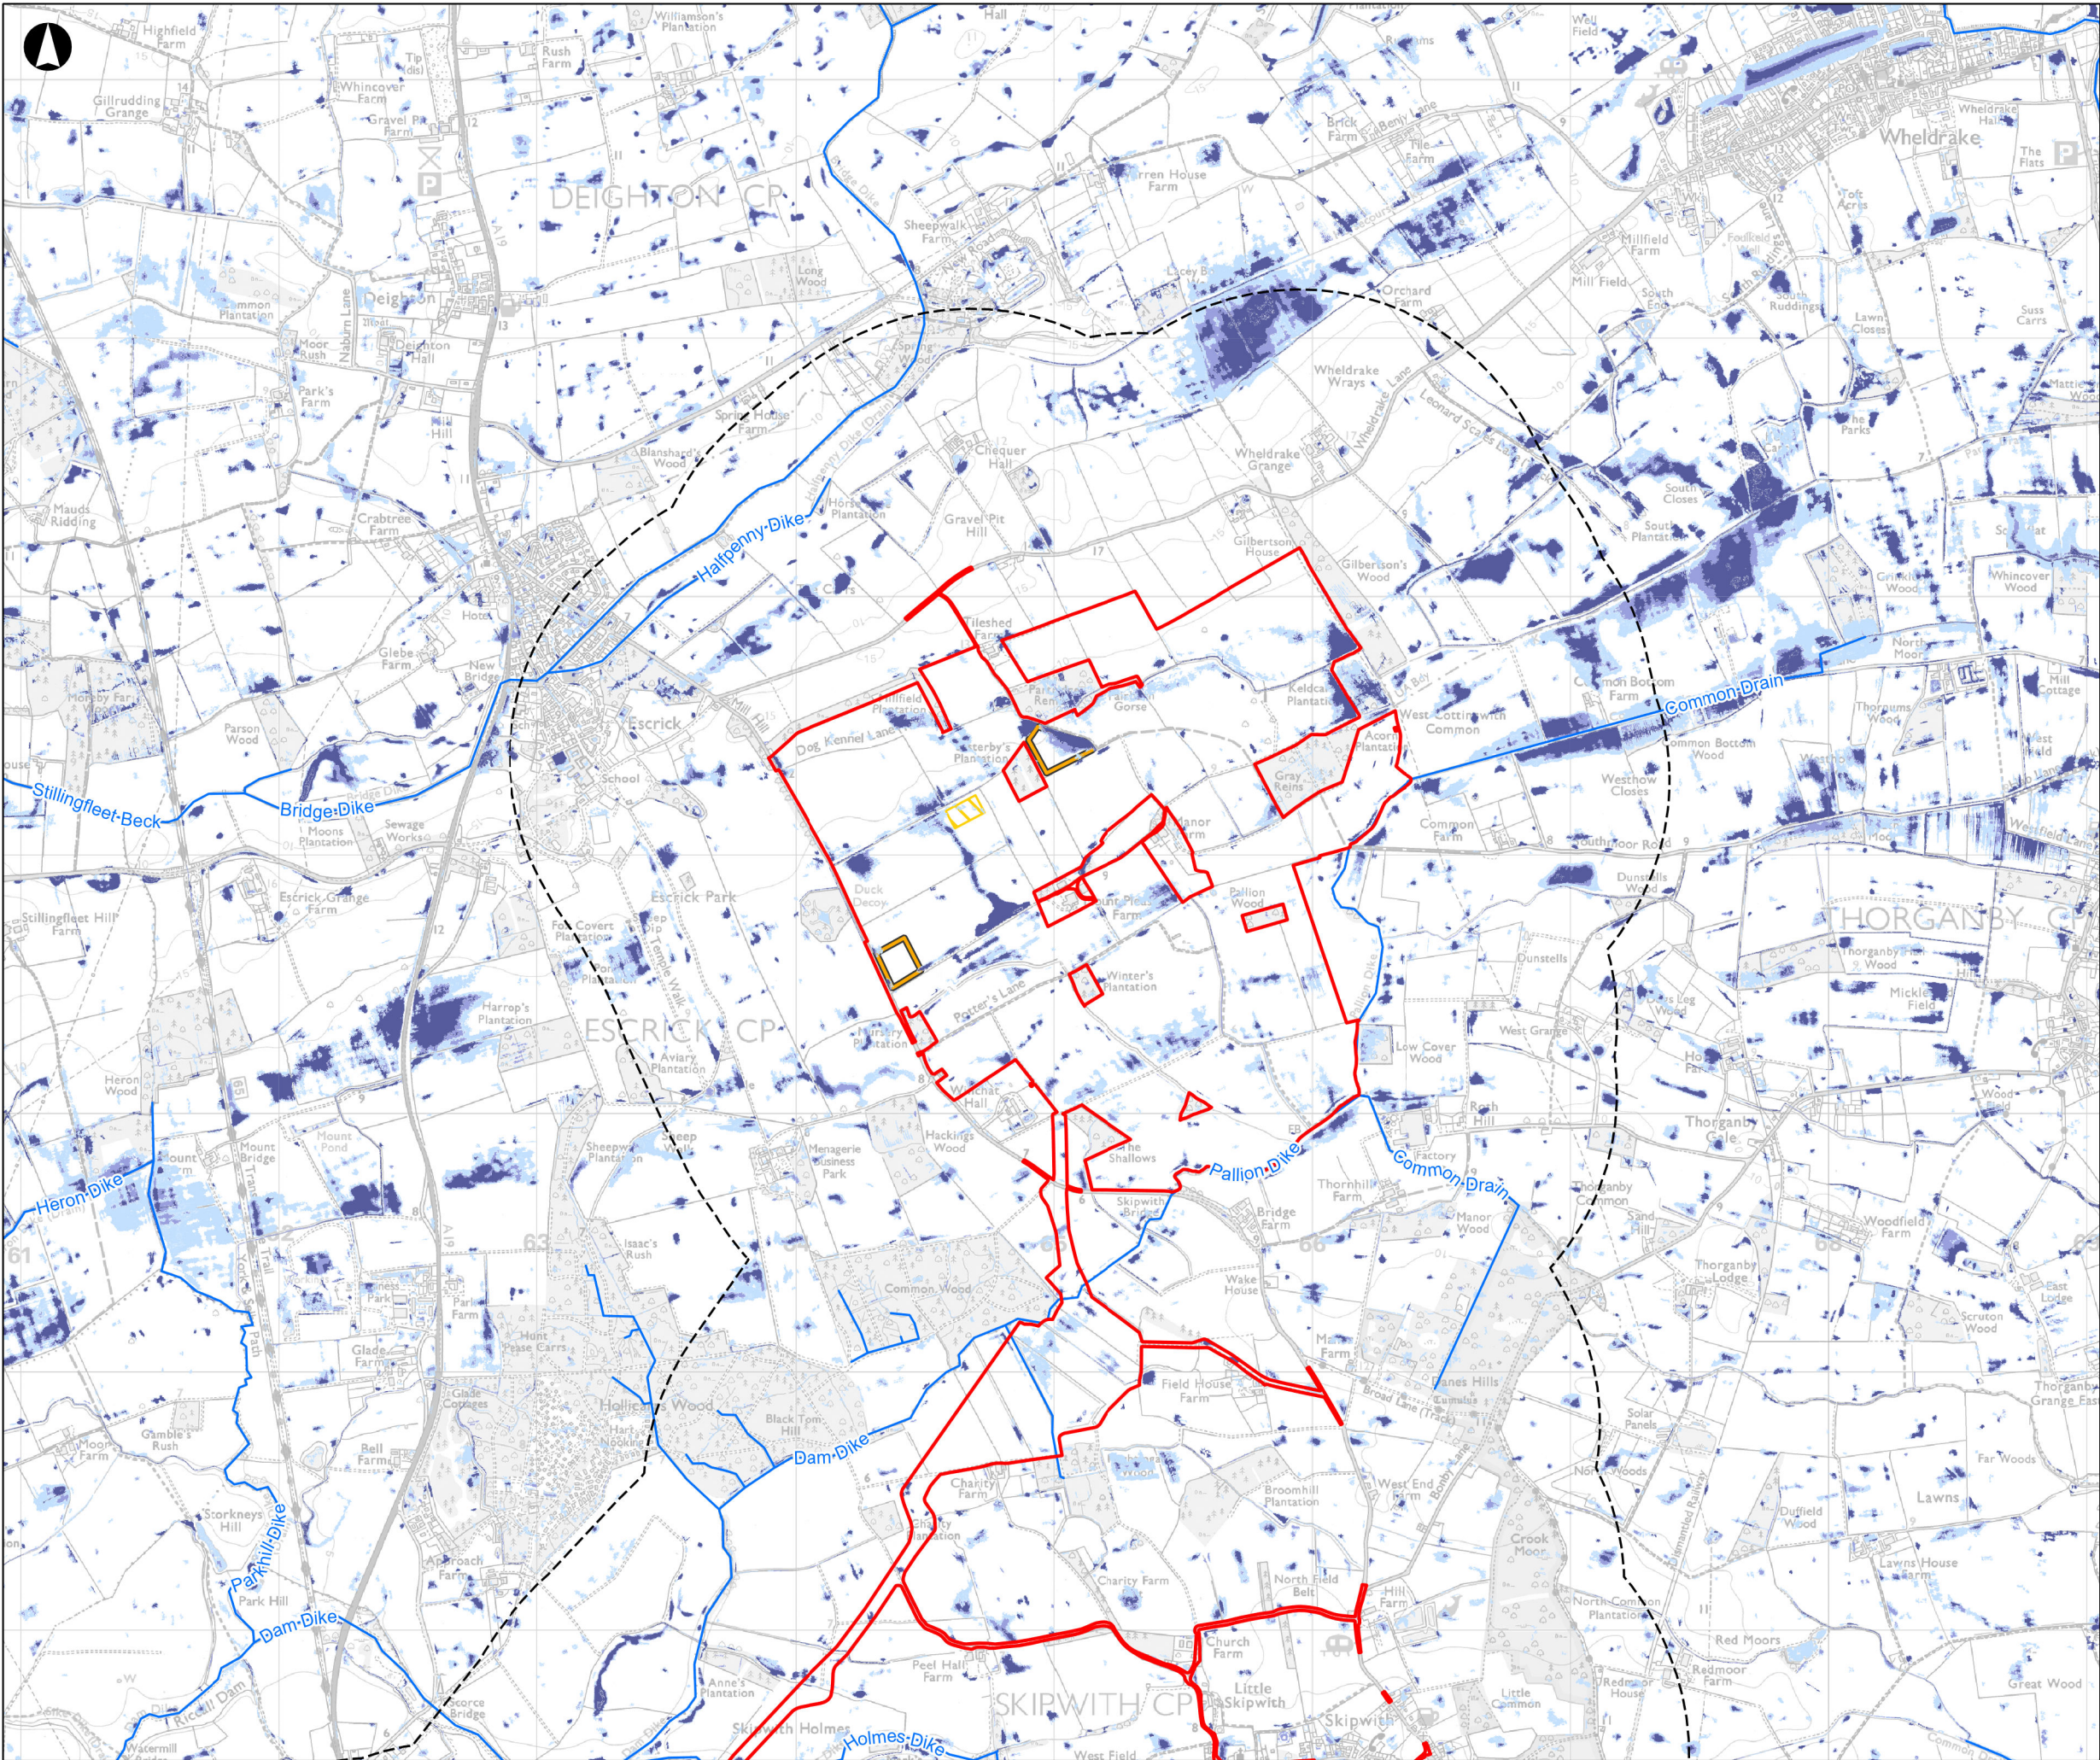

Order Limits

Study Area (1km)

Solar Development Site Construction Compounds

Substations

BESS

Main Rivers

Ordinary Watercourses

Canals

Risk of Flooding from Surface Water

High (More than 3.3% chance each year)

Medium (Between 1% and 3.3% chance each year)


Low (Between 0.1% and 1% chance each year)

A3

Coordinate System: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS. Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack

© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

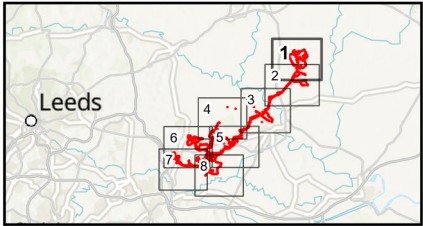

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd

Light Valley Solar

Drawing Title

Figure 15.9
Risk of Flooding from Surface Water
Sheet Number 1 of 8

Client

Light Valley Solar Limited

Project Name

Light Valley Solar

Scale at A3

1:25,000

Project Number


302939-00

Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.15.09.01

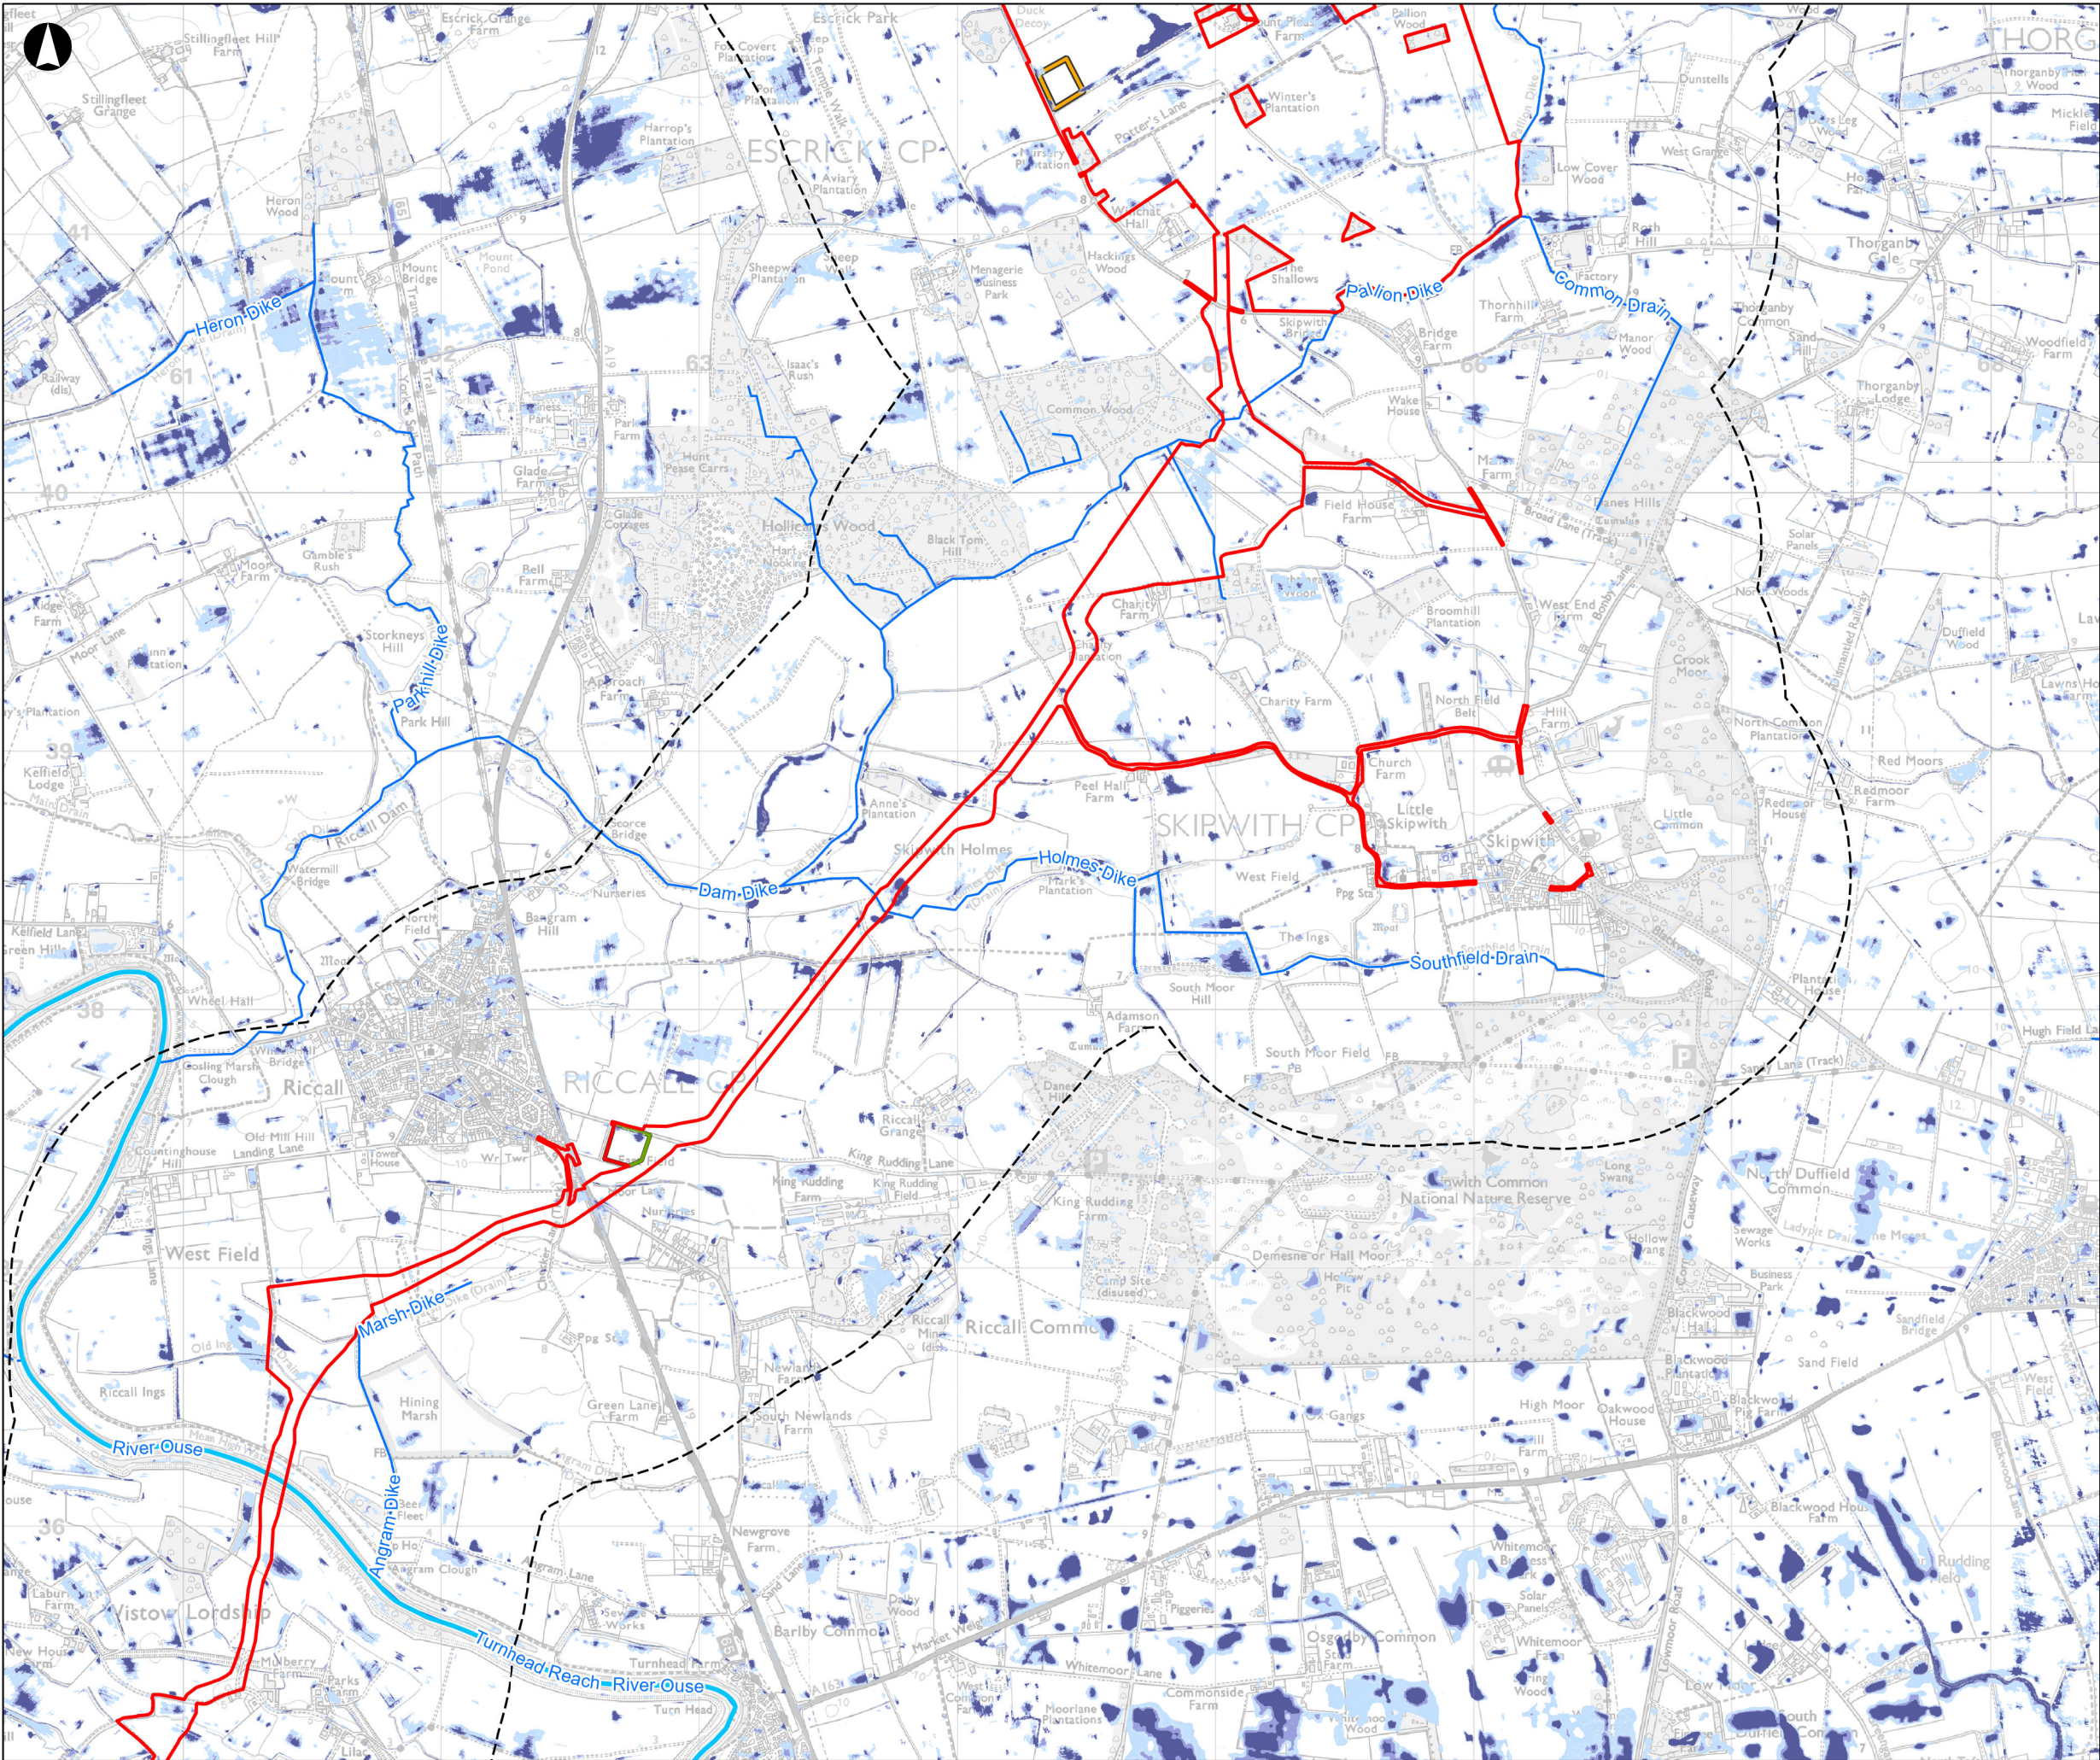


- Order Limits
 - Study Area (1km)
 - Cable Construction Compounds
 - Solar Development Site Construction Compounds
 - Substations
 - BESS
 - Main Rivers
 - Ordinary Watercourses
 - Canals
- Risk of Flooding from Surface Water**
- High (More than 3.3% chance each year)
 - Medium (Between 1% and 3.3% chance each year)
 - Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Esri, CGIAR, USGS, Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack


© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

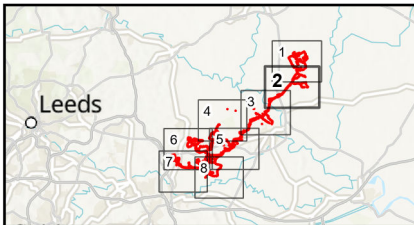

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd



Drawing Title	
Figure 15.9 Risk of Flooding from Surface Water Sheet Number 2 of 8	
Client	
Light Valley Solar Limited	
Project Name	
Light Valley Solar	
Scale at A3	
1:25,000	
Project Number	Rev
302939-00	P02
Drawing Number	
EN0110012/APP/LVS/06.02.15.09.02	

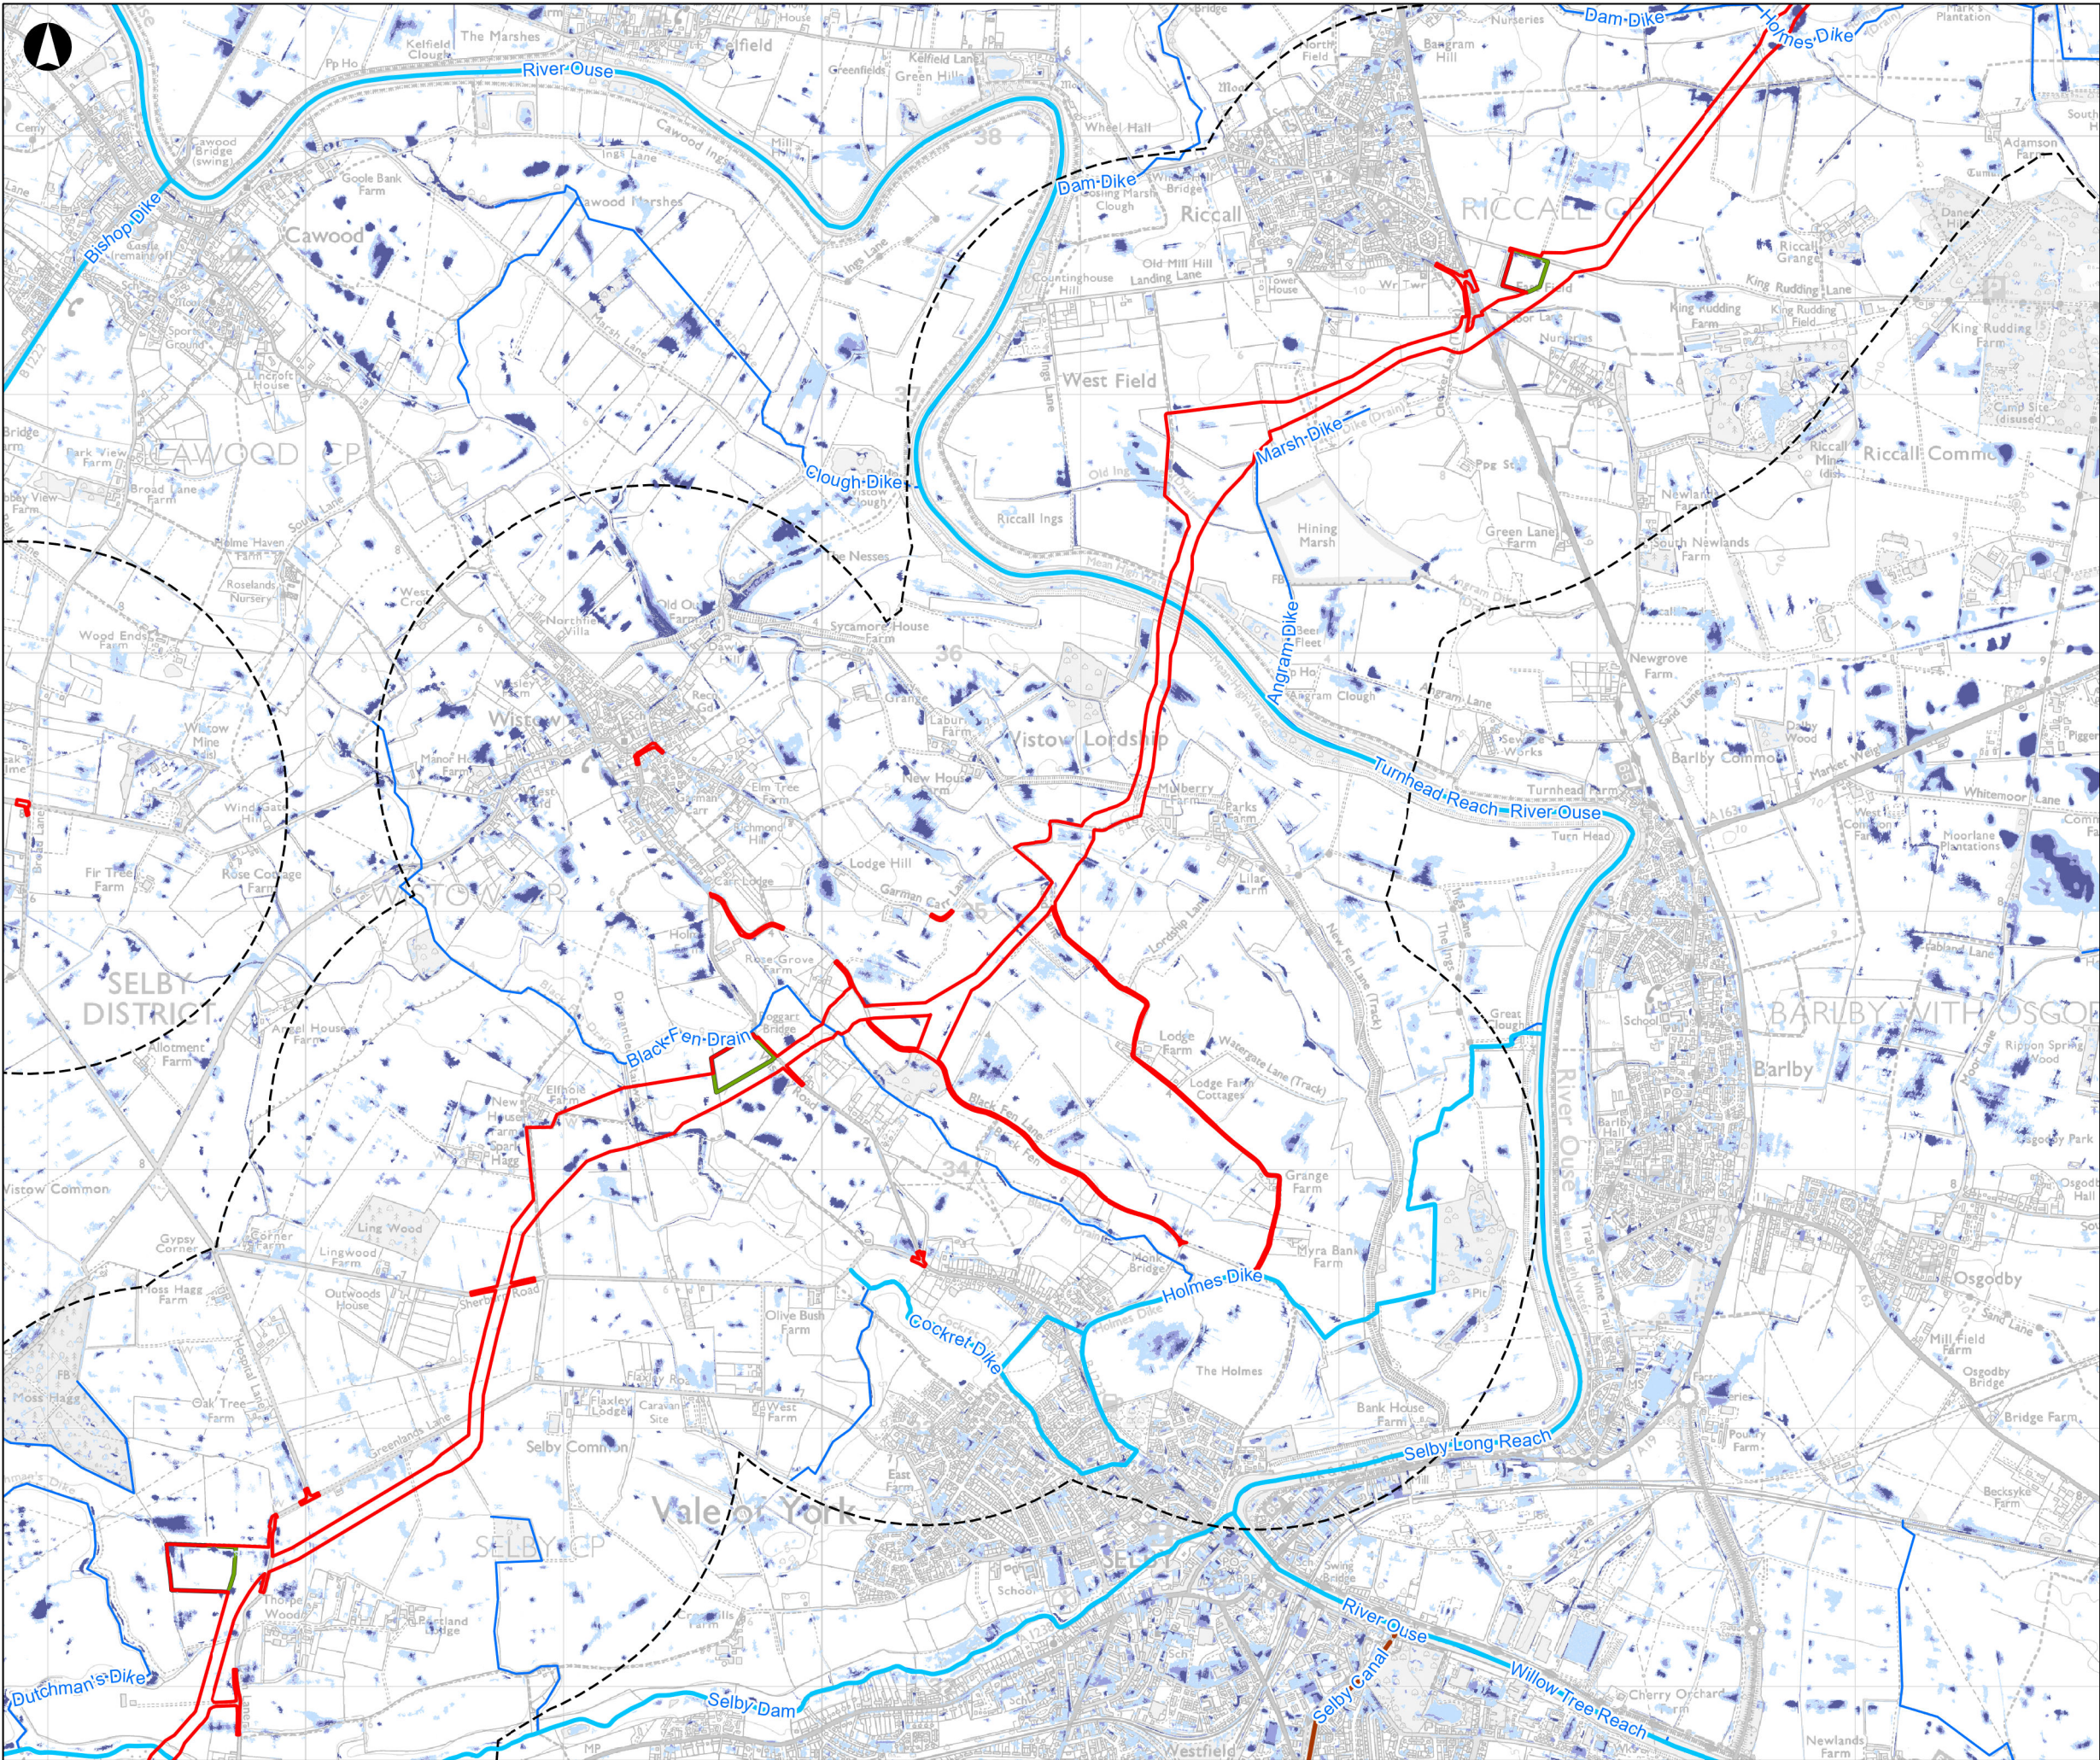


- Order Limits
- Study Area (1km)
- Cable Construction Compounds
- Substations
- BESS
- Main Rivers
- Ordinary Watercourses
- Canals
- Risk of Flooding from Surface Water**
- High (More than 3.3% chance each year)
- Medium (Between 1% and 3.3% chance each year)
- Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Esri, CGIAR, USGS, Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack

© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

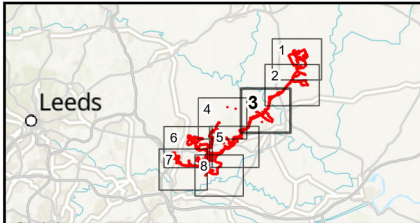

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd



Drawing Title

Figure 15.9
Risk of Flooding from Surface Water
Sheet Number 3 of 8

Client

Light Valley Solar Limited

Project Name

Light Valley Solar

Scale at A3

1:25,000

Project Number


302939-00

Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.15.09.03

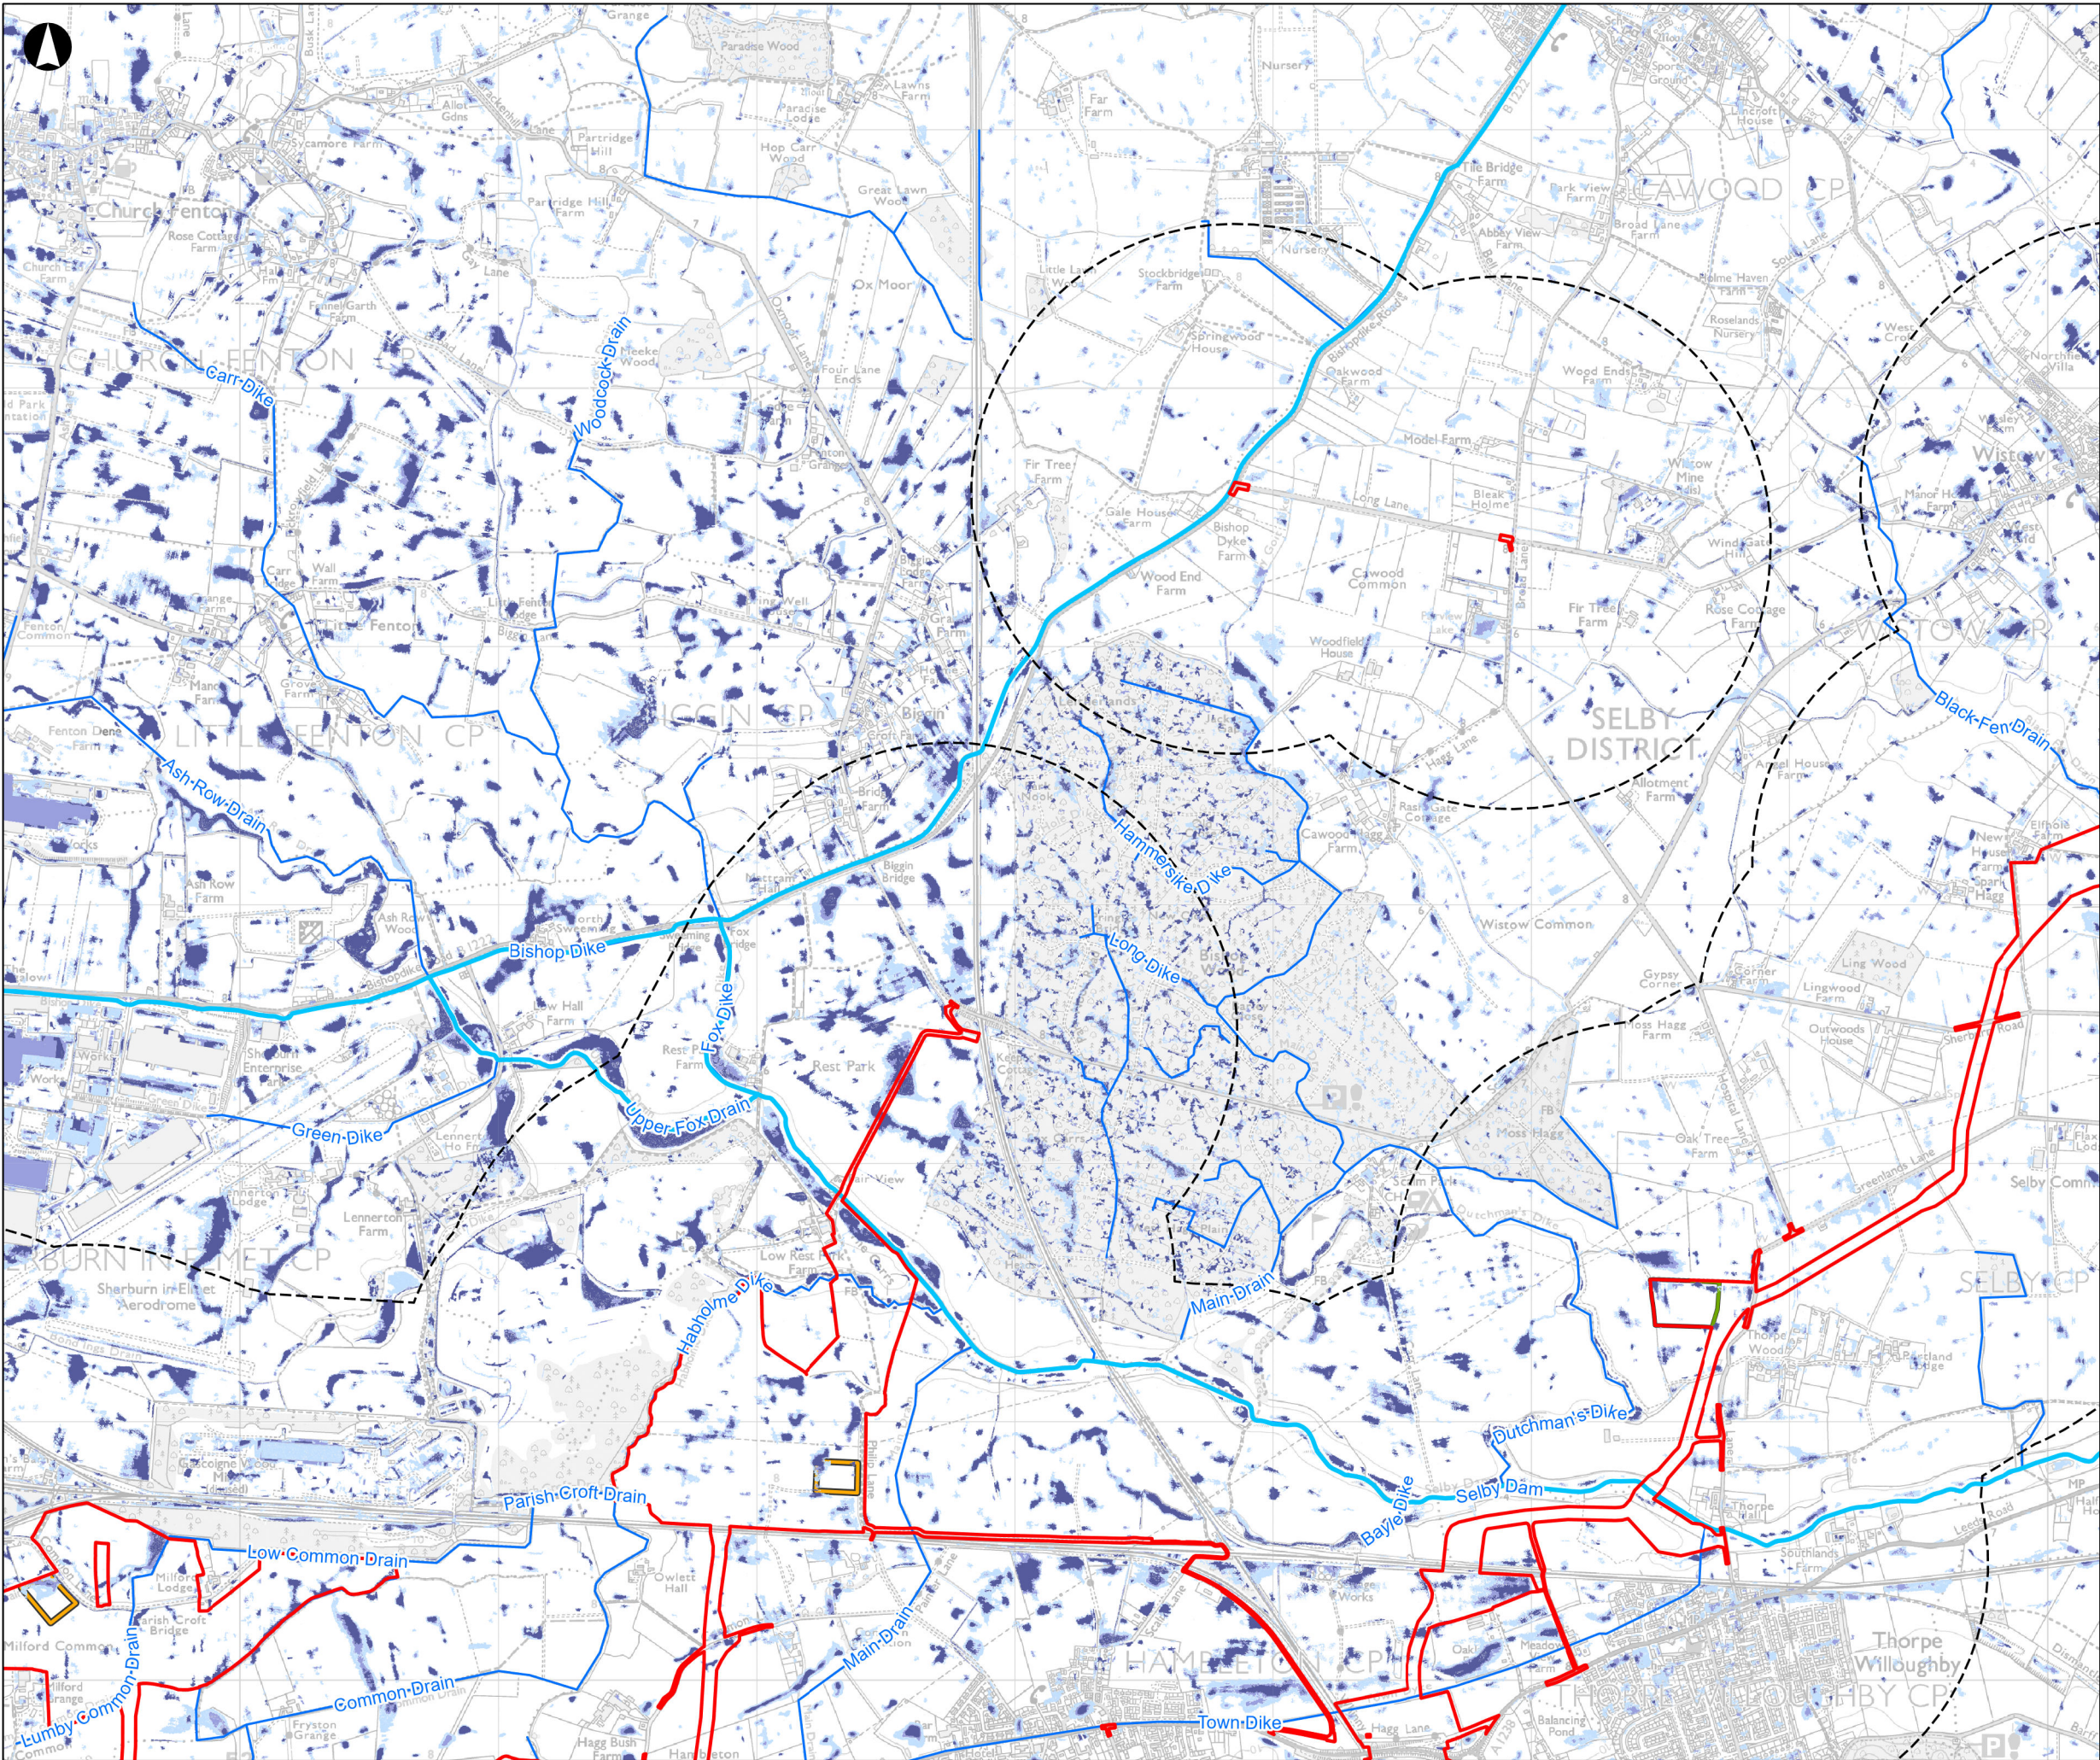

Order Limits

Study Area (1km)

Cable Construction Compounds

Solar Development Site Construction Compounds

Substations

BESS

Main Rivers

Ordinary Watercourses

Canals

Risk of Flooding from Surface Water

High (More than 3.3% chance each year)


Medium (Between 1% and 3.3% chance each year)

Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Esri, CGIAR, USGS, Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack


© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

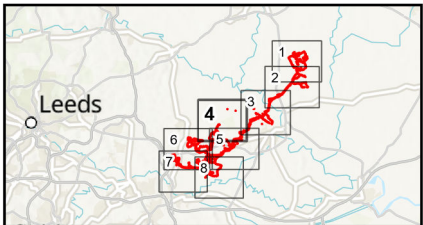

Kilometres					
0 1					
P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd



Drawing Title	
Figure 15.9 Risk of Flooding from Surface Water Sheet Number 4 of 8	
Client	
Light Valley Solar Limited	
Project Name	
Light Valley Solar	
Scale at A3	
1:25,000	
Project Number	Rev
302939-00	P02
Drawing Number	
EN0110012/APP/LVS/06.02.15.09.04	

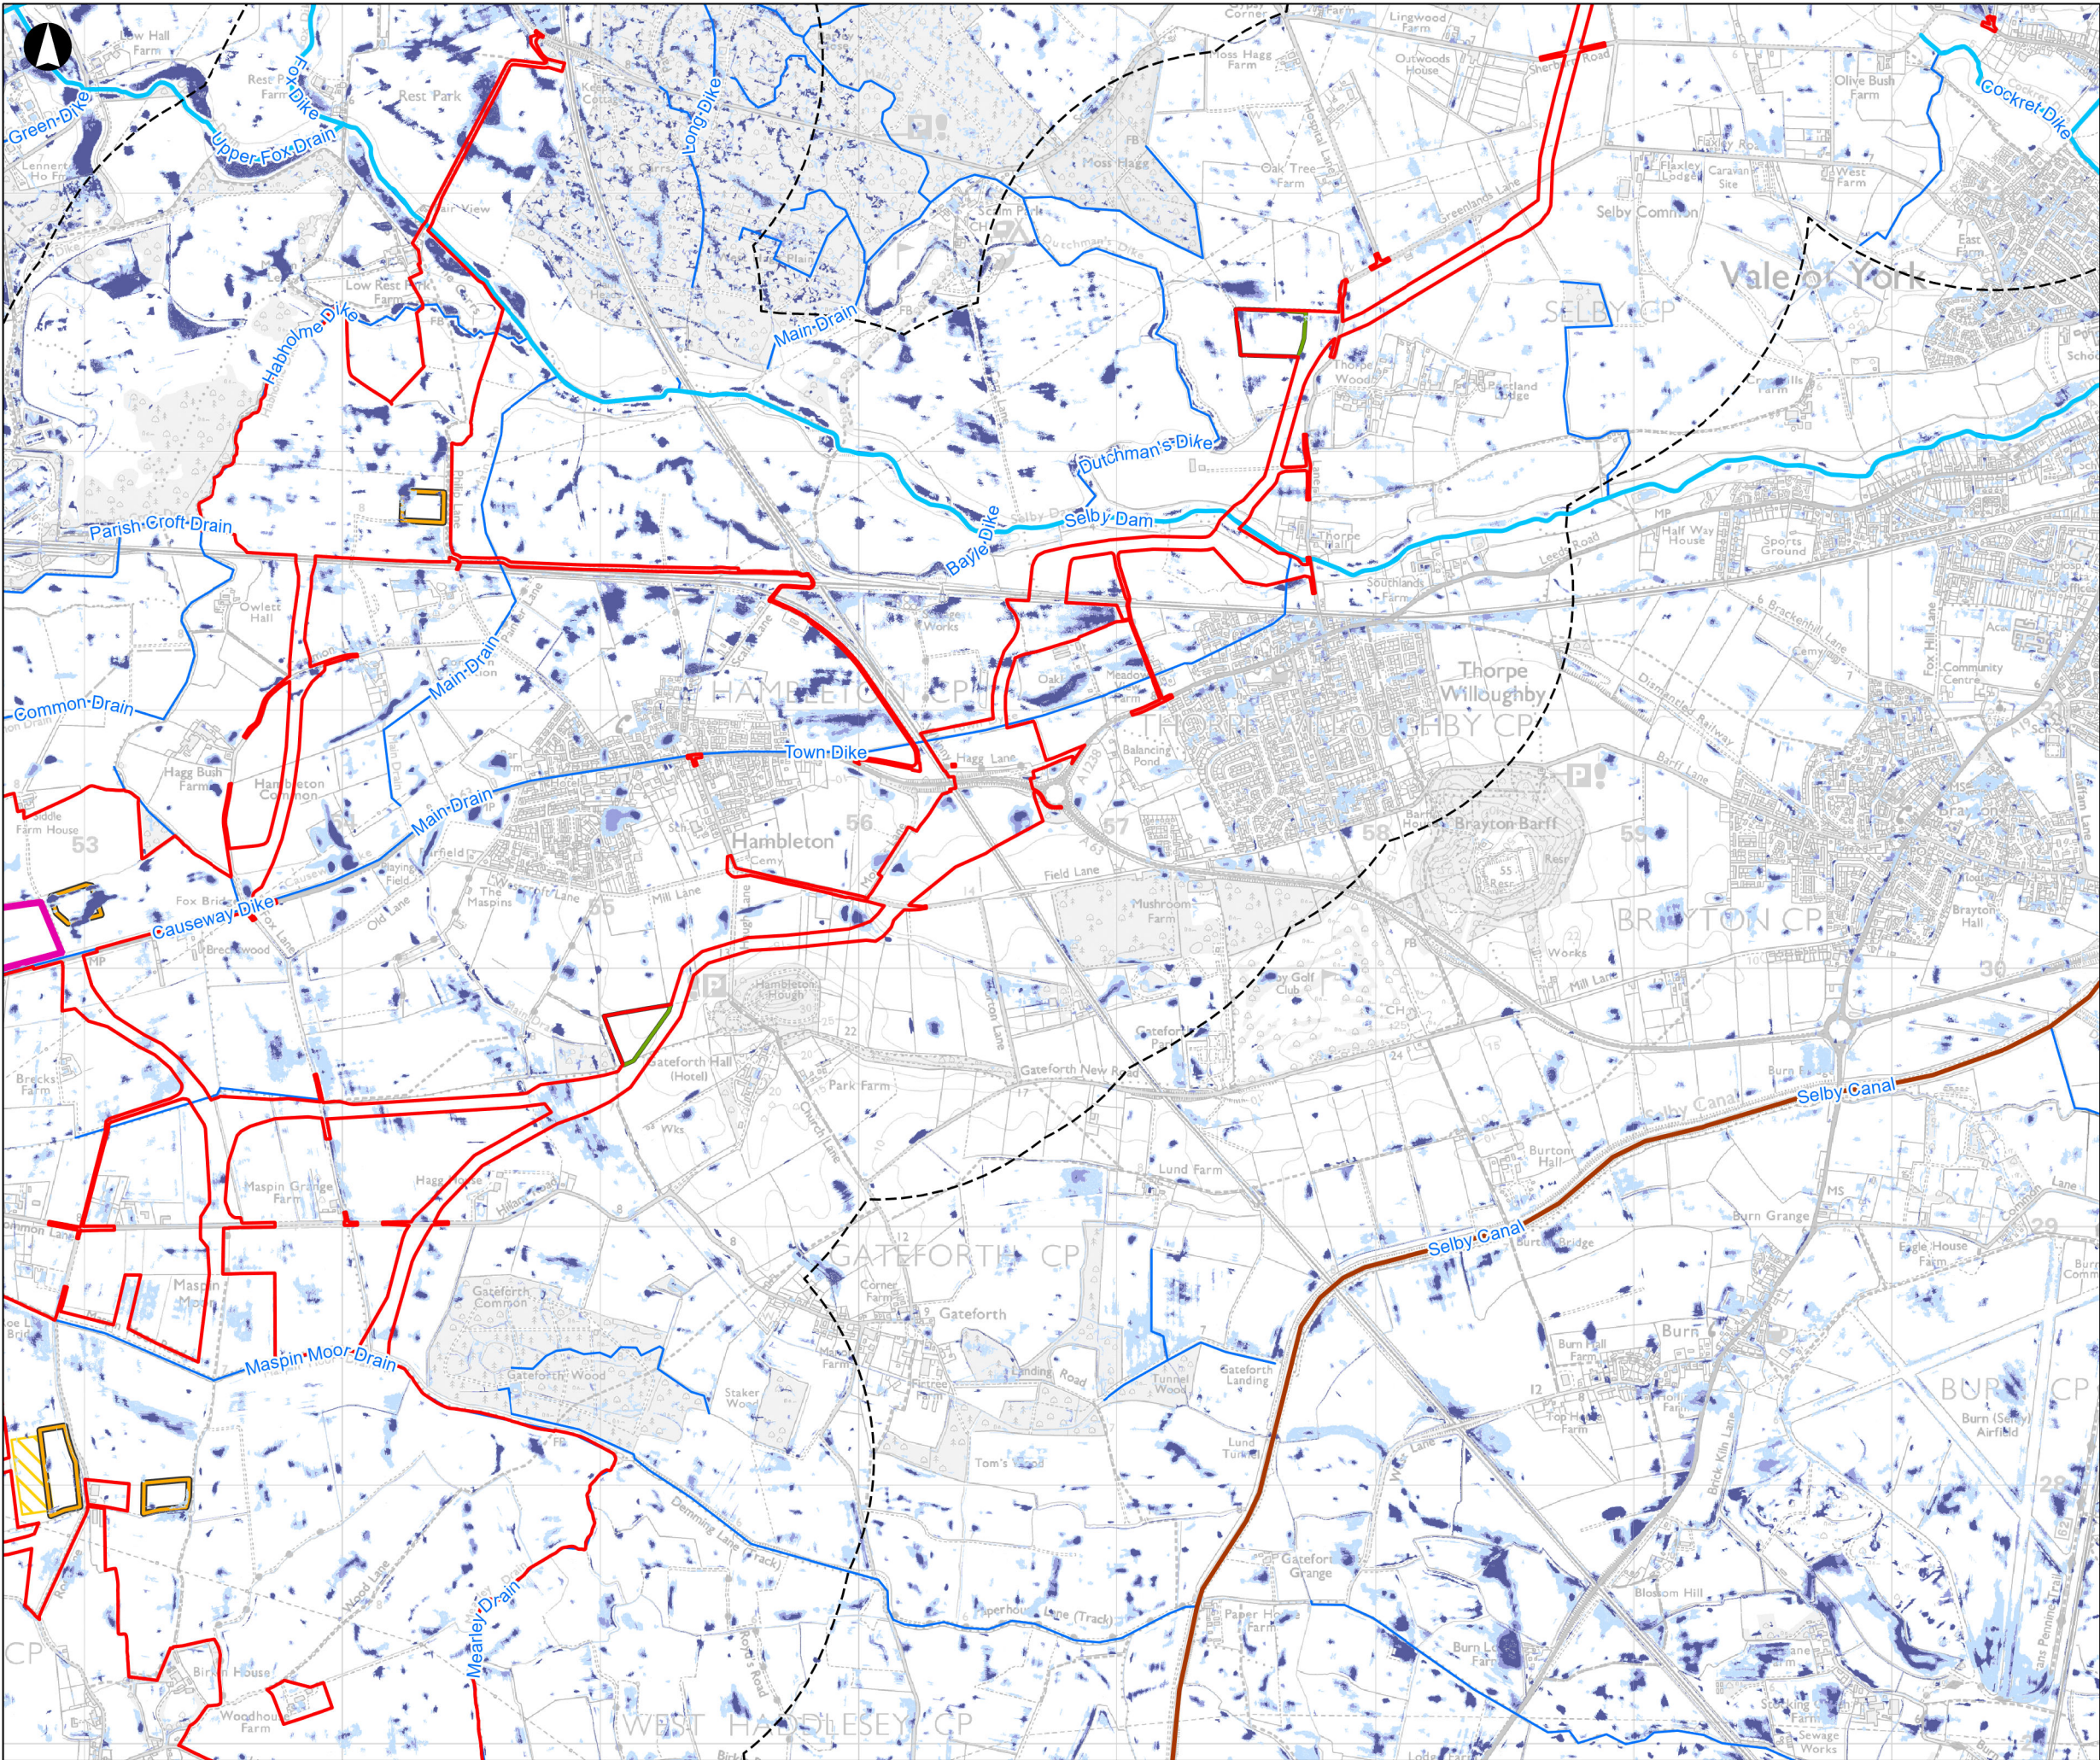

Order Limits

Study Area (1km)

Cable Construction Compounds

Solar Development Site Construction Compounds

Substations

BESS

Main Rivers

Ordinary Watercourses

Canals

Risk of Flooding from Surface Water

High (More than 3.3% chance each year)

Medium (Between 1% and 3.3% chance each year)

Low (Between 0.1% and 1% chance each year)

A3

Coordinate System: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS. Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack

© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd

Drawing Title

Figure 15.9
Risk of Flooding from Surface Water
Sheet Number 5 of 8

Client

Light Valley Solar Limited

Project Name

Light Valley Solar

Scale at A3

1:25,000

Project Number

302939-00


Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.15.09.05

© Arup 2026

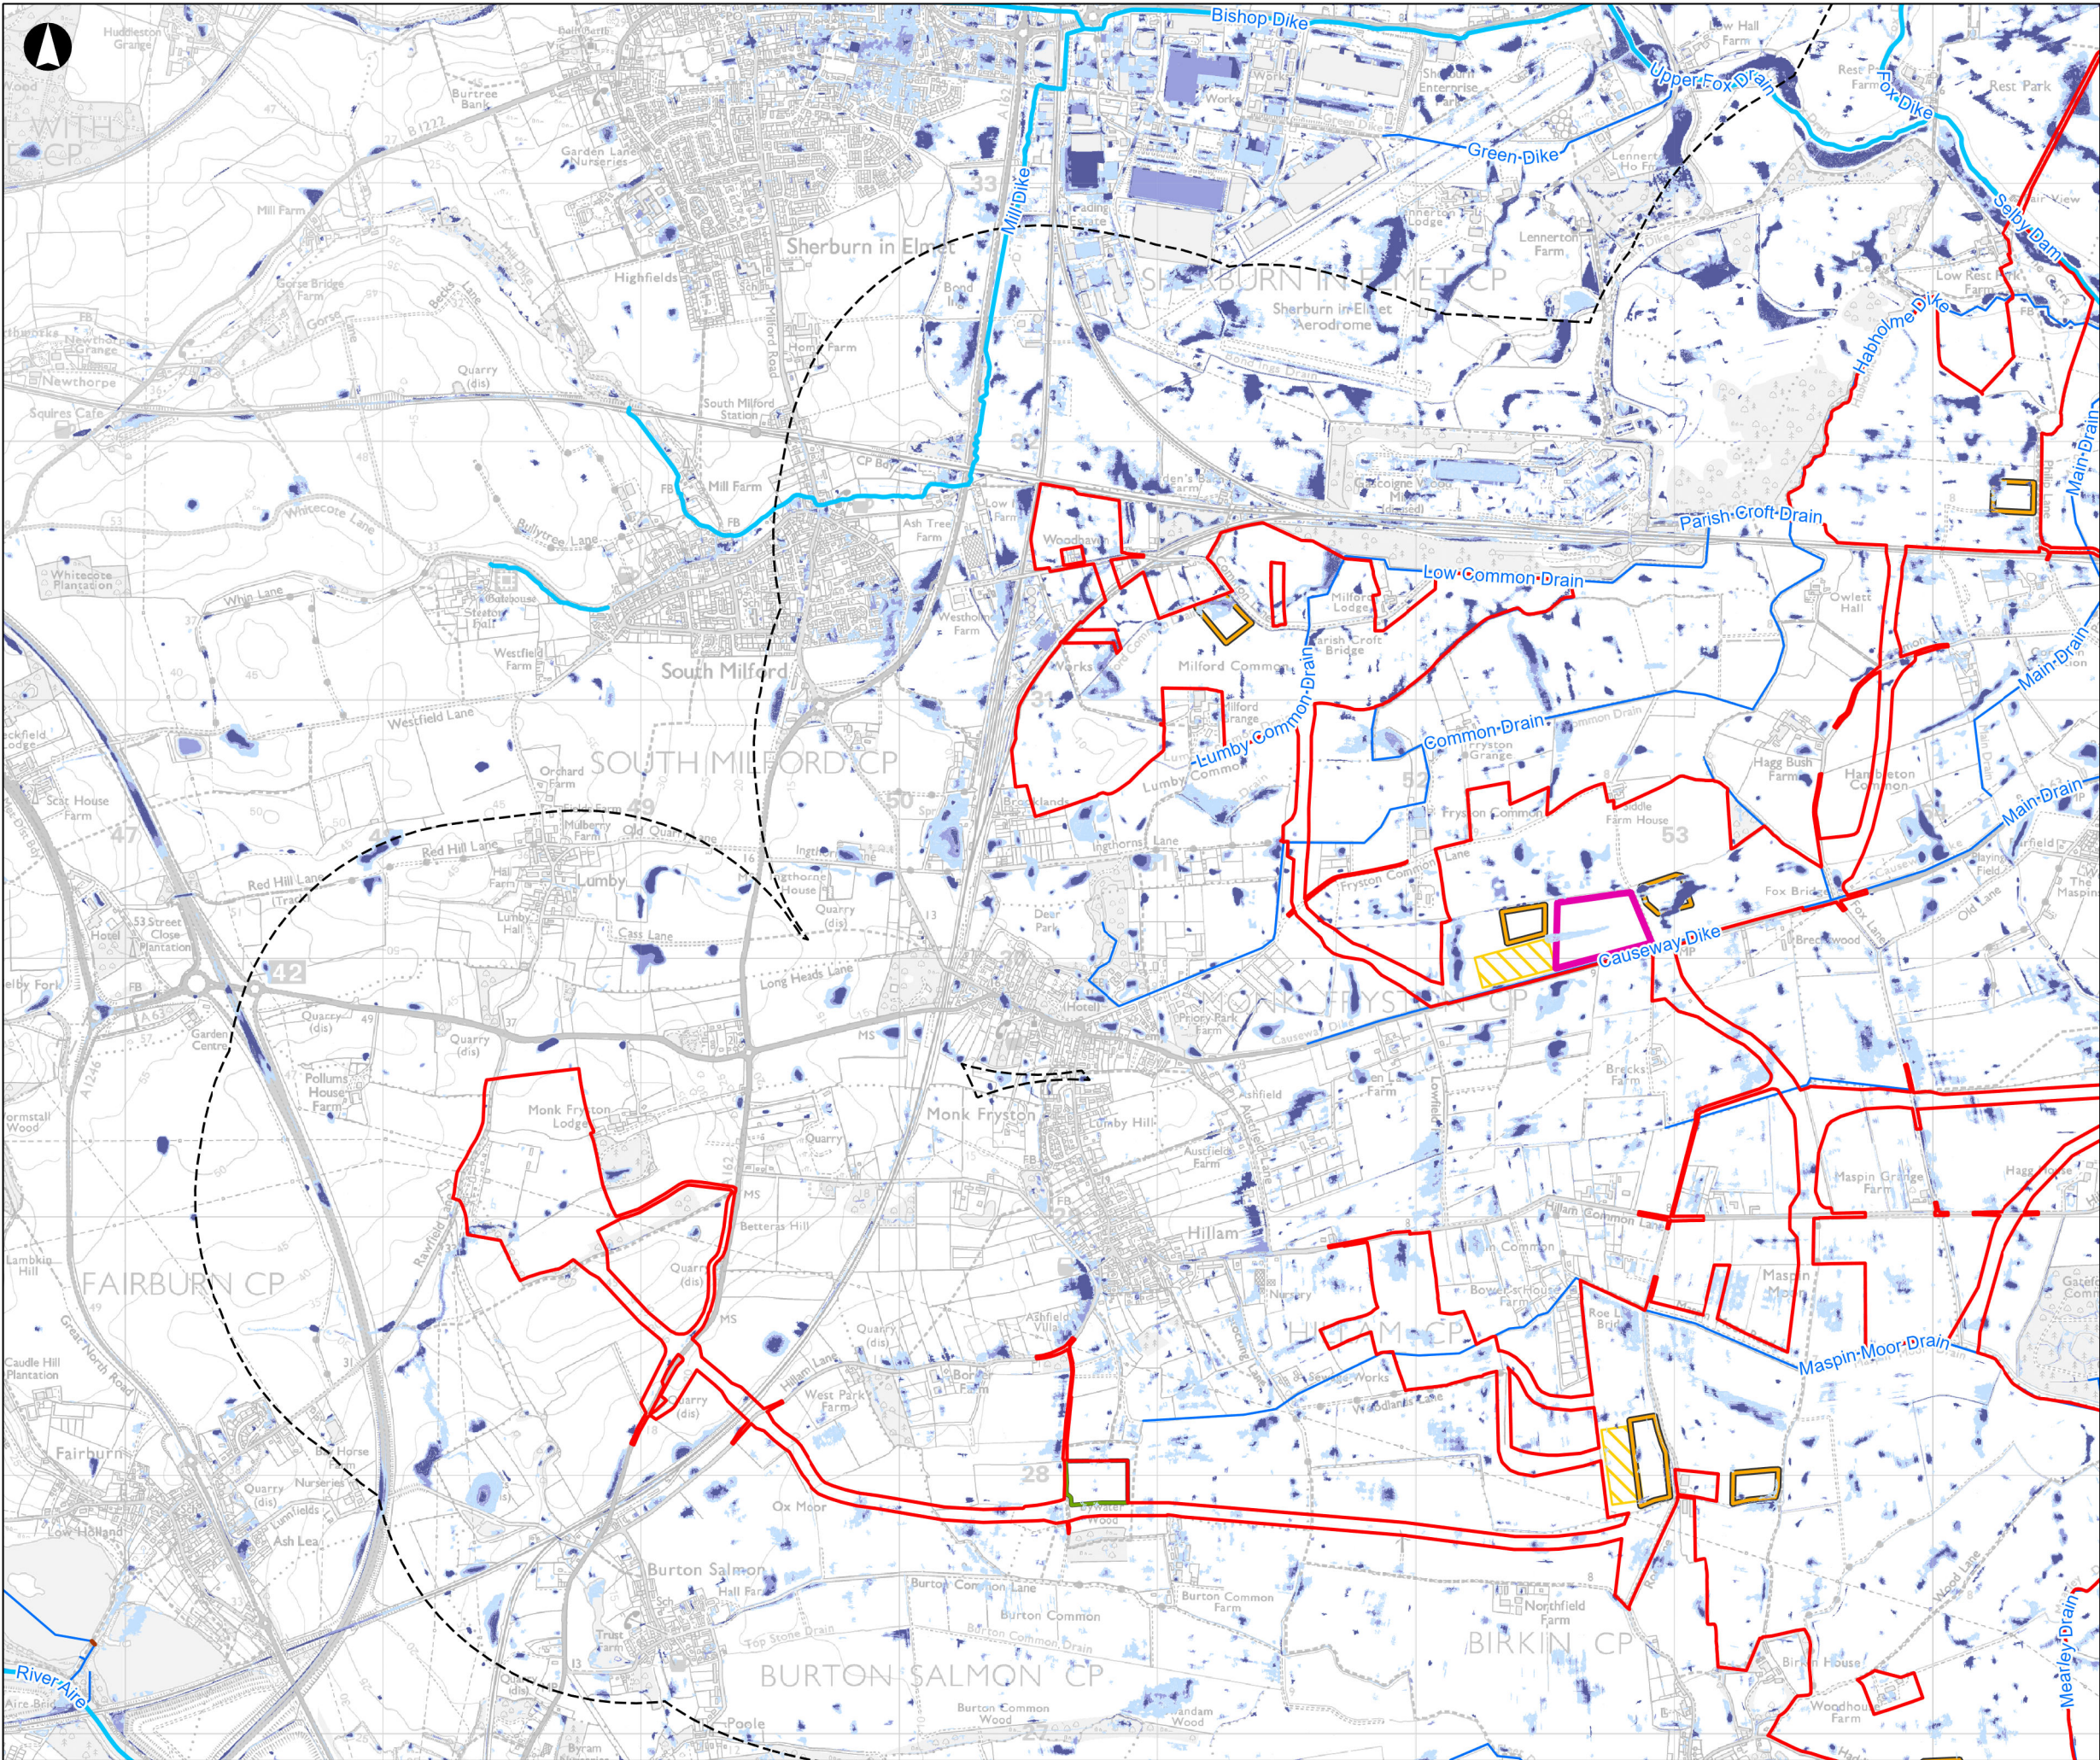


- Order Limits
 - Study Area (1km)
 - Cable Construction Compounds
 - Solar Development Site Construction Compounds
 - Substations
 - BESS
 - Main Rivers
 - Ordinary Watercourses
 - Canals
- Risk of Flooding from Surface Water**
- High (More than 3.3% chance each year)
 - Medium (Between 1% and 3.3% chance each year)
 - Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS. Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack


© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

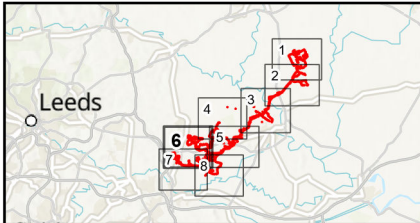

Kilometres					
0 1					
P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd



Drawing Title	
Figure 15.9 Risk of Flooding from Surface Water Sheet Number 6 of 8	
Client	
Light Valley Solar Limited	
Project Name	
Light Valley Solar	
Scale at A3	
1:25,000	
Project Number	Rev
302939-00	P02
Drawing Number	
EN0110012/APP/LVS/06.02.15.09.06	

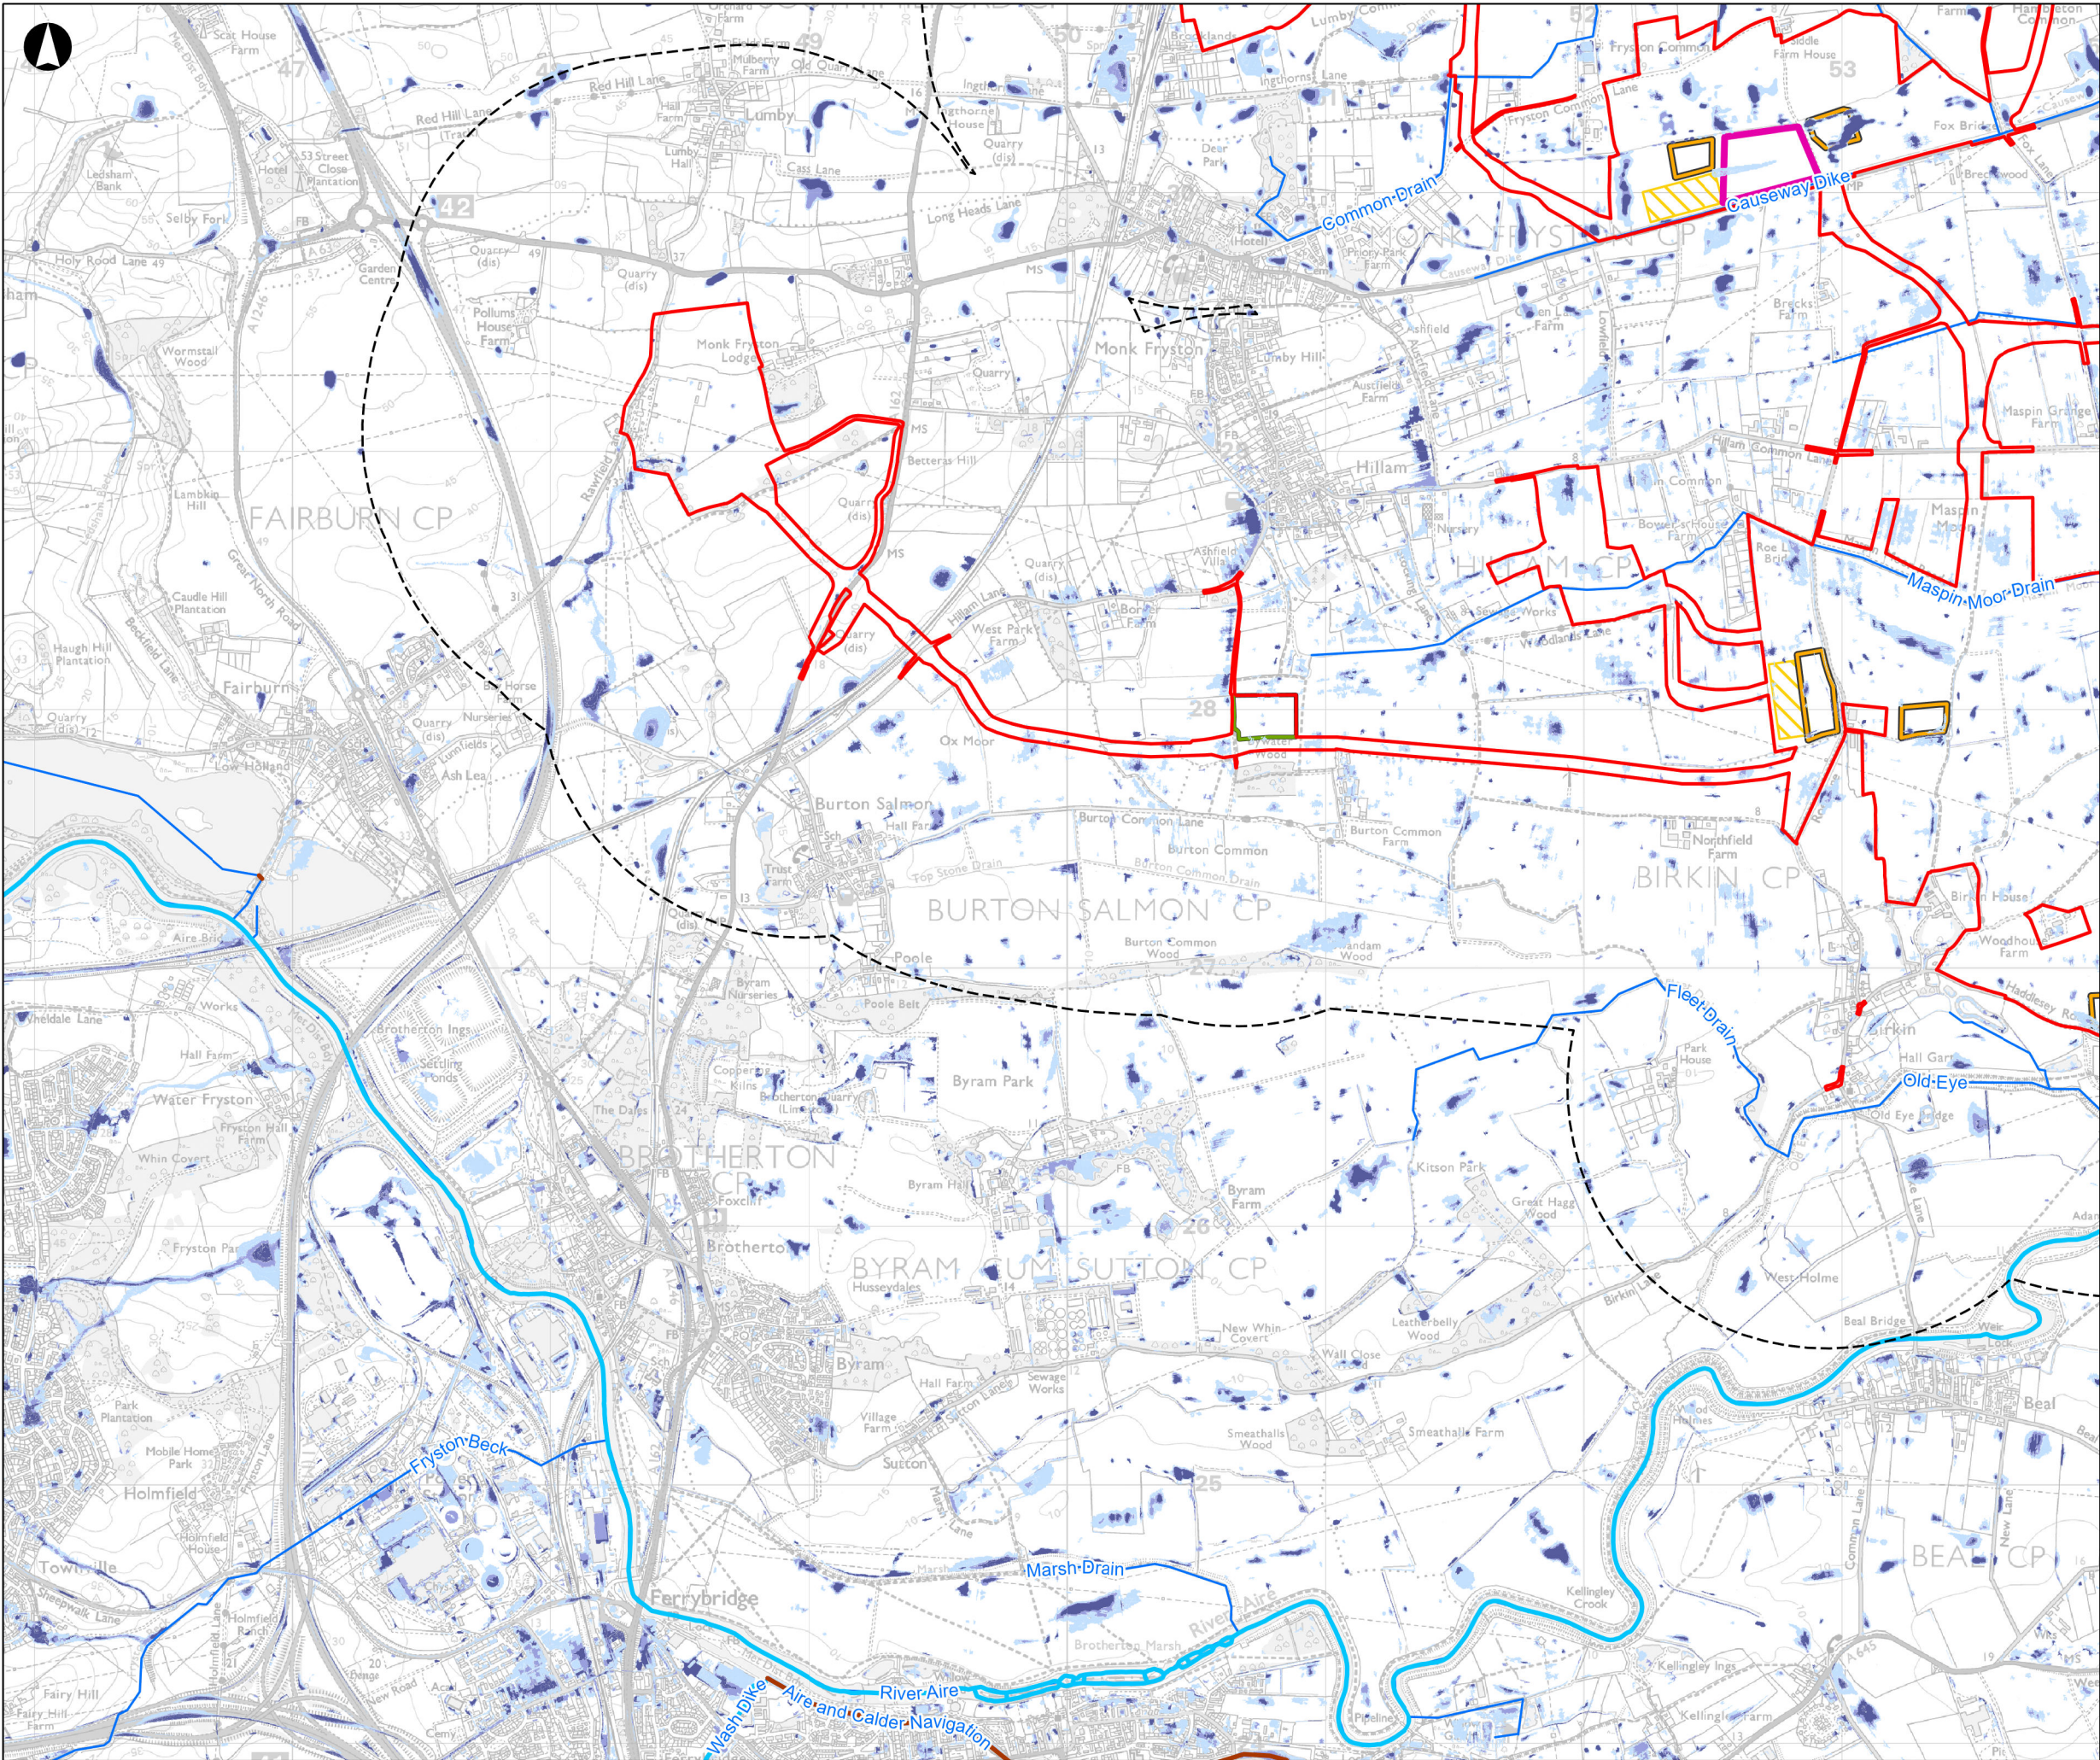


- Order Limits
 - Study Area (1km)
 - Cable Construction Compounds
 - Solar Development Site Construction Compounds
 - Substations
 - BESS
 - Main Rivers
 - Ordinary Watercourses
 - Canals
- Risk of Flooding from Surface Water**
- High (More than 3.3% chance each year)
 - Medium (Between 1% and 3.3% chance each year)
 - Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Esri, CGIAR, USGS, Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack

© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

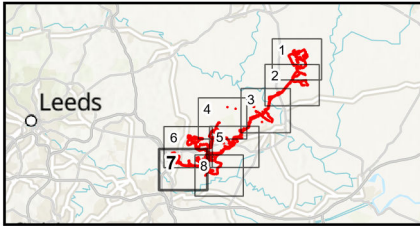

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd



Drawing Title

Figure 15.9
Risk of Flooding from Surface Water
Sheet Number 7 of 8

Client

Light Valley Solar Limited

Project Name

Light Valley Solar

Scale at A3

1:25,000

Project Number


302939-00

Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.15.09.07

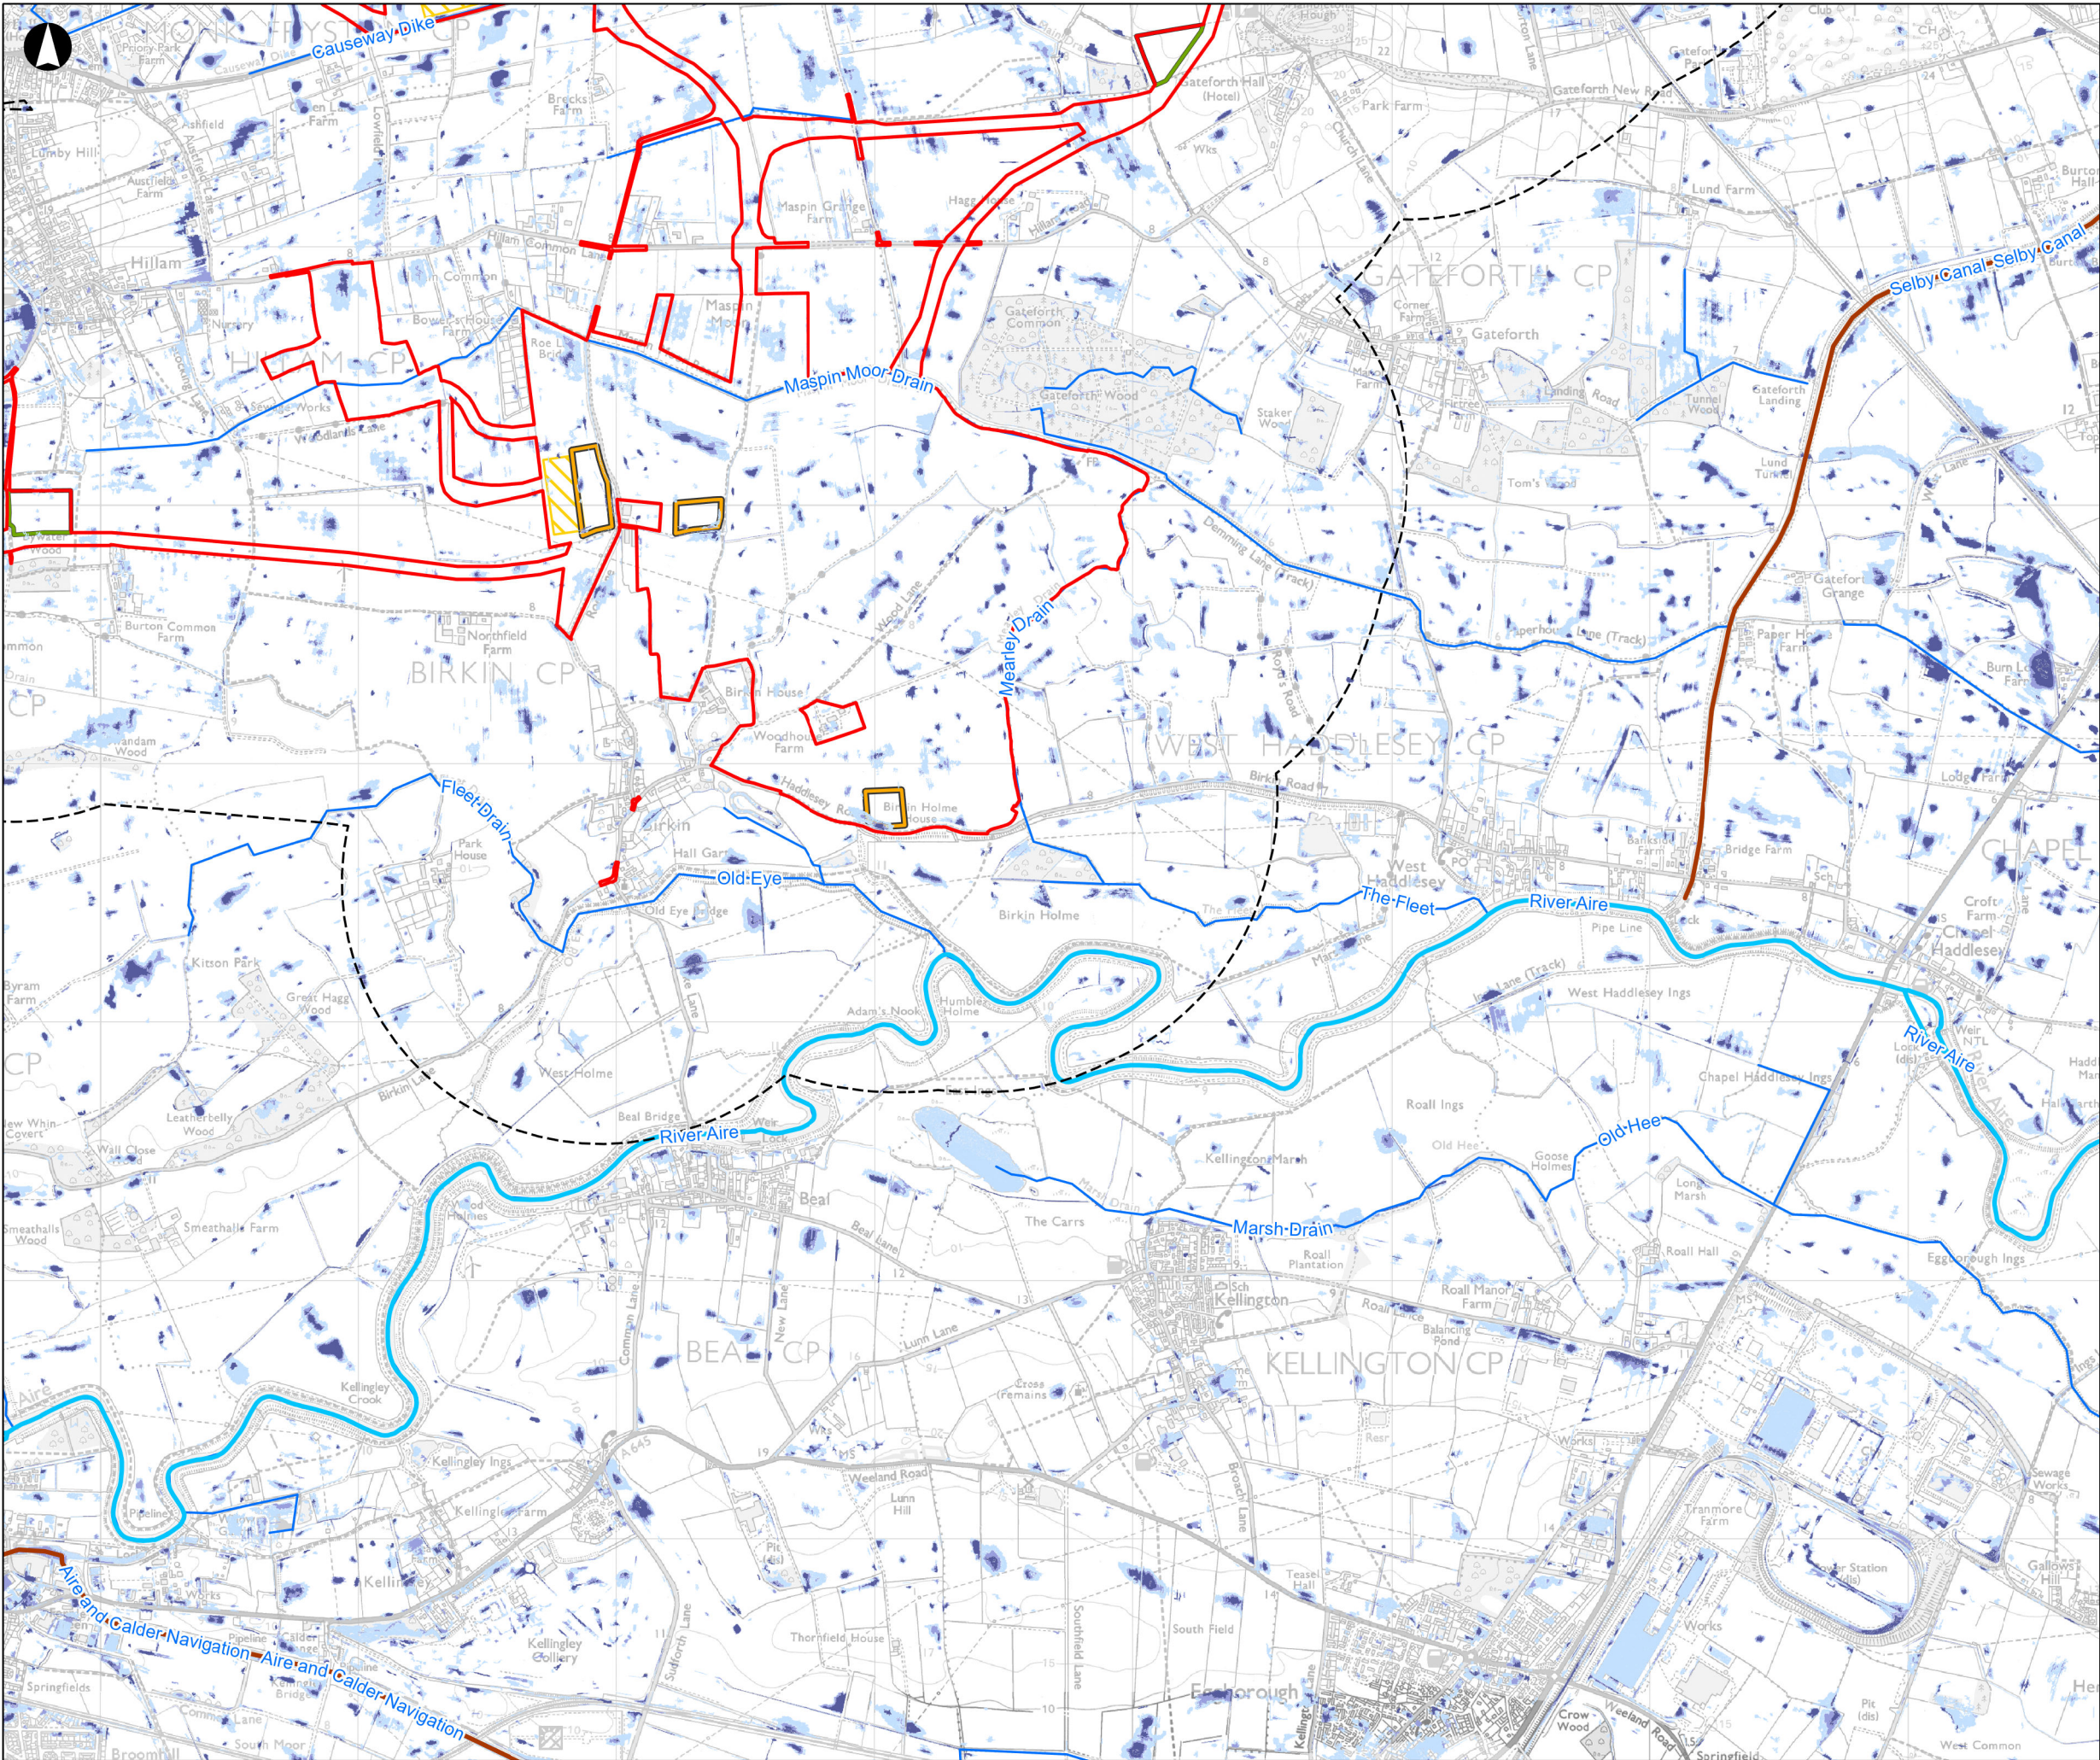


- Order Limits
- Study Area (1km)
- Cable Construction Compounds
- Solar Development Site Construction Compounds
- Substations
- BESS
- Main Rivers
- Ordinary Watercourses
- Canals
- Risk of Flooding from Surface Water**
- High (More than 3.3% chance each year)
- Medium (Between 1% and 3.3% chance each year)
- Low (Between 0.1% and 1% chance each year)

Coordinate System: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS. Contains OS data © Crown Copyright and database right 2026. Contains data from OS Zoomstack

© Environment Agency copyright and/or database right 2016. All rights reserved. Contains Ordnance Survey data © Crown copyright and database right 2013. Contains public sector information licensed under the Open Government Licence v3.0.

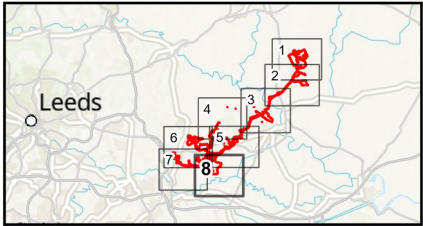

P02	27/08/2026	ACAR	CWIL	NWIL	JBEE
Rev	Date	By	Chkd	Appd	Authd

Light Valley Solar

Drawing Title

Figure 15.9
Risk of Flooding from Surface Water
Sheet Number 8 of 8

Client

Light Valley Solar Limited

Project Name

Light Valley Solar

Scale at A3

1:25,000

Project Number

302939-00

Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.15.09.08