
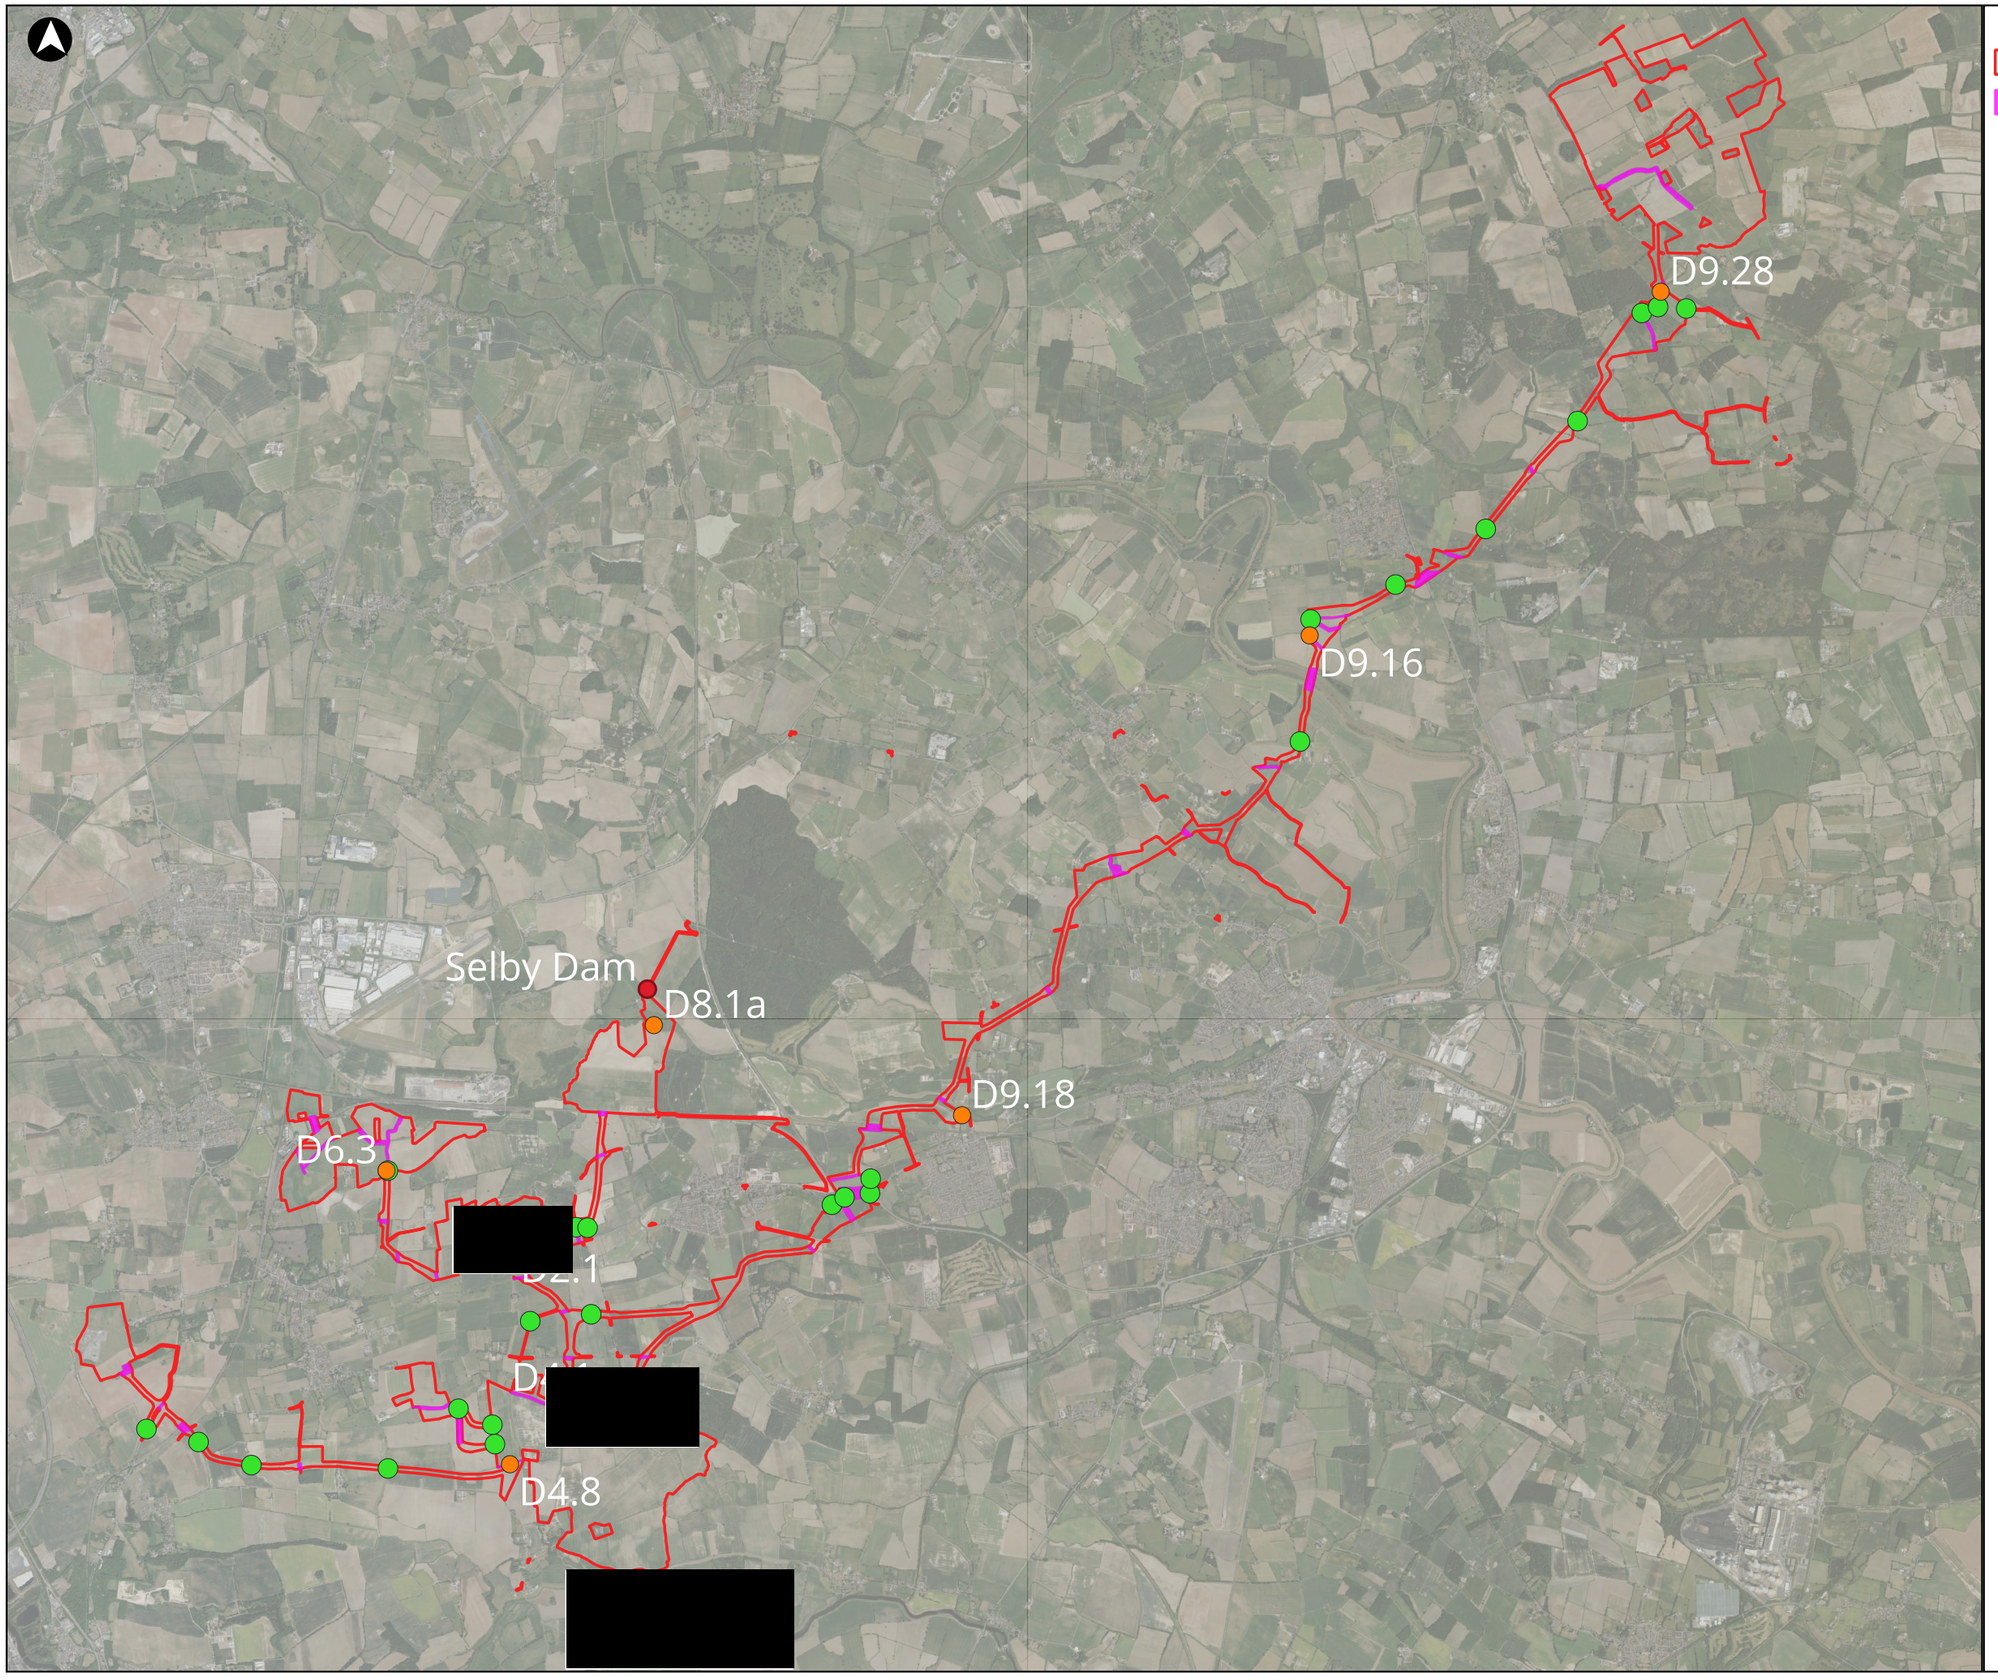


A3

- Order limits
- Avoidance Area-Any watercourse present will be crossed with trenchless techniques
- Otter field sign-spraint
- Otter field sign-prints
- Otter field sign-possible historic spraint
- Otter field sign-entry/exit point (River Aire-outside Order Limits)
- Otter field sign-couch (River Aire-outside Order Limits)
- Otter survey point within Cable Route Corridor-negligible suitability
- Otter survey point within Cable Route Corridor-low suitability
- Otter survey point within Cable Route Corridor-high suitability

Coordinate System: British National Grid

Aerial Map: Google Satelitte

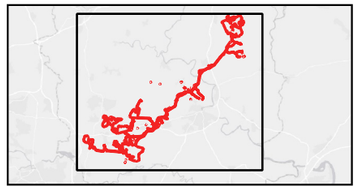

Meters

0 600 1,200 1,800 2,400 3,000 m

Rev	Date	By	Chkd	Appd	Authd
P05	09/11/2026	OMD	RR	RR	RR

Light Valley Solar

Drawing Title

Figure Number: 6.7
Otter Survey Results
Sheet Number 1 of 4

Client

Light Valley Solar Limted

Project Name

Light Valley Solar

Scale at A3

1:65,000

Project Number

302939-00


Rev

P05

Drawing Number

EN0110012/APP/LVS/06.02.06.07

© Arup 2025

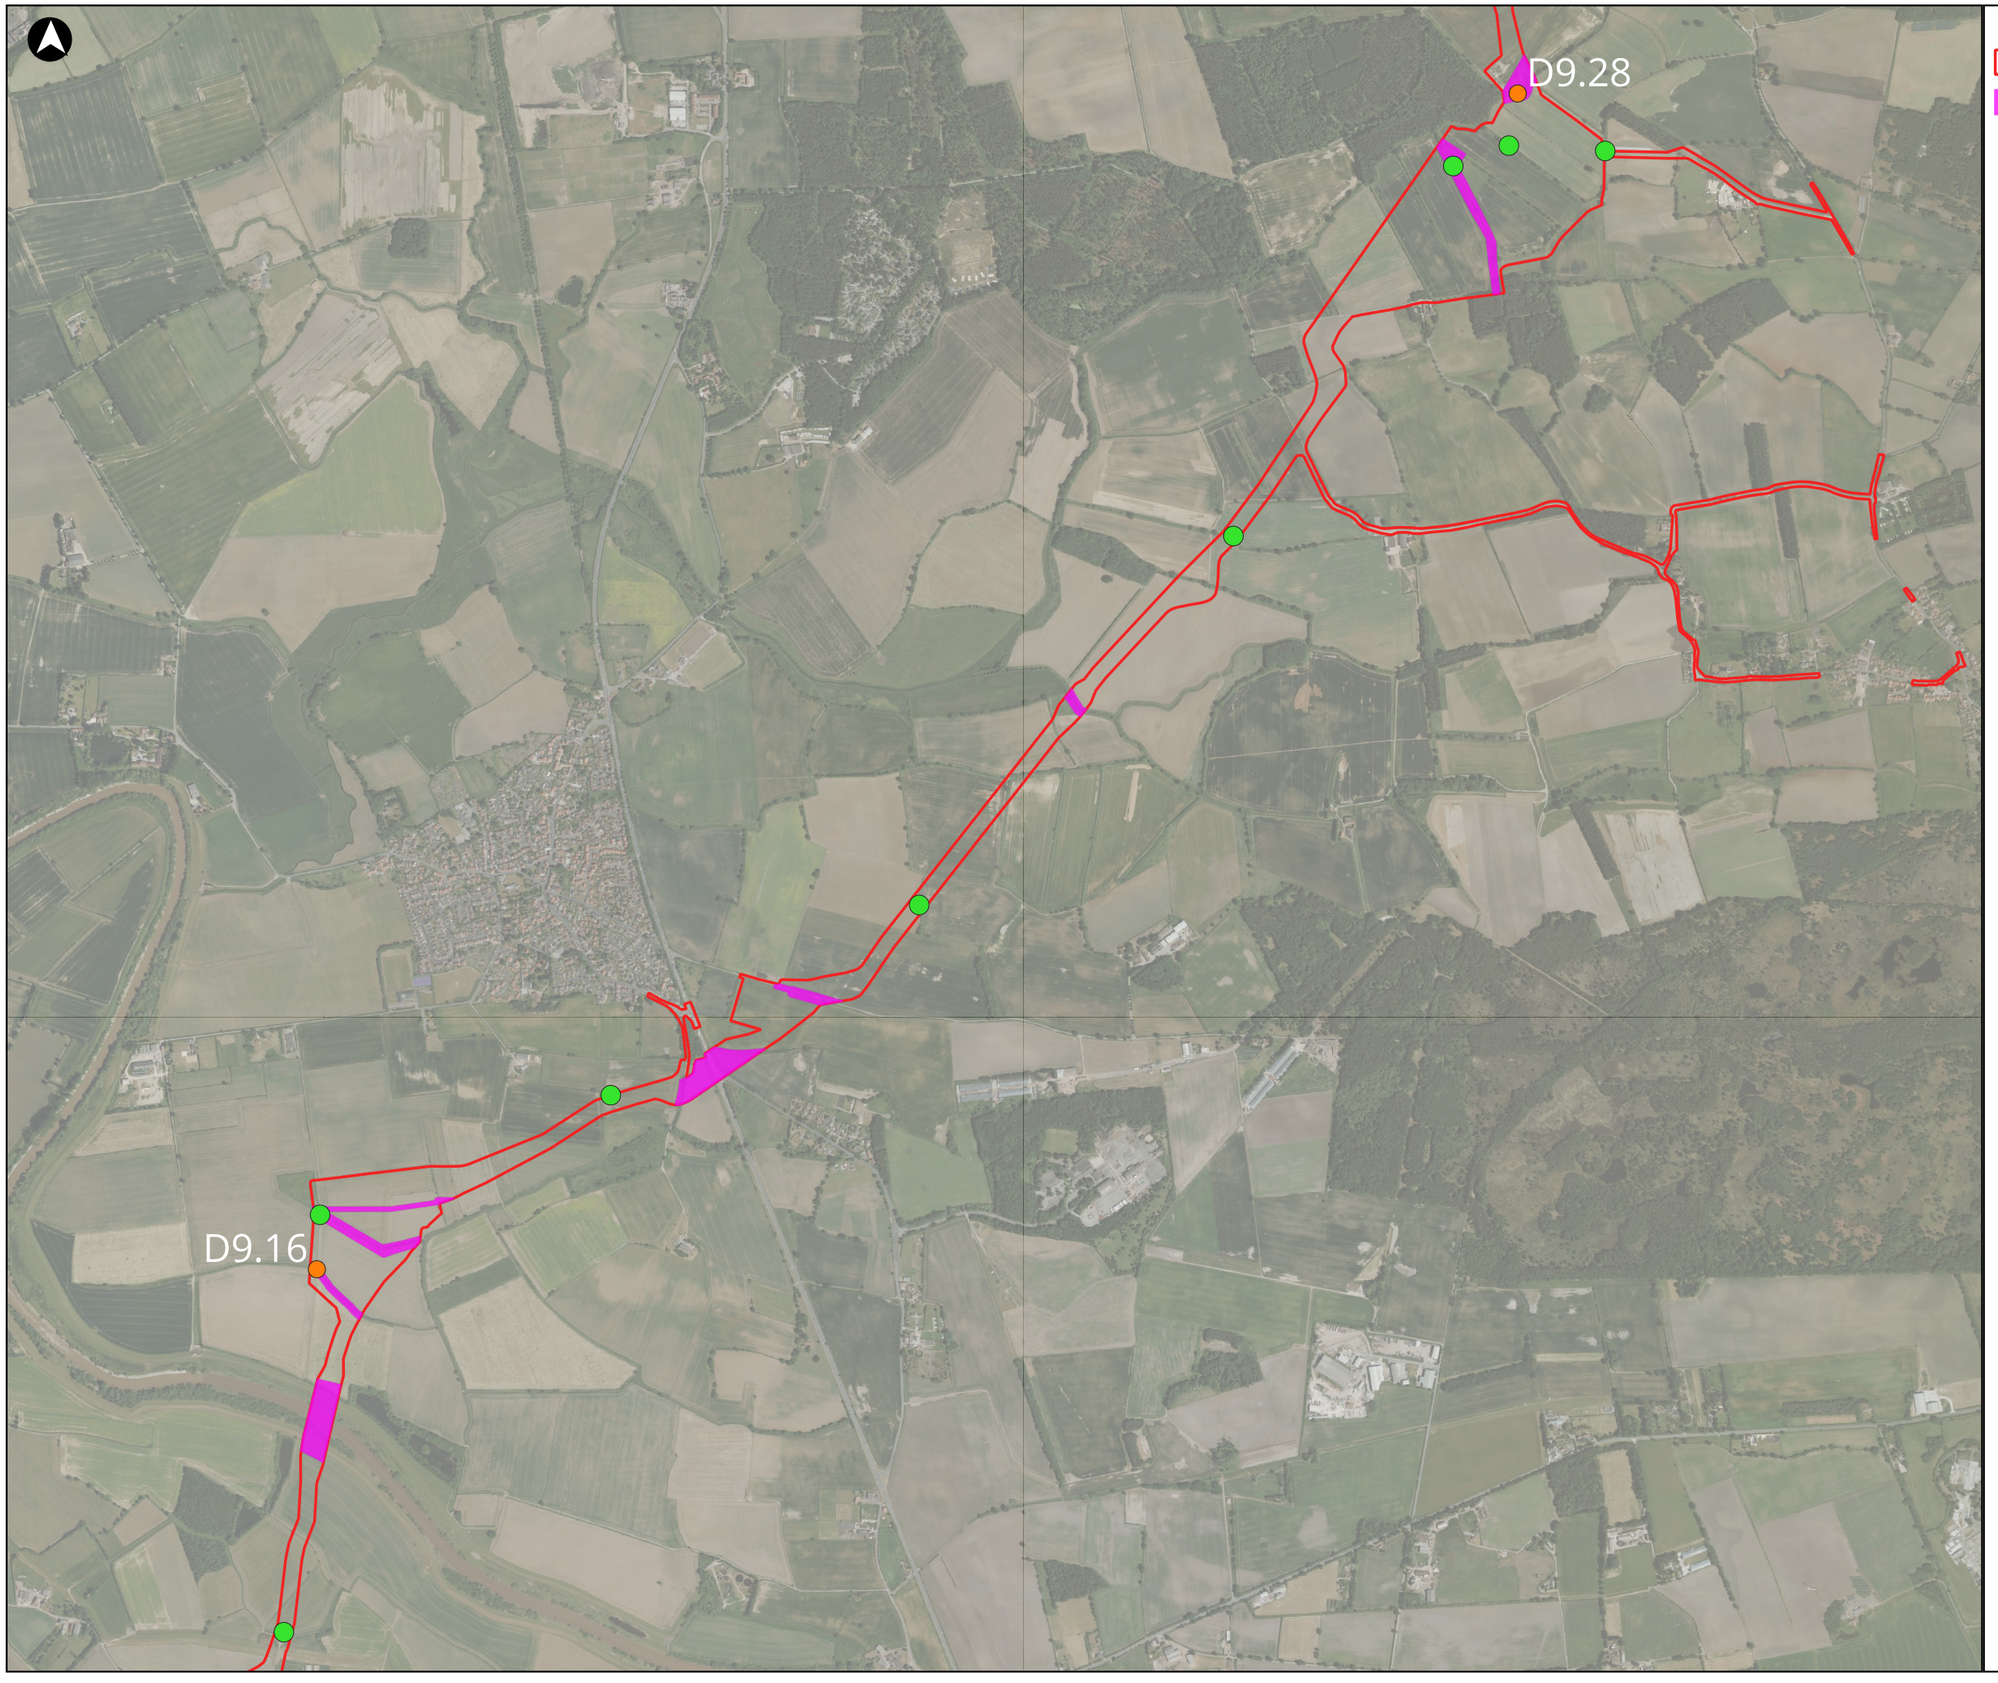

A3

Order limits


Avoidance Area-Any watercourse present will be crossed with trenchless techniques

Otter survey point within Cable Route Corridor-negligible suitability

Otter survey point within Cable Route Corridor-low suitability

Coordinate System: British National Grid

Aerial Map: Google Satelitte

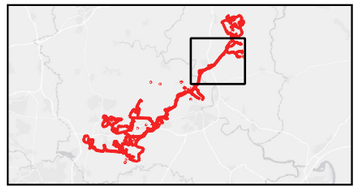

Meters

0 100 200 300 400 500 m

Rev	Date	By	Chkd	Appd	Authd
P04	09/11/2026	OMD	RR	RR	RR

Light Valley Solar

Drawing Title

Figure Number: 6.7
Otter Survey Results
Sheet Number 2 of 4

Client

Light Valley Solar Limted

Project Name

Light Valley Solar

Scale at A3

1:19,000

Project Number

302939-00


Rev

P04

Drawing Number

EN0110012/APP/LVS/06.02.06.07

© Arup 2025

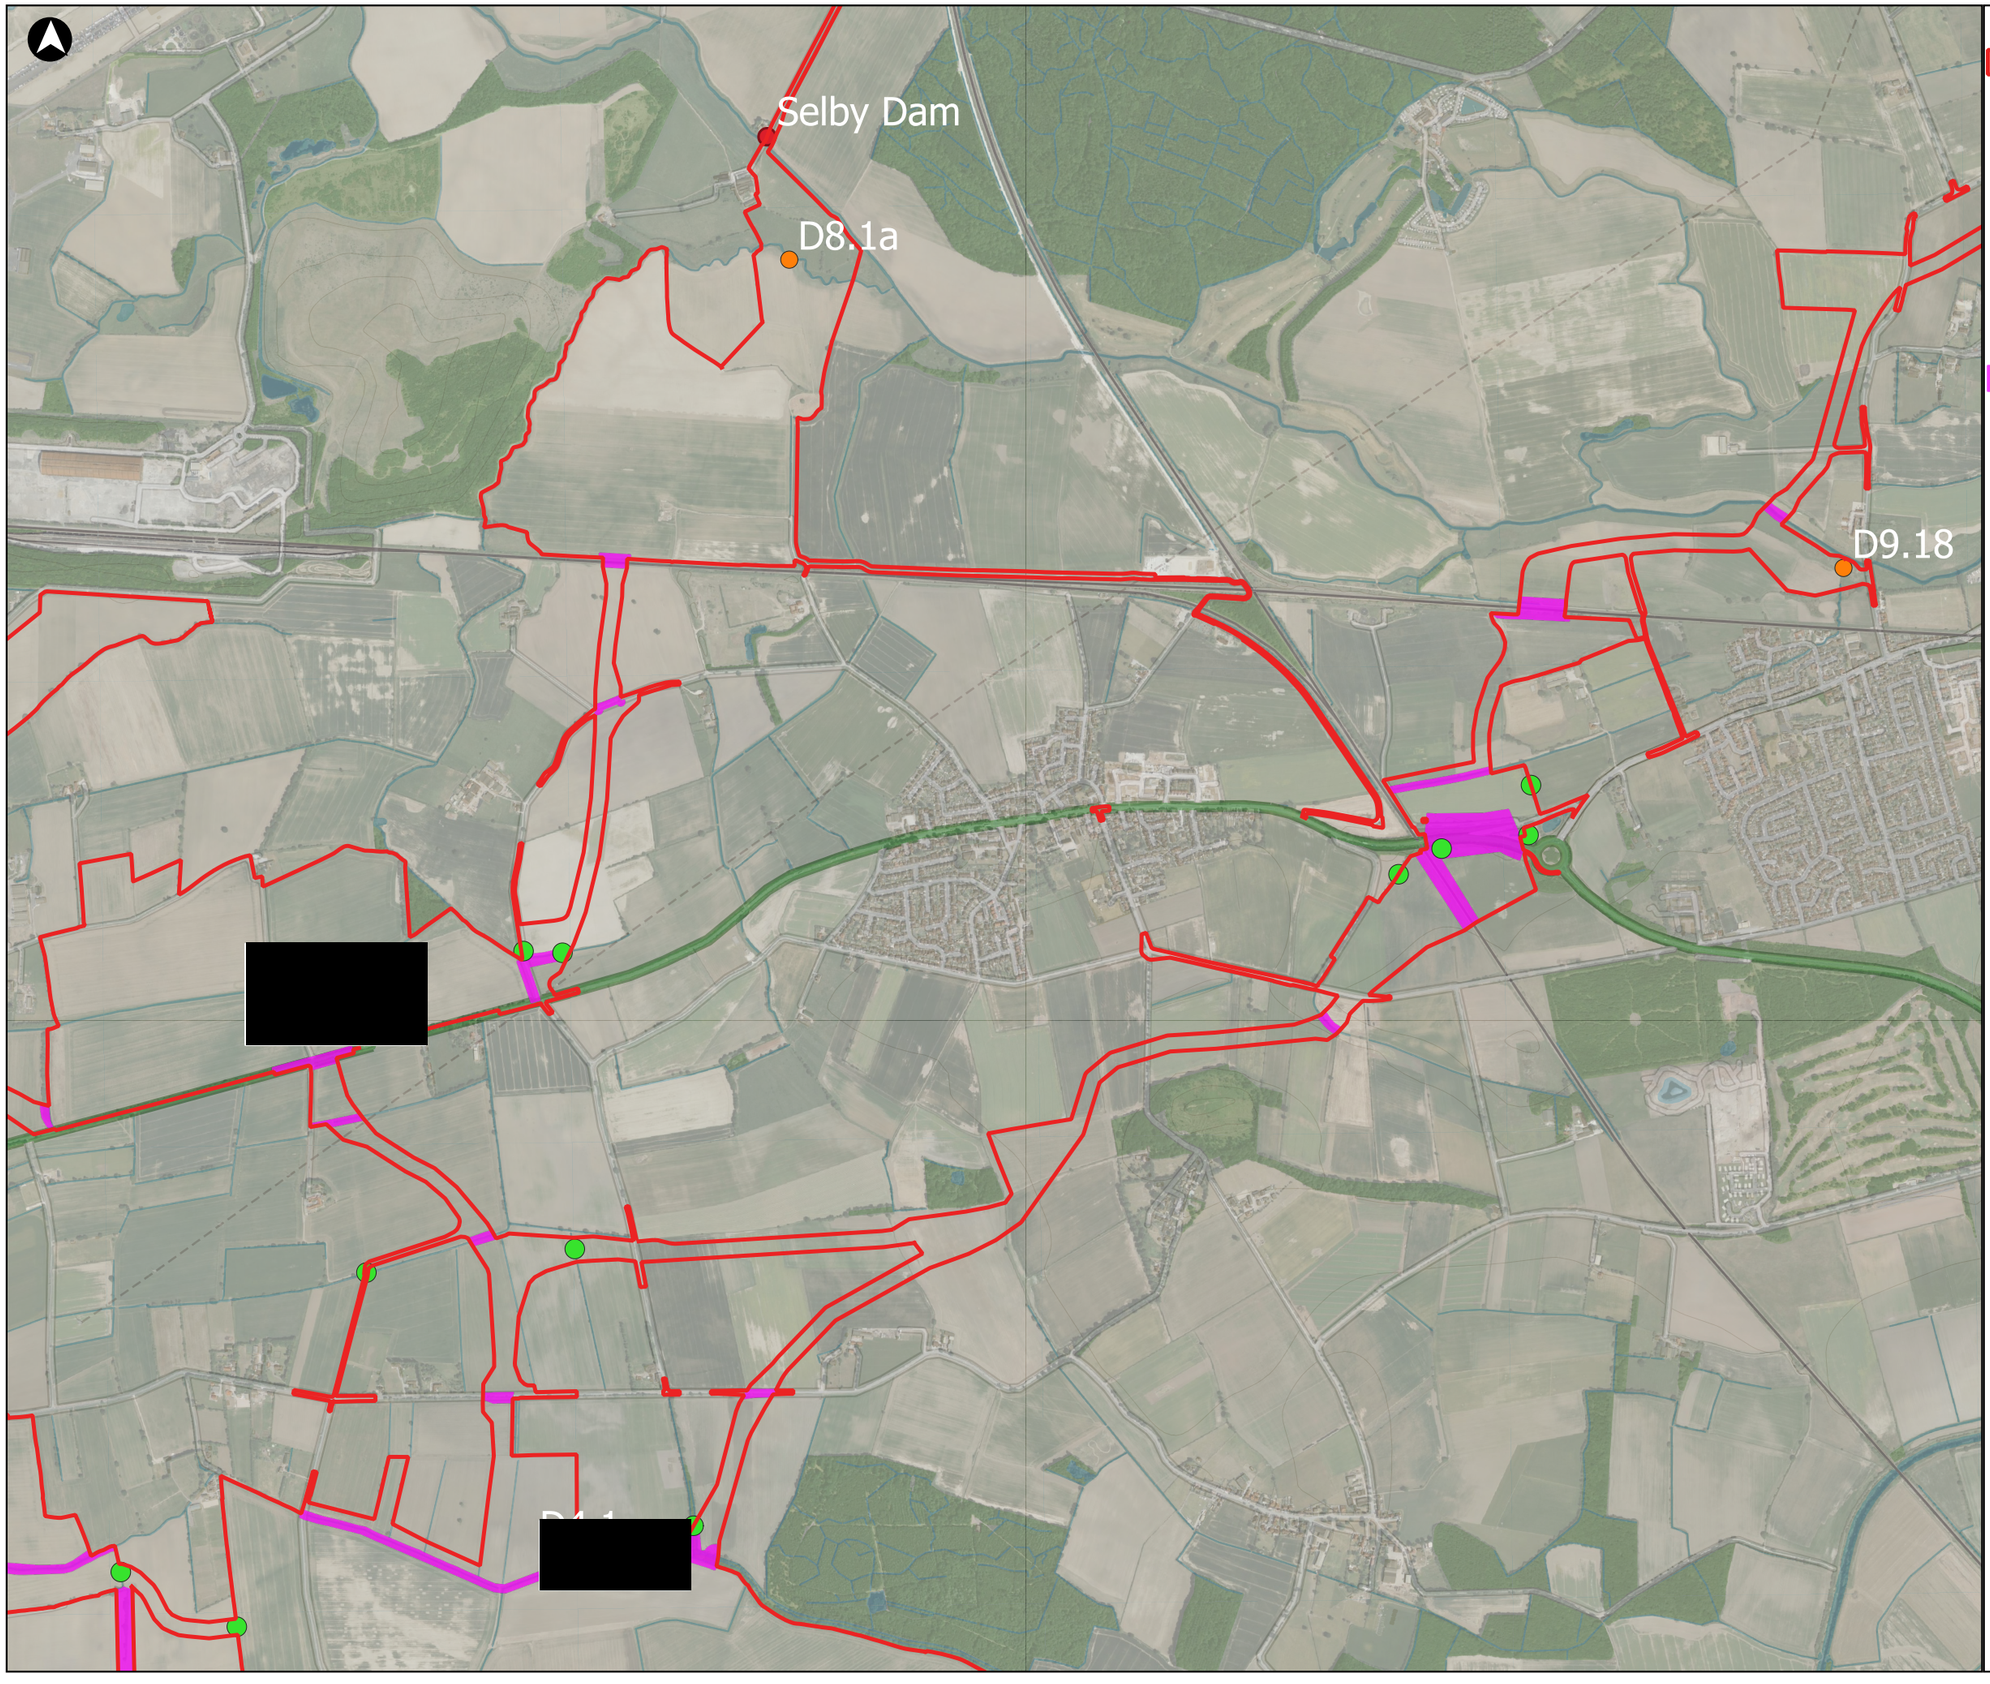


A3

- Order limits
- Otter field sign-spraint
- Otter field sign-prints
- Otter field sign-possible historic spraint
- Otter survey point within Cable Route Corridor-negligible suitability
- Otter survey point within Cable Route Corridor-low suitability
- Otter survey point within Cable Route Corridor-high suitability
- Avoidance Area-Any watercourse present will be crossed with trenchless techniques

Coordinate System: British National Grid

Aerial Map: Google Satelitte

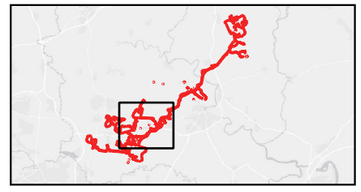

Meters

0 100 200 300 400 500 m

Rev	Date	By	Chkd	Appd	Authd
P03	03/02/2026	OMD	RR	RR	RR

Light Valley Solar

Drawing Title

Figure Number: 6.7
Otter Survey Results
Sheet Number 3 of 4

Client

Light Valley Solar Limted

Project Name

Light Valley Solar

Scale at A3

1:19,000

Project Number

302939-00


Rev

P03

Drawing Number

EN0110012/APP/LVS/06.02.06.07

© Arup 2025

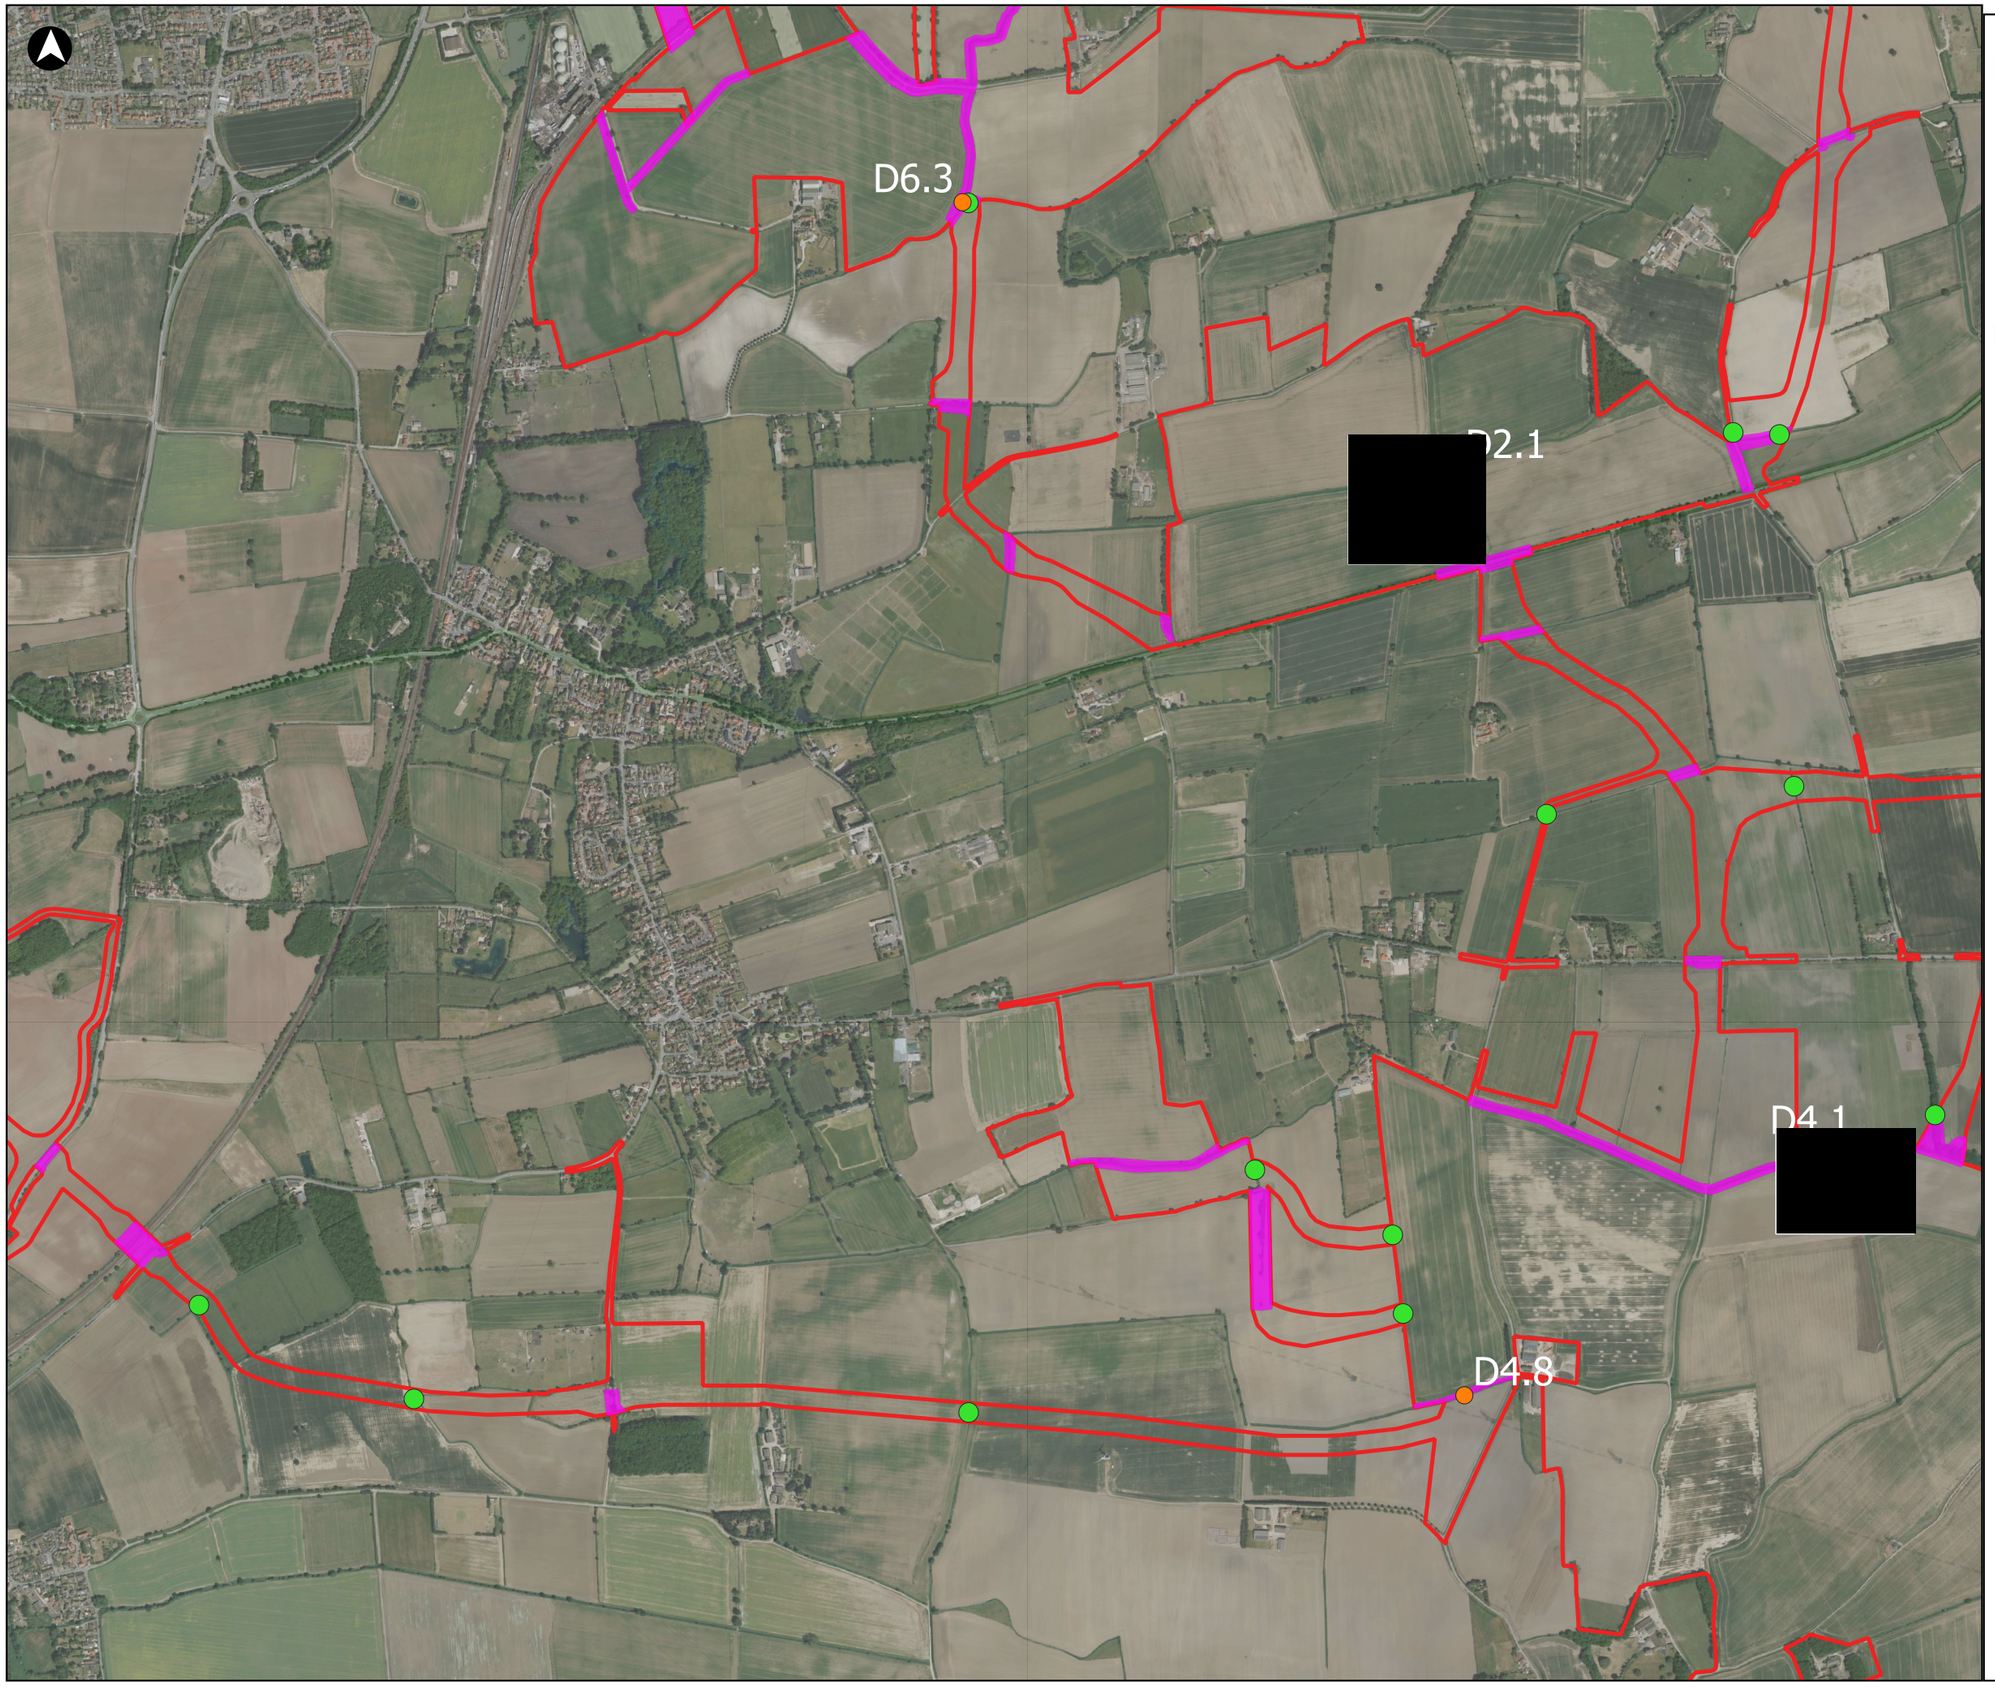


A3

- Order Limits
- Otter field sign-spraint
- Otter field sign-prints
- Otter field sign-possible historic spraint
- Otter survey point within Cable Route Corridor-negligible suitability
- Otter survey point within Cable Route Corridor-low suitability
- Avoidance Areas-Any watercourses present will be crossed with trenchless techniques

Coordinate System: British National Grid

Aerial Map: Google Satelitte

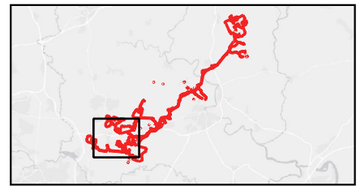

Meters

0 100 200 300 400 500 m

Rev	Date	By	Chkd	Appd	Authd
P02	07/01/2026	OMD	RR	RR	RR

Light Valley Solar

Drawing Title

Figure Number: 6.7
Otter Survey Results
Sheet Number 4 of 4

Client

Light Valley Solar Limted

Project Name

Light Valley Solar

Scale at A3

1:16,000

Project Number

302939-00

Rev

P02

Drawing Number

EN0110012/APP/LVS/06.02.06.07

© Arup 2025