

The Drovers Solar Farm

Figure 6.13: PM6, PM8, PM12 and PM14 Parameter Based Summer Photowires (Part B) (Tracked)

Prepared by: LDA Design

Date: January 2026


PINS reference: EN0110013

Document reference: APP/6.3.1 (Revision 1)

APFP Regulation Reg 5(2)(a)

Planning Act 2008

Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009

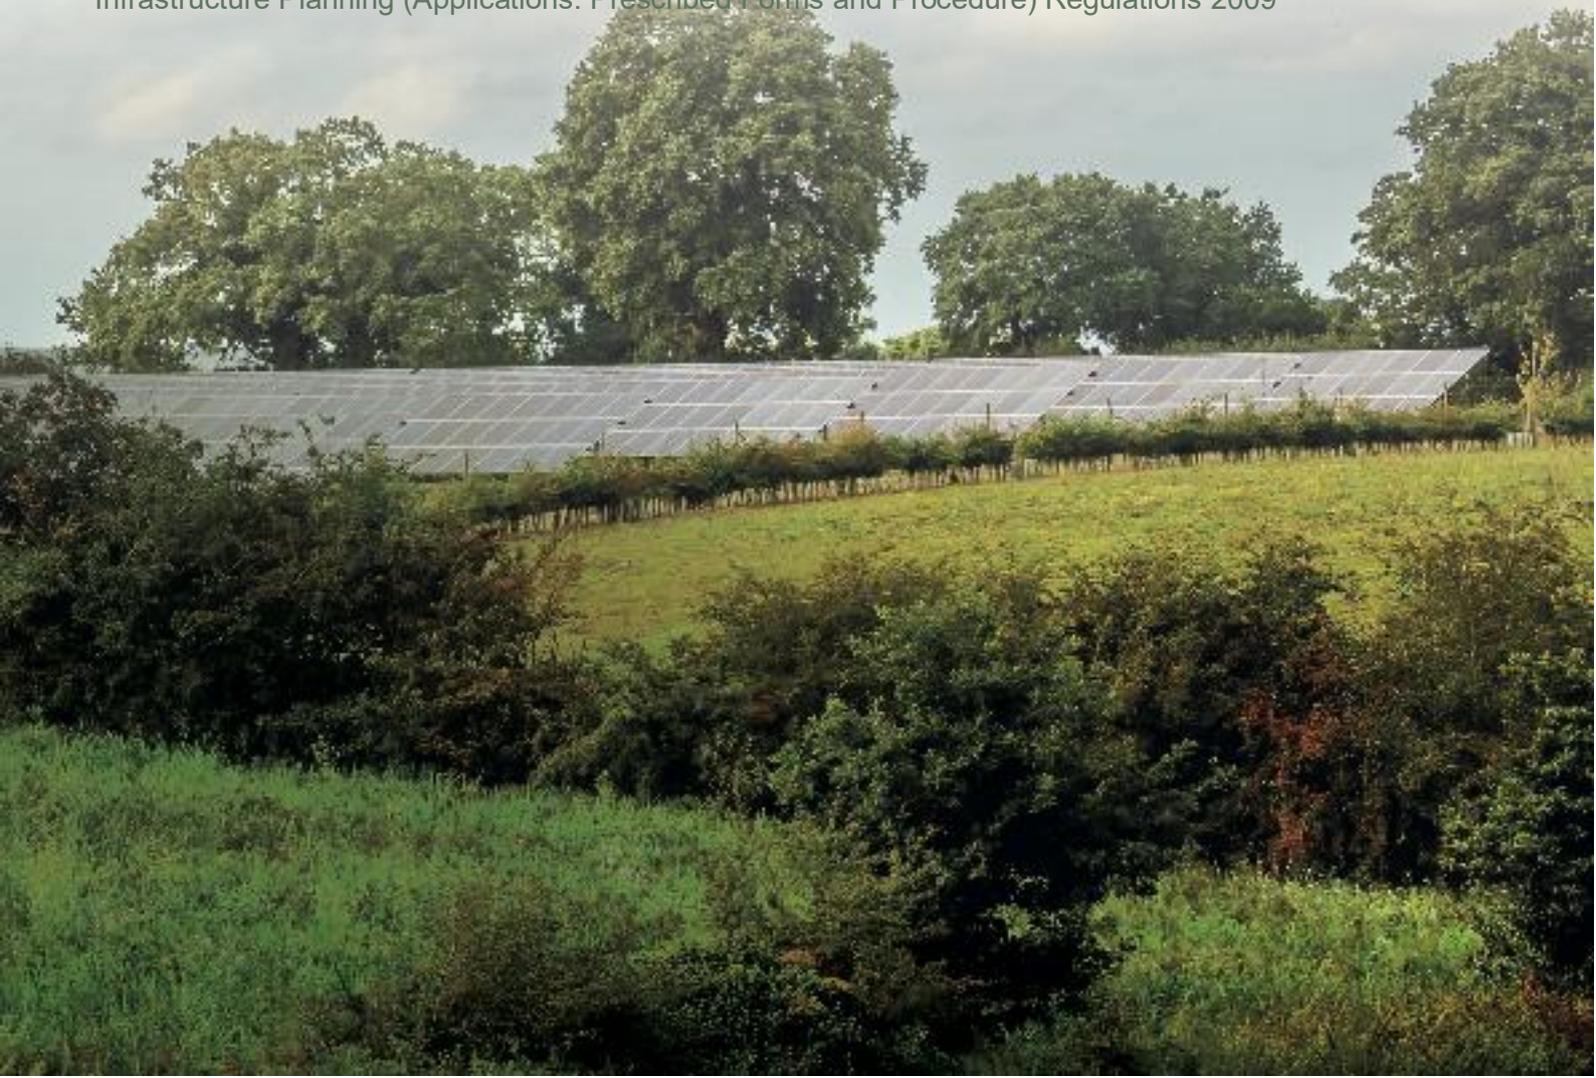

Z:\9485_KINGS_LYNN_SOLAR_FARM\BDOCS\VISUAL\9485_FIGURE_6.13_SUMMER_PARAMETERS_008.INDD



Existing Photograph

LDĀDESIGN

Camera Location (OS Grid Reference):	583129 E 312144 N
Ground Level (mAOD):	79m
Direction of View: bearing from North (0°):	273°
Distance to Site:	962m

Horizontal Field of View:	90° (Cylindrical projection)
Paper Size:	841mm x 297mm (Half A1)
Enlargement Factor:	96%
Visualisation Type:	Type 1 (for context)

Photo Date / Time:	19/06/2025 11:58
Camera Model and Sensor Format:	Canon EOS 6D, FFS
Lens Make, Model and Focal Length:	Canon EF50mm f/1.8 STM
Height of Camera Lens above Ground (mAOD):	1.5m



COPYRIGHT
Ordnance Survey material by permission of
Ordnance Survey on behalf of the Controller
of Her Majesty's Stationary Office © Crown
Copyright. All rights reserved. 2025 Reference
number AC000808122.

PROJECT TITLE
THE DROVES SOLAR FARM
DOCUMENT
6.3 Environmental Statement Volume 3
The Infrastructure Planning (Applications: Prescribed Forms and Procedure)
Regulations 2009 - Reg 5(2)(a). PINS Ref. EN0110013.

DRAWING TITLE
ES Figure 6.13 Viewpoint 8 - South Acre Road and
Peddars Way and Norfolk Coastal Path
REVISION P1, Text update DRN JB CHK OWh/MB APP RP
DWG NO 9485_0523 DATE 06/01/2026 Sheet 1 of 2

© LDA Design Consulting Ltd. Quality Assured to BS EN ISO 9001:2015



Note 1: The 3D wireline blocks demonstrate the scale and siting of the maximum development parameters, without the screening effects of new mitigation planting.
 Note 2: The exact siting of the larger infrastructure, such as the Customer Substation, National Grid Substation and Grid Connection Infrastructure will be defined at the detailed design stage. These Photowire visualisations have been modelled to show the full extent of the Works Areas as shown on the Works Plans [App 2.3]

Note 3: Solar PV Array development has been modelled at 4.5m high, which assumes all Solar PV Array development as being Single Axis Trackers at maximum inclination, to demonstrate the worst-case scenario. In reality, the Single Axis Trackers Solar PV Array would likely vary in height throughout the day as the sun moves above the Site and the inclination of Single Axis Trackers Solar PV Array reduces; therefore appearing less than 4.5m high.
 Note 4: Grid Connection Infrastructure modelled at a maximum height parameter of 55m from ground level. Breaks in the parameter line are present where different areas of the parameter are visible within the Order Limits. This height parameter takes account for variations in existing topography and required ground levels for new electricity pylons. In reality, all new Grid Connection Infrastructure would likely be no higher than the existing 400kV overhead lines and pylons.

Wireline

	Camera Location (OS Grid Reference):	583129 E 312144 N	Horizontal Field of View:	90° (Cylindrical projection)	Photo Date / Time:	19/06/2025 11:58	This wireframe is based upon LIDAR digital terrain data with spot heights at 1m resampled to 5m (which does not precisely model small scale changes in landform or sharp breaks in slope). The three dimensional model of the development is based on ES Figure 5.1: Concept Masterplan IAPP 6.3I, 9485_0523_C_Concept_Masterplan .		COPYRIGHT Ordnance Survey material by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office © Crown Copyright. All rights reserved. 2025 Reference number AC000808122.	LEGEND ■ Maximum extent of siting zone for Solar PV Array (modelled at 4.5m high) ■ Maximum extent of siting zone for BESS (modelled at 3.5m high) ■ Maximum extent of siting zone for Customer Substation (modelled at 13m high) ■ Maximum extent of siting zone for National Grid Substation (modelled at 13m high) - - - Maximum extent of siting zone for Grid Connection Infrastructure (modelled at 55m high)	PROJECT TITLE THE DROVES SOLAR FARM DOCUMENT 6.3 Environmental Statement Volume 3 <small>The Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009 - Reg 9(2)(a). PINS Ref. EN0110013.</small>	DRAWING TITLE ES Figure 6.13 Viewpoint 8 - South Acre Road and Peddars Way and Norfolk Coastal Path REVISION P1, Text update DRN JB CHK OWh/MB APP RP DWG NO 9485_0523 DATE 06/01/2026 Sheet 2 of 2
	Ground Level (mAOD):	79m	Paper Size:	841mm x 297mm (Half A1)	Camera Model and Sensor Format:	Canon EOS 6D, FFS						
	Direction of View: bearing from North (0°):	273°	Enlargement Factor:	96%	Lens Make, Model and Focal Length:	Canon EF50mm f/1.8 STM						
	Distance to Site:	962m	Visualisation Type:	Type 3	Height of Camera Lens above Ground (mAOD):	1.5m						