

The Drovers Solar Farm

Figure 12.7 Triangulated Baseline Groundwater Elevation (Clean)

Prepared by: Raincloud Consulting

Date: July 2026

PINS reference: EN0110013


Document reference: APP/6.3.1 (Revision 1)

APFP Regulation Reg 5(2)(a)

Planning Act 2008

Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009



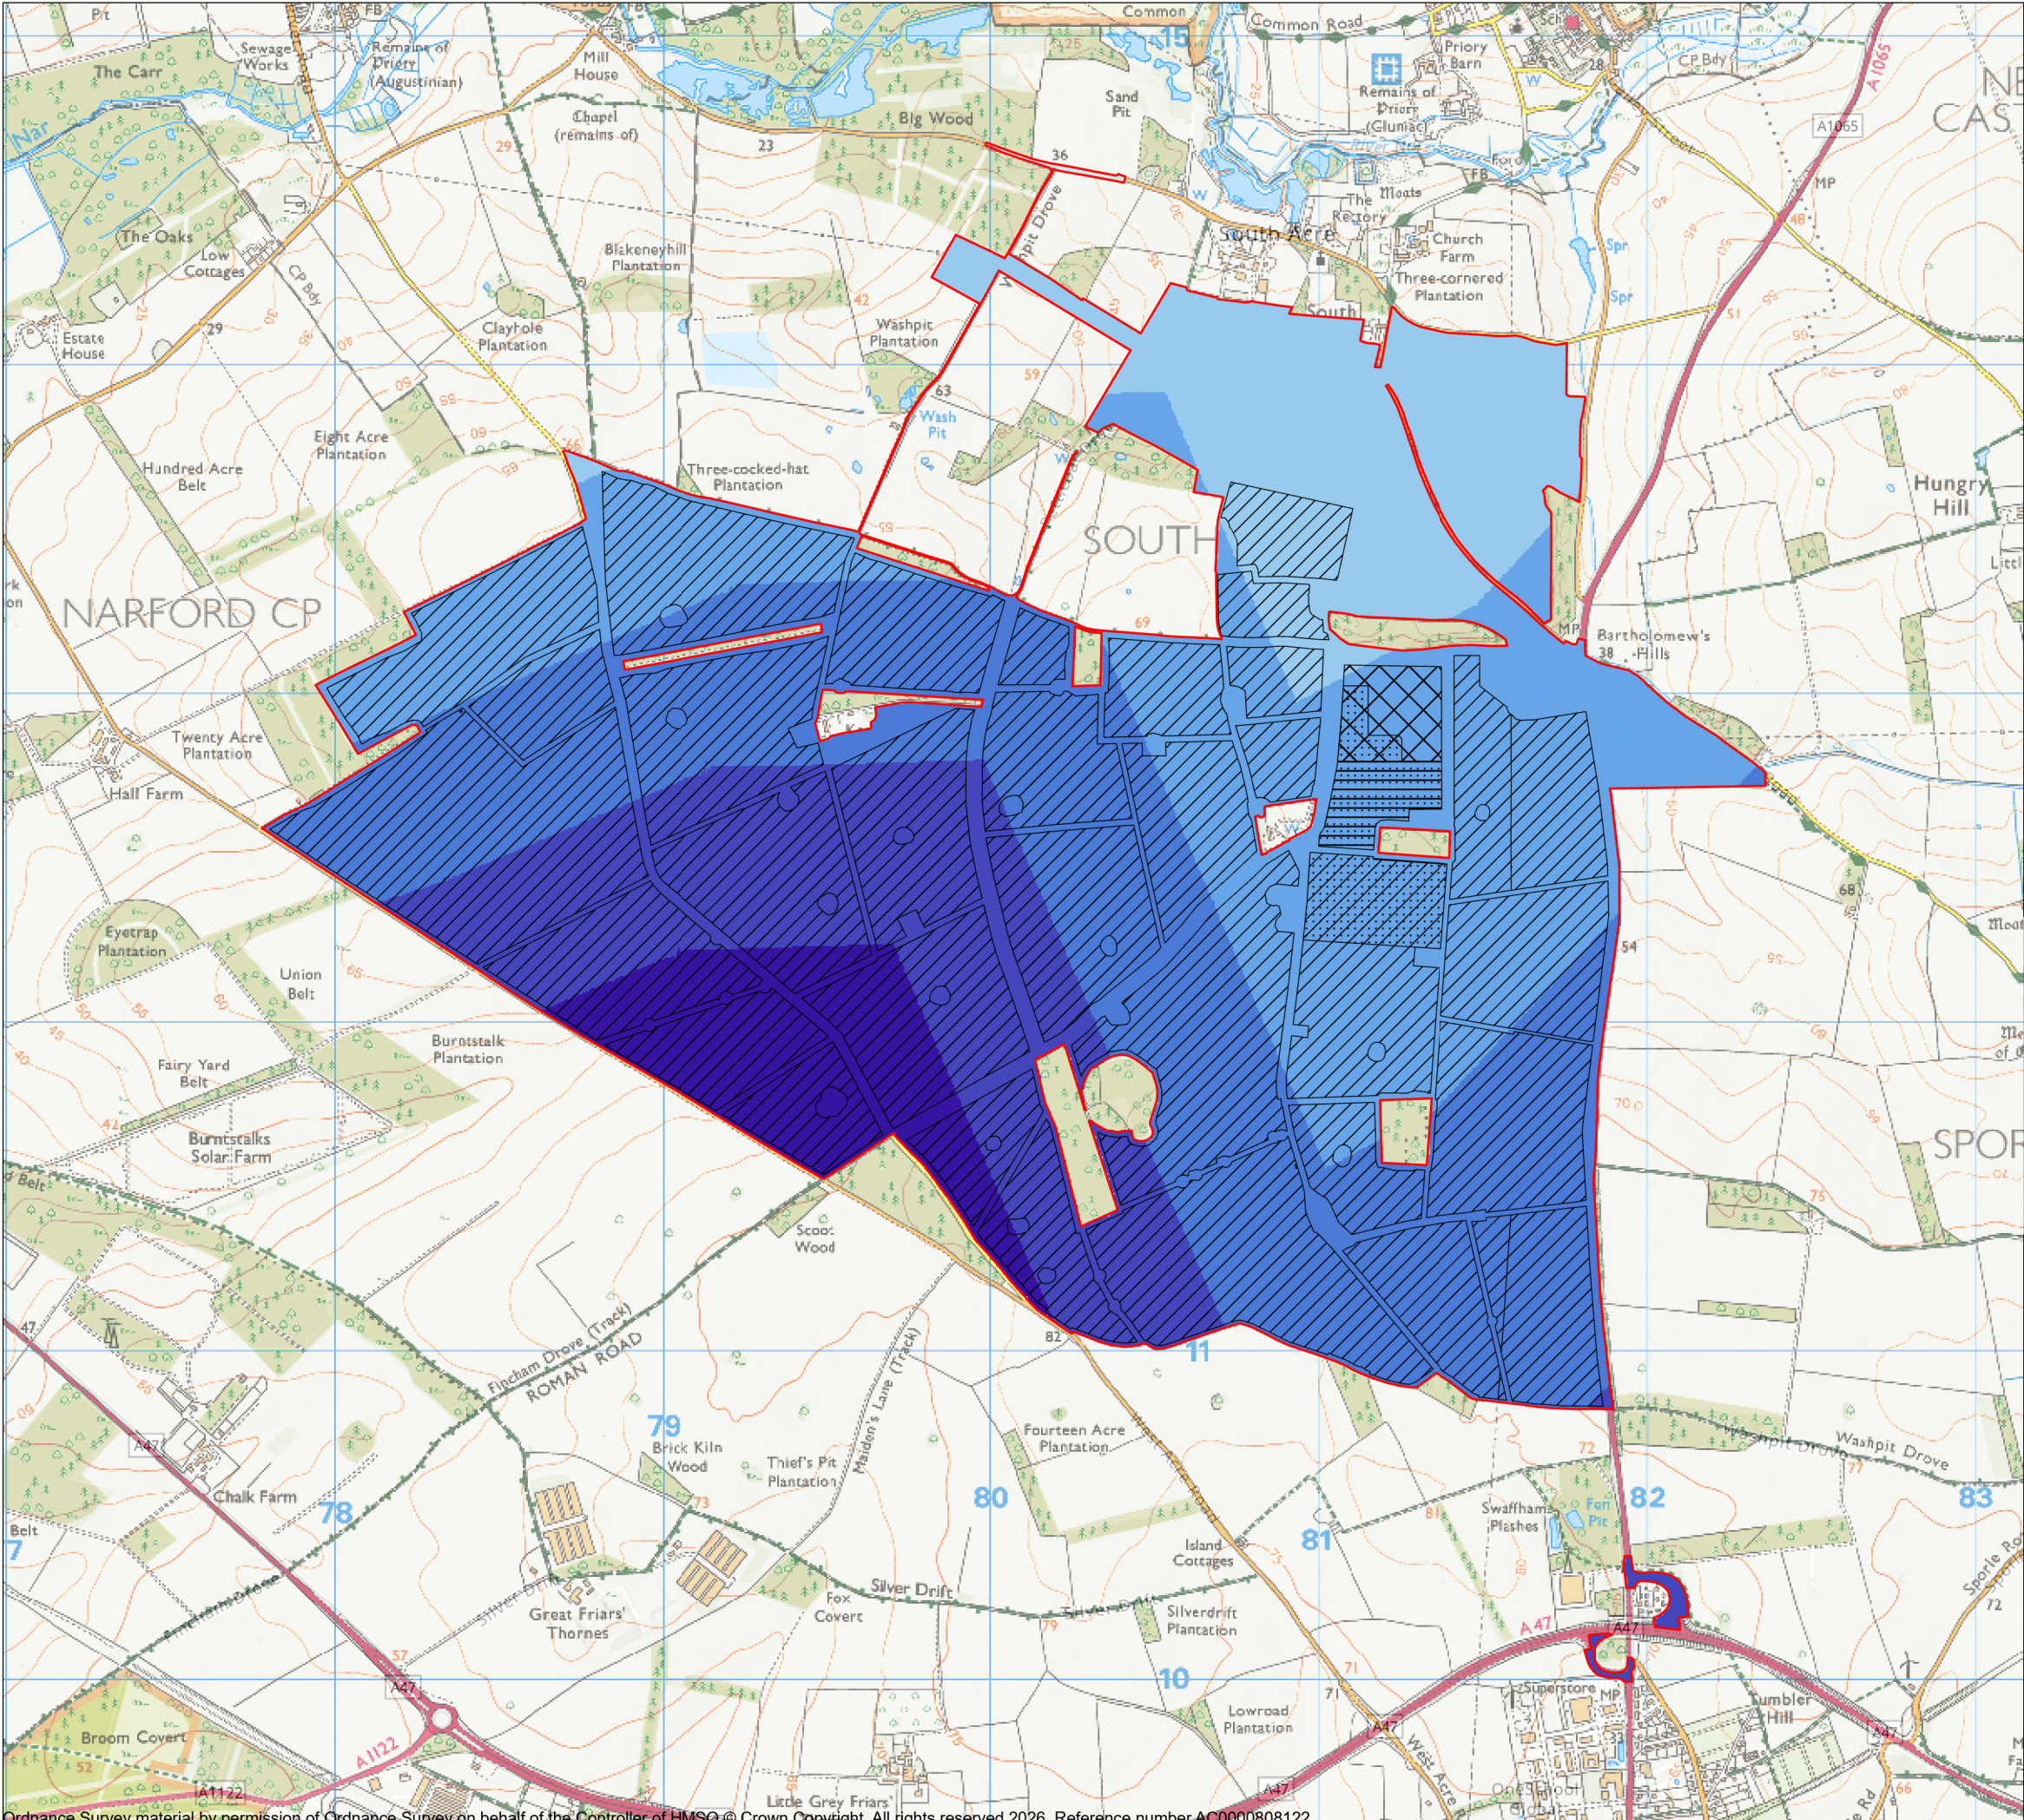

DRAWING TITLE:
Figure 12.7: Triangulated Baseline Groundwater Elevation

DOCUMENT:
6.3.1 Environmental Statement Volume III
ES Figure 12.7: Triangulated Baseline Groundwater Elevation

LEGEND:

Order Limits / Core Study Area

Work No. 1: Solar PV

Work No. 2: BESS Compound

Work No. 3: Customer Substation


Work No. 4: National Grid Substation

Triangulated Baseline Groundwater Elevation
m AOD

	23.06 - 25
	25.001 - 30
	30.001 - 35
	35.001 - 40
	40.001 - 45
	45.001 - 50

*Note - No dimensions are to be scaled from this drawing. All dimensions are to be checked on site. Area measurements for indicative purposes only.

Sources: EA, LDA Design, IGP 2025

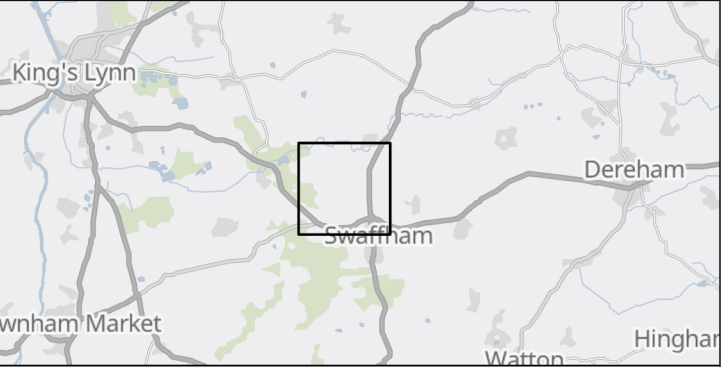

The Infrastructure (Applications: Prescribed Forms and Procedure) (APFP) Regulations 2009 – Reg 5(2)(a)

Application Doc no. EN0110013/APP/6.3.1 Drawing no.: 083-ES-008-Rev02

DATE	July 2026	DRAWN	EL
SCALE @A3	1:20,000	CHECKED	LN
STATUS	Final	APPROVED	RP

002	Deadline 3 Update	July 2026
REV.	DESCRIPTION	APP. DATE

THIS DRAWING IS THE PROPERTY ISLAND GREEN POWER AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION

