

The Drovers Solar Farm

Figure 12.5 Source Protection Zones

Prepared by: Raincloud Consulting

Date: September 2026

PINS reference: EN0110013


Document reference: APP/6.3.2 (Revision 2)

APFP Regulation Reg 5(2)(a)

Planning Act 2008

Infrastructure Planning (Applications: Prescribed Forms and Procedure) Regulations 2009



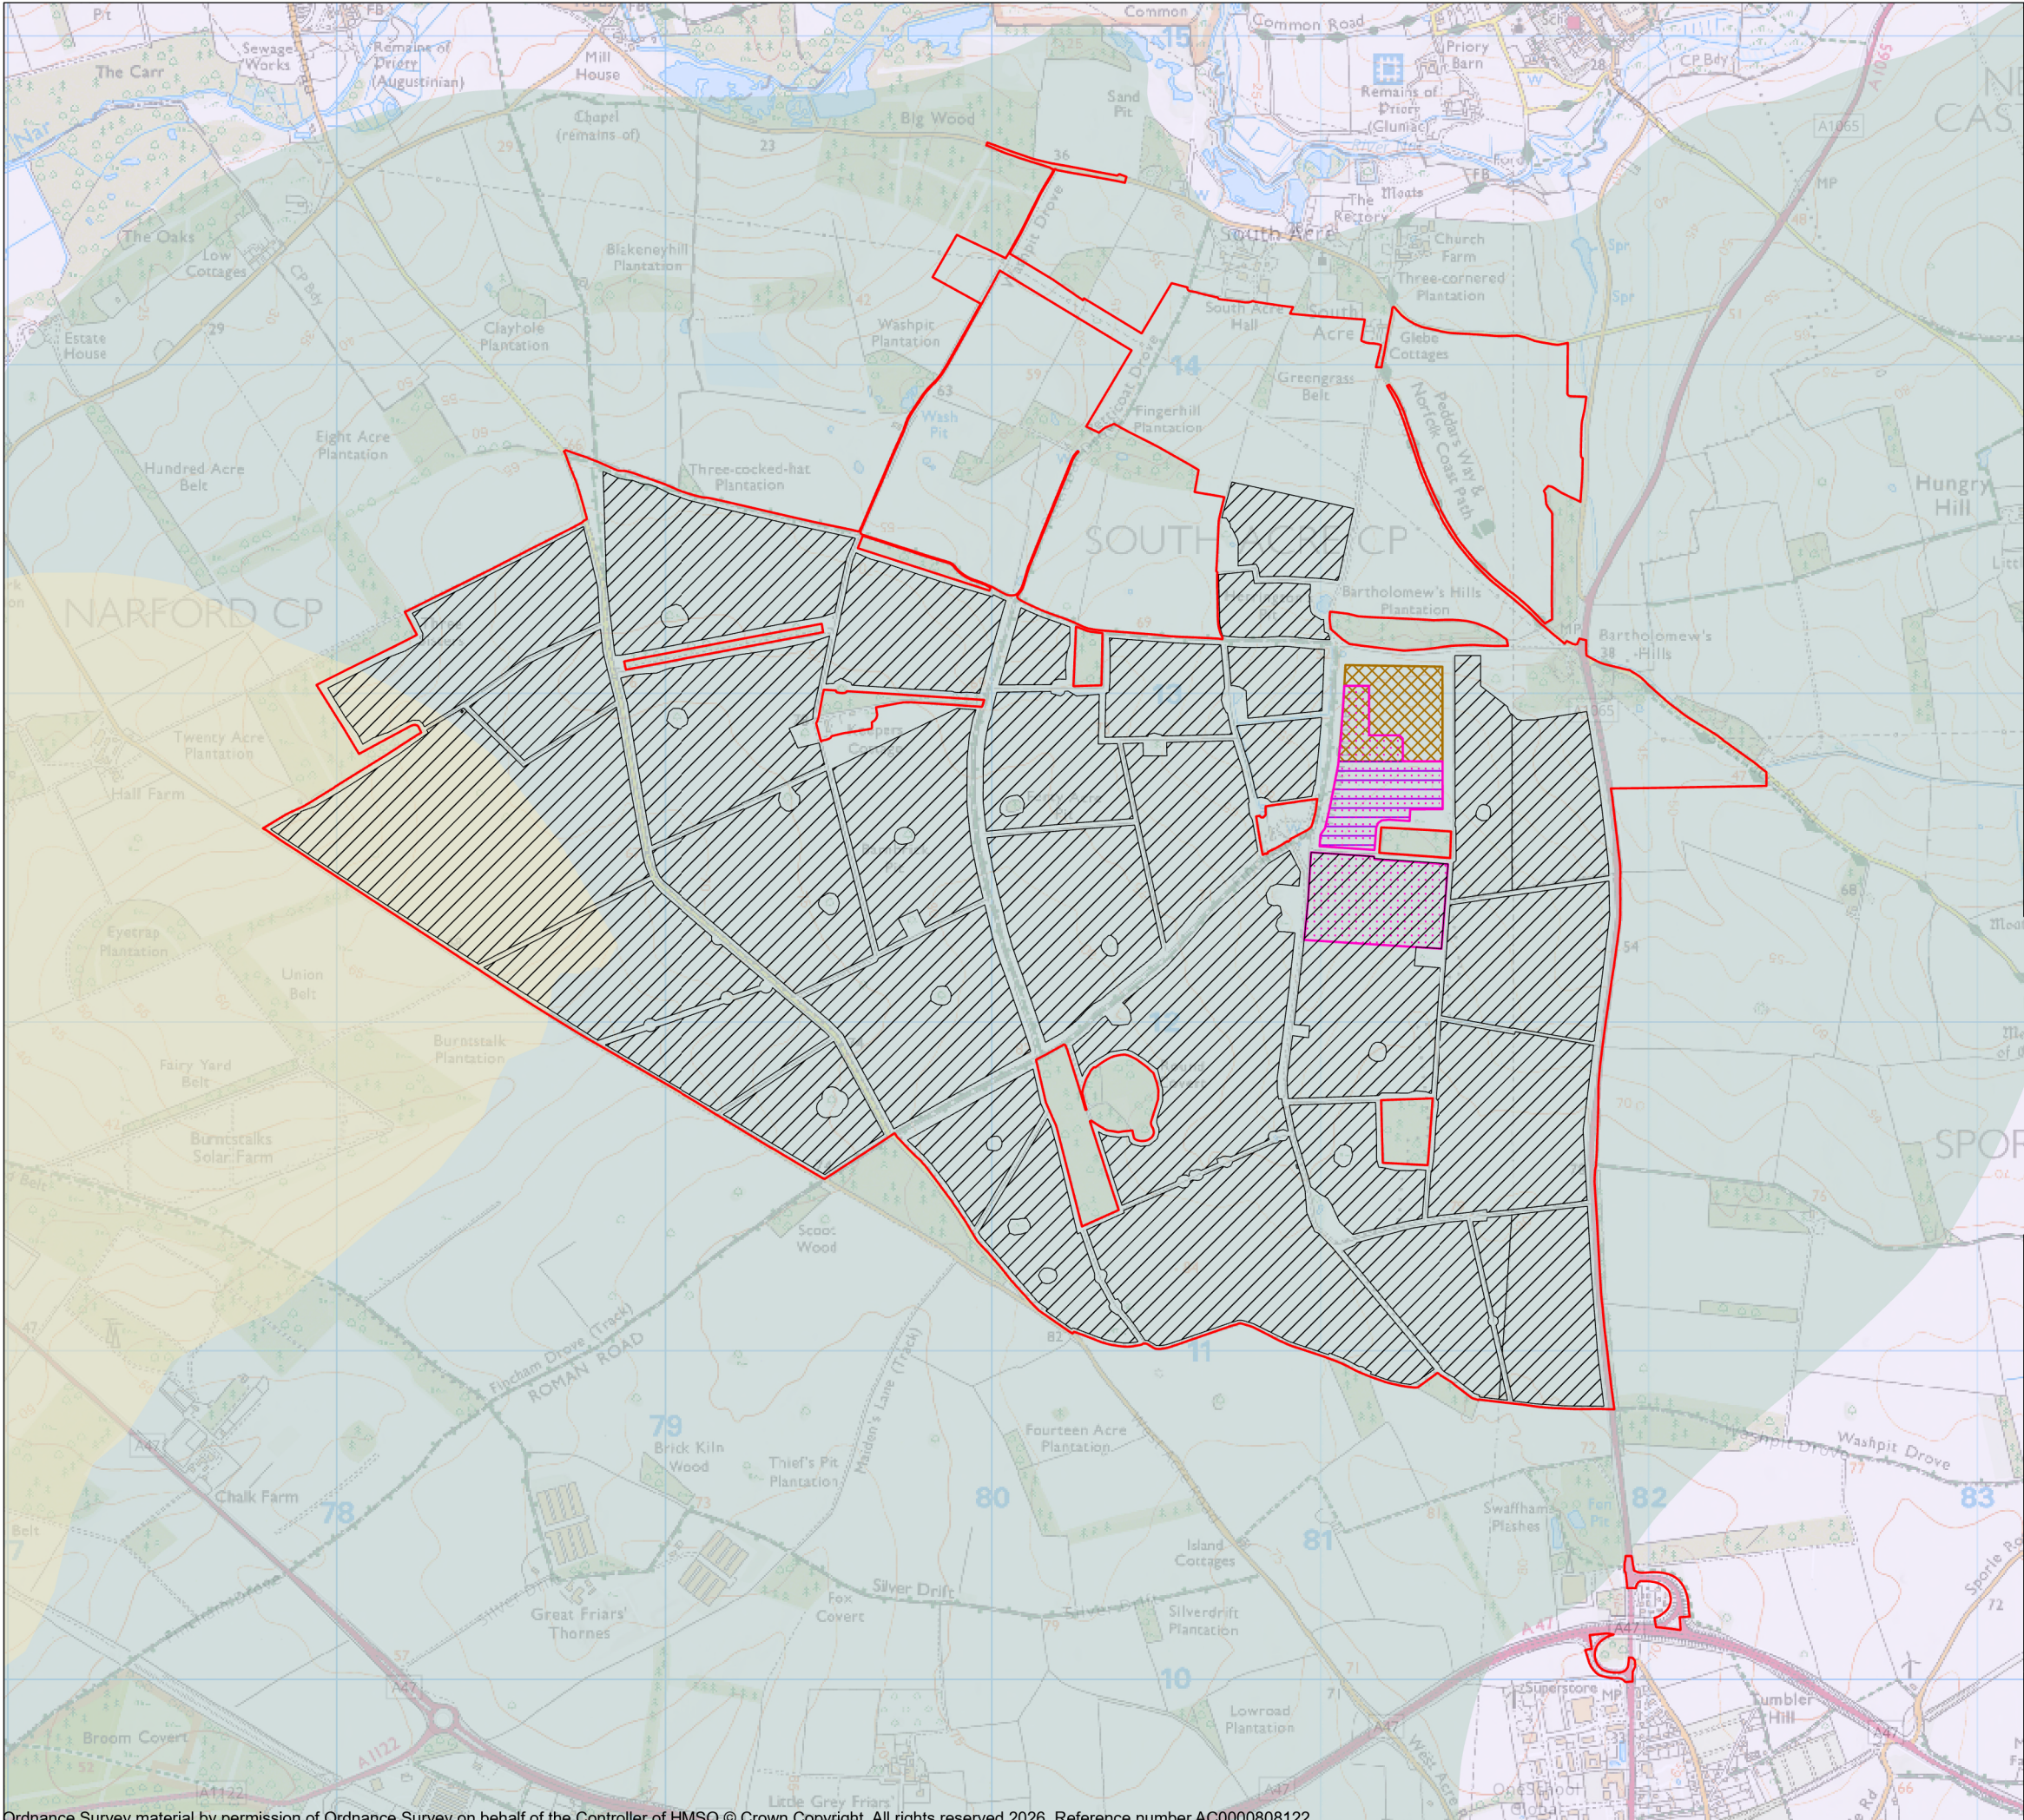


DRAWING TITLE:
Figure 12.5: Source Protection Zones

DOCUMENT:
**6.3.2 Environmental Statement Volume III
ES Figure 12.5 Source Protection Zones**

- LEGEND:
- Order Limits / Core Study Area
 - Source Protection Zone 1
 - Source Protection Zone 2
 - Source Protection Zone 3
 - Work No. 1: Solar PV
 - Work No. 2: BESS Compound
 - Work No. 3: Customer Substation
 - Work No. 4: National Grid Substation

*Note - No dimensions are to be scaled from this drawing. All dimensions are to be checked on site. Area measurements for indicative purposes only.

Sources: EA, LDA Design, IGP 2025

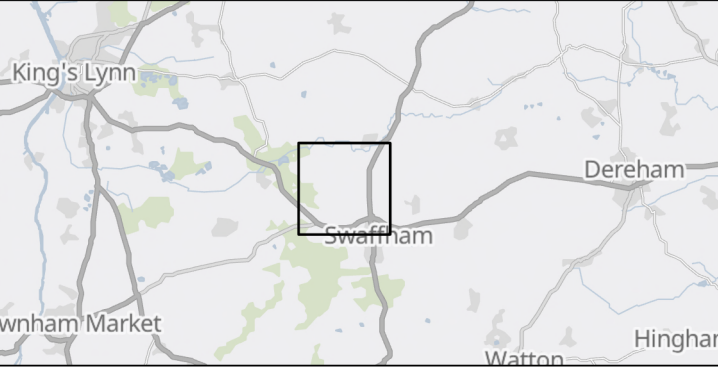

The Infrastructure (Applications: Prescribed Forms and Procedure) (APFP) Regulations 2009 – Reg 5(2)(a)

Application Doc no. EN0110013/APP/6.3.2 Drawing no.: 083-ES-010-Rev02

DATE	August 2026	DRAWN	EL
SCALE @A3	1:20,000	CHECKED	LN
STATUS	Final	APPROVED	RP

003	Deadline 4 Update	LN	August 2026
REV.	DESCRIPTION	APP.	DATE

THIS DRAWING IS THE PROPERTY ISLAND GREEN POWER AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION

