

MORGAN AND MORECAMBE OFFSHORE WIND FARMS: TRANSMISSION ASSETS

Environmental Statement

Volume 3, Annex 2.3: Flood risk assessment - part 3 of 3 (Tracked)



~~December 2024~~ May 2025

Rev: F032

MOR001-FLO-CON-ENV-RSA-0002
MRCNS-J3303-RPS-10127

PINS Reference: EN020028
APFP Regulations: 5(2)(a)
Document reference: F3.2.3/F032

Flood defences

Environment Agency Spatial Flood Defences (including standardised attributes)

- 1.7.2.8** The Environment Agency Spatial Flood Defences (including standardised attributes) mapping shows the presence of the following flood defences within the study area. Defences and associated attributes are listed below within **Table 1.33** and presented within Figure 1.15.
- 1.7.2.9** It was been confirmed by the Environment Agency within the first HFR EWG in May 2023 that difference in phasing between the Transmission Assets and Preston and South Ribble Flood Risk Management Scheme makes interaction between the schemes unlikely.
- 1.7.2.10** Whilst not included within the Environment Agency Spatial Flood Defences dataset, the Fylde sand dunes offer protection from tidal flooding to inland areas by virtue of elevation and also act to reduce wave action.

Table 1.33: Flood Defences

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S027	107677	Natural High Ground	Unknown	Unknown	100
FR/09/S027	107865	Natural High Ground	Unknown	Unknown	5
FR/09/S027	107874	Natural High Ground	Unknown	Unknown	70
FR/09/S027	108669	Natural High Ground	Unknown	Unknown	5
FR/09/S027	108758	Natural High Ground	Unknown	Unknown	5
FR/09/S027	109095	Natural High Ground	Unknown	Unknown	5
FR/09/S027	109340	Natural High Ground	Unknown	Unknown	70
FR/09/S027	180173	Natural High Ground	Unknown	Unknown	5
FR/09/S027	182200	Natural High Ground	Unknown	Unknown	5
FR/09/S027	58021	Natural High Ground	Unknown	Unknown	5
FR/09/S027	63290	Natural High Ground	Unknown	Unknown	5
FR/09/S027	63291	Natural High Ground	Unknown	Unknown	50
FR/09/S027	63327	Natural High Ground	Unknown	Unknown	5
FR/09/S027	63347	Natural High Ground	Unknown	Unknown	5
FR/09/S027	63378	Natural High Ground	Unknown	Unknown	5
FR/09/S027	64141	Natural High Ground	Unknown	Unknown	5
FR/09/S027	64365	Natural High Ground	Unknown	Unknown	5
FR/09/S027	64366	Natural High Ground	Unknown	Unknown	5
FR/09/S027	64467	Natural High Ground	Unknown	Unknown	5

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S027	64479	Natural High Ground	Unknown	Unknown	100
FR/09/S027	64680	Embankment	Environment Agency	3	5
FR/09/S027	65140	Natural High Ground	Unknown	Unknown	5
FR/09/S027	65142	Natural High Ground	Unknown	Unknown	5
FR/09/S027	65247	Natural High Ground	Unknown	Unknown	100
FR/09/S027	65635	Natural High Ground	Unknown	Unknown	50
FR/09/S027	65694	Natural High Ground	Unknown	Unknown	5
FR/09/S027	65855	Natural High Ground	Unknown	Unknown	70
FR/09/S027	65987	Natural High Ground	Unknown	Unknown	5
FR/09/S027	65988	Natural High Ground	Unknown	Unknown	5
FR/09/S027	66591	Embankment	Environment Agency	3	5
FR/09/S027	66599	Embankment	Environment Agency	3	50
FR/09/S027	67023	Embankment	Environment Agency	3	50
FR/09/S027	67030	Natural High Ground	Unknown	Unknown	5
FR/09/S027	67031	Natural High Ground	Unknown	Unknown	5
FR/09/S027	67091	Embankment	Environment Agency	3	70
FR/09/S027	67131	Embankment	Environment Agency	3	70
FR/09/S027	67645	Natural High Ground	Unknown	Unknown	5
FR/09/S027	68662	Embankment	Environment Agency	3	50
FR/09/S027	80180	Natural High Ground	Unknown	Unknown	5

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S027	80536	Natural High Ground	Unknown	Unknown	5
FR/09/S027	82144	Natural High Ground	Unknown	Unknown	70
FR/09/S027	89657	Natural High Ground	Unknown	Unknown	5
FR/09/S027	90202	Natural High Ground	Unknown	Unknown	5
FR/09/S027	90989	Natural High Ground	Unknown	Unknown	5
FR/09/S027	92105	Embankment	Environment Agency	3	5
FR/09/S027	93397	Natural High Ground	Unknown	Unknown	100
FR/09/S027	93458	Natural High Ground	Unknown	Unknown	50
FR/09/S027	95087	Natural High Ground	Unknown	Unknown	5
FR/09/S124	109299	Natural High Ground	Unknown	Unknown	70
FR/09/S124	109300	Natural High Ground	Unknown	Unknown	70
FR/09/S124	64291	Natural High Ground	Unknown	Unknown	70
FR/09/S124	64292	Natural High Ground	Unknown	Unknown	70
FR/09/S124	64463	Natural High Ground	Unknown	Unknown	70
FR/09/S124	64464	Natural High Ground	Unknown	Unknown	70
FR/09/S124	64629	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66369	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66370	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66597	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66658	Natural High Ground	Unknown	Unknown	70

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S124	67087	Natural High Ground	Unknown	Unknown	70
FR/09/S124	89411	Natural High Ground	Unknown	Unknown	50
FR/09/S124	93616	Natural High Ground	Unknown	Unknown	50
FR/09/S124	107834	Natural High Ground	Unknown	Unknown	150
FR/09/S126	109114	Embankment	Environment Agency	3	150
FR/09/S124	110137	Natural High Ground	Unknown	Unknown	70
FR/09/S145	144743	Natural High Ground	Private individual, Company or Charity	Unknown	5
FR/09/S145	160186	Embankment	Unknown	Unknown	100
FR/09/S145	160187	Embankment	Unknown	Unknown	100
FR/09/S145	163491	Embankment	Private individual, Company or Charity	Unknown	100
FR/09/S126	175240	High Ground	Unknown	Unknown	150
FR/09/S126	175241	Embankment	Local Authority	Unknown	No information
FR/09/S126	176539	High Ground	Private individual, Company or Charity	Unknown	150
FR/09/S126	176541	Embankment	Environment Agency	3	150
FR/09/S126	176542	Embankment	Environment Agency	3	50
FR/09/S126	176543	Embankment	Environment Agency	3	50
FR/09/S126	176544	Embankment	Environment Agency	3	50
FR/09/S145	184536	Embankment	Unknown	Unknown	100
FR/09/S124	64308	Natural High Ground	Unknown	Unknown	50

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S124	64787	Natural High Ground	Unknown	Unknown	150
FR/09/S124	64839	Natural High Ground	Unknown	Unknown	50
FR/09/S124	65146	Natural High Ground	Unknown	Unknown	50
FR/09/S124	65147	Natural High Ground	Unknown	Unknown	50
FR/09/S124	65350	Natural High Ground	Unknown	Unknown	50
FR/09/S124	65351	Natural High Ground	Unknown	Unknown	50
FR/09/S126	65562	Natural High Ground	Unknown	Unknown	50
FR/09/S124	65776	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66580	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66581	Natural High Ground	Unknown	Unknown	70
FR/09/S124	66654	Natural High Ground	Unknown	Unknown	70
FR/09/S124	67019	Natural High Ground	Unknown	Unknown	70
FR/09/S124	67034	Natural High Ground	Unknown	Unknown	50
FR/09/S124	67043	Natural High Ground	Unknown	Unknown	70
FR/09/S124	67361	Natural High Ground	Unknown	Unknown	70
FR/09/S145	81901	Embankment	Unknown	Unknown	100
FR/09/S124	88252	Natural High Ground	Unknown	Unknown	150
FR/09/S124	88445	Natural High Ground	Unknown	Unknown	50
FR/09/S126	88617	Natural High Ground	Unknown	Unknown	50
FR/09/S126	88735	Natural High Ground	Unknown	Unknown	50

Flood and Coastal Risk Management code	Asset id	Asset type	Asset maintainer	Current condition	Design standard of protection (years)
FR/09/S124	90994	Natural High Ground	Unknown	Unknown	50
FR/09/S124	92128	Natural High Ground	Unknown	Unknown	50
FR/09/S126	93428	Natural High Ground	Unknown	Unknown	150
FR/09/S126	93554	Natural High Ground	Unknown	Unknown	50
FR/09/S145	9692	Natural High Ground	Unknown	Unknown	5
FR/09/S145	9693	Natural High Ground	Unknown	Unknown	5
FR/09/S124	97078	Natural High Ground	Unknown	Unknown	150
FR/09/S145	9759	Natural High Ground	Unknown	Unknown	5
FR/09/S145	9763	Natural High Ground	Unknown	Unknown	5
FR/09/S145	9764	Natural High Ground	Unknown	Unknown	5
FR/09/S145	9765	Natural High Ground	Unknown	Unknown	5

- 1.7.2.11 The Lancashire County Council asset register lists several flood risk assets within the county council's boundary. Assets specifically for flood defence are listed within **Table 1.34** below.

Table 1.34: Lancashire County Council flood risk assets

Reference	Unit type	Location	Easting	Northing
LCC01	Flood defence bank	Squires Gate To St Anne's Pier, Clifton Drive North, Lytham St Annes	330626	431699
LCC02	Flood defence bank	Lea Marsh Flood Defence Bank, Blackpool Road, Preston	348768	429250

Flood alert and flood warnings

- 1.7.2.12 Flood warning and flood alert areas located within the study area are presented below within Table 1.35 and Table 1.36 and shown within Figure 1.15.
- 1.7.2.13 All flood warning and flood alert areas are present within the extents of the landfall, onshore export cable corridor and 400 kV grid connection cable corridor.

Table 1.35: Flood Warnings

Flood Warning Area Code	Description	Flood source
012FWCTL13A	Lancashire coastline at Lytham St. Annes, from Squires Gate to Warton Bank	Irish Sea
012FWCTL12A	Lancashire coastline at Blackpool, along the Promenade from Little Bispham to Squires Gate	Irish Sea
012FWCTL14B	Lancashire coastline at Clifton Marsh, between Freckleton and Savick Brook	Ribble Estuary
012FWCTL37A	Ribble Estuary at Hutton and Longton	Ribble Estuary

Table 1.36: Flood Alerts

Flood Alert Area Code	Description	Flood source
012WACLS	Coast at Lytham St Annes	Irish Sea
012WACFB	Coast from Fleetwood to Blackpool	Irish Sea

Flood Alert Area Code	Description	Flood source
012WAFLW	Lower River Wyre	River Wyre, Main Dyke, Dow Brook
012WAFLR	Lower River Ribble and Darwen	Ribble Estuary
012WATRE	Ribble estuary west of Preston	Ribble Estuary

1.7.3 Hydrogeological overview

Bedrock

- 1.7.3.1 The majority of the study area is underlain by bedrock comprising the mudstones of the Singleton Mudstone Member and Mercia Mudstone Group. The eastern end of the study area is underlain by bedrock comprising sandstones of the Sherwood Sandstone Group.
- 1.7.3.2 The bedrock within the study area is presented within **Figure 1.5** and discussed in further detail within Volume 3, Chapter 1: Geology, hydrogeology and ground conditions of the ES.

Superficial Deposits

- 1.7.3.3 The superficial deposits underlying the study area are listed below in Table 1.37 and presented within Figure 1.4.

Table 1.37: Superficial Deposits

Superficial deposits	Location within the study area
Tidal Flat Deposits (clay and silt)	Intertidal zone
Storm Beach Deposits (gravel)	Intertidal zone
Blown Sand (sand)	From intertidal zone to inland
Tidal Flat Deposits (clay and silt)	Inland of sand deposits
Peat (peat)	Localised inland areas
Diamicton Till, Devensian	Inland of Peat, alternating with Head
Alluvium (clay, silt, sand and gravel)	Inland, across River Ribble Tributary
Head (clay, silt, sand and gravel)	Inland of Alluvium deposits, alternating with Till
Tidal Flat Deposits, 1 (silt, clay and sand)	North and south of River Ribble
Tidal River or Creek Deposits (clay, silt and sand)	Beneath River Ribble
River Terrace Deposits, 1 (clay, silt, sand and gravel)	South of River Ribble

Aquifer designation

- 1.7.3.4 In regard to bedrock deposits, Mudstones of the Singleton Mudstone Member and Mercia Mudstone Group are designated as a Secondary B aquifer. These are predominantly lower permeability layers which may store and yield limited amounts of groundwater. Sherwood sandstone group (sandstone) is classified as a principal aquifer; permeable geology able to provide a high level of water storage and able to support water supply and/or river base flow on a strategic scale.
- 1.7.3.5 Superficial deposits form a continuous secondary A aquifer at the western end of the study area, reflecting the extent of blown sand deposits; formations formed of permeable layers capable of supporting water supplies at a local scale, in some cases forming an important source of base flow to rivers. The remainder of the study area comprises secondary undifferentiated or unproductive strata, reflecting the distribution of superficial deposits with low permeability such as glacial till and tidal flat deposits. Additional detail can be found within Volume 3, Chapter 1: Geology, hydrogeology and ground conditions of the ES.

Source Protection Zones

- 1.7.3.6 An approximate area of 220 ha within the far eastern extent of the study area to the north of the Ribble Estuary is located within a Zone III: Total catchment SPZ. SPZs are presented within **Figure 1.6**.

1.7.4 Fluvial and tidal flood risk

Flood Map for Planning

- 1.7.4.1 The Environment Agency Flood Map for Planning, [was updated in March 2025, as and is as-illustrated in Figure 1.15.](#)
- 1.7.4.2 [Mapping](#) shows ~~t~~The landfall construction compound in which the TJB entry pits are located are within Flood Zone 1. The TJB exit pits located within the intertidal area are located within Flood Zone 3. The two remaining landfall compounds are located within Flood Zone 1.
- 1.7.4.3 The Environment Agency Flood Map for Planning, as illustrated in Figure 1.15 shows the onshore export cable corridor and associated temporary construction compounds and temporary construction access tracks are located within Flood Zones 1, 2 and 3.
- 1.7.4.4 The Environment Agency Flood Map for Planning, as illustrated in Figure 1.15 shows the 400 kV grid connection cable corridor and associated temporary construction compounds and temporary construction access tracks are located within Flood Zones 1, 2 and 3.
- 1.7.4.5 Throughout the 250 m study area, The Environment Agency Flood Map for Planning, as illustrated in Figure 1.15 shows land adjacent to watercourses and sea are located within Flood Zone 2 and 3.

Delineation of Flood Zone 3a and 3b

1.7.4.6 The delineation between Flood Zone 3a and 3b has been undertaken via the use of the 'River and Sea with Defences' dataset which is included within the updated Flood Map for Planning. The mapped 1 in 30-year annual likelihood of flooding extent provides an indicative extent of Flood Zone 3b.

~~1.7.4.6 The delineation between Flood Zone 3a and 3b has been undertaken via the use of the 3.3% AEP extent from with the Ribble Estuary (2014) hydraulic model and the 4% AEP extent from the Ribble Douglas (2010) hydraulic model.~~

1.7.4.7 With regards to the Landfall, onshore export cables and 400 kV grid connection cable corridor elements of the Transmission Assets, the following components located within Flood Zone 3 have been further assessed to be partially located within Flood Zone 3b: ~~are located partially within Flood Zone 3a:~~

- ~~The~~ The onshore export cable corridor;
- ~~Areas of t~~ The 400kv grid connection cable corridor;
- Areas of temporary construction, and operational access tracks;
- Temporary construction compounds;

~~1.7.4.7 The following components are located within Flood Zone 3b:~~

- ~~A small extent of the 400kv grid connection cable corridor in proximity to the River Ribble and Savick Brook;~~
- ~~An operational access track located to the south of the River Ribble;~~
- ~~Portions of two 400kv grid connection temporary construction access tracks; and~~
- ~~Two temporary construction compounds located to the south of the River Ribble.~~

Construction phase

Environment Agency Flood Model data

1.7.4.8 A number of datasets relating to flood risk have been obtained from the Environment Agency in 2023 under a conditional licence, including:

- Ribble Estuary Tidal model (2014);
- Ribble Douglas model (2010); and
- Coastal Design Sea Levels - Coastal Flood Boundary Extreme Sea Levels dataset (2017).

1.7.4.9 The Coastal Design Sea Levels dataset has been used to assess flood risk at the landfall. The Ribble Estuary tidal model has been used to assess tidal flood risk within the onshore infrastructure area. The Ribble Douglas model has been used to assess fluvial and joint probability fluvial and tidal flooding within the onshore infrastructure area. For additional information regarding Environment Agency flood model data and climate change allowances used within the assessment, see **section 1.2.3** and **section 1.4.3**.

Landfall

- 1.7.4.10 The ~~2032–2036~~ 0.5% AEP peak sea levels at chainage 1210 is ~~6.25m–28m~~ AOD. One metre resolution DSM LIDAR data demonstrates landfall construction compound in which the TJB entry pits are located between 9.10 m AOD and 9.50 m AOD, and is located above peak sea levels, including an uplift for project sea level rise during the construction period.
- 1.7.4.11 The landing of the offshore export cable at or around MHWS to the landfall compound will be undertaken via trenchless techniques. The trenchless installation will drill underground from the landfall compound and punch out of the direct pipe seaward of the dunes and at least 15m from the toe of the Lytham St Annes dunes. Within this area, ground levels are between 2.50 m AOD and 5.00 m AOD and as such it is expected the area will be at risk of flooding from the ~~2032–2036~~ 0.5% AEP peak sea level.

Onshore export cable corridor and 400 kV grid connection cable corridor

Tidal flooding

- 1.7.4.12 To account for sea level rise to the end of the construction phase, ~~135.3–108.3~~ mm has been applied to the 2014 0.5% AEP undefended tidal flood extent from the Ribble Estuary tidal flood model (~~2032–2036~~ 0.5% AEP).
- 1.7.4.13 Mapping of flood levels and spot depths derived from LIDAR data associated with this event are presented within **Figure 1.7**. Tidal flooding generally inundates land within proximity to Main Rivers and ordinary watercourses flowing into the River Ribble.
- 1.7.4.14 During construction, the majority of the onshore export cable corridor is located outside the extent of inundation associated with the ~~2032–2036~~ 0.5% AEP tidal flood extent.
- 1.7.4.15 The central extent of the onshore export cable corridor located between Ballam Road and Moss Side is inundated with flood depth between ~~1.42–15~~ m and ~~2.54–57~~ m. Temporary construction compounds located immediately to the east of Ballam Road are inundated by ~~0.76–79~~ m and ~~1.55–58~~ m of flooding, while the construction compound to the west is inundated by flood depths of up to ~~0.41–44~~ m during the ~~2032–2036~~ 0.5% AEP event.
- 1.7.4.16 Whilst the 400 kV grid connection cable corridor and associated temporary compounds are inundated by tidal flooding, the Ribble Douglas (2010, updated 2020) model included modelling of both fluvial and tidal contributions which present greater flood depths (discussed in greater detail within paragraphs **1.7.4.17** to **1.7.4.21**).

Fluvial flooding

- 1.7.4.17 To account for climate change occurring to peak river flow by the end of the construction phase, the 0.1% AEP + 20% climate change event has been used to assess fluvial flooding to the onshore export cable corridor. During this scenario, a limited section of the 400 kV grid connection cable corridor is

inundated by up to 1.5 m of flooding associated with out of bank flows from the Savick Brook, as presented within **Figure 1.16**.

- 1.7.4.18** During the undefended 0.1% AEP + 20% climate change event as presented within
- 1.7.4.19** **Figure 1.17**, the 400 kV grid connection cable corridor to the south of the River Ribble is inundated a limited extent of flooding with depths between 0.12 m and 0.35 m. Flooding is associated with out of bank flows from tributaries of Mill Brook.
- 1.7.4.20** It is additionally noted that fluvial flooding from the 4% AEP and 2% AEP fluvial event inundates the and 400 kV grid connection cable corridor to the north of the River Ribble. Flooding associated with out of bank flows from a tributary of Mill Brook which immediately outfalls to the River Ribble to the west of the site.
- 1.7.4.21** The fluvial model boundary within the Ribble Douglas model does not include the onshore export cable corridor or landfall area of the Onshore Infrastructure Area.

Fluvial and tidal flooding

- 1.7.4.22** To account for the fluvial and tidal contribution on flood extents and for the effects of climate change occurring to peak river flow by the end of the construction phase, the 1% AEP + 20% climate change event has modelled alongside tidal flooding to assess flooding to the onshore export cable corridor from both fluvial and tidal sources occurring in unison. Commentary on the worst-case flooding from the defended and undefended events is presented below.
- 1.7.4.23** The 400 kV grid connection cable corridor is impacted by fluvial flooding. Land to the south of Blackpool Road within the far eastern extent of the cable corridor, presenting flood depths between 0.40 m and 1.55 m during the 0.1% AEP defended event with a 20% climate change uplift in fluvial flows, as presented within **Figure 1.18**. The 400 kV grid connection cable corridor to the south of the River Ribble is not inundated by this event under the defended scenario but during the 0.1% + 20% undefended scenario, flood depths between 0.40 m and 2.89 m are evident across the cable corridor, as presented within **Figure 1.19**.

Credible maximum climate change scenario

Upper estimate peak river flows

- 1.7.4.24** The upper estimate peak river flow allowance has been used to assess the credible maximum climate change scenario from fluvial flows. This is 27% for the Ribble management catchment and 24% for the Douglas Management catchment under the 2020's epoch, as per **Table 1.9**.
- 1.7.4.25** The onshore export cable corridor and 400 kV grid connection cable corridor are assessed to be at risk of fluvial flooding during the construction phase and throughout the development lifetime, and thus are considered to be risk from the upper estimate peak river flow extent. However, the construction of these aspects of the Transmission Assets are to be waterproof and not considered

to be sensitive to the depth of floodwater inundation. As such, further assessment of fluvial flood data is not considered to be required.

H++ assessment

- 1.7.4.26 based on the Environment Agency's Coastal Design Sea Levels Level data the H++ flood level is 8.06m AOD at landfall. TJBs are located between 9.10 – 9.50m AOD and as such will not be affected by the H++ scenario, or by flooding during the operational lifetime.
- 1.7.4.27 The landfall, onshore export cable corridor and 400 kV grid connection cable corridor are assessed to be at risk of flooding during the construction phase and throughout the development lifetime, and thus at risk from the H++ event. However, the construction of these aspects of the Transmission Assets are to be waterproof and not considered to be sensitive to the depth of floodwater inundation. As such, the H++ approach is not considered necessary to be applied.

Operational and maintenance phase

- 1.7.4.28 The construction phase is expected to continue until ~~2032~~2036 and the operational lifetime of the Transmission Assets is assumed to be 35 years.
- 1.7.4.29 During the operation and maintenance phase there will be no permanent above ground structures associated with landfall, the onshore export cable corridor and 400 kV grid connection cable corridor other than joint bay and link box covers at ground level. As such, development will not increase flood risk to the surrounding area and has negligible risk of flooding to and from the development.
- 1.7.4.30 Volume 1, Chapter 3: Project description of the ES details activities associated with the operation and maintenance phase of the Transmission Assets and is summarised below.
- The landfall TJBs will only require to be accessed in the event of a cable failure or fault resulting in replacement or repair.
 - The operation and maintenance requirements for the onshore export cables and 400 kV grid connection cables is expected to involve routine inspections of the links boxes, which will be places at intervals along the onshore route.
 - Joint bays are only expected to require access in the event of a cable failure or fault resulting in replacement or repair.

As such, it is expected mitigation measures within **Table 1.38** will ensure vulnerability of site users is managed during this phase.

Decommissioning

- 1.7.4.31 Activities associated with decommissioning will operate within the parameters of those established for construction. An Onshore Decommissioning Plan is detailed as a CoT36 (see **Table 1.38**) and will be developed prior to decommissioning in a timely manner. The Onshore Decommissioning Plan will include details relevant to flood risk, pollution prevention and avoidance of

ground disturbance. The Onshore Decommissioning Plan will be in line with the latest relevant available guidance.

Mitigation measures (commitments)

- 1.7.4.32 Site workers will be present within areas of the landfall, onshore export cable corridor and 400 kV grid connection cable corridor at risk of fluvial and tidal flooding (Flood Zone 2 and [3a and 3b](#)) during the construction phase of the development. Occasional operation and maintenance activities are also expected to take place at the landfall, onshore export cable corridor and 400 kV grid connection cable corridor. As outline in the outline operational drainage management plan (document reference J10), the onshore export cables and 400 kV grid connection cables will be installed below ground, and the existing land cover will be reinstated at surface level, in line with best practice, during the construction phase. On this basis it is not considered necessary to provide permanent surface water management measures for the onshore cable route.
- 1.7.4.33 The following mitigation measures (commitments) presented below within **Table 1.38** below are proposed to manage flood risk and vulnerability to site workers during the construction, operational and maintenance and decommissioning phases. Commitments are also presented within **Section 1.8, Table 1.44**. Commitments are to be secured through requirements of the DCO.

Table 1.38: Summary of CoT for fluvial and tidal flood risk for landfall, the onshore export corridor and 400 kV grid connection cable corridor

CoT	Summary	Reason	How CoT is to be secured
CoT02	<p>The following features will be crossed by trenchless techniques, as set out in the Onshore Crossing Schedule submitted as part of the application for development consent:</p> <ul style="list-style-type: none"> - A, B and Classified unnumbered roads (known as C roads) (including the Preston Western Distributor Road, A582 South Ribble Western Distributor Upgrade and M55 Heyhouses Link Road; excluding Leech Lane); - All Environment Agency Main Rivers, including: Moss Sluice, east of Midgeland Road along Pegs Lane; Savick Brook, south of A583; Wrea Brook southeast of Cartmell Lane; Dow Brook east of Lower Lane between the A584 and the A583; Middle Pool north of Lund Way; and - All Network Rail crossings, including along the line which runs between Blackpool North and 	To reduce flood risk from fluvial and tidal sources	DCO Schedules 2A and 2B, Requirement 8 (Code of Construction Practice)

CoT	Summary	Reason	How CoT is to be secured
	Preston, south of Cartmell Lane; and at the Network Rail crossing along the line which runs to Blackpool North, south east of Squires Gate, parallel to the A584.		
CoT06	<p>The construction area associated with onshore export cable corridor will be 100 m working width and the 400 kV grid connection cable corridor will be working width 76 m to minimise the construction footprint, except at complex trenchless technique crossings, including, but not limited to:</p> <ul style="list-style-type: none"> • Network Railway Crossings; • A, B and Classified unnumbered roads (known as C roads), including B5261 (Queensway); • the approach to landfall; • river and water course crossings; and • sensitive utility assets (e.g. high pressure gas pipelines). <p>The widths of both the onshore export cable corridor and 400 kV grid connection cable corridor also increases up to 270 m in width, on the access and egress to the onshore substations, to facilitate consideration of trenchless crossings as well as being subject to detailed design. These increased widths and crossing methodologies are set out in the Onshore Crossing Schedule and Works Plans-Onshore and Intertidal.</p>	To reduce flood risk from fluvial and tidal sources	DCO Schedules 2A & 2B, Requirement 5 (Detailed design parameters onshore); Works Plans - Onshore and Intertidal
CoT08	Post-construction, the working area will be reinstated to pre-existing condition as far as reasonably practical in line with the DEFRA Construction Code of Practice for the Sustainable Use of Soils on Construction Sites (PB13298), Institute of Quarrying (IQ) Good Practice Guide for Handling Soils in Mineral Workings (IQ, 2021) and British Society of Soil Science (BSSS) Working with Soil Guidance Note on Benefitting from Soil Management in Development and Construction (BSSS, 2022).	To ensure working areas are reinstated to pre-existing conditions after construction has been completed	DCO Schedules 2A & 2B, Requirement 18 (Restoration of land temporarily used for construction); DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed	To implement construction phase drainage to control runoff	DCO Schedules 2A and 2B, Requirement 8

CoT	Summary	Reason	How CoT is to be secured
	CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	during this phase of the Transmission Assets.	(Code of Construction Practice)
CoT10	<p>Where trenchless techniques are proposed for Environment Agency Main Rivers, the following distances will be used:</p> <ul style="list-style-type: none"> 8 m from the bank of the Environment Agency Main River or landward toe of any associated flood defence structure; 16 m from tidal Environment Agency Main Rivers or the landward toe of any flood defences, where the Main River is a sea defence structure; and a minimum of 2 m vertical clearance will be maintained below the hard bed of all Environment Agency Main Rivers, including the landward toe of any associated flood defences. <p>Final vertical clearance depths beneath Environment Agency Main Rivers will be identified during detailed design stage, in consultation with the Environment Agency, to ensure the export cables remain buried for the operational lifetime of the project.</p>	To reduce flood risk from fluvial and tidal sources	DCO Schedules 2A and 2B, Requirement 8 (Code of Construction Practice)
CoT12	The onshore export cables and the 400 kV grid connection cables will be completely buried underground for the entire length. No overhead pylons will be installed as part of the Transmission Assets.	To reduce flood risk from fluvial and tidal sources	DCO Schedule 1, Part 1, Authorised Development
CoT14	Joint bays will be completely buried, with the land above reinstated. An inspection cover will be provided on the surface for link boxes for access during operation and maintenance phase.	To ensure no above ground development (and potential floodplain displacement) will arise from the installation of joint bays and link boxes	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT27	All temporary compounds will be removed and sites will be reinstated when construction has been completed.	To ensure working areas are reinstated to pre-existing conditions after construction has been completed	DCO Schedules 2A and 2B, Requirement 8 (Code of Construction Practice); and DCO Schedules 2A and 2B, Requirement 16 (Restoration of land used temporarily for construction)

CoT	Summary	Reason	How CoT is to be secured
CoT35	<p>An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP will include measures to maintain and address:</p> <ul style="list-style-type: none"> [...] flood protection and control measures; -water environment and drainage; and pollution prevention [...] 	<p>To implement control measures in regards to fluvial and tidal flooding, including:</p> <ul style="list-style-type: none"> Measures to prevent a reduction in the capacity of the fluvial floodplain which can increase flood risk downstream; Measures regarding dewatering; Measures regarding restricting the placement of stockpiling, storage of fuels and chemicals and refuelling to Flood Zone 1 (where practical) and at least 8 m from ordinary watercourses and Main Rivers and 16m from tidal Main Rivers to reduce vulnerability to flood risk; 	DCO Schedules 2A and 2B, Requirement 8 (Code of Construction Practice)
CoT36	<p>Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the latest relevant available guidance.</p>	To manage flood risk during decommissioning	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)
CoT39	<p>Fences, walls, ditches and drainage outfalls will be retained at the landfall and along the onshore export cable corridor and 400 kV grid connection cable corridor, where possible. Where it is not reasonably practicable to retain them, any damage will be repaired and reinstated as soon as reasonably practical. The Environment Agency must be notified if damage occurs to any Environment Agency main river or related flood infrastructure.</p>	To ensure flood risk is not increased as a result of construction activities	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT44	<p>The Project Description (Volume 1, Chapter 3 of the Environmental Statement) sets out that the installation of the offshore export</p>	To ensure flood risk is not increased at the landfall as a result of construction activities	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

CoT	Summary	Reason	How CoT is to be secured
	cables under Lytham St Annes SSSI and the St Annes Old Links Golf Course will be undertaken by direct pipe trenchless installation technique. The exit pits associated with the direct pipe installation will be at least 100 m seaward of the western boundary of the SSSI.		
CoT90	The Project Description (Volume 1, Chapter 3 of the Environmental Statement) sets out that the installation of the 400 kV Grid Connection Cable Corridor beneath the River Ribble will be undertaken by direct pipe or micro tunnel trenchless installation techniques.	To ensure flood risk is not increased in proximity to the River Ribble as a result of construction activities	DCO Schedules 2A & 2B, Requirement 5(3)(Detailed design parameters onshore); and Requirement 8 (Code of Construction Practice)"
CoT95	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. The Outline CoCP includes that during the construction phase the Principal Contractor(s) will sign up to the Flood Warning Service and will be alerted by a phone call or text when a Flood Warning becomes active. The flood warning will be applied to the entire Onshore Infrastructure Area located within Flood Zones 2 and 3 to enable site personnel to be evacuated from the site in a timely manner prior to a flood event occurring, if appropriate.	To reduce vulnerability to flood risk	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT97	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. The Detailed CoCPs detail that where necessary at the compounds located within the landfall area, construction measures will be adopted to maintain the existing level of flood protection during construction. These measures will be discussed with the Environment Agency. If applicable, these measures could include scheduling work windows against tide times and briefing site personnel regarding weather conditions, tide times and heights. If a Flood Warning/Flood Alert is issued for the 'Lancashire coastline at Lytham St. Annes, along the coast	To reduced flood risk vulnerability to site users during the construction phase.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

CoT	Summary	Reason	How CoT is to be secured
	from Squires Gate to Warton Bank' Flood Warning Area (reference 012FWCTL13A) and the 'Coast at Lytham St Annes' Flood Alert area (reference 012WACLS) works within the relevant areas within the landfall area would also be stopped whilst the Flood Warning/Flood Alert is active.		

Strategic Flood Risk Assessment Data

The Fylde Coast Authorities Strategic Flood Risk Assessment (2024)

1.7.4.34 Relevant information to fluvial and tidal flood risk from the FCA SFRA has been extracted and included as follows.

- The following summaries have been made for the Blackpool Council area:
 - Fluvial flood risk is minimal in Blackpool. There are a small number of main rivers which form in the east of the study area and flow east into Fylde and Wyre but no main rivers which flow through the area. The main fluvial flood risk is along Main Dyke in the east.
 - The western boundary of Blackpool is entirely coastal with tidal flood risk along its length. The risk is mainly confined along the coastline but does encroach inland in the south around Foxhall and South Shore. The largest area of tidal flood risk comes from the Wyre Estuary and impacts the urban areas of Anchorsholme and Whiteholme in the north of the area.
- The following summaries have been made for the Fylde Council area:
 - The main fluvial flood risk in Fylde comes from tributaries of the River Ribble which flow south through the area to join the River Ribble, which runs along the southern border of the area. Considerable parts of the fluvial flood risk affect rural areas; however, settlements affected by fluvial flood risk include Lytham, Kirkham, Warton, and Freckleton.
 - The Ribble estuary presents a tidal flood risk to the south of the area. In the southwest, the east side of the settlement of Lytham is shown to be at tidal risk. In the southeast, it is largely rural areas to the east of Freckleton that are shown to be at risk.
- FCA details the following historical flood events recorded by the Councils:
 - February and March 2020, overtopping of sea defences led to flooding of roads and properties within Blackpool.
- Within supporting SFRA mapping, the majority of Flood Zone 3 extents are further classified as Flood Zone 3b. Extents of Flood Zone 3/3b within SFRA mapping broadly correspond to extents of Flood Zone 3 featured

within the Environment Agency Flood Map for Planning prior to updates made in March 2025. Extents of Flood Zone 3b assessed within the FCA are broadly comparable to the 'River and Sea with Defences' dataset used to assess extents of Flood Zone 3b to the Transmission Assets.

Strategic Flood Risk Assessment (Fylde Borough Council, 2011)

~~1.7.4.34 Relevant information to fluvial and tidal flood risk from the FC SFRA has been extracted and included as follows.~~

- ~~• Fylde Borough Council do not hold any records of historical flooding.~~

Central Lancashire Strategic Flood Risk Assessment (2007)

1.7.4.35 Relevant information to fluvial and tidal flood risk from the CL SFRA has been extracted and included as follows.

- Raised river defences have been built across parts of the catchment to prevent flooding.
- Watercourses within the Ribble and Douglas catchments are tidally influenced.

Blackpool Council Strategic Flood Risk Assessment (2014)

~~1.7.4.36 Relevant information to fluvial and tidal flood risk from the Blackpool Council SFRA has been extracted and included as follows.~~

- ~~• There are no areas of the Transmission Assets that are located within Blackpool in Zone 3b (functional floodplain).~~
- ~~• Historical overtopping of the existing sea defences has occurred during storm events; however, the new sea defences have on the whole, addressed this risk.~~

Summary

~~1.7.4.37~~ 1.7.4.36 At landfall, the TJB entry pits are not considered to be at risk of tidal or fluvial flooding and will only be accessed by site users during the operational and maintenance phase if a repair is required. The offshore export cables landing location is within the intertidal area and as such is considered to be at risk of tidal flooding throughout the construction period.

~~1.7.4.38~~ 1.7.4.37 Partial extents of the onshore export cable corridor and 400 kV grid connection cable corridor are at risk of flooding during construction.

~~1.7.4.39~~ 1.7.4.38 The installation of below ground cables will be undertaken during the construction phase. During the operation and maintenance phase there will be no permanent above ground structures associated with landfall, the onshore export cable corridor and 400 kV grid connection cable corridor other than joint bay and link box covers at ground level. As such, development will not increase flood risk to the surrounding area and has negligible risk of flooding to and from the development. Furthermore,

only planned maintenance activities will take place within these aspects of the Transmission Assets during the operational and maintenance phase, and activities associated with decommissioning will operate within the parameters of those established for construction.

~~1.7.4.40~~1.7.4.39 Commitments are to be secured through requirements of the DCO. With the implementation of mitigation measures (commitments) presented within **Table 1.38** during the construction, operational and maintenance and decommissioning phases of the landfall, onshore export cable corridor and 400 kV grid connection cable corridor, flood risk from fluvial and tidal source is assessed to be low.

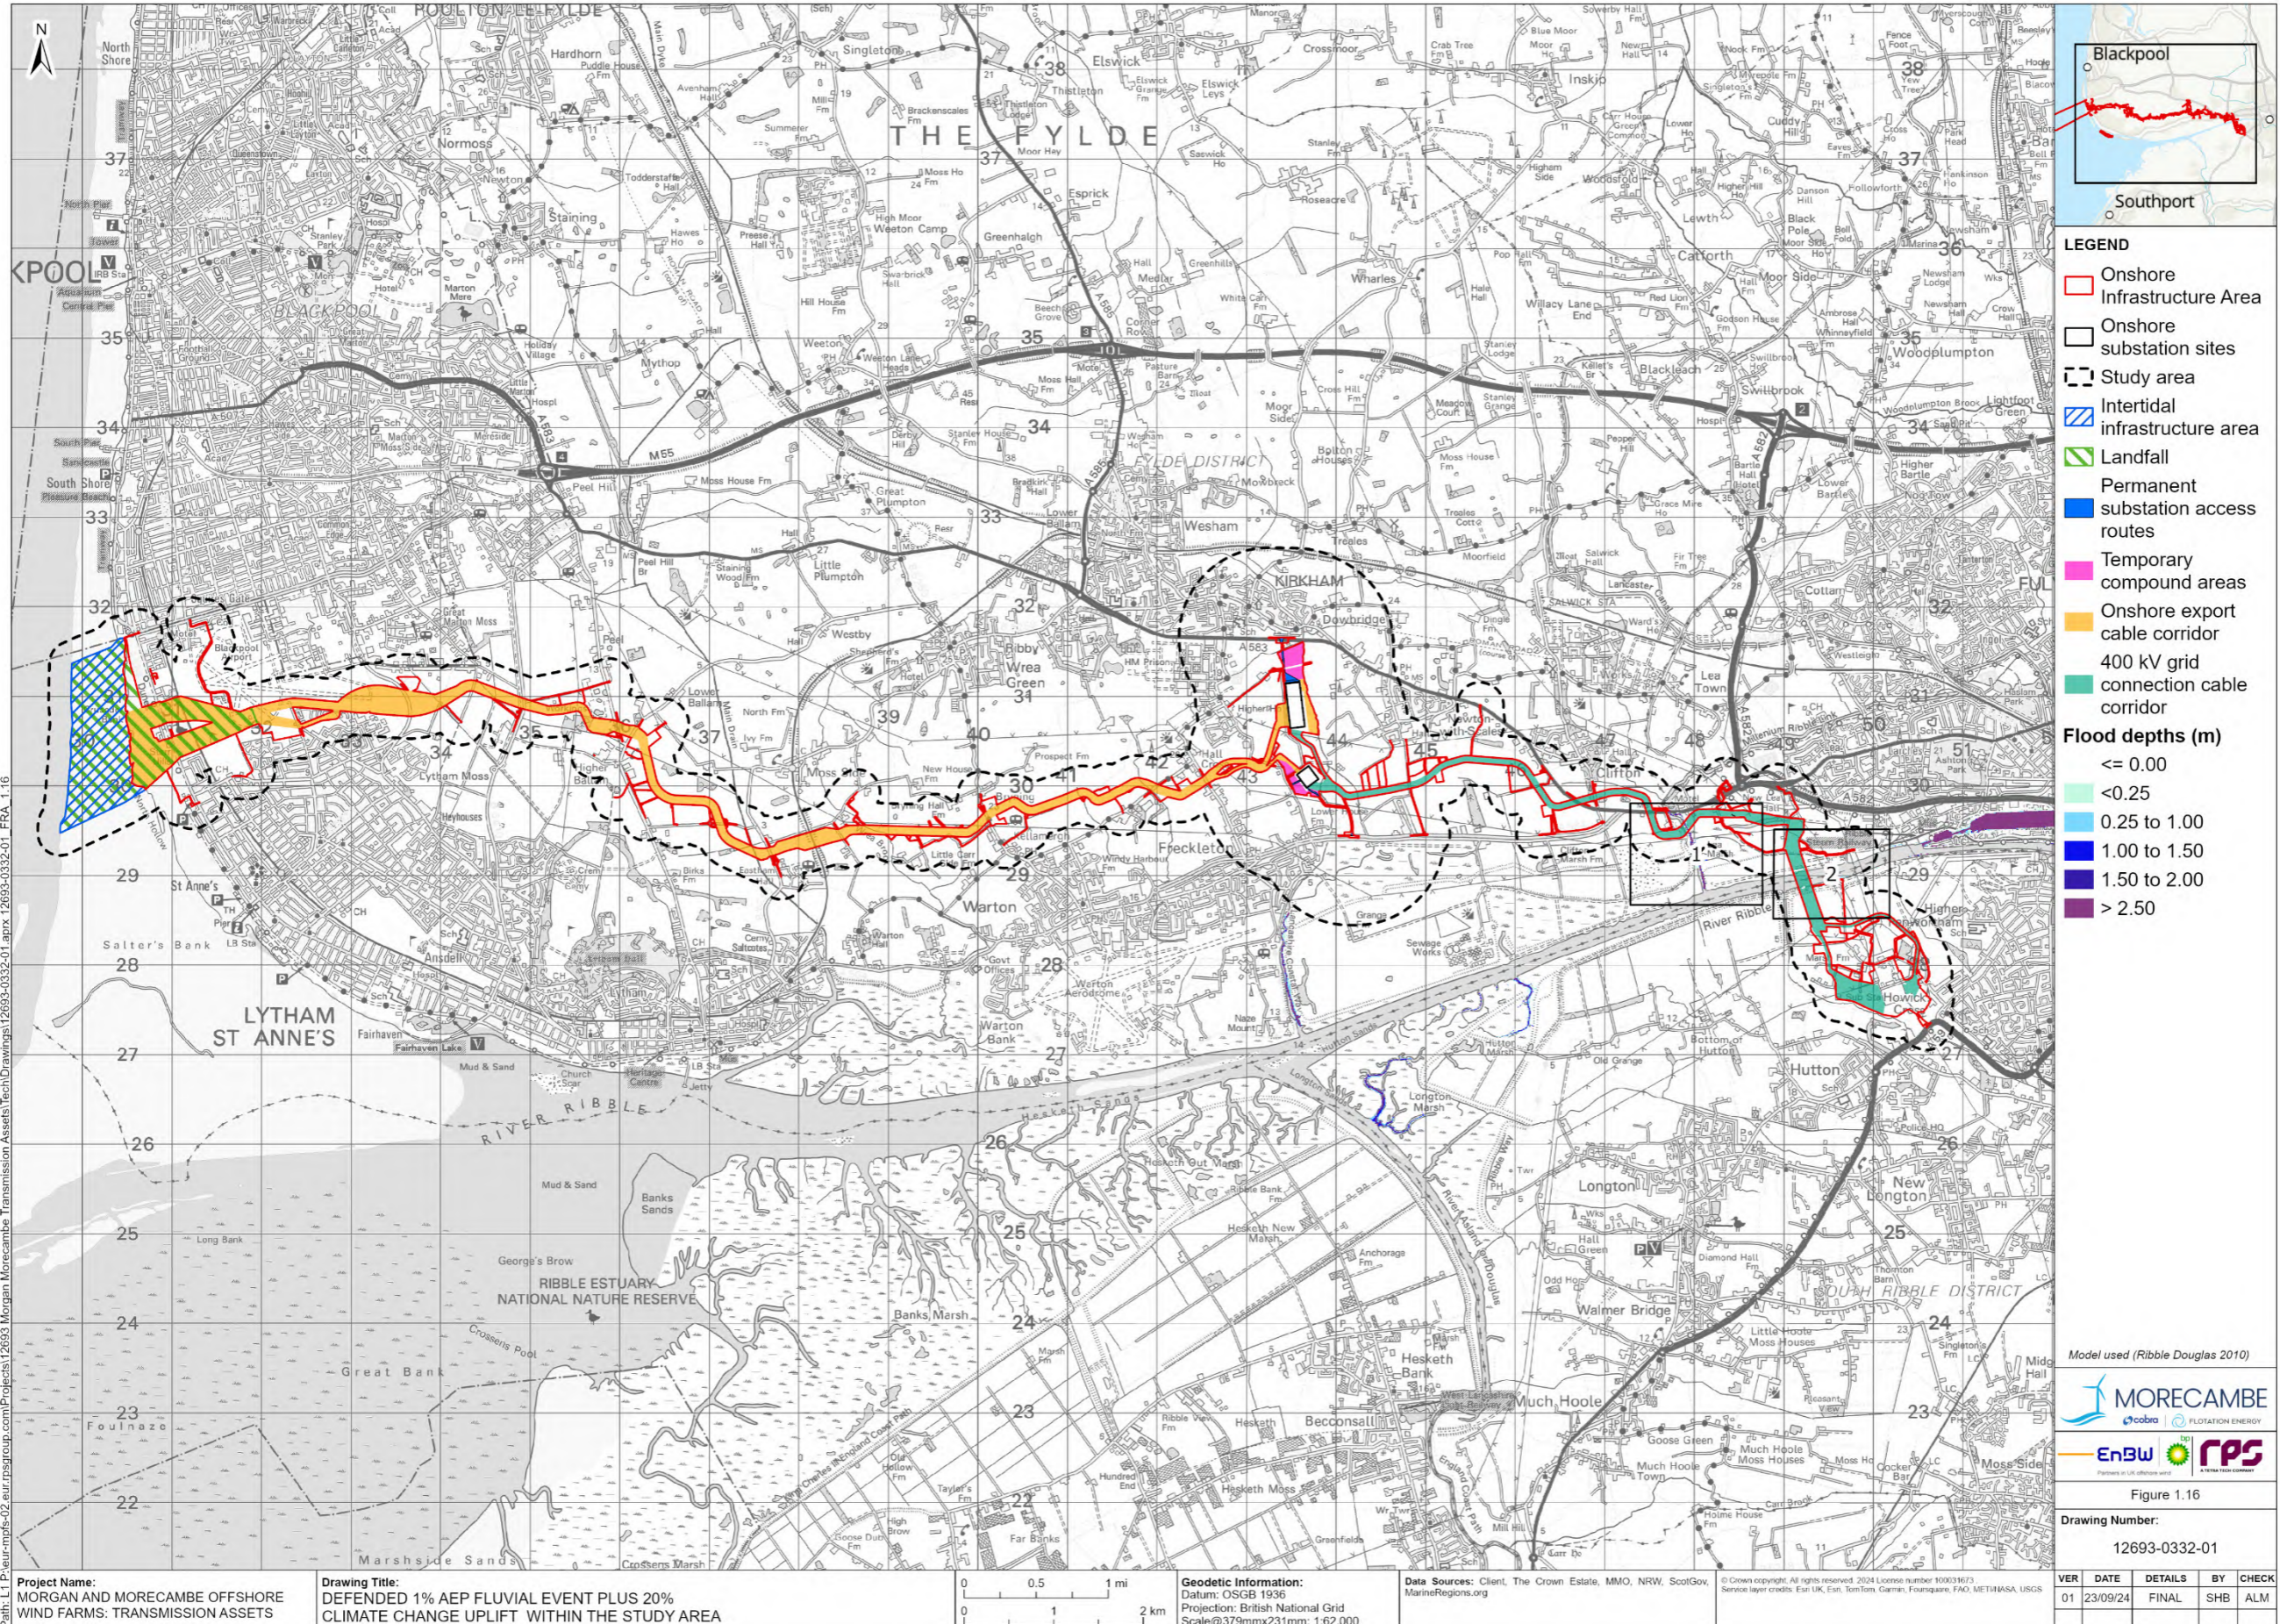


Figure 1.16a: Defended 1% AEP fluvial event plus 20% climate change uplift

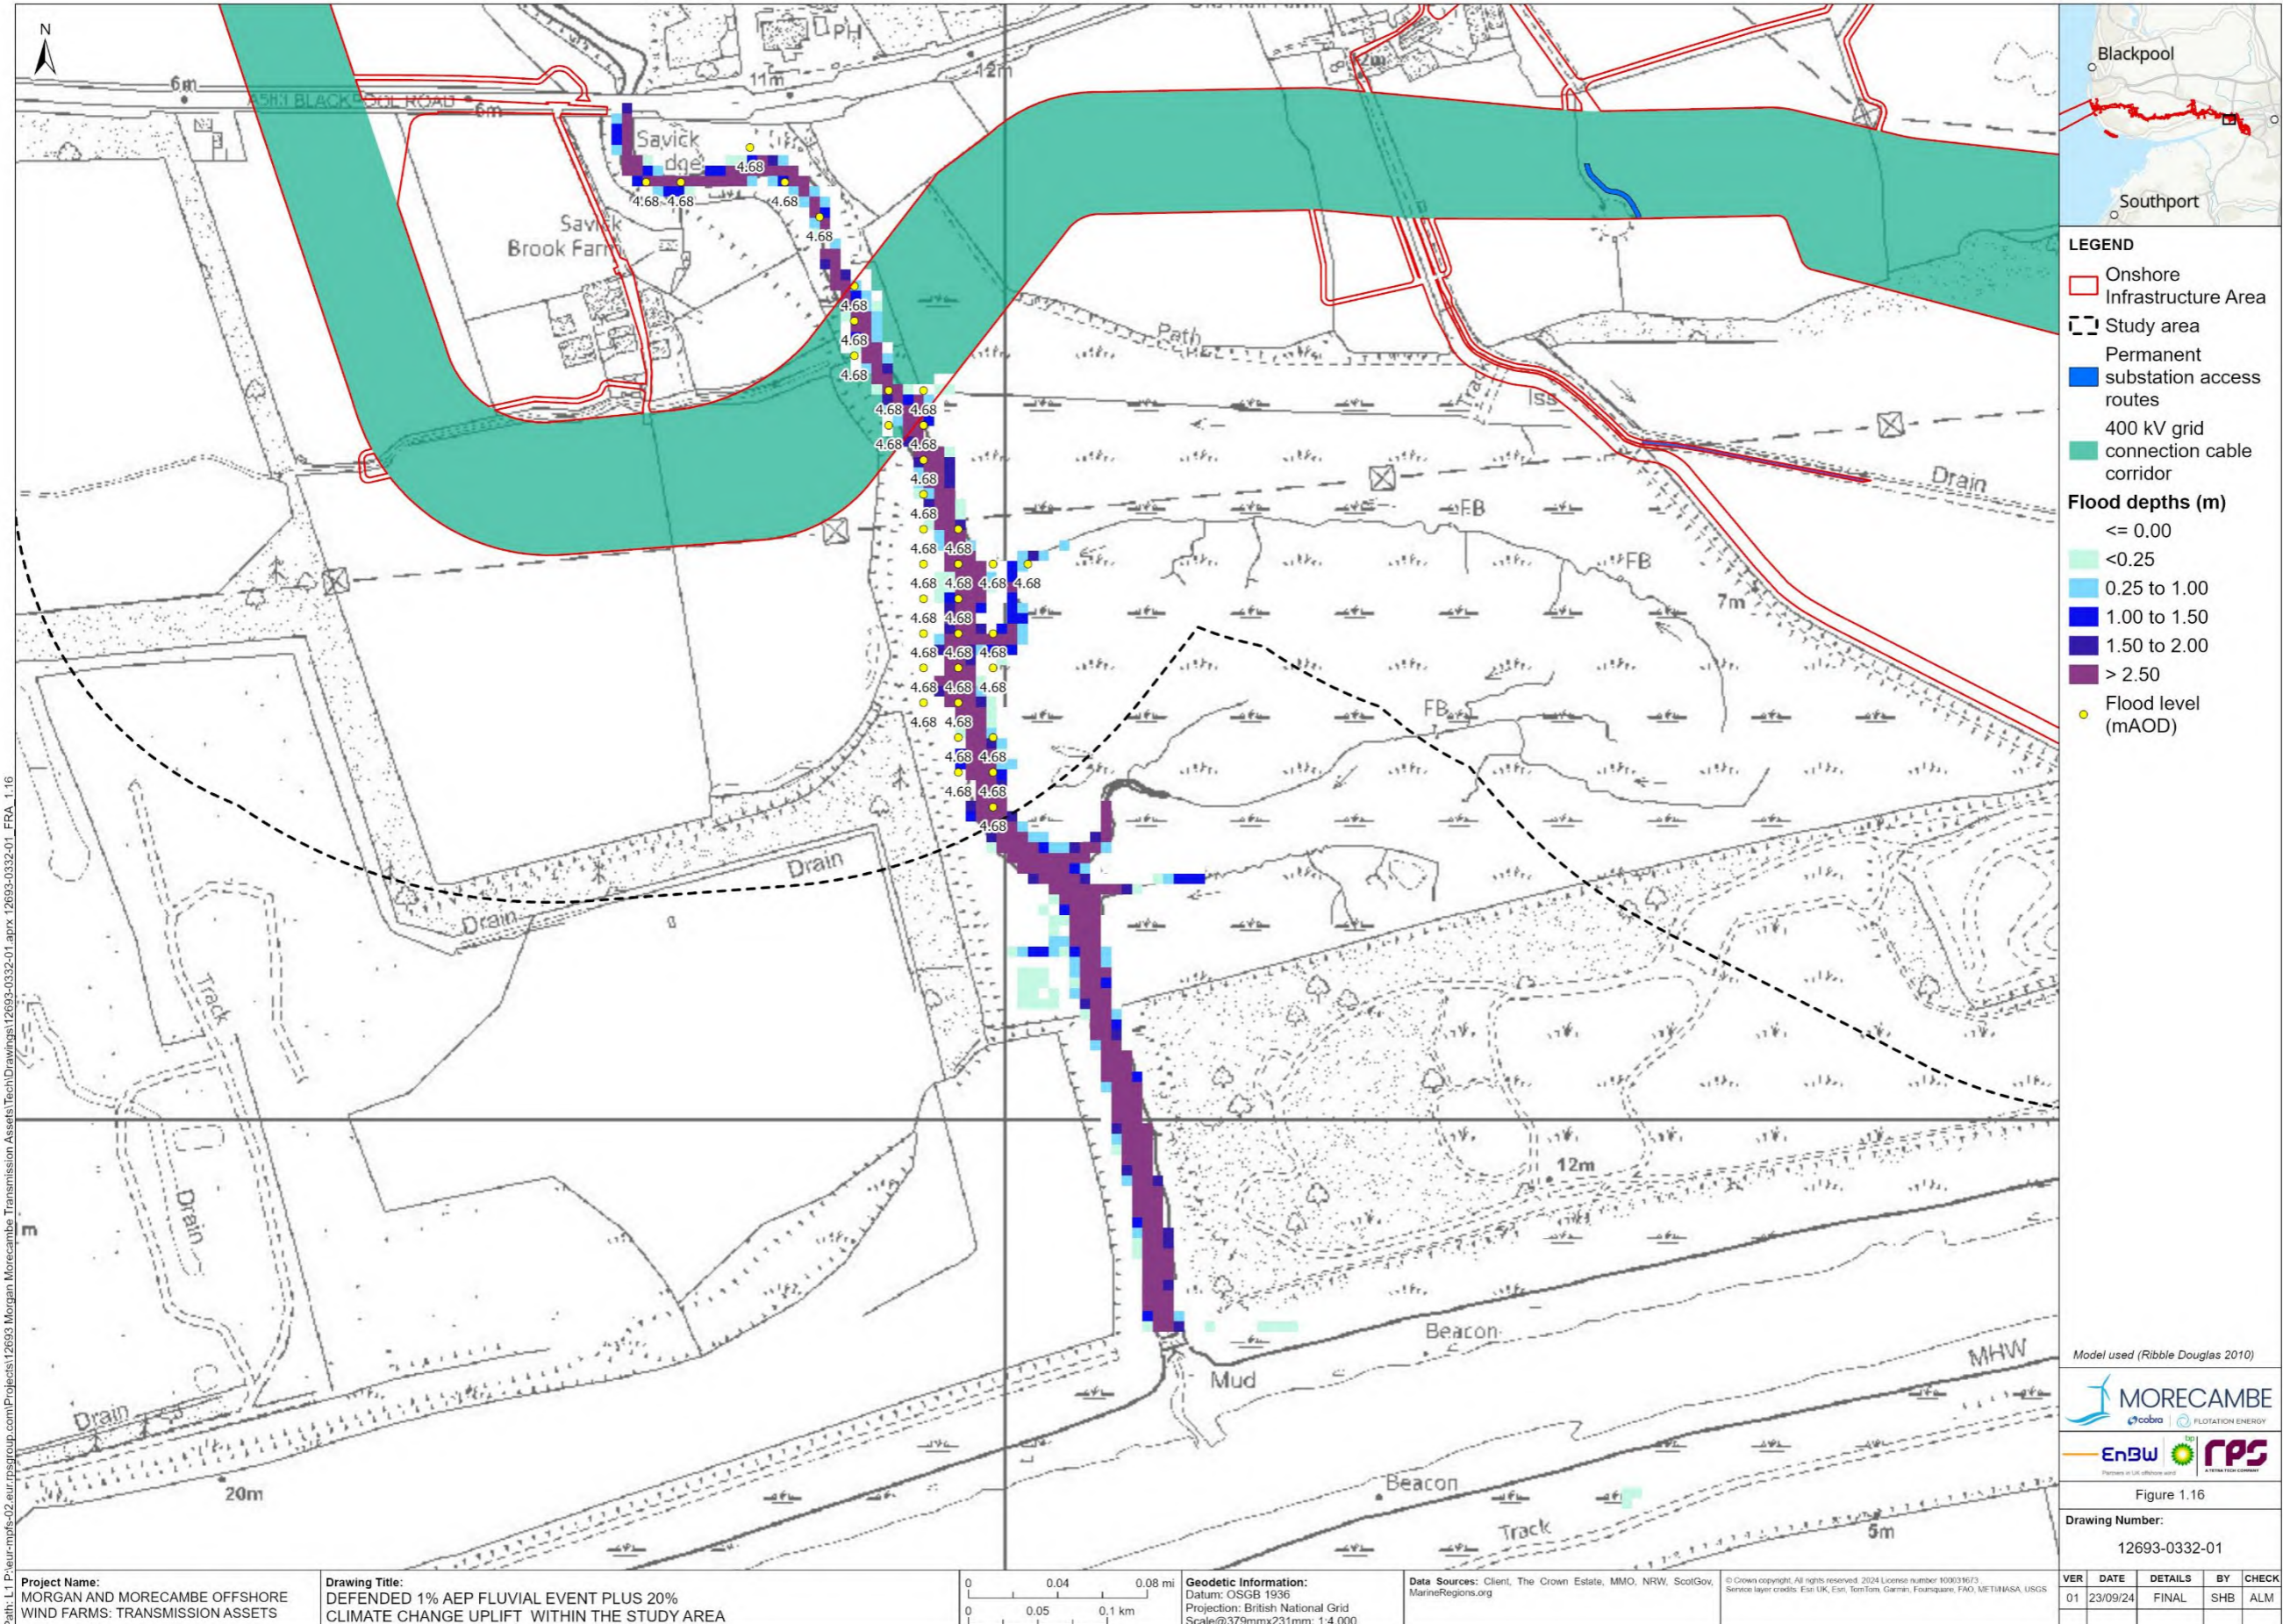


Figure 1.16a: Defended 1% AEP fluvial event plus 20% climate change uplift

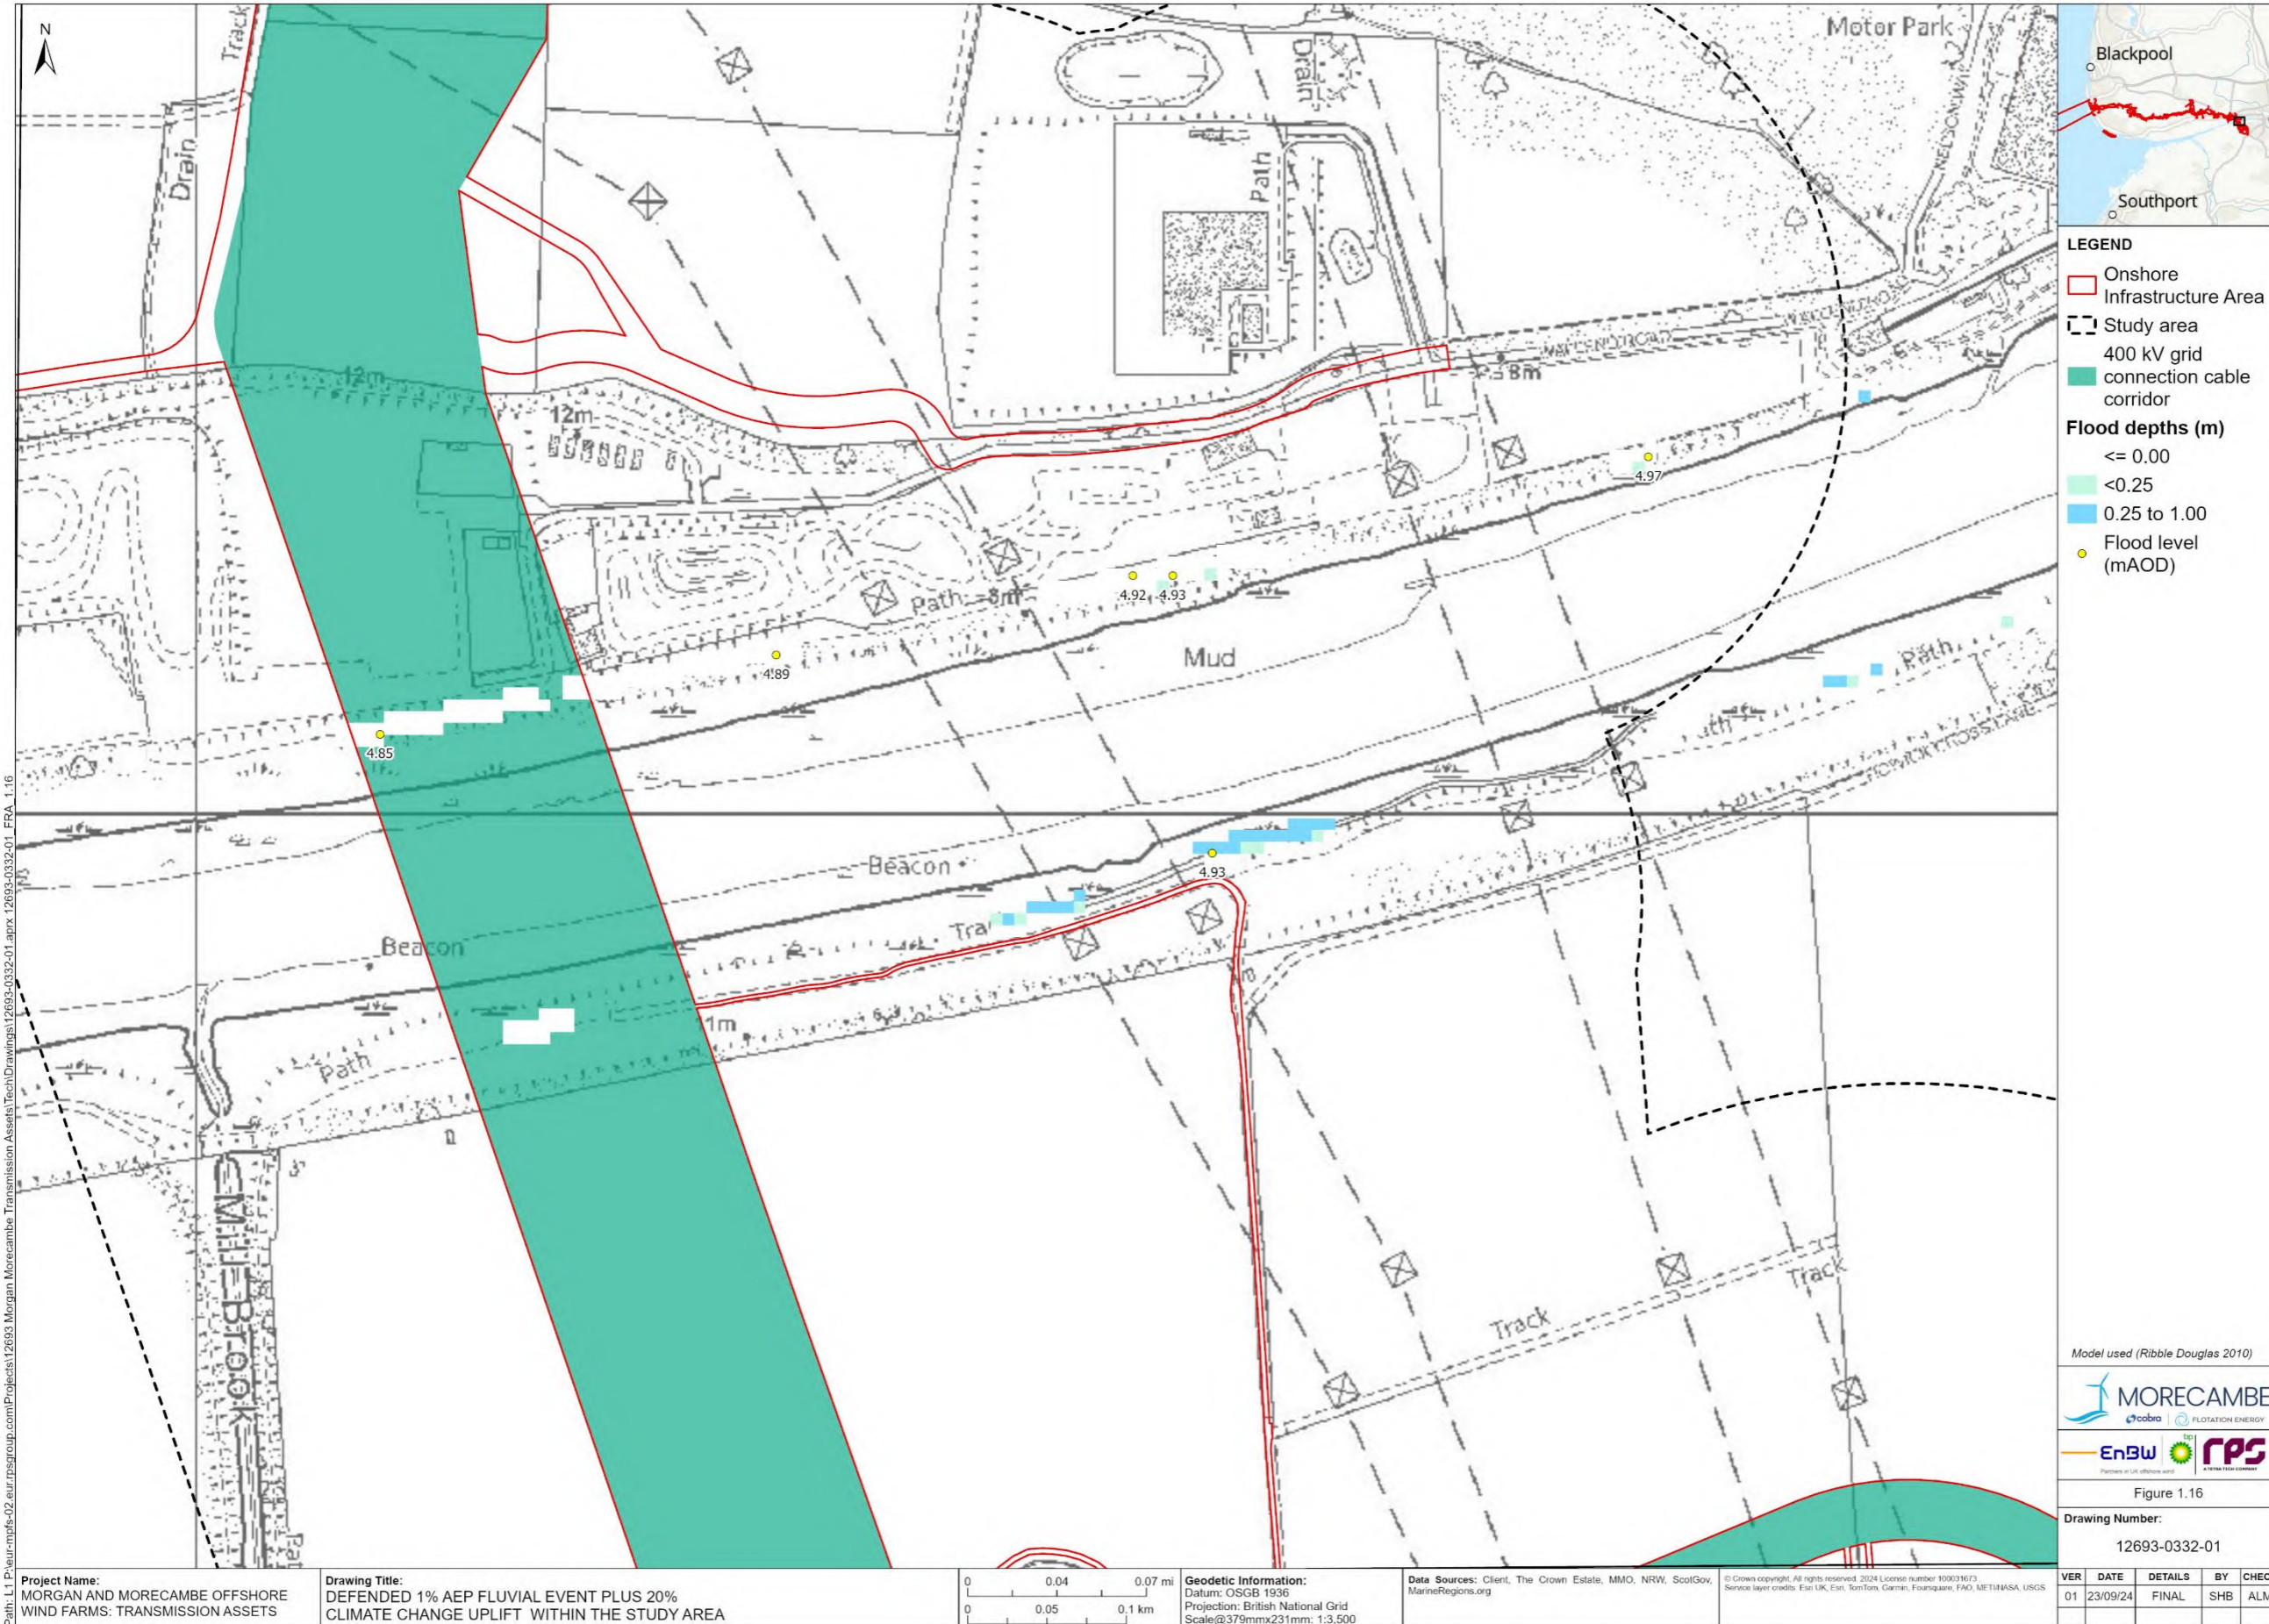


Figure 1.16a: Defended 1% AEP fluvial event plus 20% climate change uplift

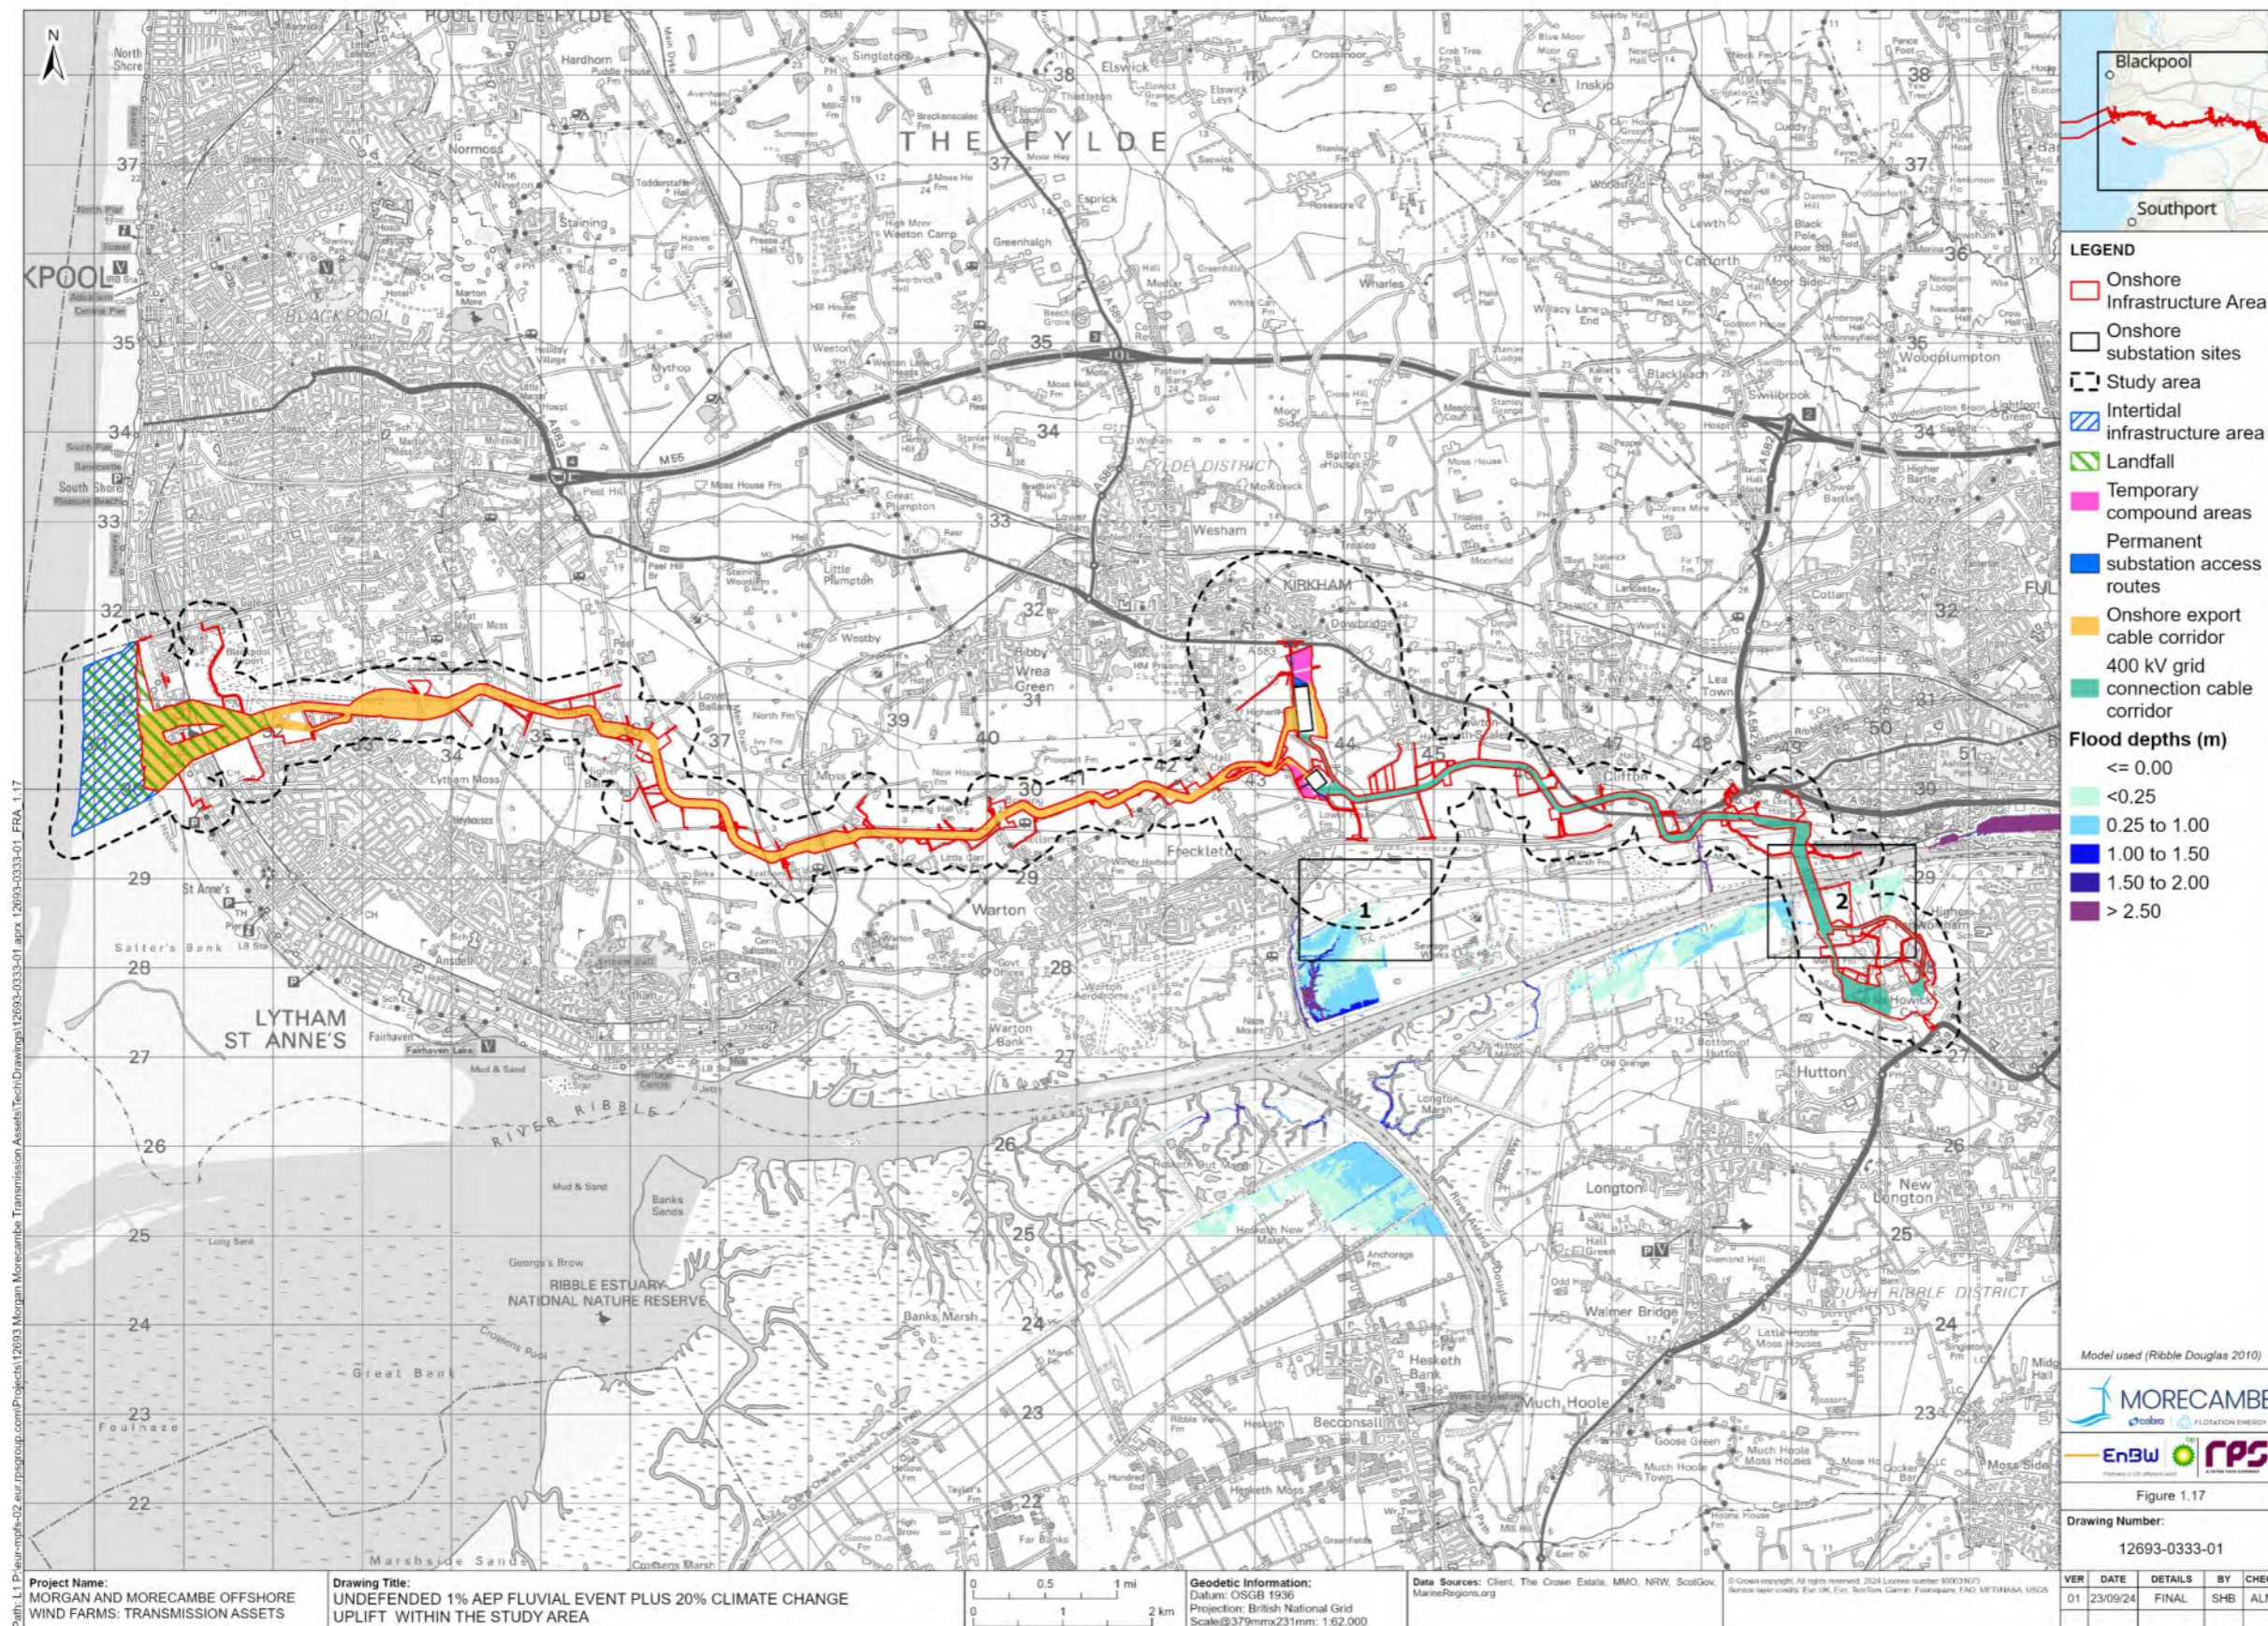


Figure 1.17a: Undefended 1% AEP fluvial event plus 20% climate change uplift

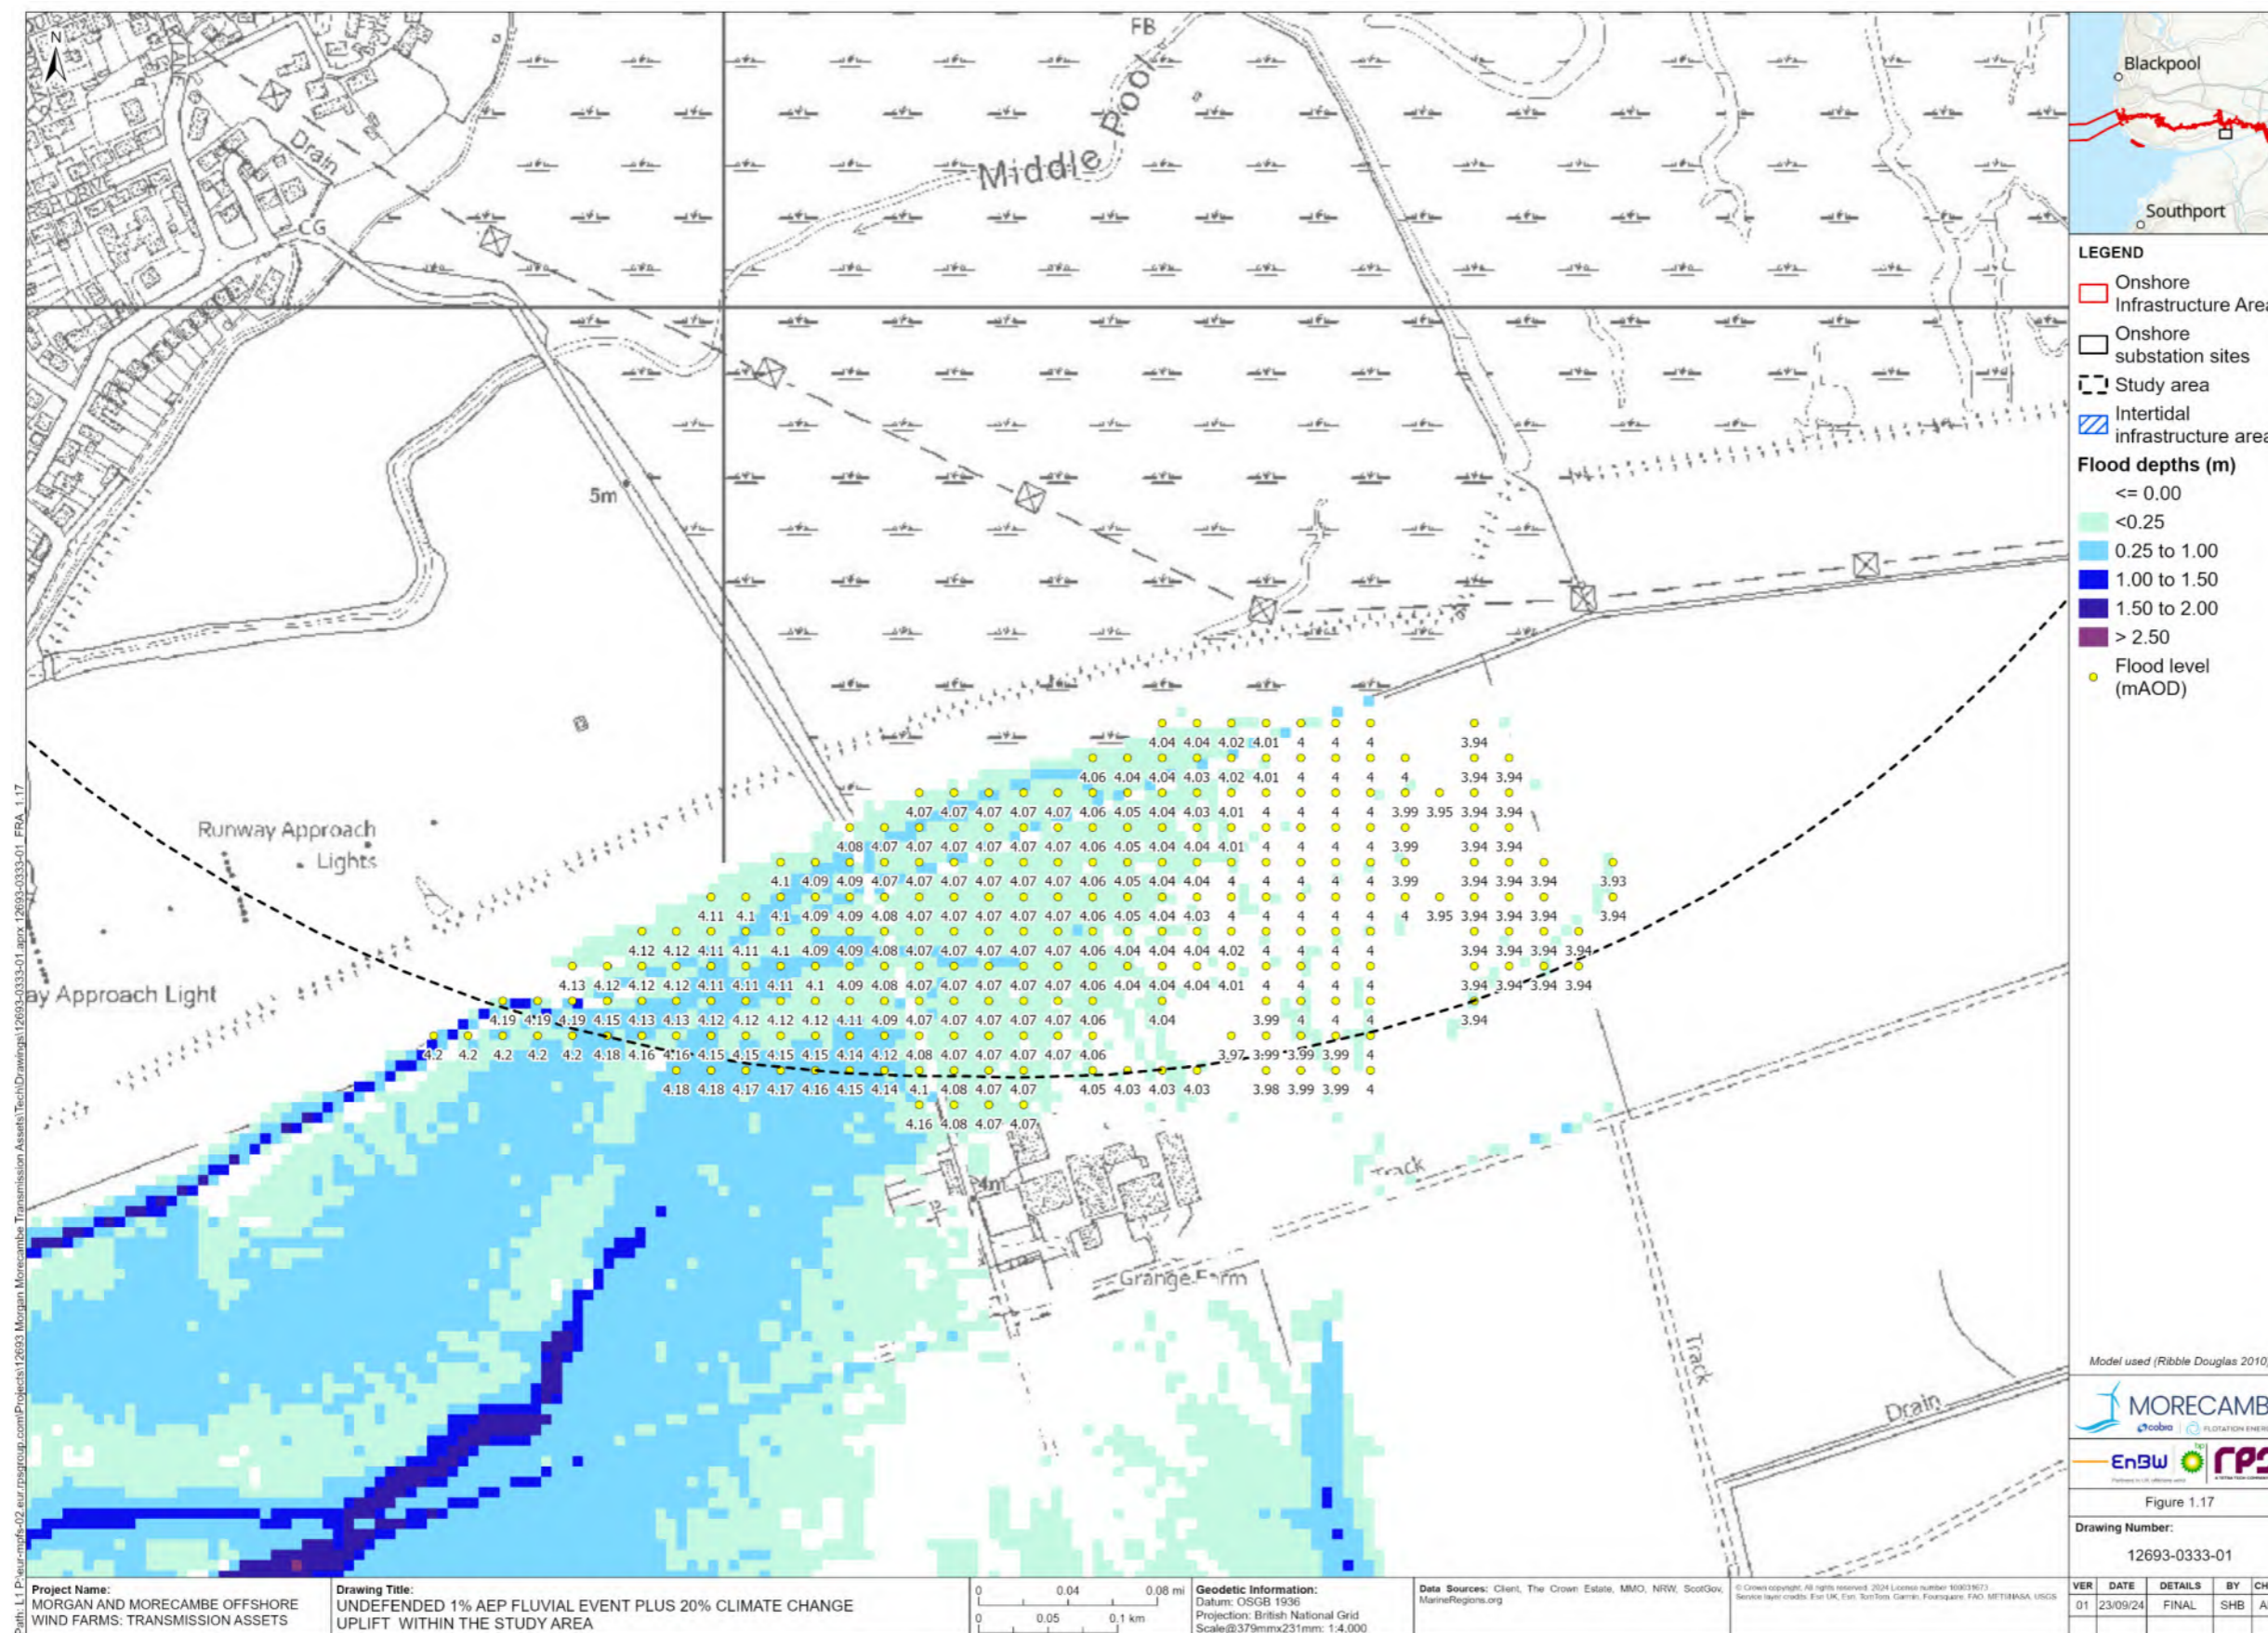


Figure 1.17a: Undefended 1% AEP fluvial event plus 20% climate change uplift

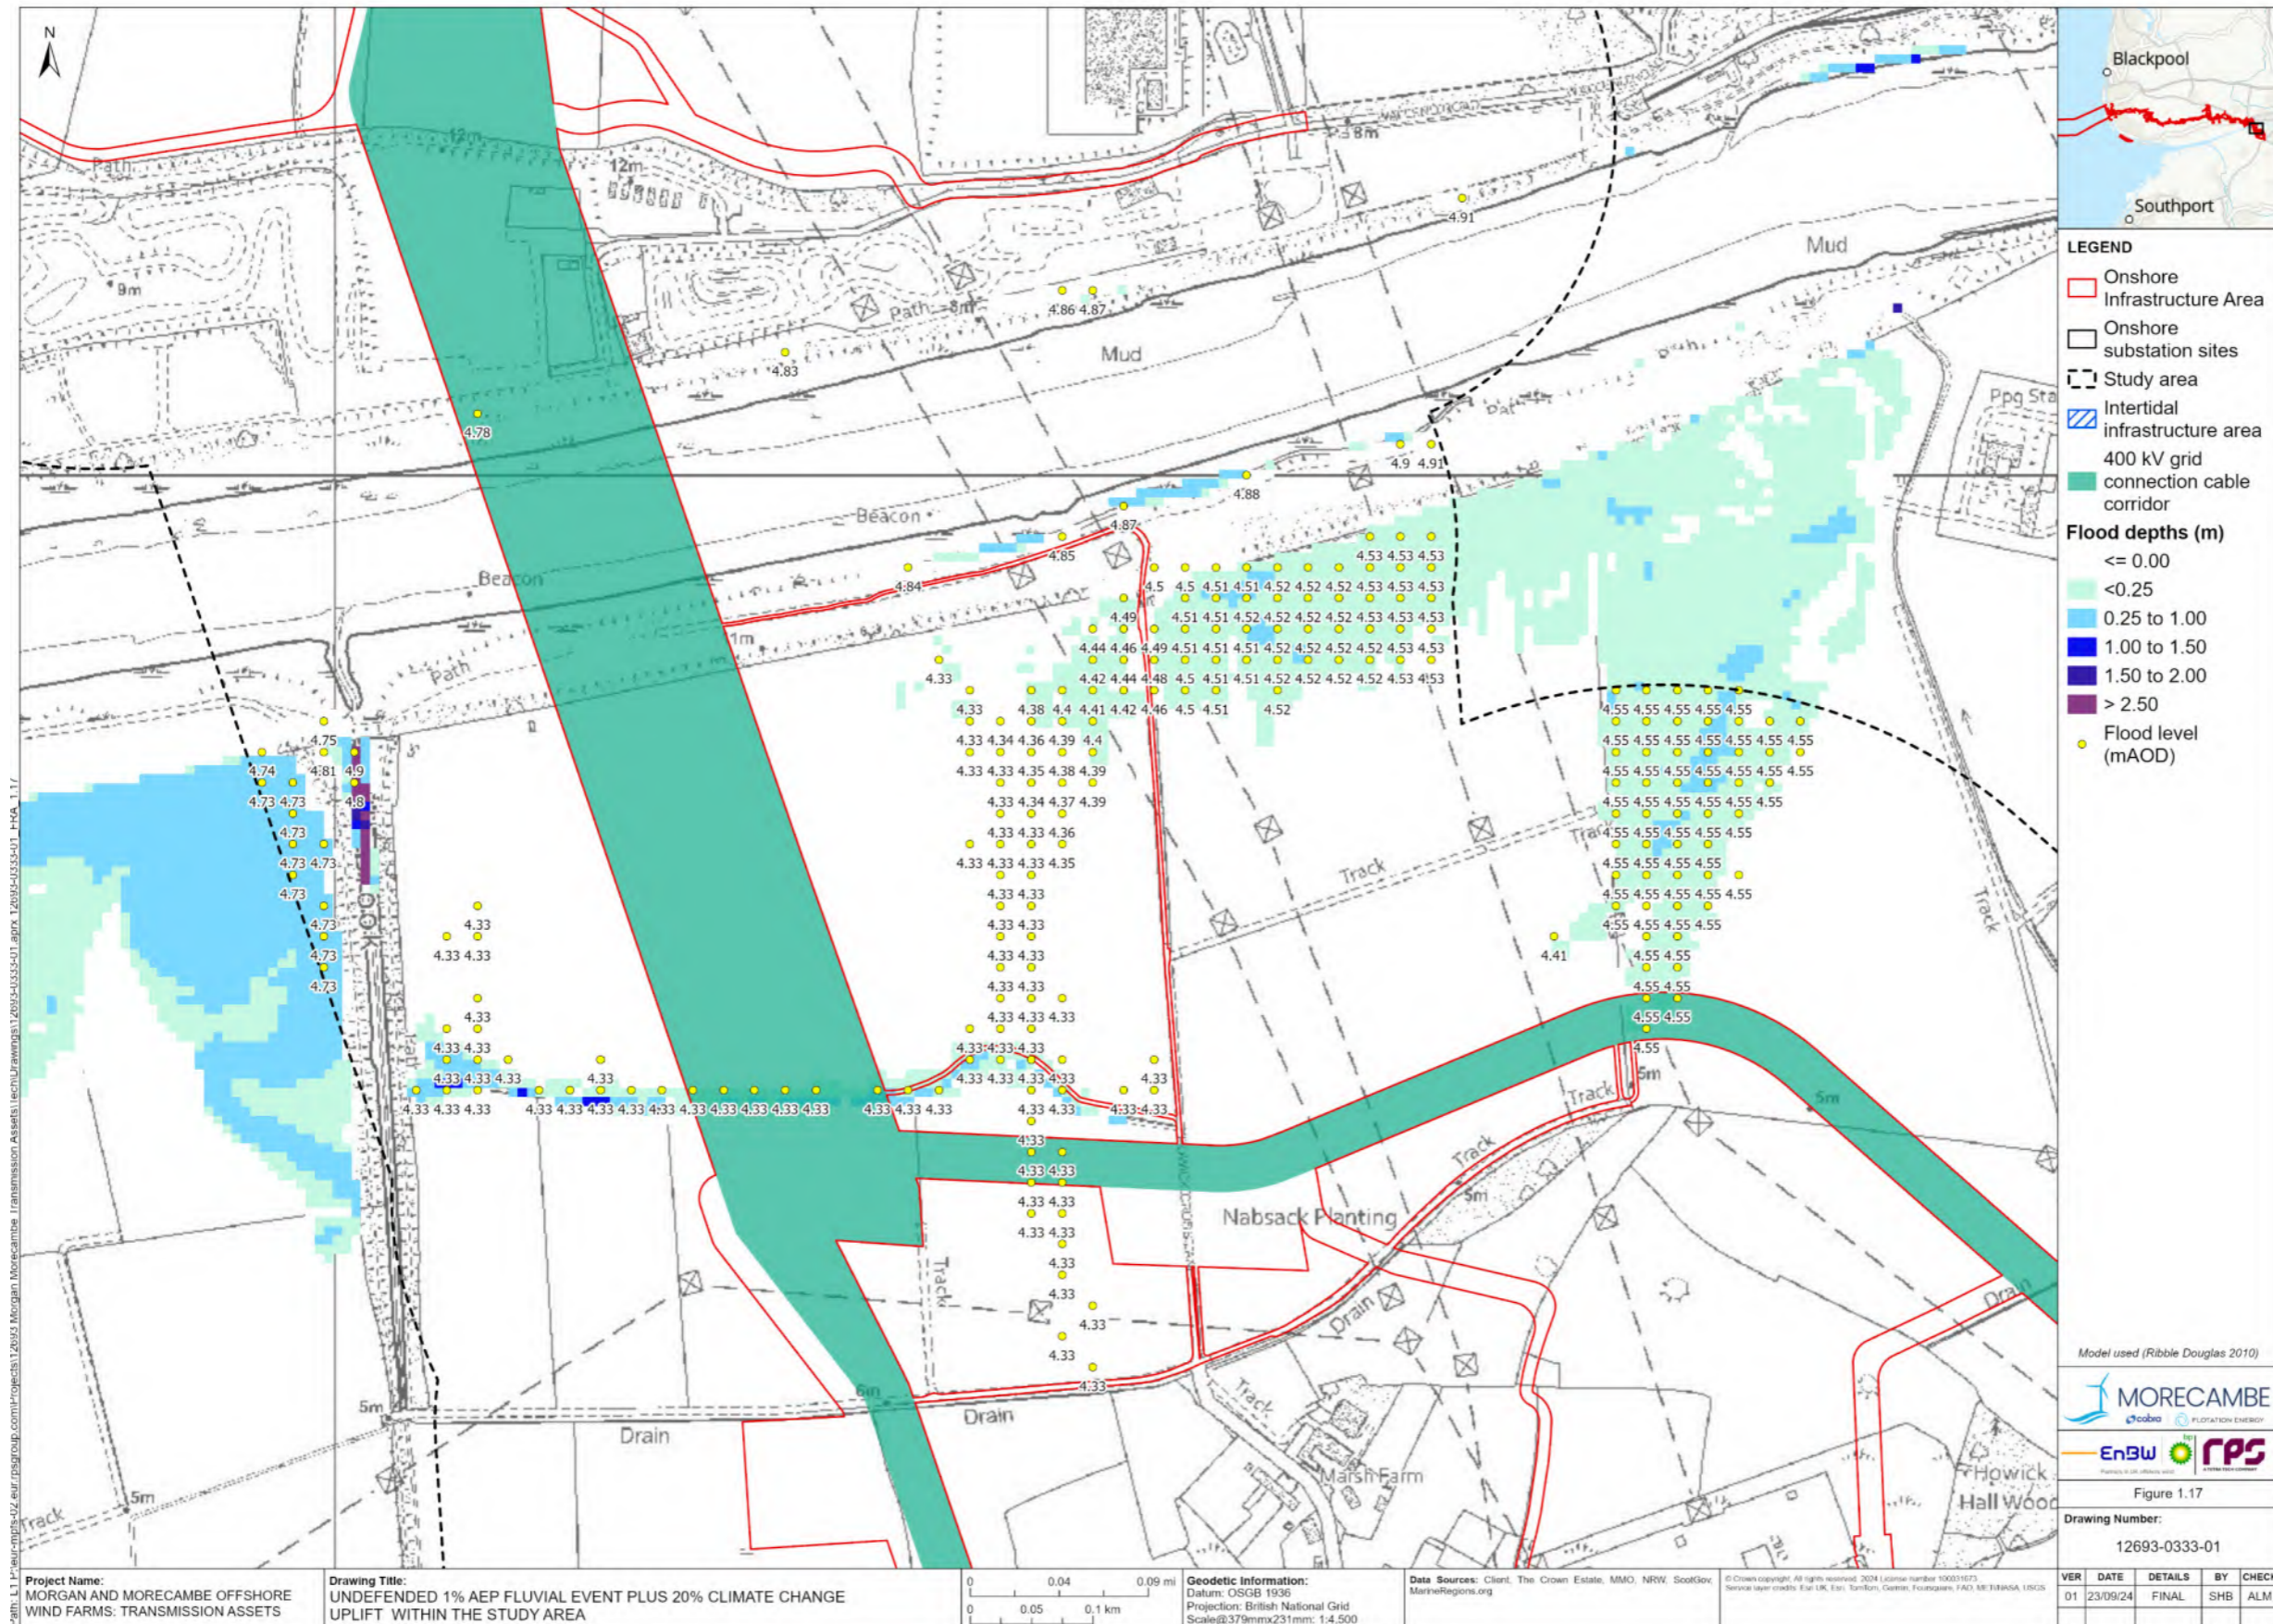
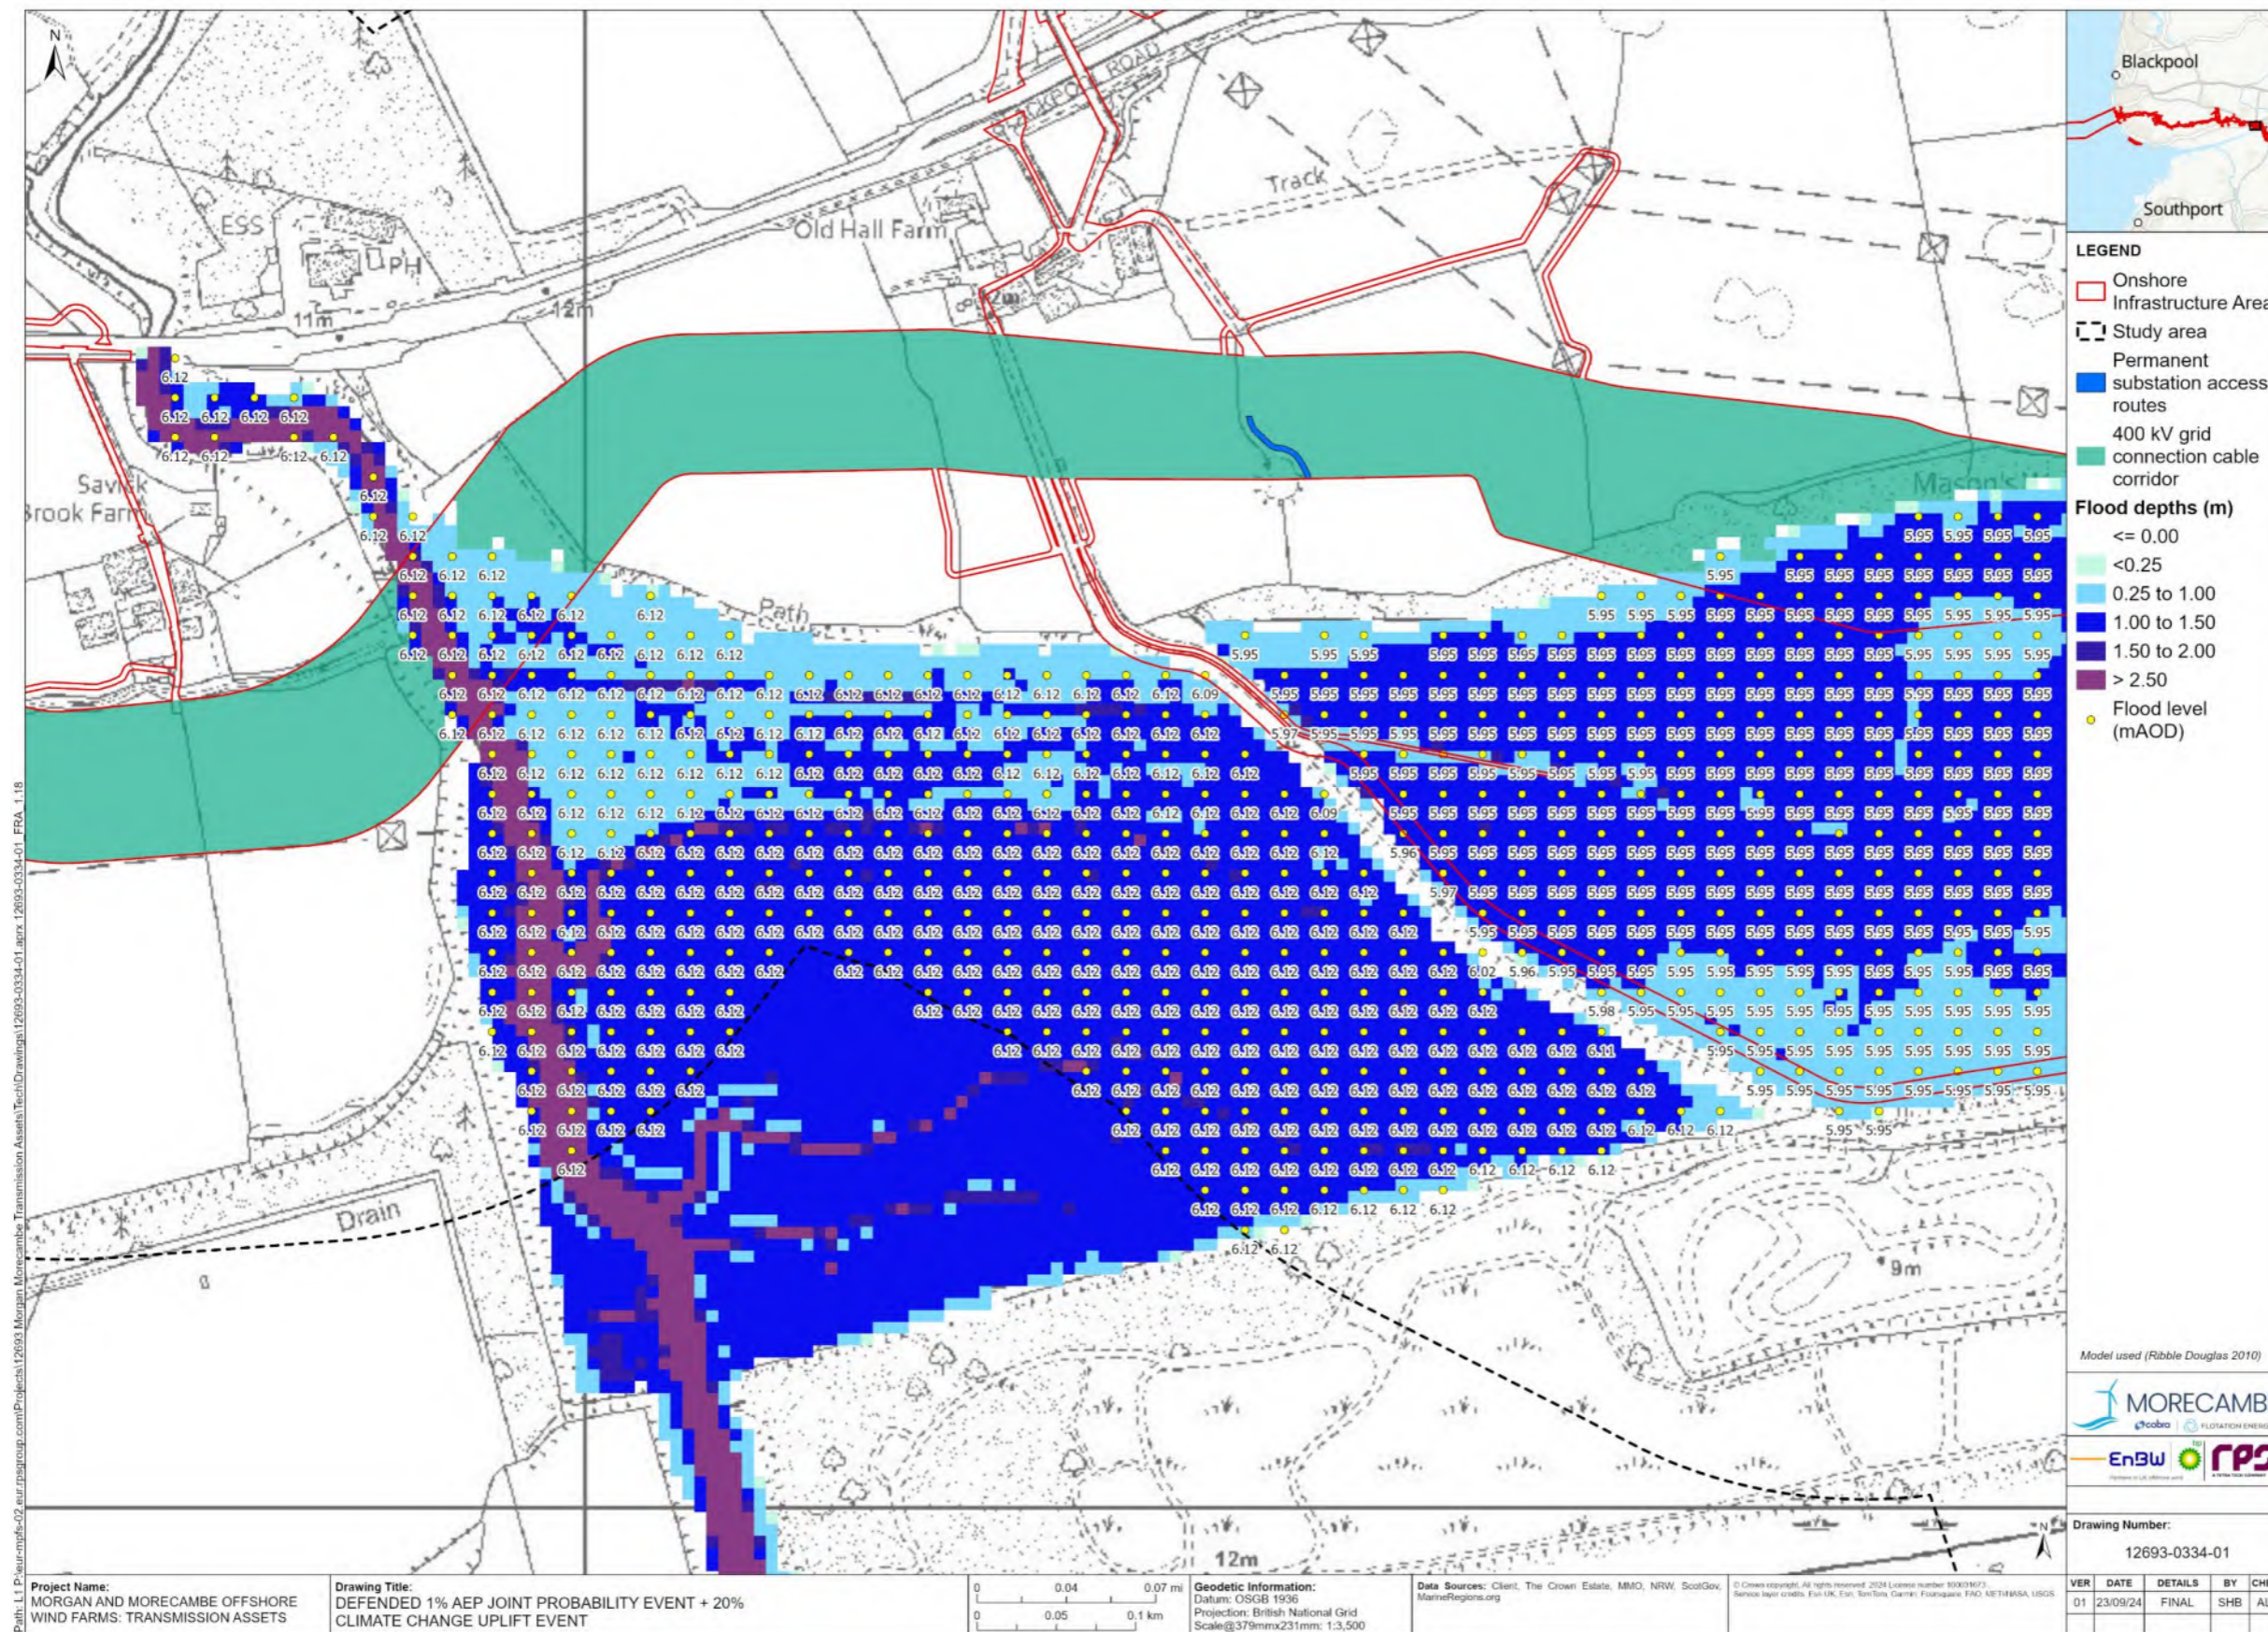
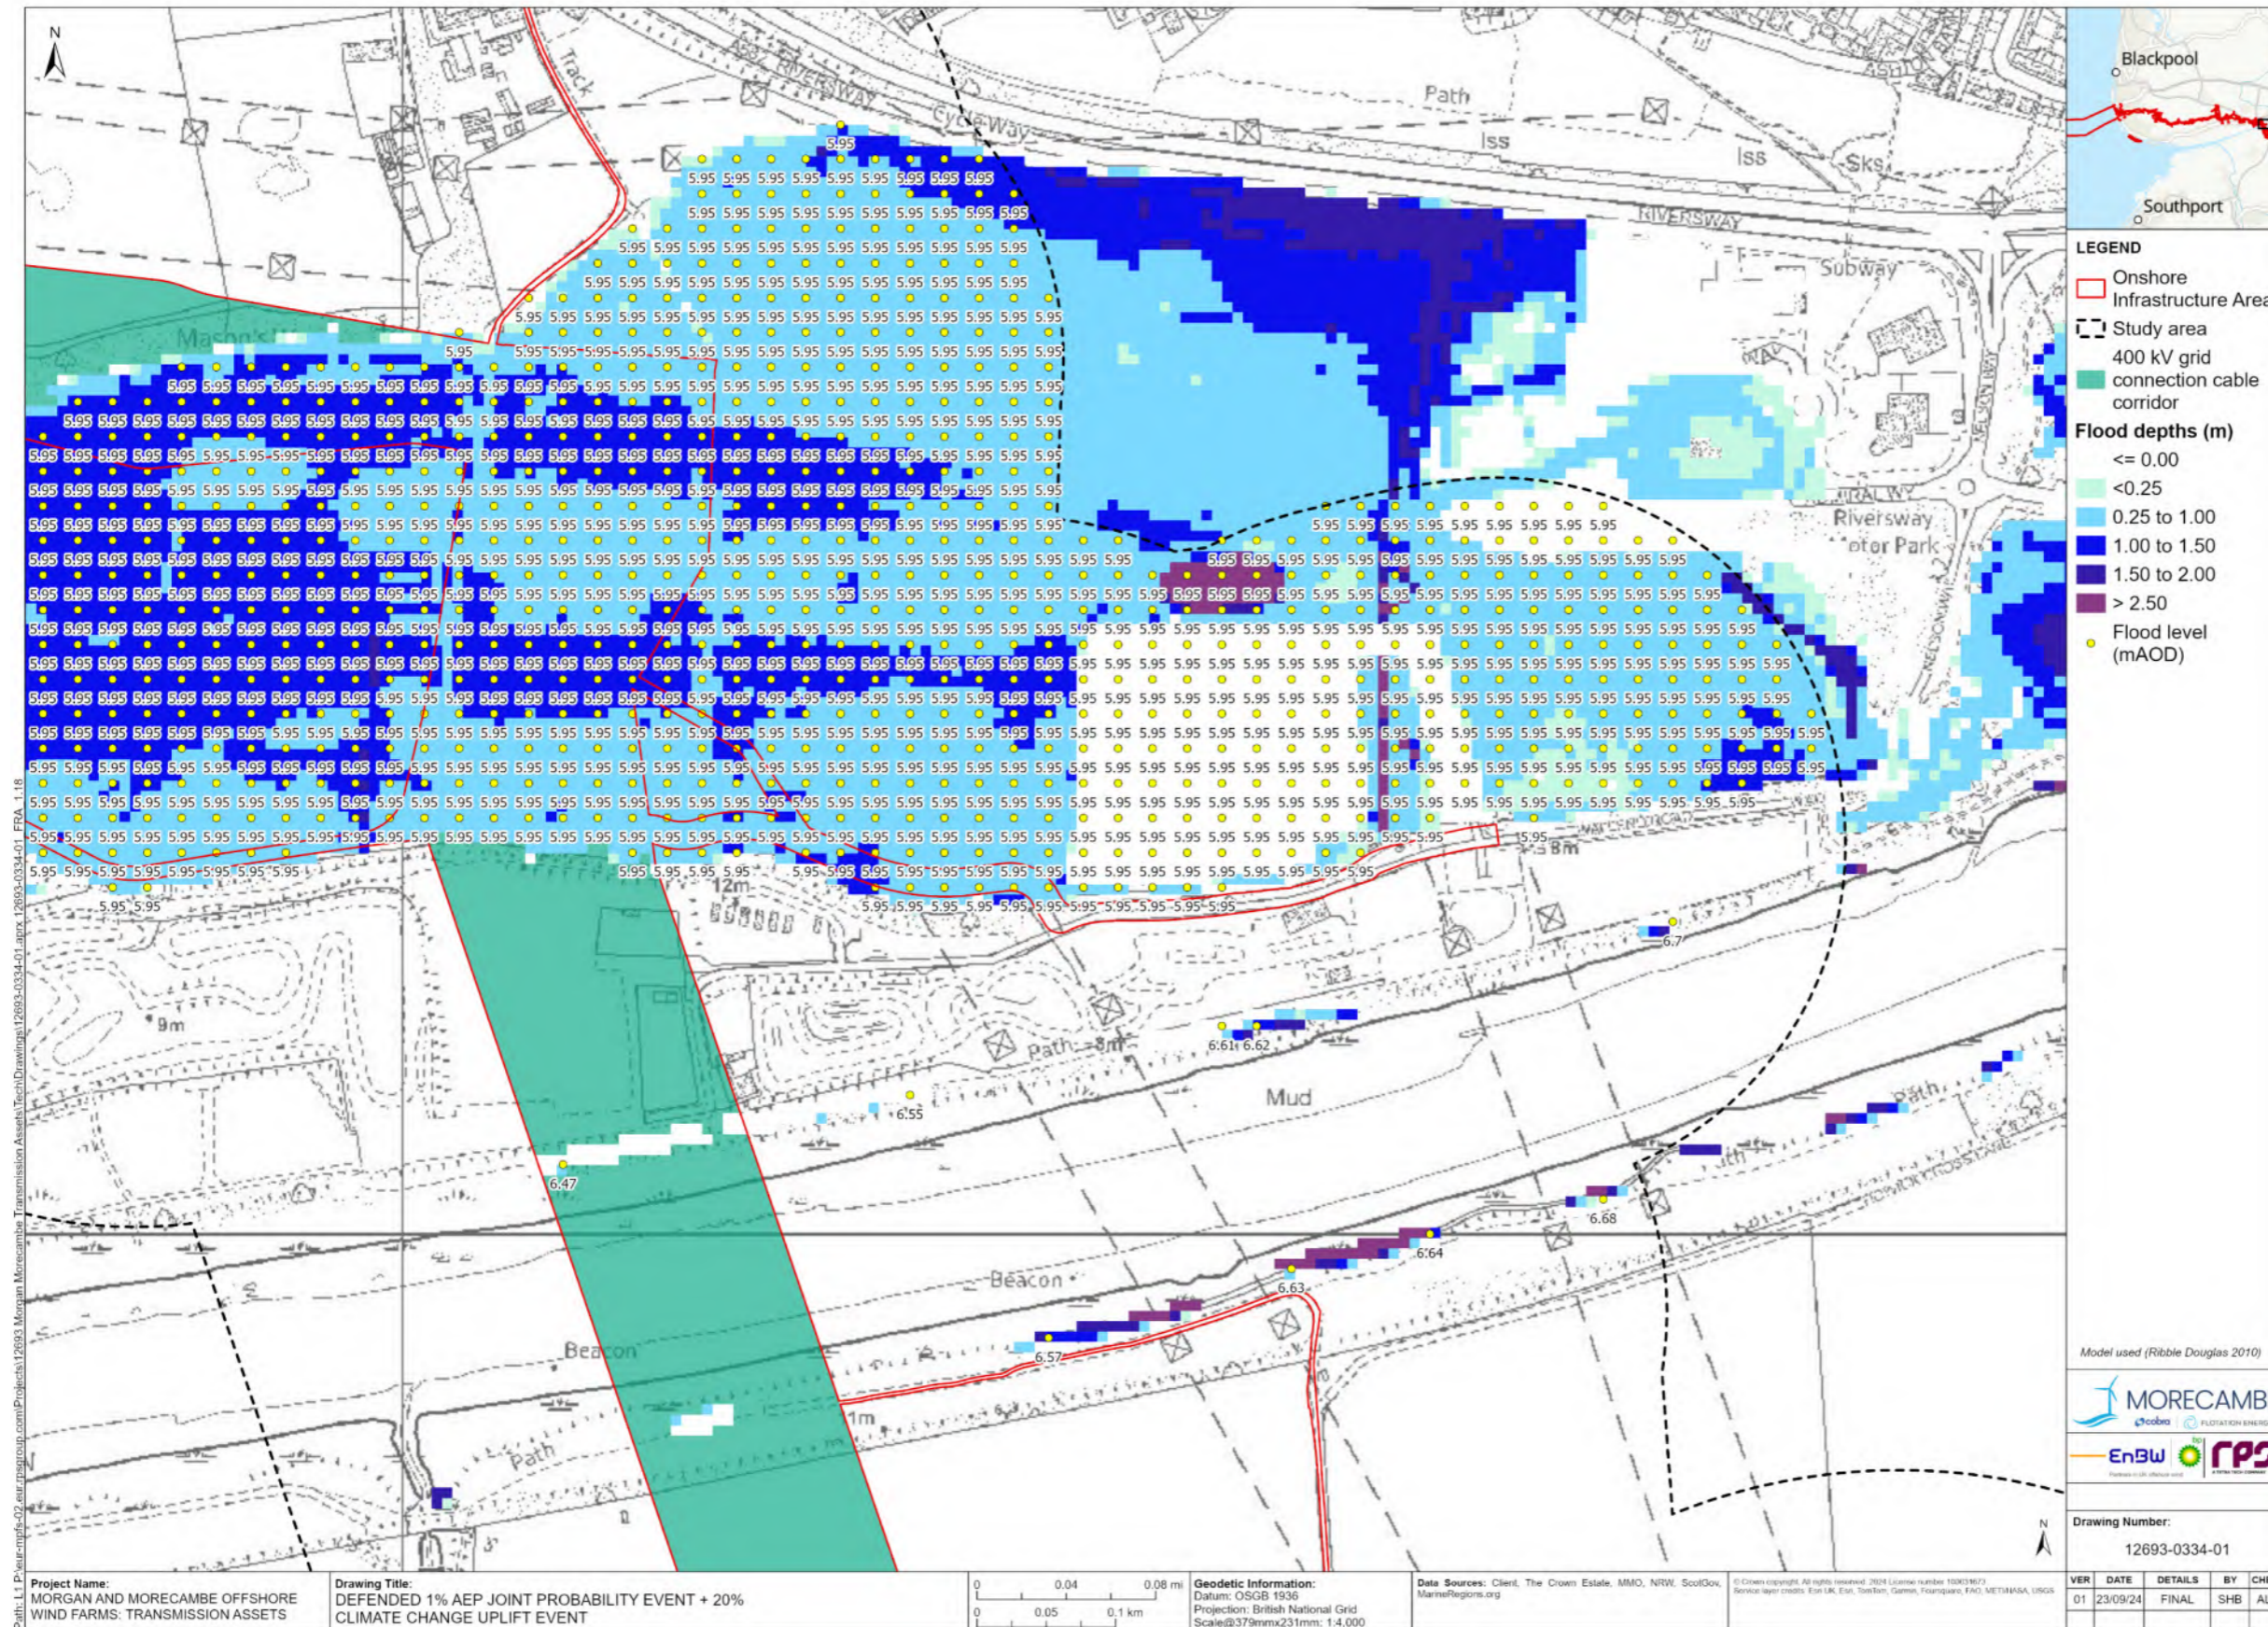


Figure 1.17a: Undefended 1% AEP fluvial event plus 20% climate change uplift







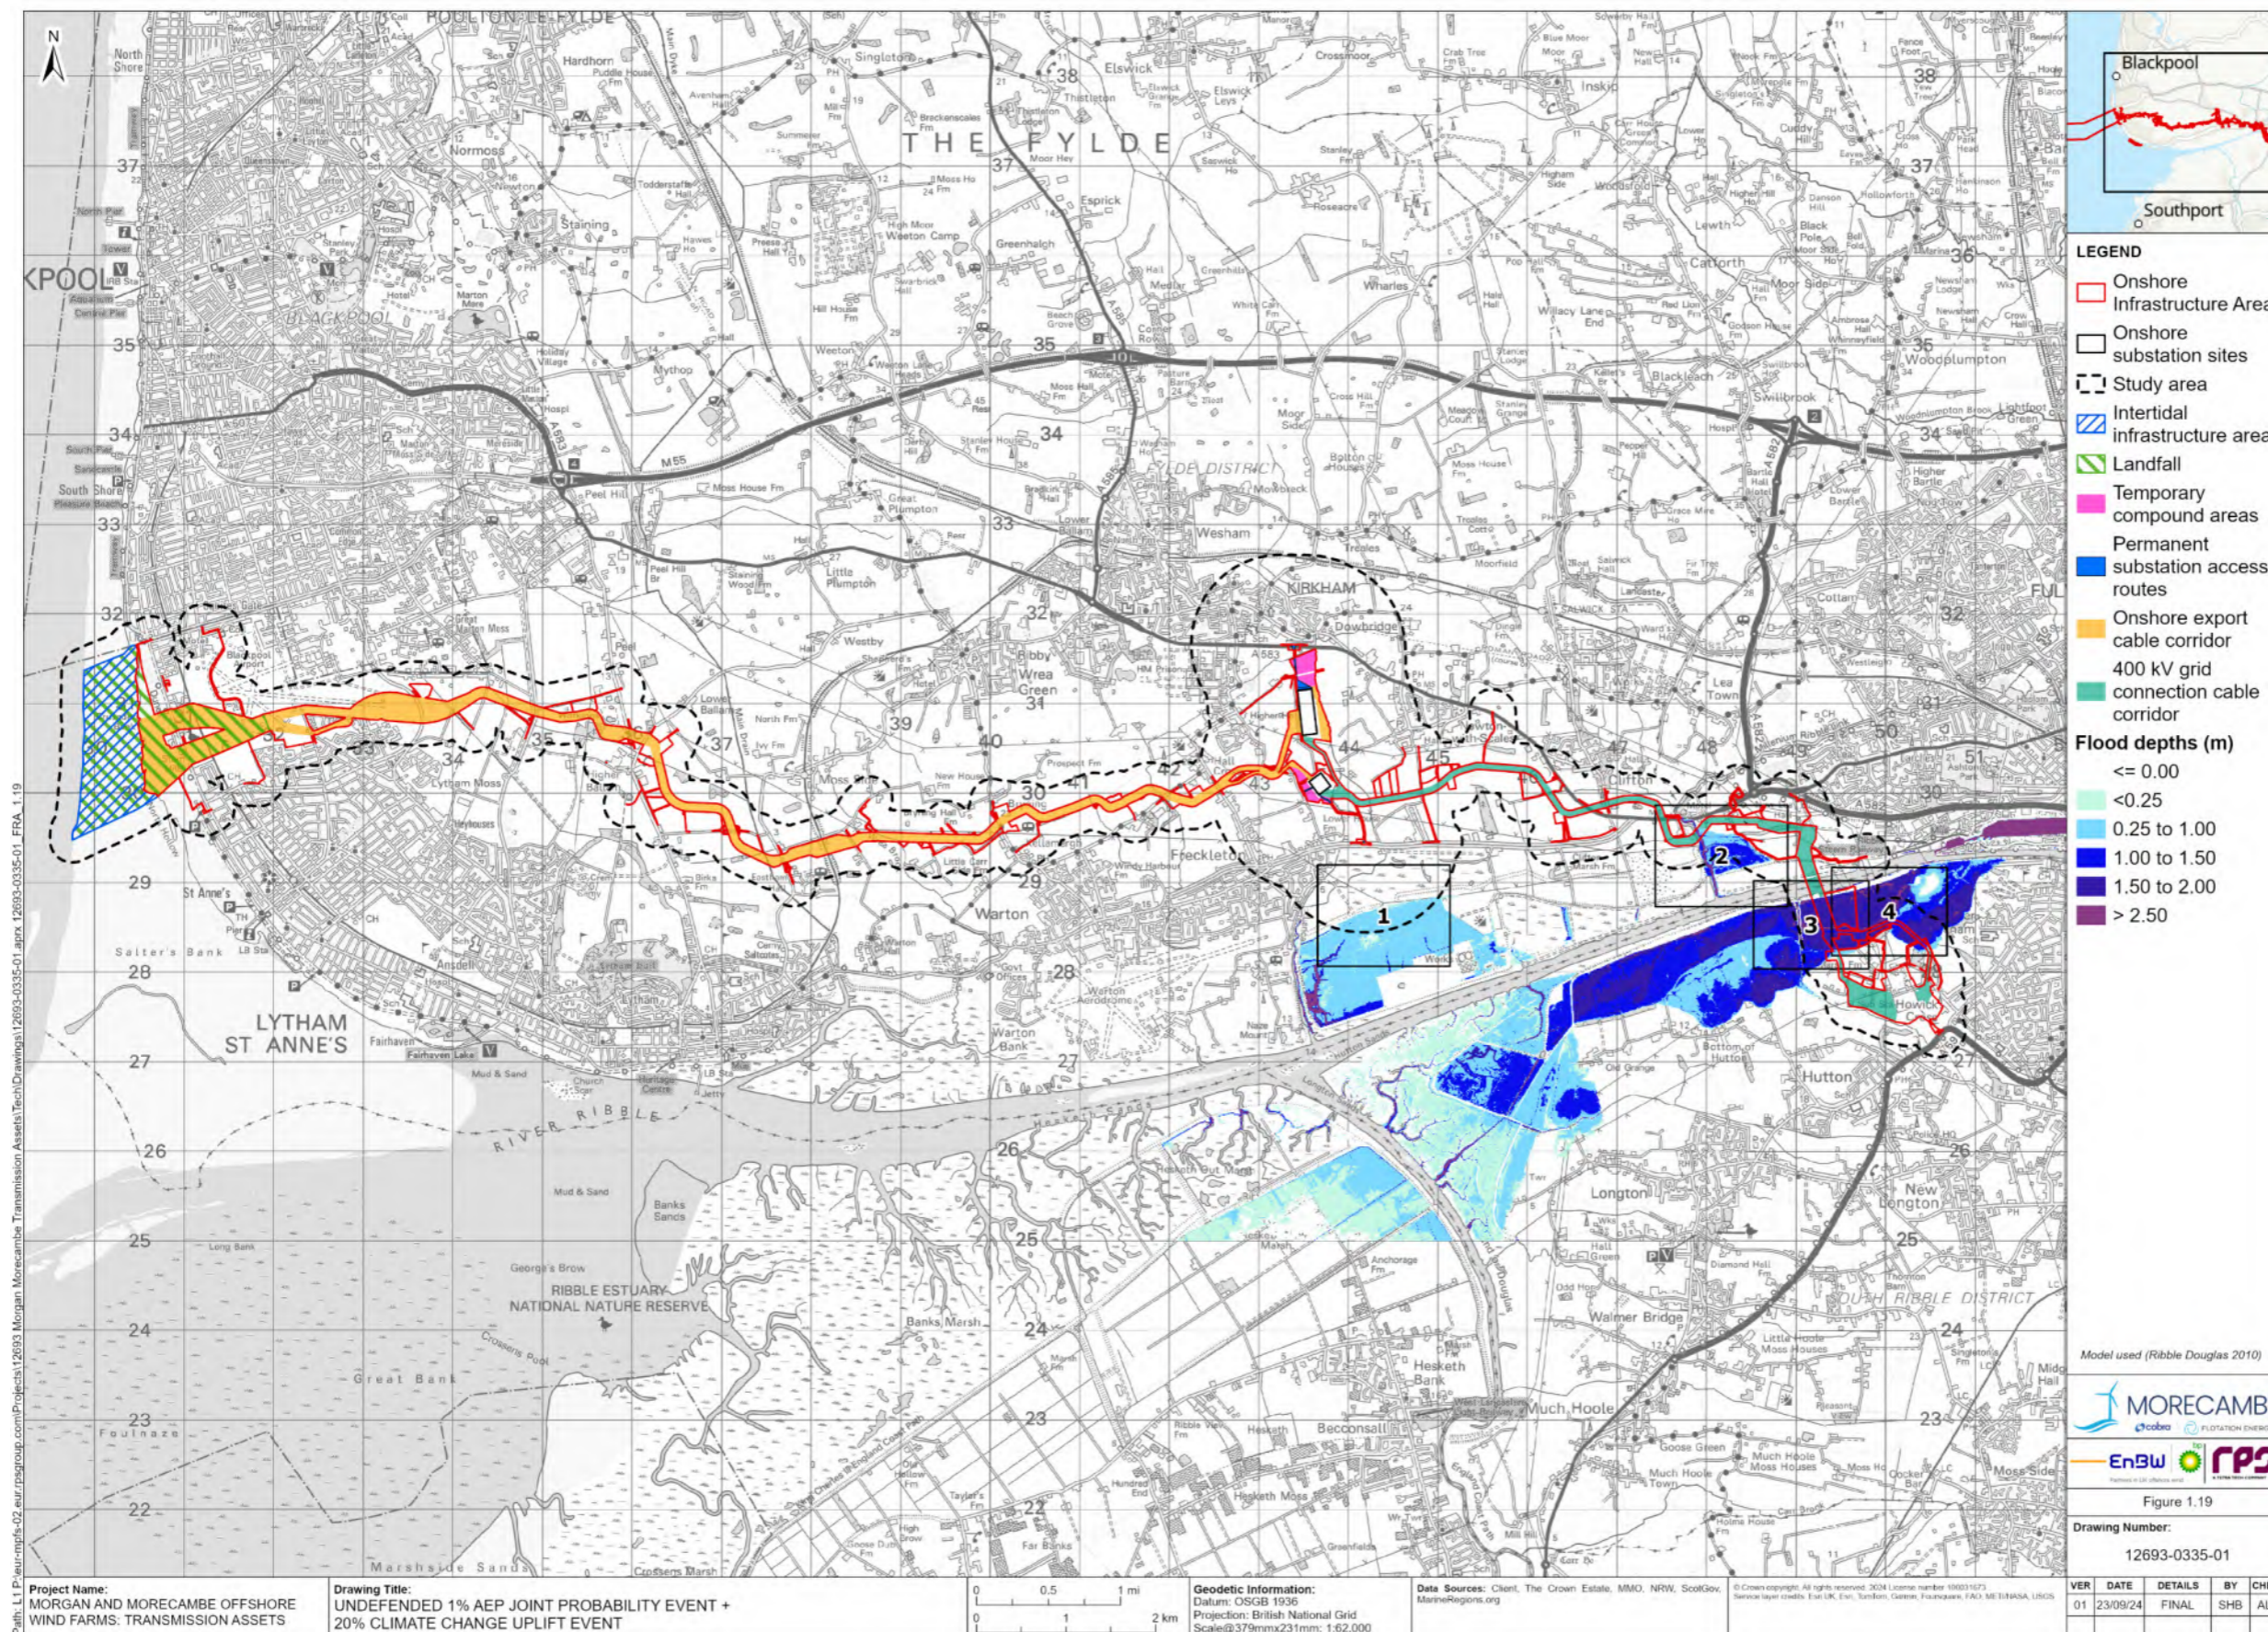


Figure 1.19a: Undefended 1% AEP joint probability event plus 20% climate change uplift event

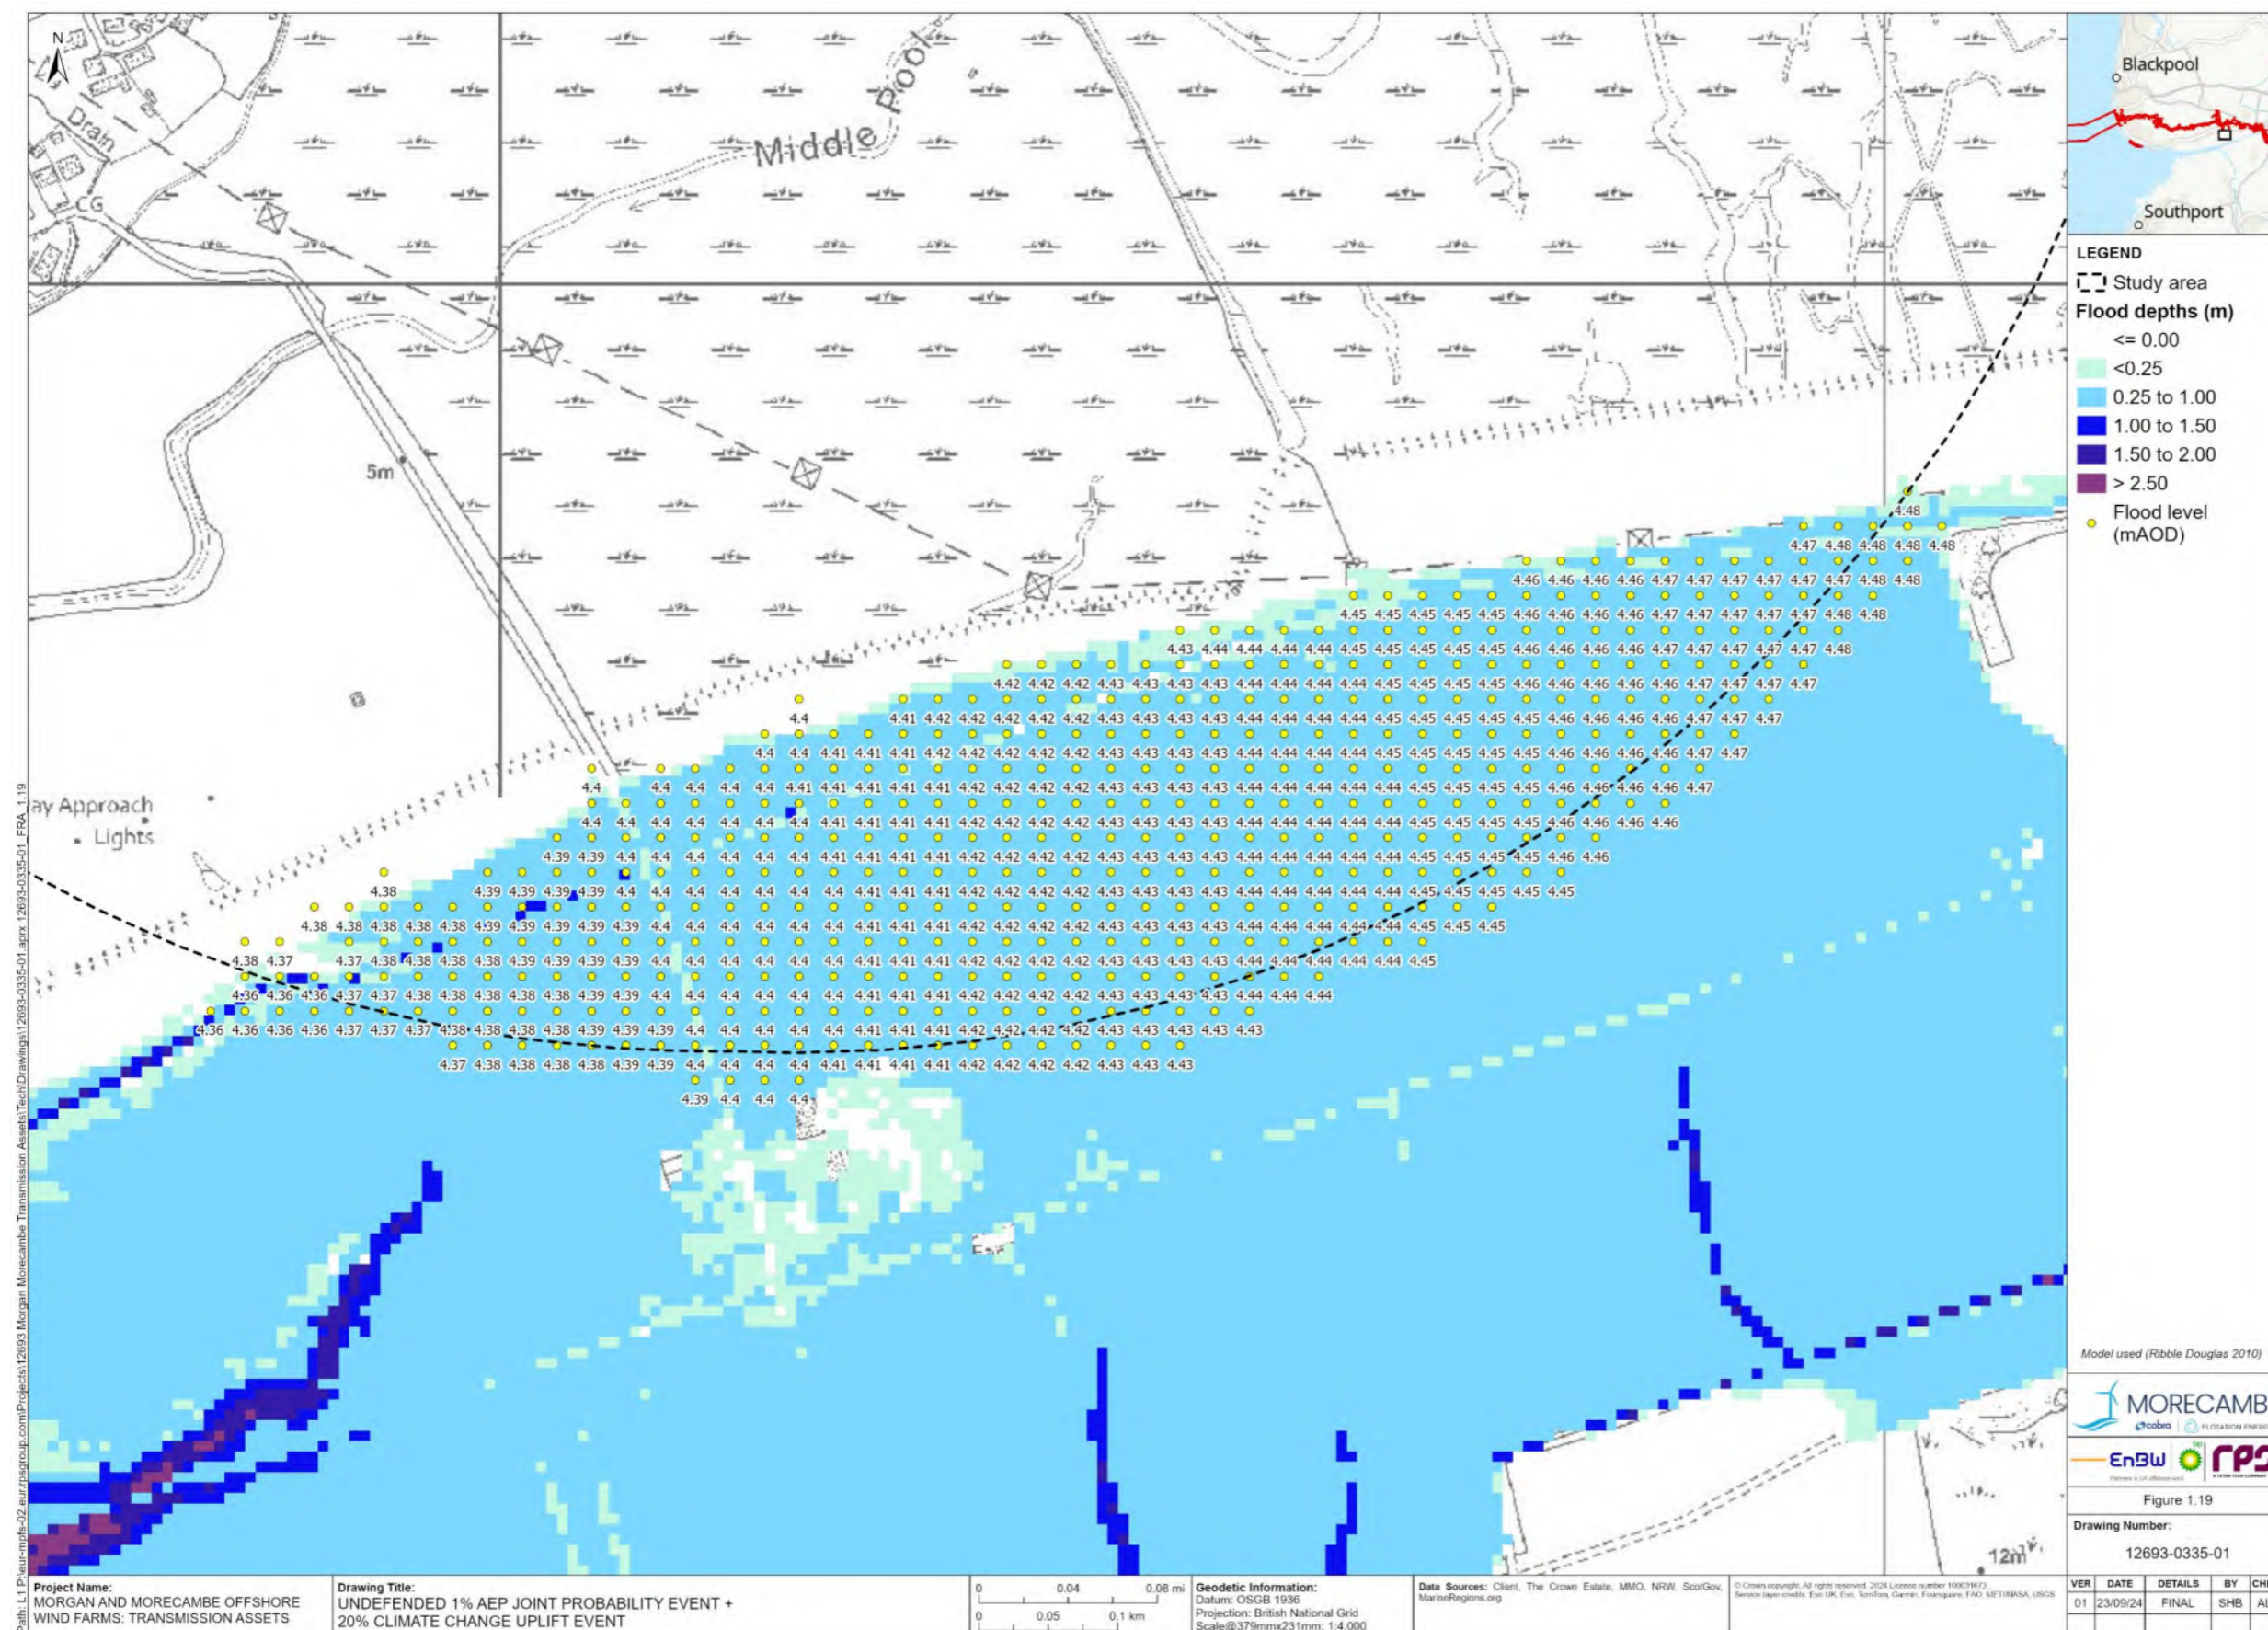


Figure 1.19a: Undefended 1% AEP joint probability event plus 20% climate change uplift event

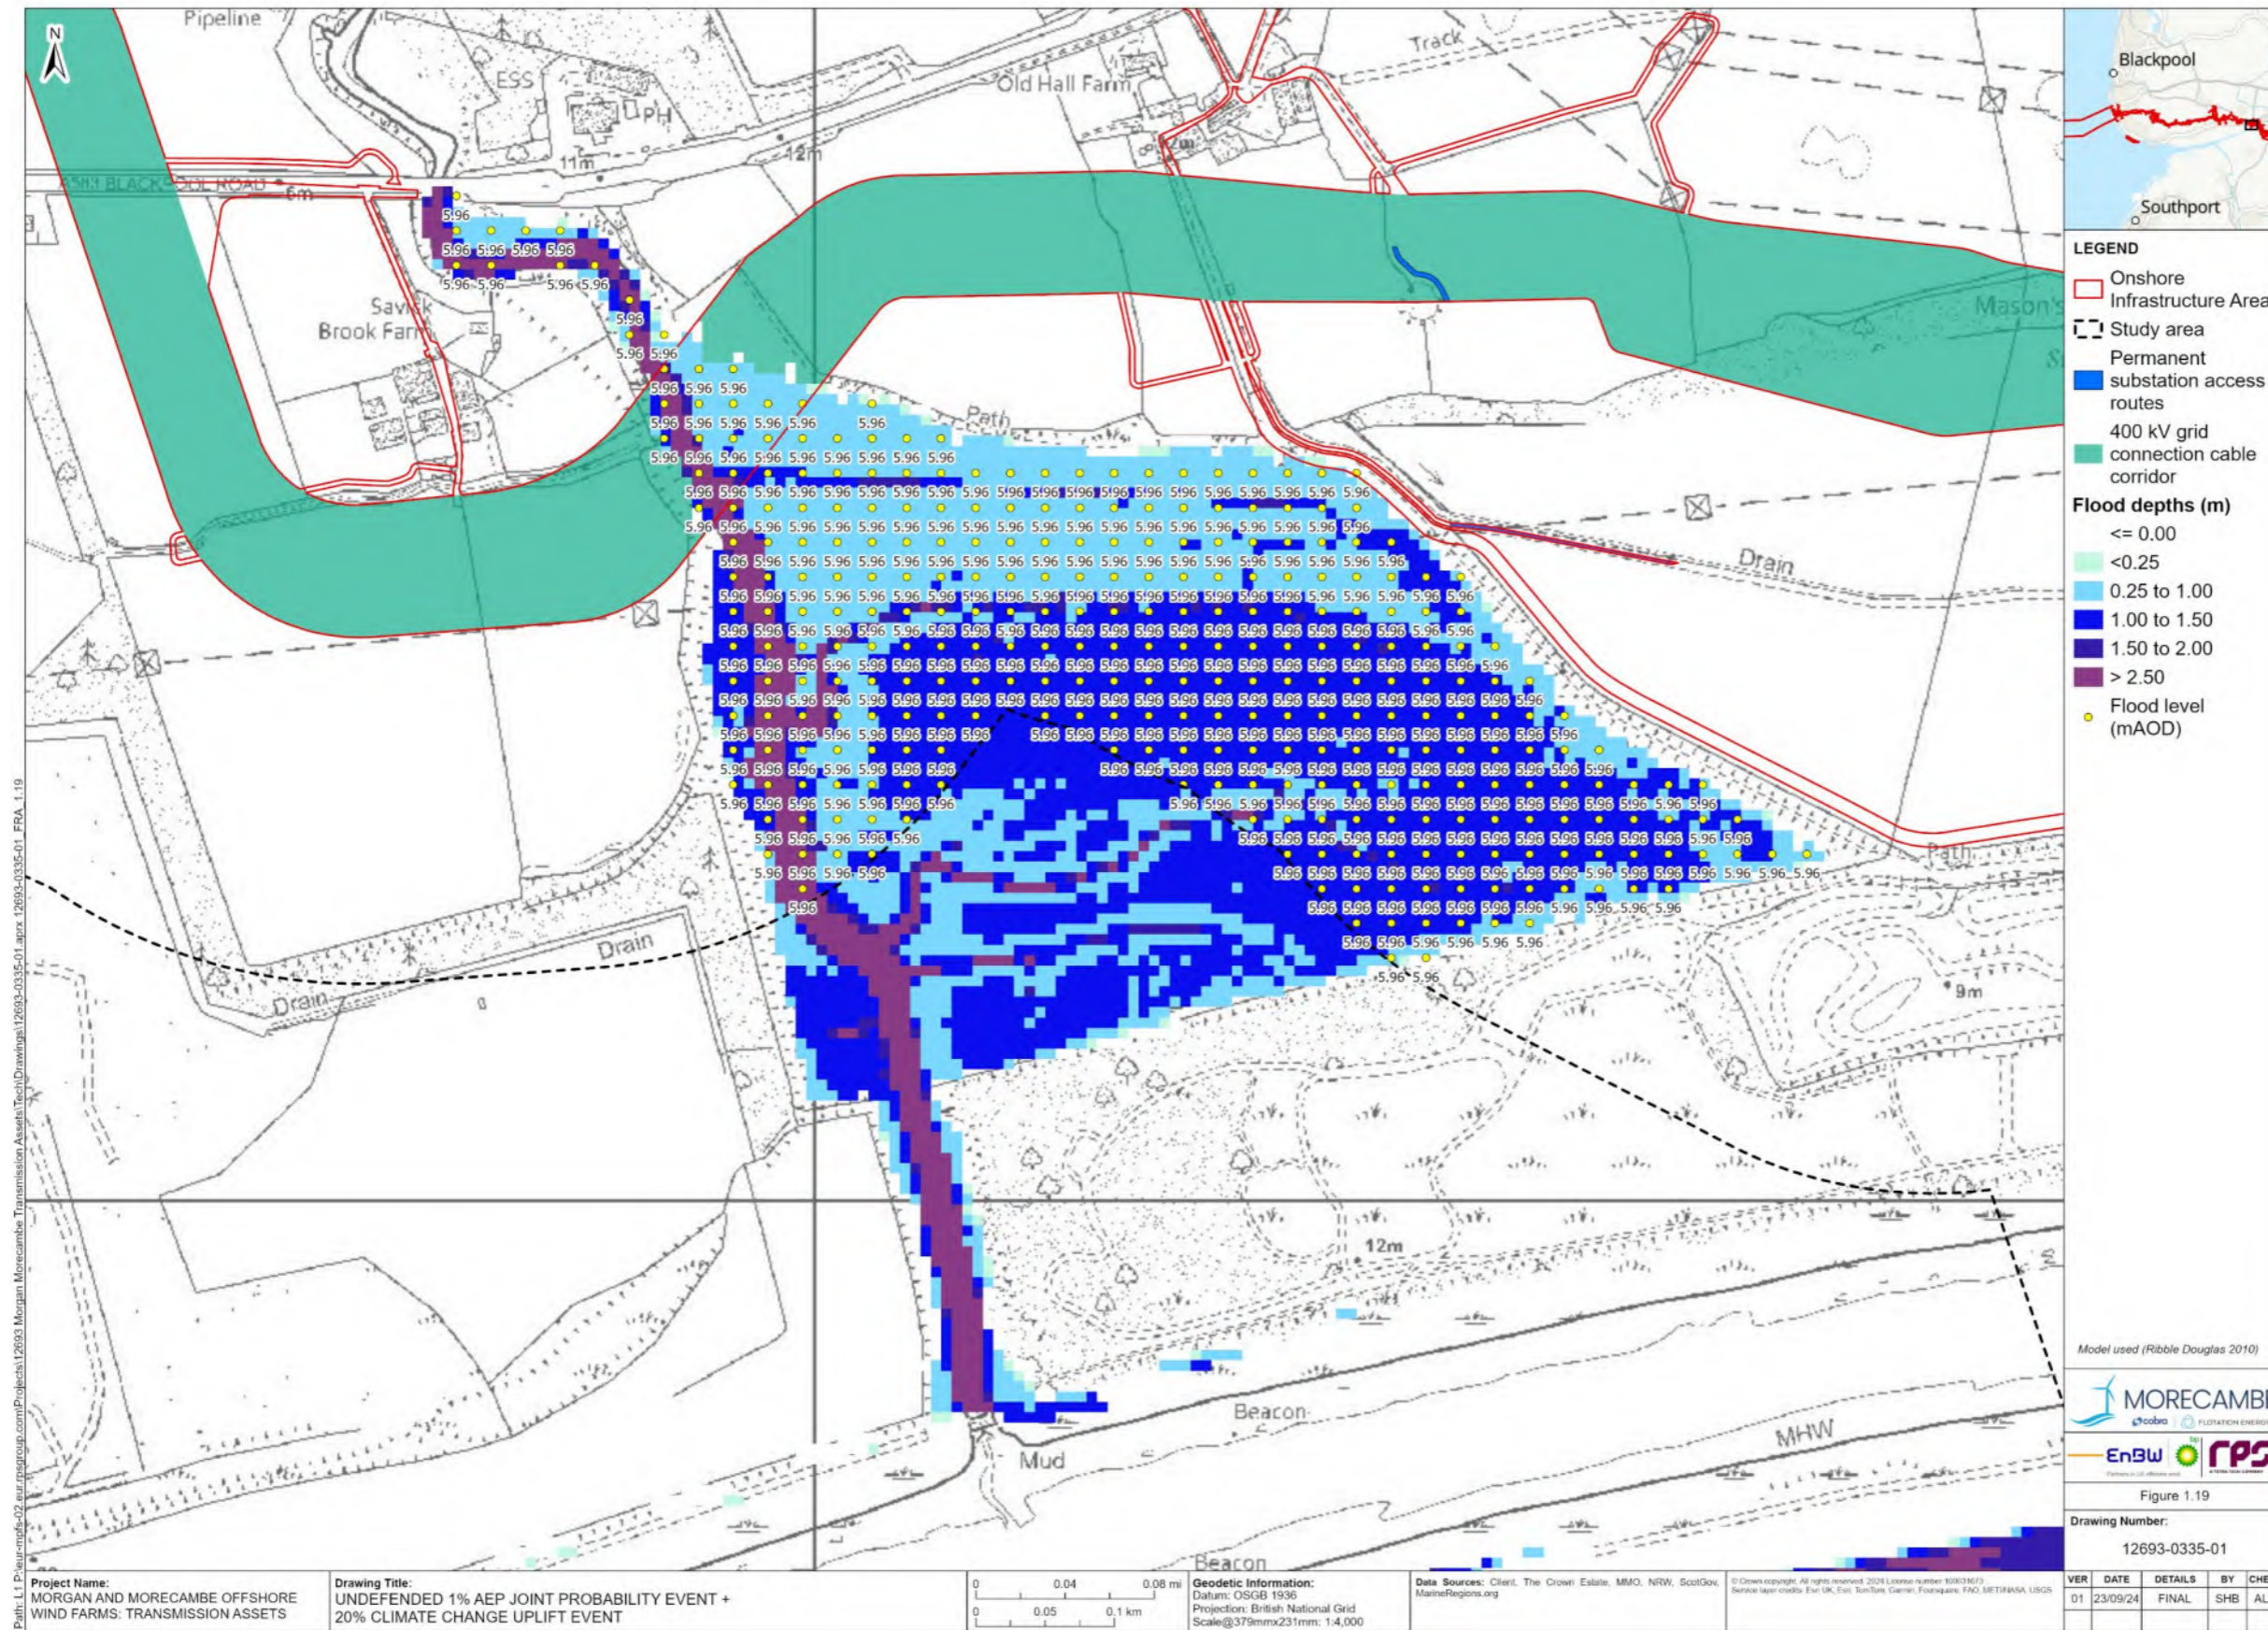


Figure 1.19a: Undefended 1% AEP joint probability event plus 20% climate change uplift event

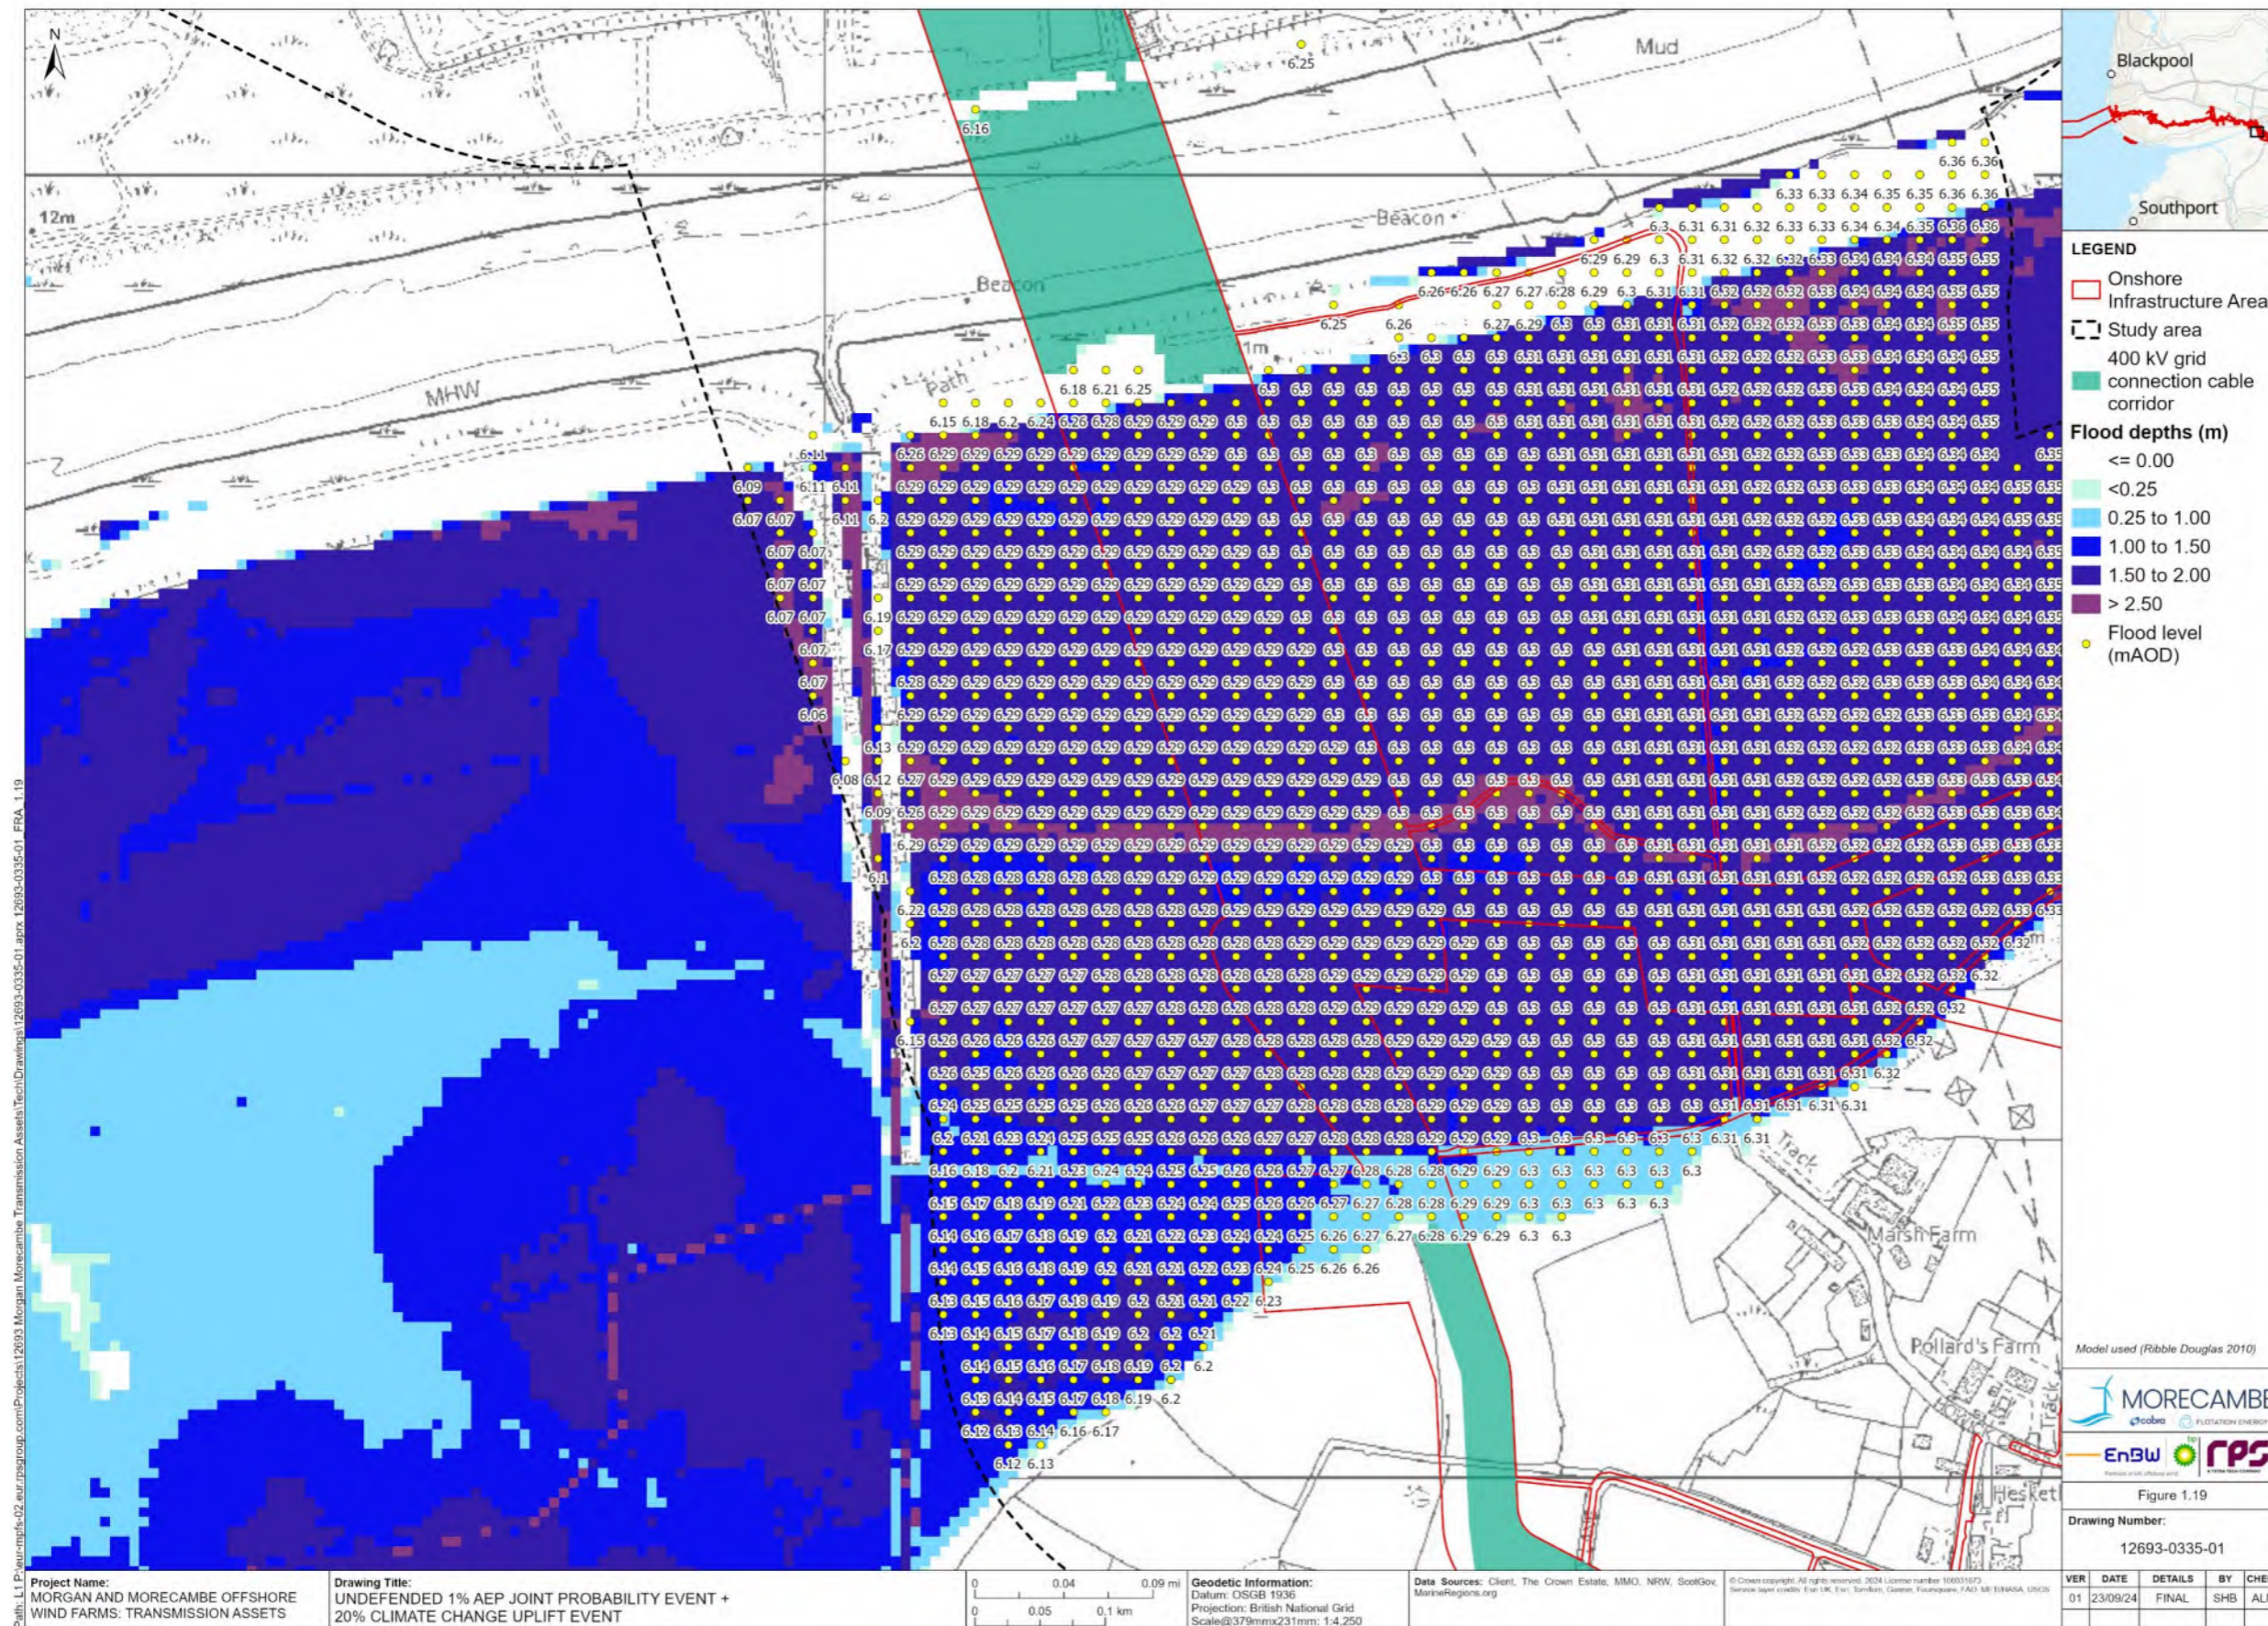


Figure 1.19a: Undefended 1% AEP joint probability event plus 20% climate change uplift event

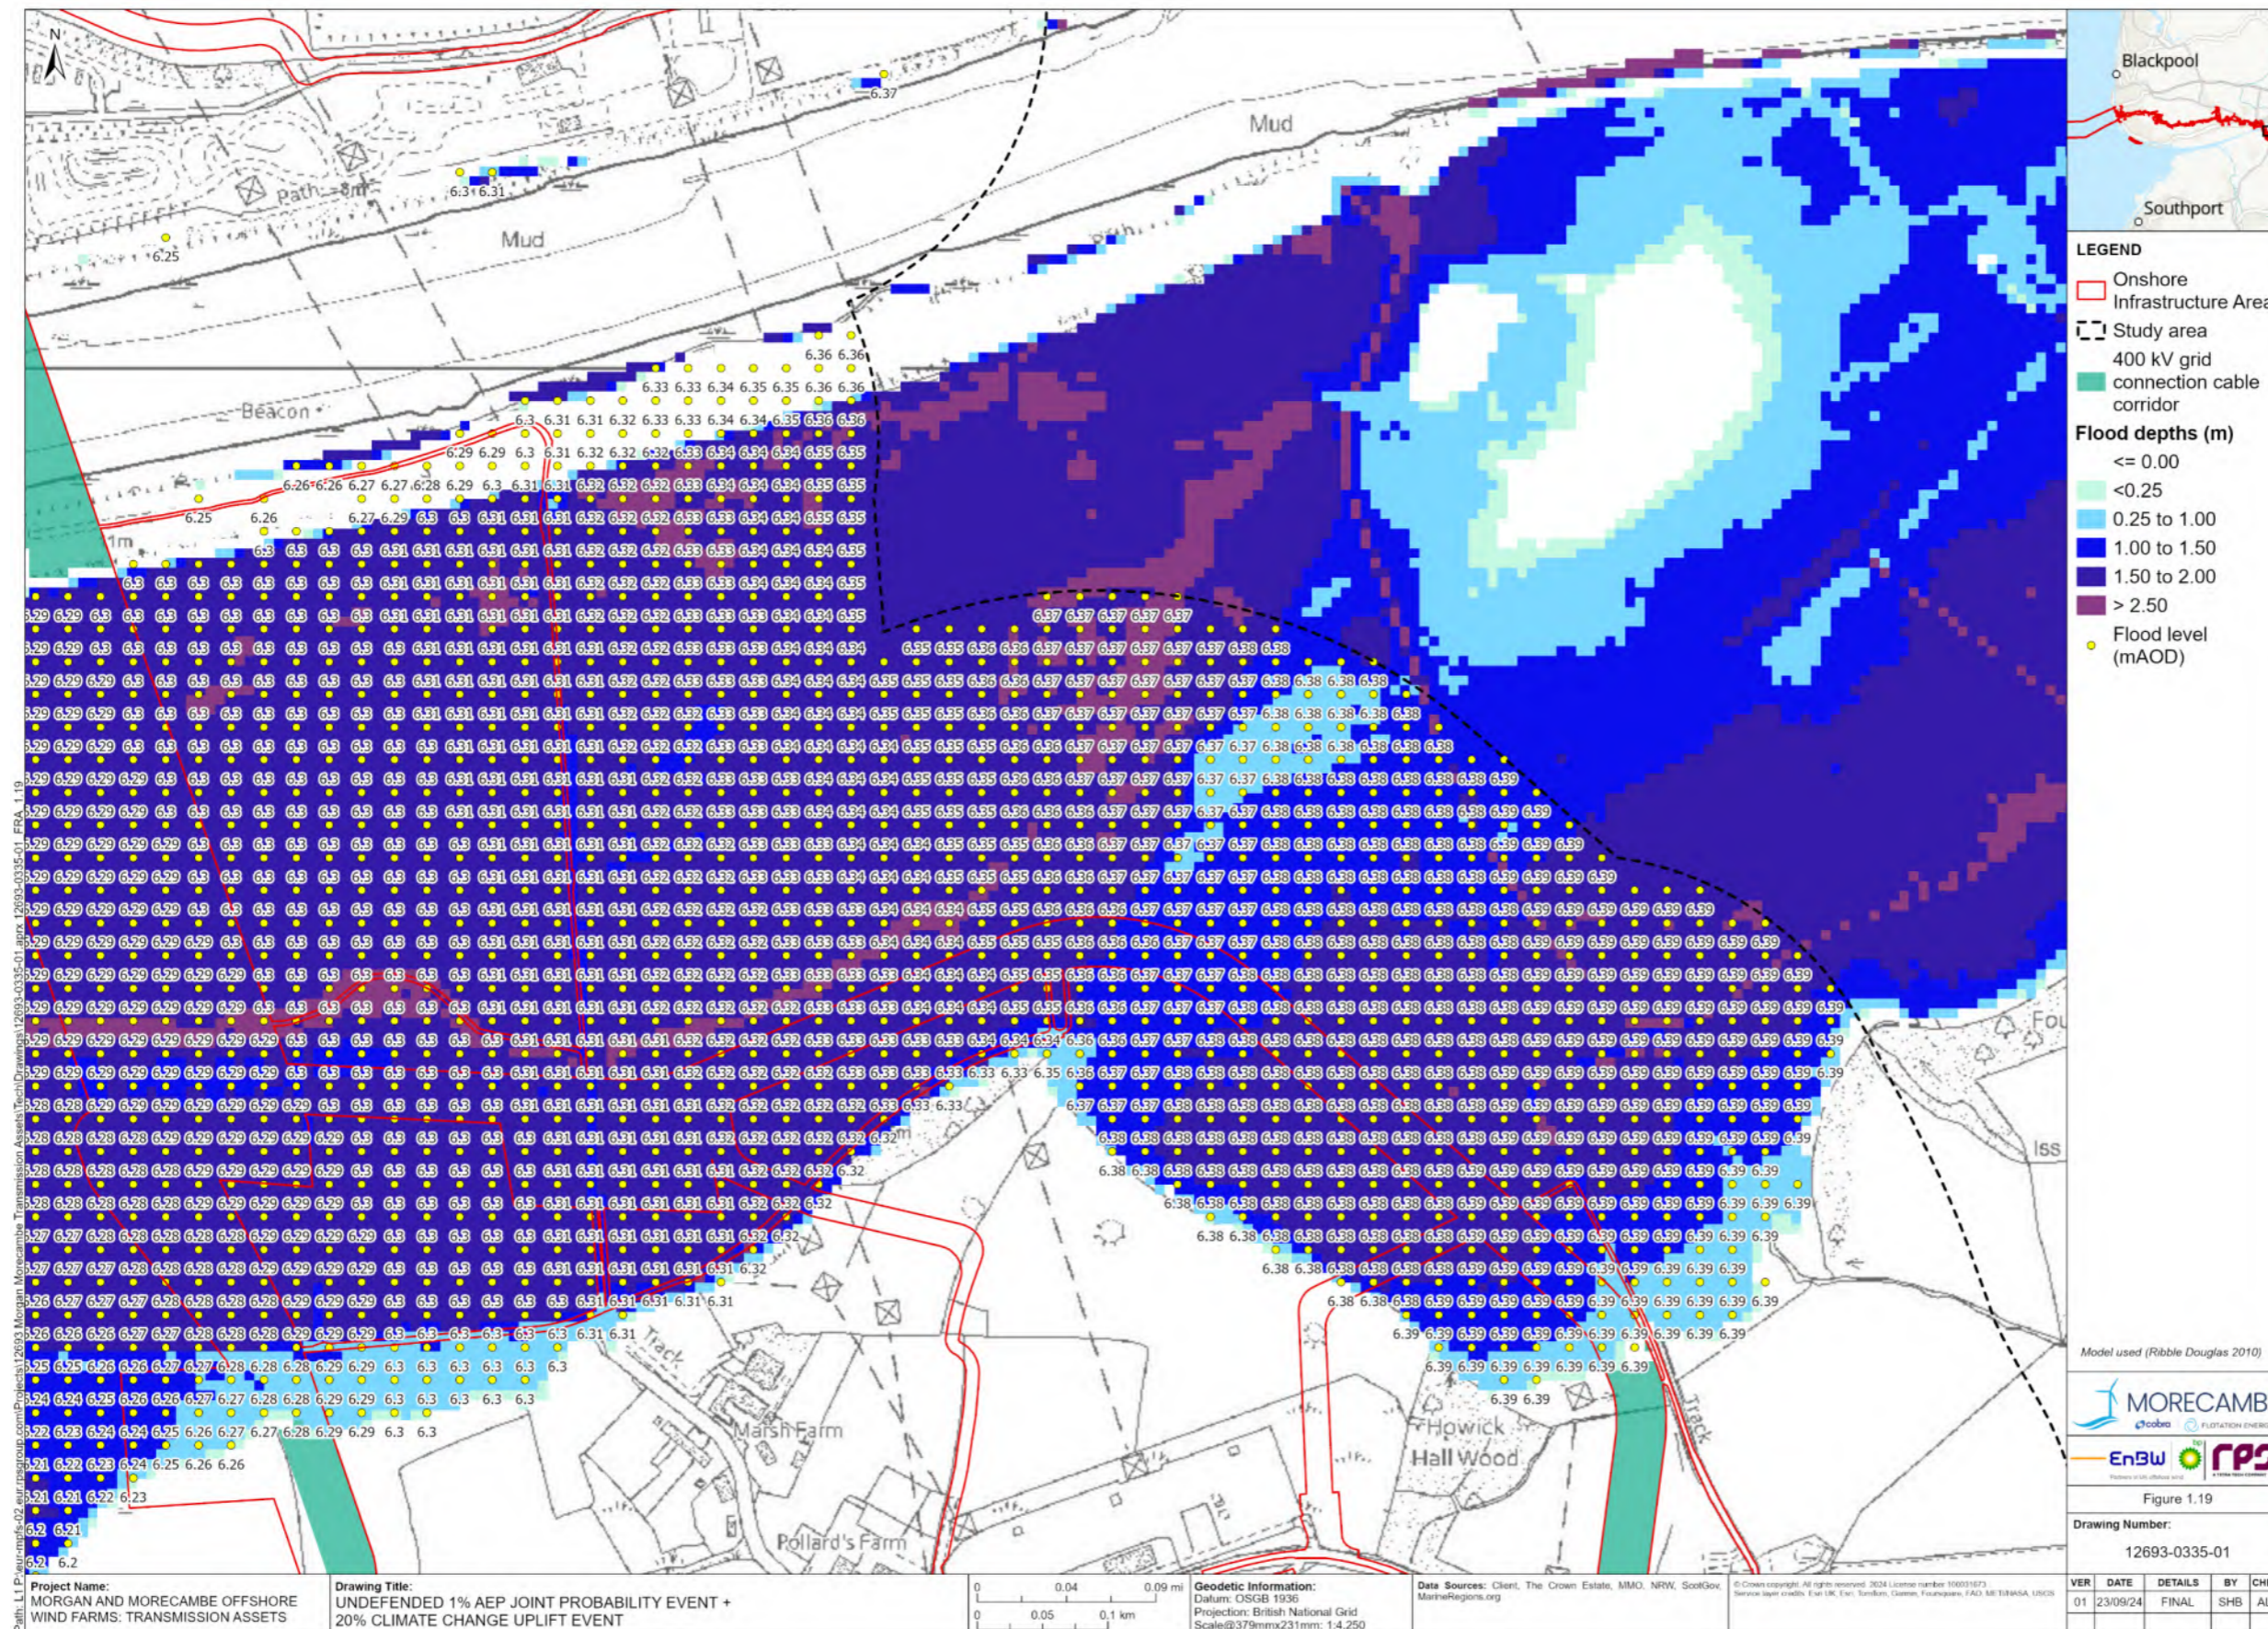


Figure 1.19a: Undefended 1% AEP joint probability event plus 20% climate change uplift event

1.7.5 Groundwater flood risk

- 1.7.5.1 Groundwater flood risk mapping included within the Groundsure Enviro and Geo Insight report shows the western extent of the study area has a 'low' risk of groundwater flooding. The eastern extent of the study area has a 'moderate' to 'high' risk of groundwater flooding, associated with the water table being located closer to the surface within proximity to the Ribble Estuary.
- 1.7.5.2 Mitigation measures as identified in Volume 3, Chapter 1: Geology, hydrogeology and ground conditions of the ES limit the potential impact from this source. Any ingress of groundwater during excavation and trenching will be managed appropriately using dewatering as outlined in Volume 1, Chapter 3: Project description. With the mitigation, the overall risk of flooding from groundwater has been assessed to be very low.

Strategic Flood Risk Assessment Data

The Fylde Coast Authorities Strategic Flood Risk Assessment (2024)

- 1.7.5.3 Relevant information to groundwater flood risk from the FCA SFRA to the landfall, onshore export cables and 400 kV grid connection cables has been extracted and included as follows.

- Within the Blackpool Council area, the Environment Agency's 'Areas Susceptible to Groundwater Flooding' map shows considerable variability across Blackpool. The JBA groundwater emergence map shows most of Blackpool is at 'no risk' of groundwater emergence. Groundwater levels are highest in the south of the area, mainly between 0.025m and 0.5m below the ground surface.
- Within the Fylde Council area, the Environment Agency's 'Areas Susceptible to Groundwater Flooding' map shows considerable variability across Fylde. The JBA groundwater emergence map shows large parts of Fylde are at 'no risk' of groundwater emergence. Groundwater levels are highest in the southwest of the area, across Lytham and St Annes, where they are mainly within 0.5m of the ground surface.

Central Lancashire Strategic Flood Risk Assessment (2007)

- 1.7.5.3 1.7.5.4 The CL SFRA reported occurrences of groundwater flooding from hard rock aquifers or superficial deposits in the north west Environment Agency region.

Mitigation measures (commitments)

- 1.7.5.4 1.7.5.5 Mitigation measures (commitments) presented below within **Table 1.39** are proposed to manage flood risk and vulnerability to site workers during the construction and decommissioning phase. No commitments relating to groundwater flooding are required during the operation and maintenance phase. Commitments are also presented within **Section 1.8, Table 1.44**. Commitments are to be secured through requirements of the DCO.

Table 1.39: Summary of CoT for groundwater flood risk

CoT	Summary	Reason	How CoT is to be secured
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	To implement construction phase drainage to control runoff during this phase of the Transmission Assets.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT35	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP will include measures to maintain and address: <ul style="list-style-type: none"> • [...] flood protection and control measures; • -water environment and drainage; and • pollution prevention [...] 	To implement control measures in regards to fluvial and tidal flooding, including: <ul style="list-style-type: none"> • Measures to prevent a reduction in the capacity of the fluvial floodplain which can increase flood risk downstream; • Measures regarding dewatering; Measures regarding restricting the placement of stockpiling, storage of fuels and chemicals and refuelling to Flood Zone 1 (where practical) and at least 8 m from ordinary watercourses and Main Rivers and 16m from tidal Main Rivers to reduce vulnerability to flood risk;	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT36	Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the latest relevant available guidance.	To manage flood risk during decommissioning	DCO Schedules 2A and 2B, Requirement 22 (Onshore decommissioning)

CoT	Summary	Reason	How CoT is to be secured
CoT41	Where the onshore export cable corridor or 400 kV grid connection cable corridor crosses sites of particular sensitivity (e.g. embanked Environment Agency surface watercourses, Sites of Special Scientific Interest or groundwater inner Source Protection Zones) hydrogeological risk assessment(s) will be undertaken to inform a site-specific crossing method statement(s) where required. These will be agreed with the relevant stakeholders prior to construction.	To inform groundwater flood risk	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

Summary

~~1.7.5.5~~ 1.7.5.6 With the implementation of commitments listed within **Table 1.39** the overall risk of flooding from groundwater is assessed to be very low.

1.7.6 Surface water flood risk

1.7.6.1 Surface water flooding occurs when the amount of rainfall exceeds the drainage or infiltration capacity of the surface it falls upon. Surface water runoff can coalesce into surface water flow pathways as it flows towards a drainage system or watercourse. Surface water can also pond within areas of inadequate drainage.

Environment Agency Long Term Flood Risk Mapping

1.7.6.2 The Environment Agency Long Term Flood Risk mapping includes Risk of Flooding from Surface Water mapping which was updated in January 2025 and is~~The Environment Agency long term flood risk from surface water mapping is~~ presented within Figure 1.20. Mapping and~~shows~~ localised areas along the study area as having 'low' to 'high' ~~risk~~ chance of flooding from surface water and ordinary watercourses. Flooding is predominantly associated overland flow pathways flowing towards ordinary watercourses and out-of-bank flows from ordinary watercourses which form tributaries to main rivers.

Strategic Flood Risk Assessment ~~Data~~

The Fylde Coast Authorities Strategic Flood Risk Assessment (2024)

1.7.6.3 Relevant information to fluvial and tidal flood risk from the FCA SFRA has been extracted and included as follows.

- Within the Blackpool Council area, surface water flood risk is very localised but is generally shown to follow the contours of the roads throughout the settlement, but with several areas of ponding affecting

properties across the area. Flood risk is widespread, but key large areas of ponding affect Anchorholme in the north, South Shore, Hawes Side, Marton Moss, and Squires Gate in the south.

- Within the Fylde Council area, surface water flood risk is very localised but generally follows the main watercourses through the area and follows the roads through the settlements. There is considerable surface water flood risk across both St Anne's and Lytham in the west of the area, but all settlements across the area are affected by surface water risk.
- FCA details the following historical flood events recorded by councils:
 - Winter 1958, heavy rainfall caused flooding at Mere Road, Blackpool
 - At Carr Lane to the West of Warton to the north of Little Carr Side Farm and at the junction with West End Lane
 - Lytham Road and Bank Lane to the south west of Warton

Strategic Flood Risk Assessment (Fylde Borough Council, 2011)

~~1.7.6.3 Relevant information from the Fylde Council SFRA has been extracted and included as follows:~~

- ~~Localised flooding hotspots from surface water flooding are identified within Little Eccleston, Elswick, Freckleton and the eastern edge of Blackpool.~~

~~1.7.6.4 No in-depth mapping was available as a part of the Fylde Council SFRA.~~

Blackpool Council Strategic Flood Risk Assessment (2014)

~~1.7.6.5 Relevant information from the Blackpool Council SFRA has been extracted and included as follows:~~

- ~~There are certain areas of the Blackpool Council area, that are at risk of surface water flooding from and during exceptional rainfall events. These areas include:~~
 - ~~Anchorholme;~~
 - ~~Marton Mere Catchment Station;~~
 - ~~Staining North Catchment; and~~
 - ~~Marton Moss; and~~
 - ~~Any area of the borough which is susceptible to inundation from a failure of the Public Sewerage Network/Highway Drainage System, or domestic or watercourse systems.~~

Mitigation measures (commitments)

~~1.7.6.6~~ 1.7.6.4 Mitigation measures (commitments) presented below within **Table 1.40** are proposed to manage flood risk and vulnerability to site workers during the construction and decommissioning phase. No commitments relating to surface water flooding are required during the operation and maintenance phase. Commitments are also presented

within **Section 1.8, Table 1.44**. Commitments are to be secured through requirements of the DCO.

Table 1.40: Summary of CoT for surface water flood risk for landfall, the onshore export corridor and 400 kV grid connection cable corridor

CoT	Summary	Reason	How CoT is to be secured
CoT08	Post-construction, the working area will be reinstated to pre-existing condition as far as reasonably practical in line with the DEFRA Construction Code of Practice for the Sustainable Use of Soils on Construction Sites (PB13298), Institute of Quarrying (IQ) Good Practice Guide for Handling Soils in Mineral Workings (IQ, 2021) and British Society of Soil Science (BSSS) Working with Soil Guidance Note on Benefitting from Soil Management in Development and Construction (BSSS, 2022).	To ensure working areas are reinstated to pre-existing conditions to not increase flood risk from surface water runoff as a result of increased impermeable areas	DCO Schedules 2A & 2B, Requirement 18 (Restoration of land temporarily used for construction); DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	To implement construction phase drainage to control runoff during this phase of the Transmission Assets.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT24	Where practicable, during construction, access routes within the onshore export cable corridor and 400 kV grid connection corridor (i.e. for example, the use of haul roads) will be used, to minimise potential impacts to the local road network.	To not increase impermeable areas associated with haul roads and in turn increase surface water runoff and flood risk from this source	DCO Schedules 2A & 2B, Requirement 9 (Traffic and Transport) Access to Works Plan
CoT27	All temporary compounds will be removed and sites will be reinstated when construction has been completed.	To not increase surface water runoff as a result of greater impermeable areas during the operation and maintenance phase	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice) DCO Schedules 2A & 2B, Requirement 16 (Restoration of land used temporarily for construction)

CoT	Summary	Reason	How CoT is to be secured
CoT35	<p>An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP will include measures to maintain and address:</p> <ul style="list-style-type: none"> • [...] flood protection and control measures; • -water environment and drainage; and • pollution prevention [...] 	<p>To implement control measures in regards to fluvial and tidal flooding, including:</p> <ul style="list-style-type: none"> • Measures to prevent a reduction in the capacity of the fluvial floodplain which can increase flood risk downstream; • Measures regarding dewatering; • Measures regarding restricting the placement of stockpiling, storage of fuels and chemicals and refuelling to Flood Zone 1 (where practical) and at least 8 m from ordinary watercourses and Main Rivers and 16m from tidal Main Rivers to reduce vulnerability to flood risk; 	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)
CoT36	<p>Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the latest relevant available guidance.</p>	To manage flood risk during decommissioning	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)

Summary

~~1.7.6.7~~ 1.7.6.5 Commitments listed in **Table 1.40** above will ensure the landfall and onshore export cable corridor and 400 kV grid connection cable corridor will not be impacted by or cause any adverse effect on surface water flooding during the construction phase. As such, flood risk from this source is assessed to be low.

1.7.7 Reservoir flood risk

1.7.7.1 Reservoir flood maps show where water may go in the unlikely event of a dam or reservoir failure. EA reservoir flood risk mapping is presented within **Figure 1.10** shows that for a dry scenario (defined by the Environment Agency as where river levels are normal), flood water is expected to remain within the channels of the River Ribble and the Savick Brook.

- 1.7.7.2 During a wet scenario (defined by the Environment Agency as when there is also flooding from rivers) a significant portion of the study area is expected to become inundated. Water is shown to extend north and south from the River Ribble and encompass approximately 460 ha of land. There are additional small portions of land around the Main Drain in the west of the study area that are also shown to be affected during the wet scenario.
- 1.7.7.3 Due to the regular inspection and maintenance regime in place on large reservoirs, the likelihood of catastrophic failure and therefore risk of flooding to the site from this source is unlikely to occur.
- 1.7.7.4 Taking into account the above, the overall risk of flooding from a reservoir failure has been assessed to be low.

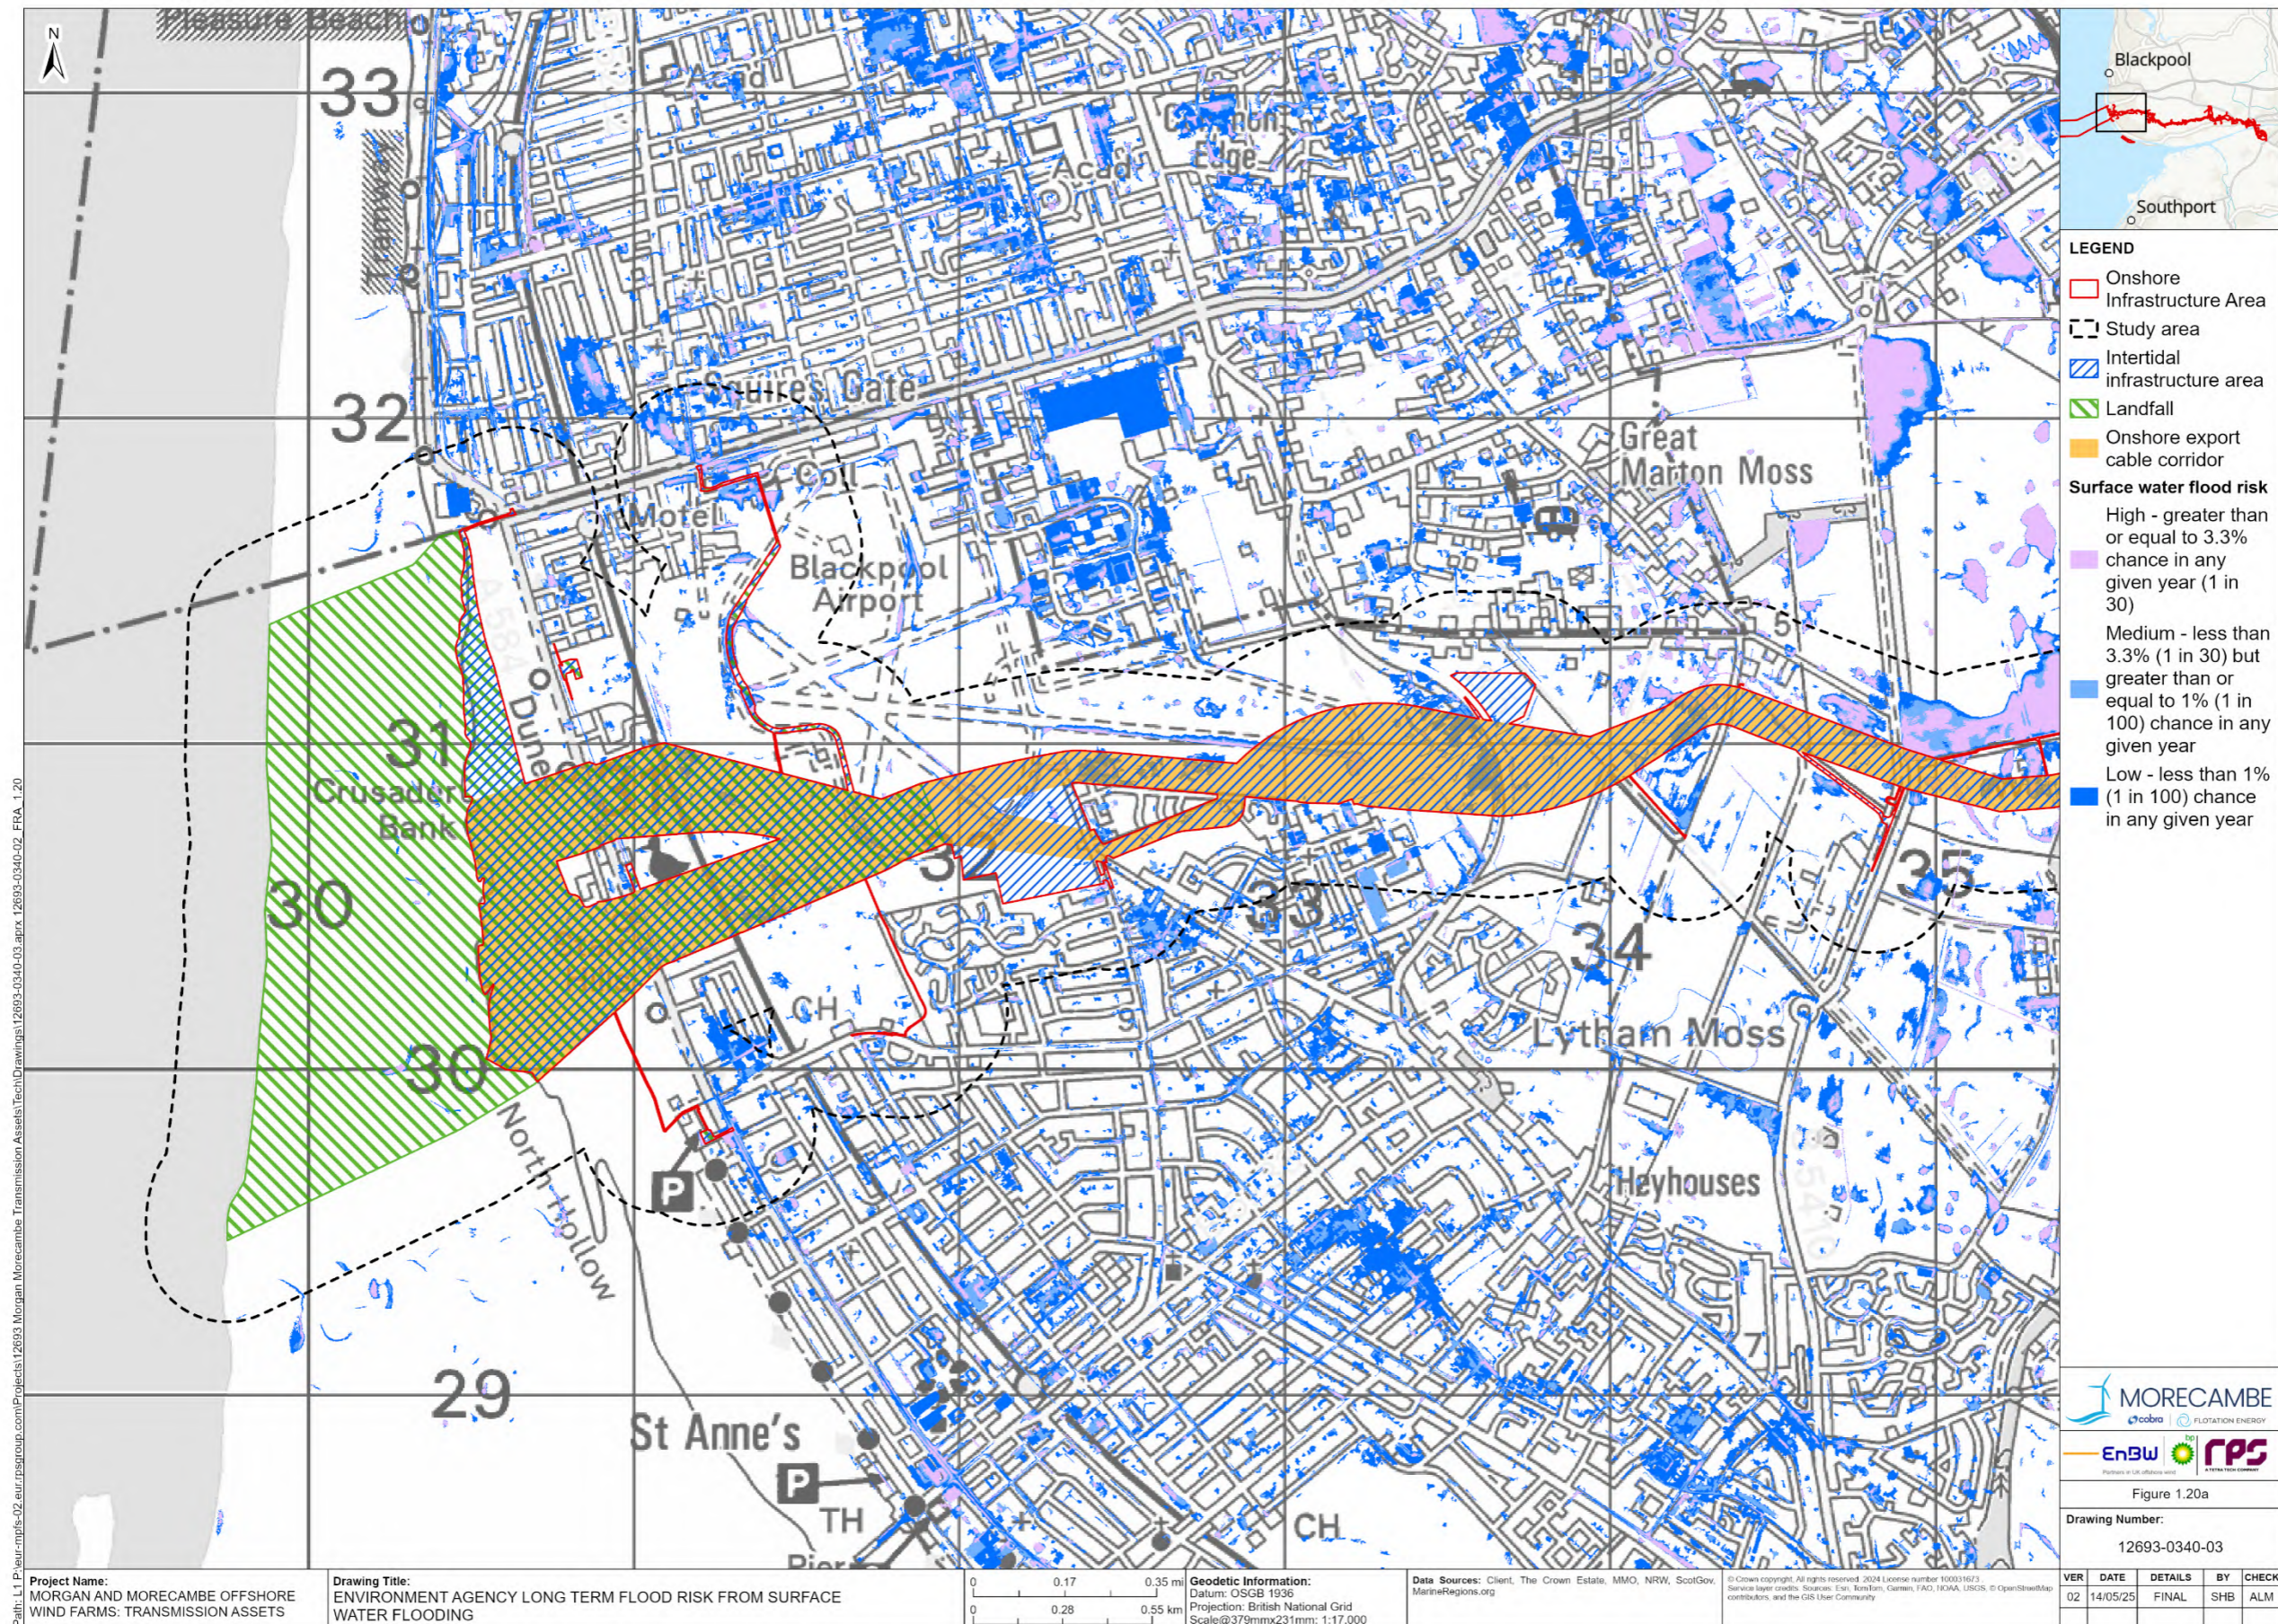


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding

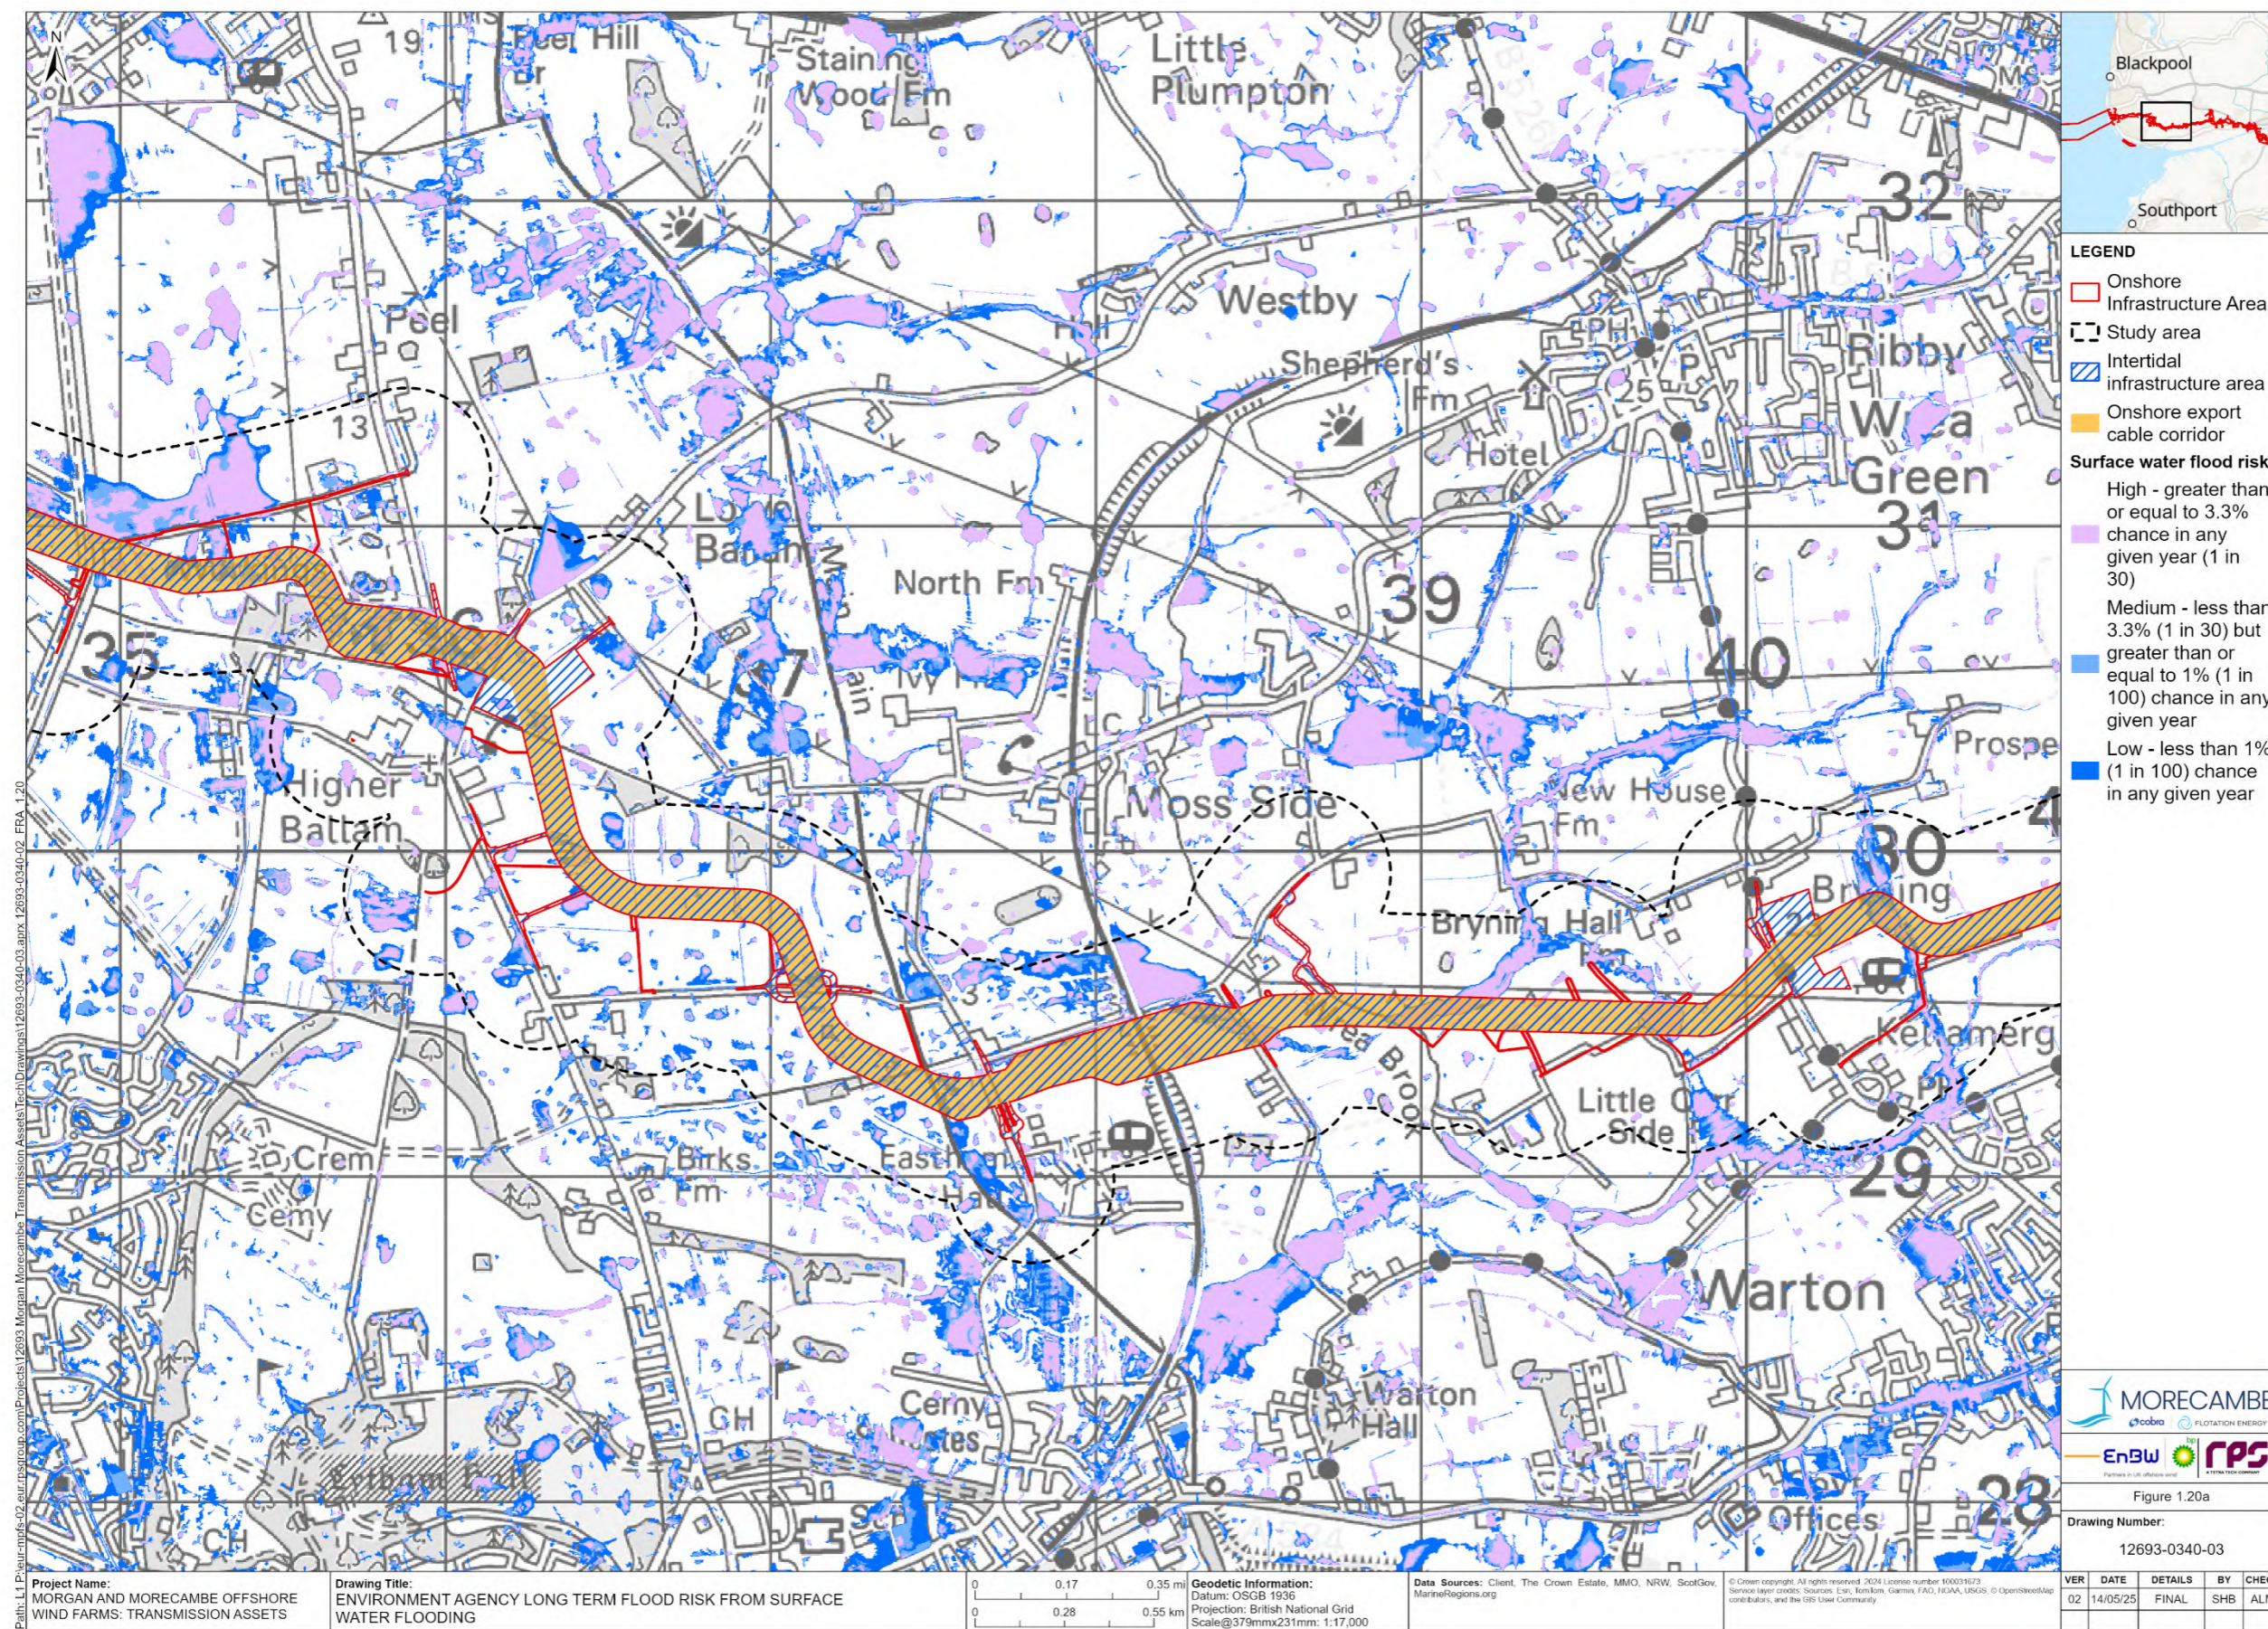


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding

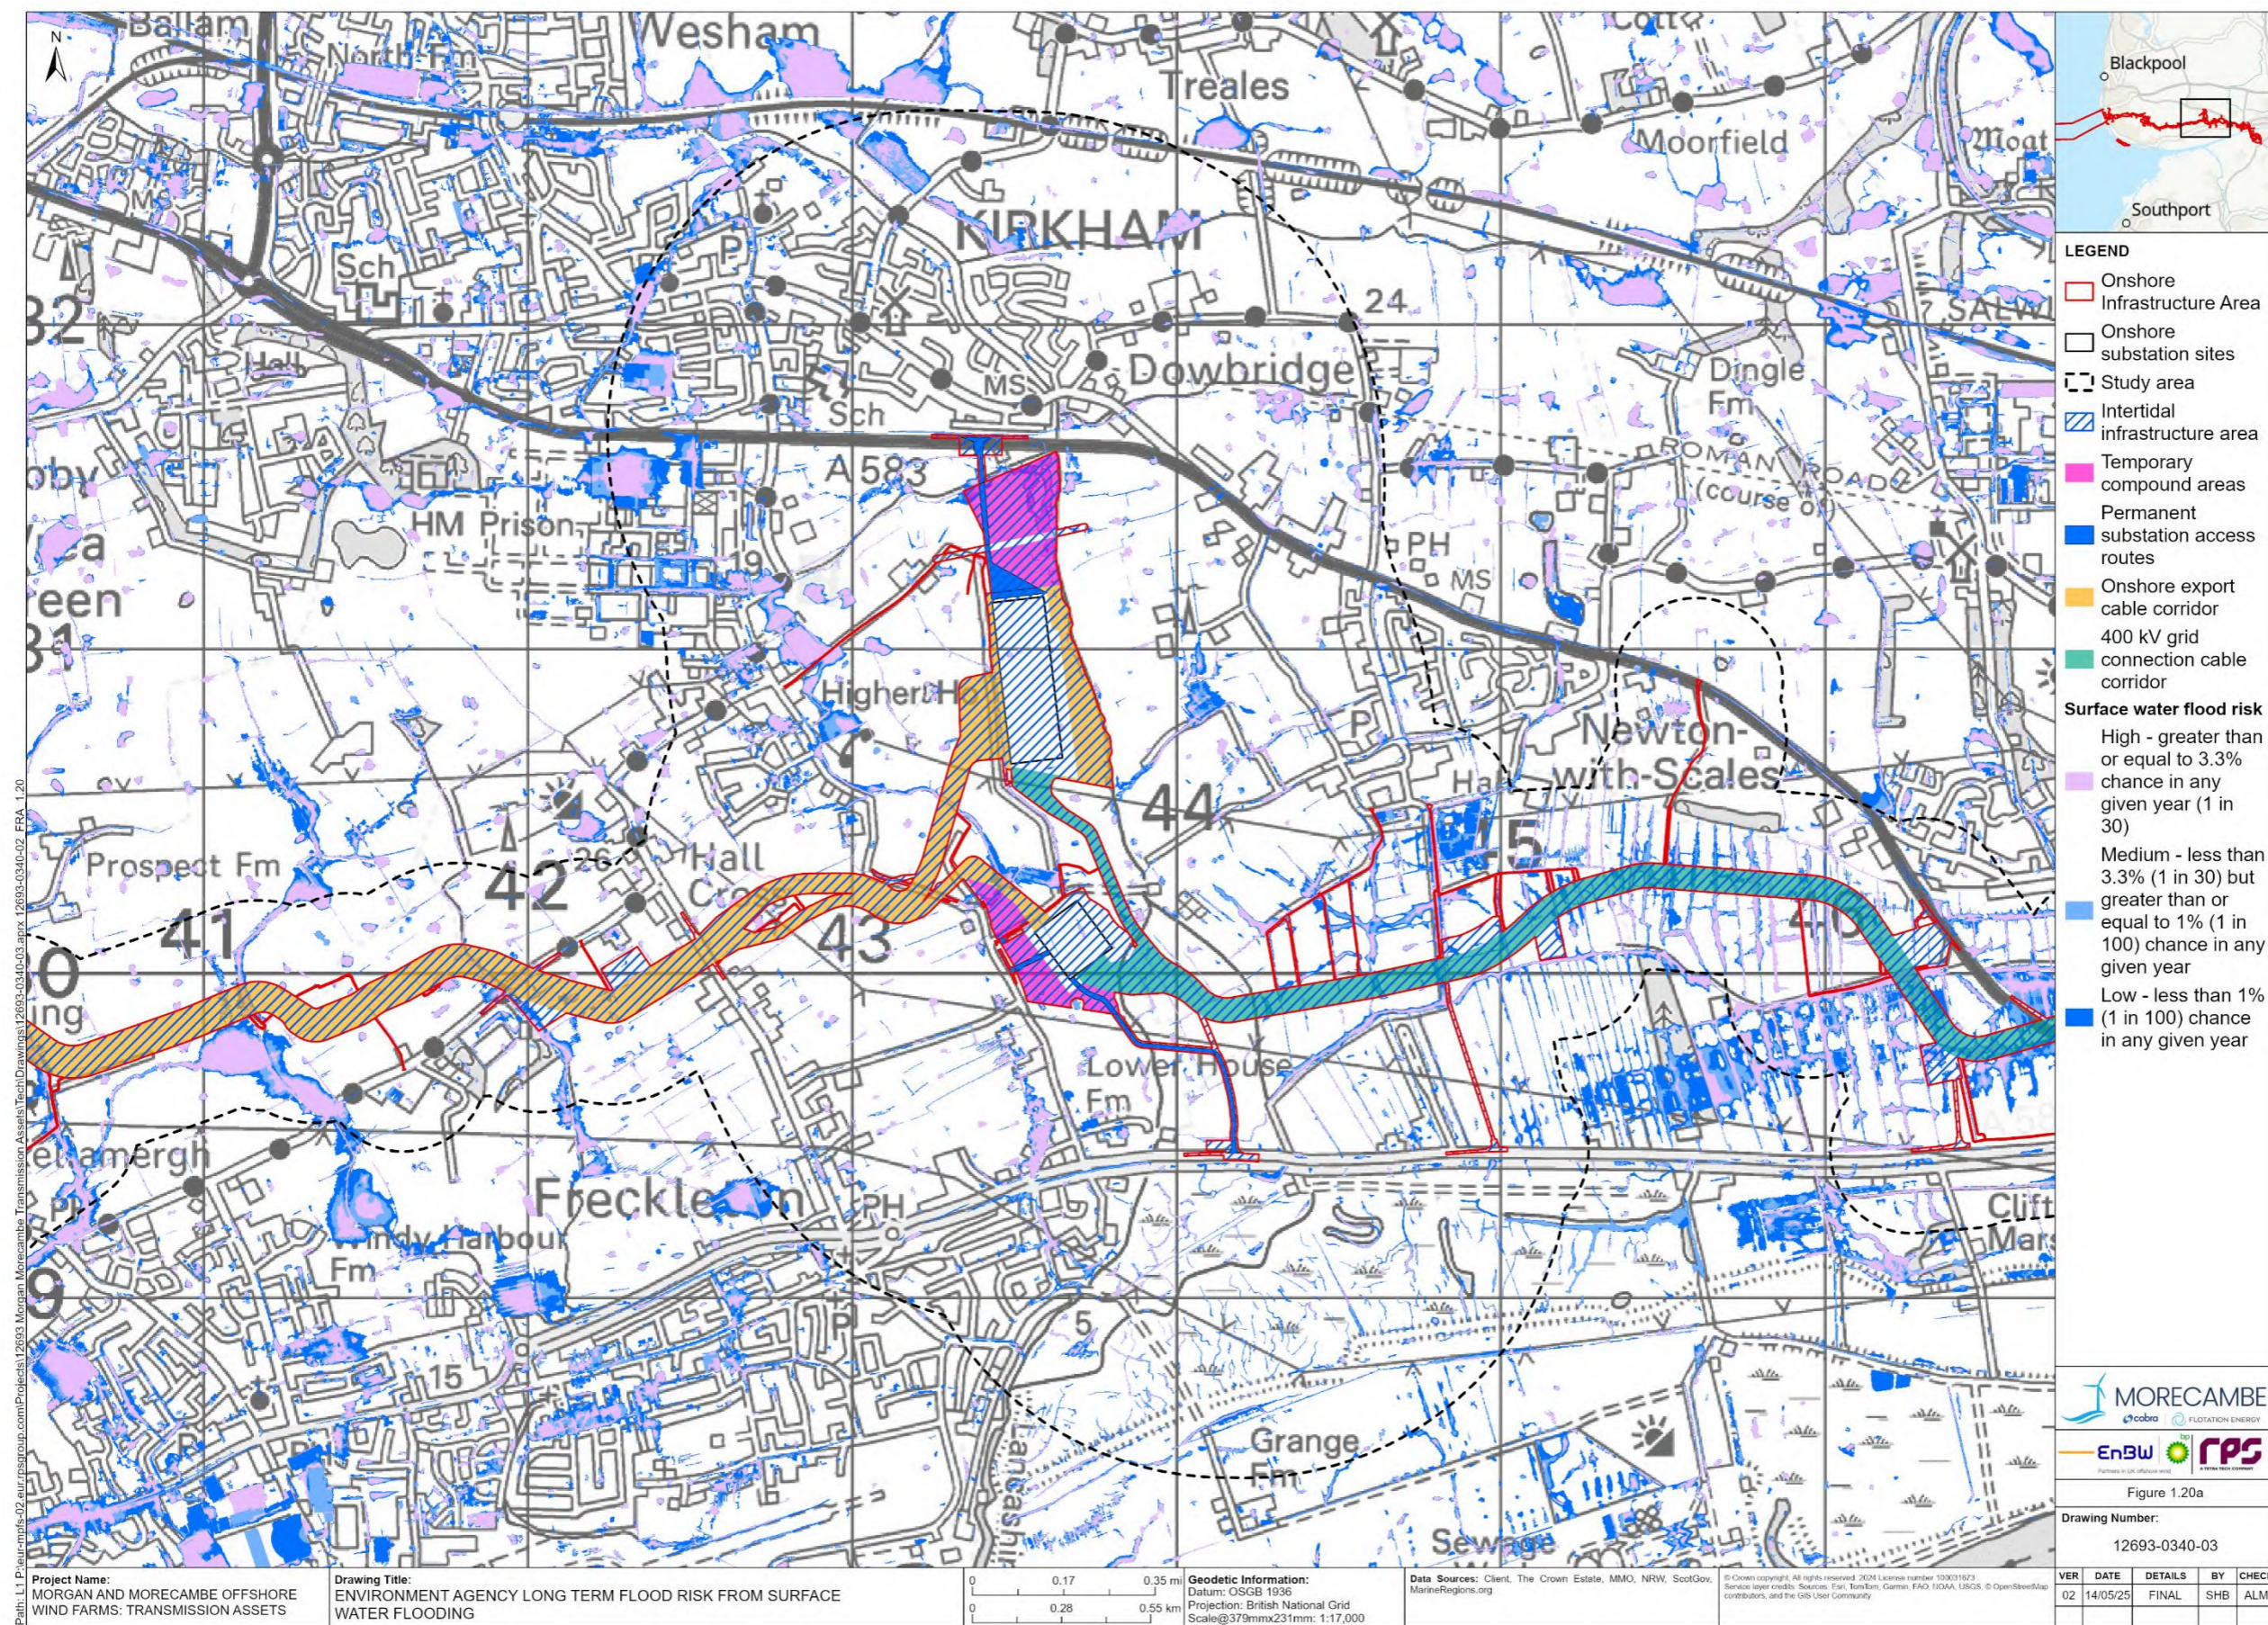


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding

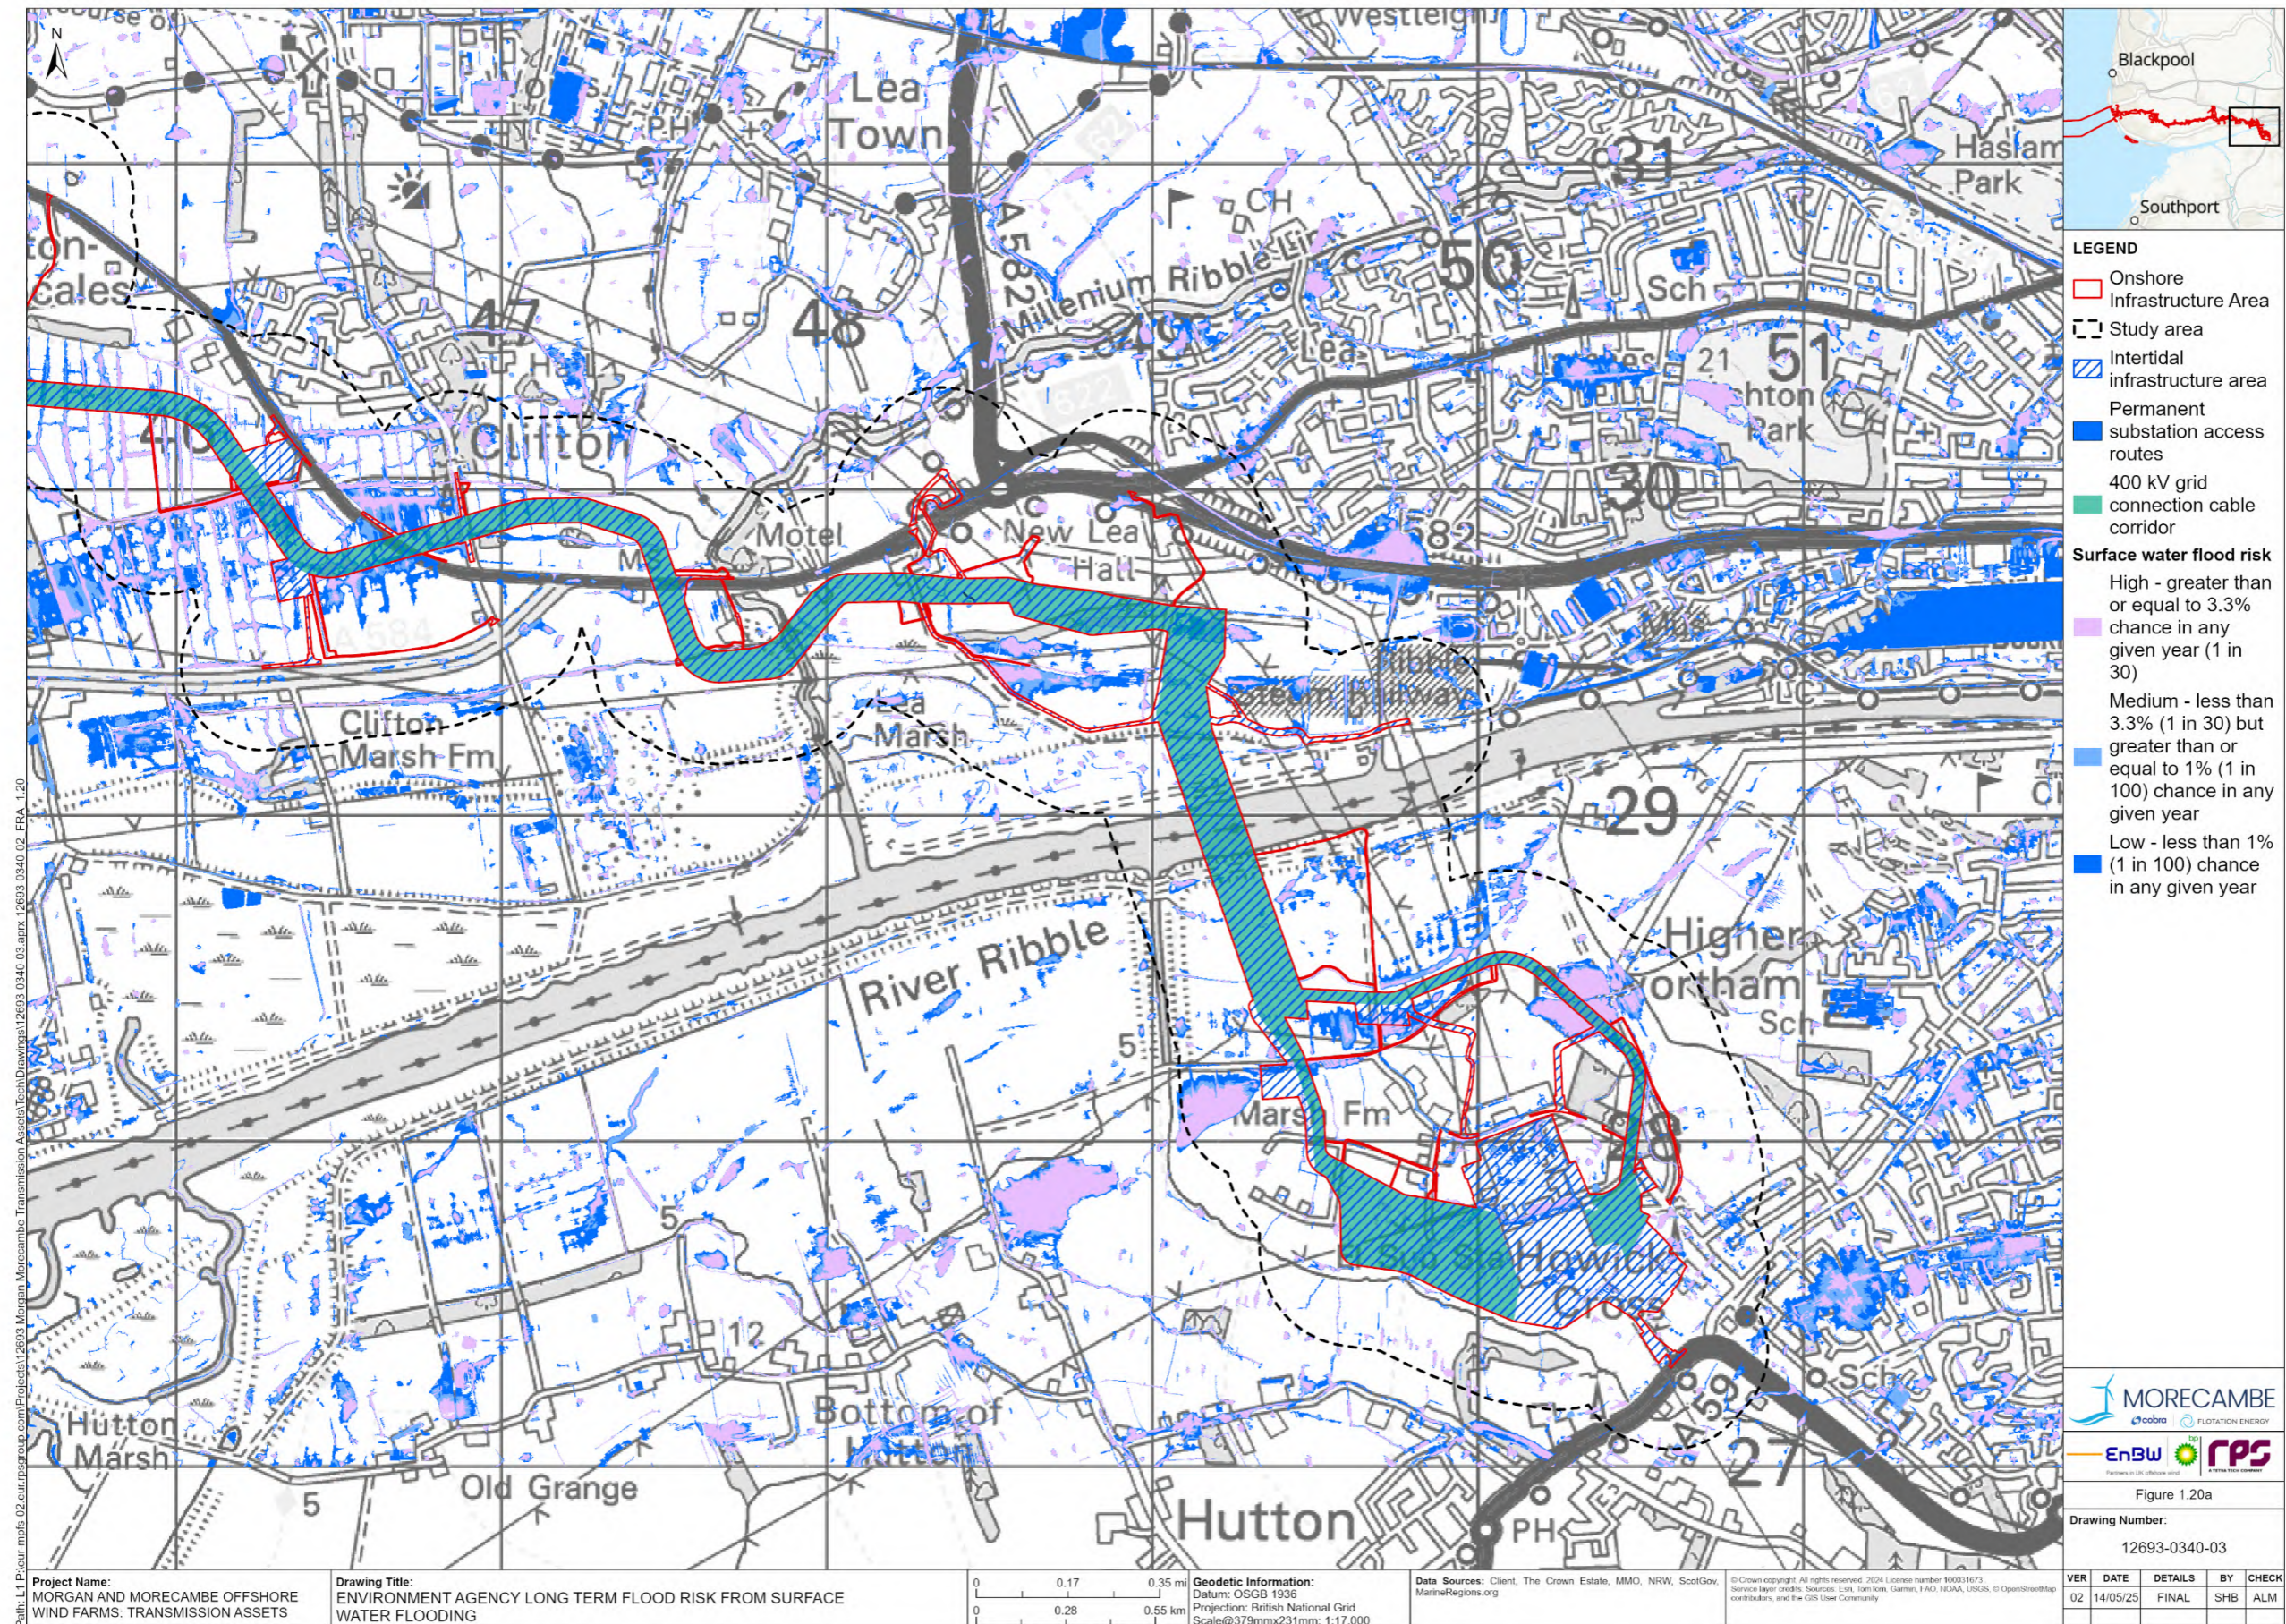


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding

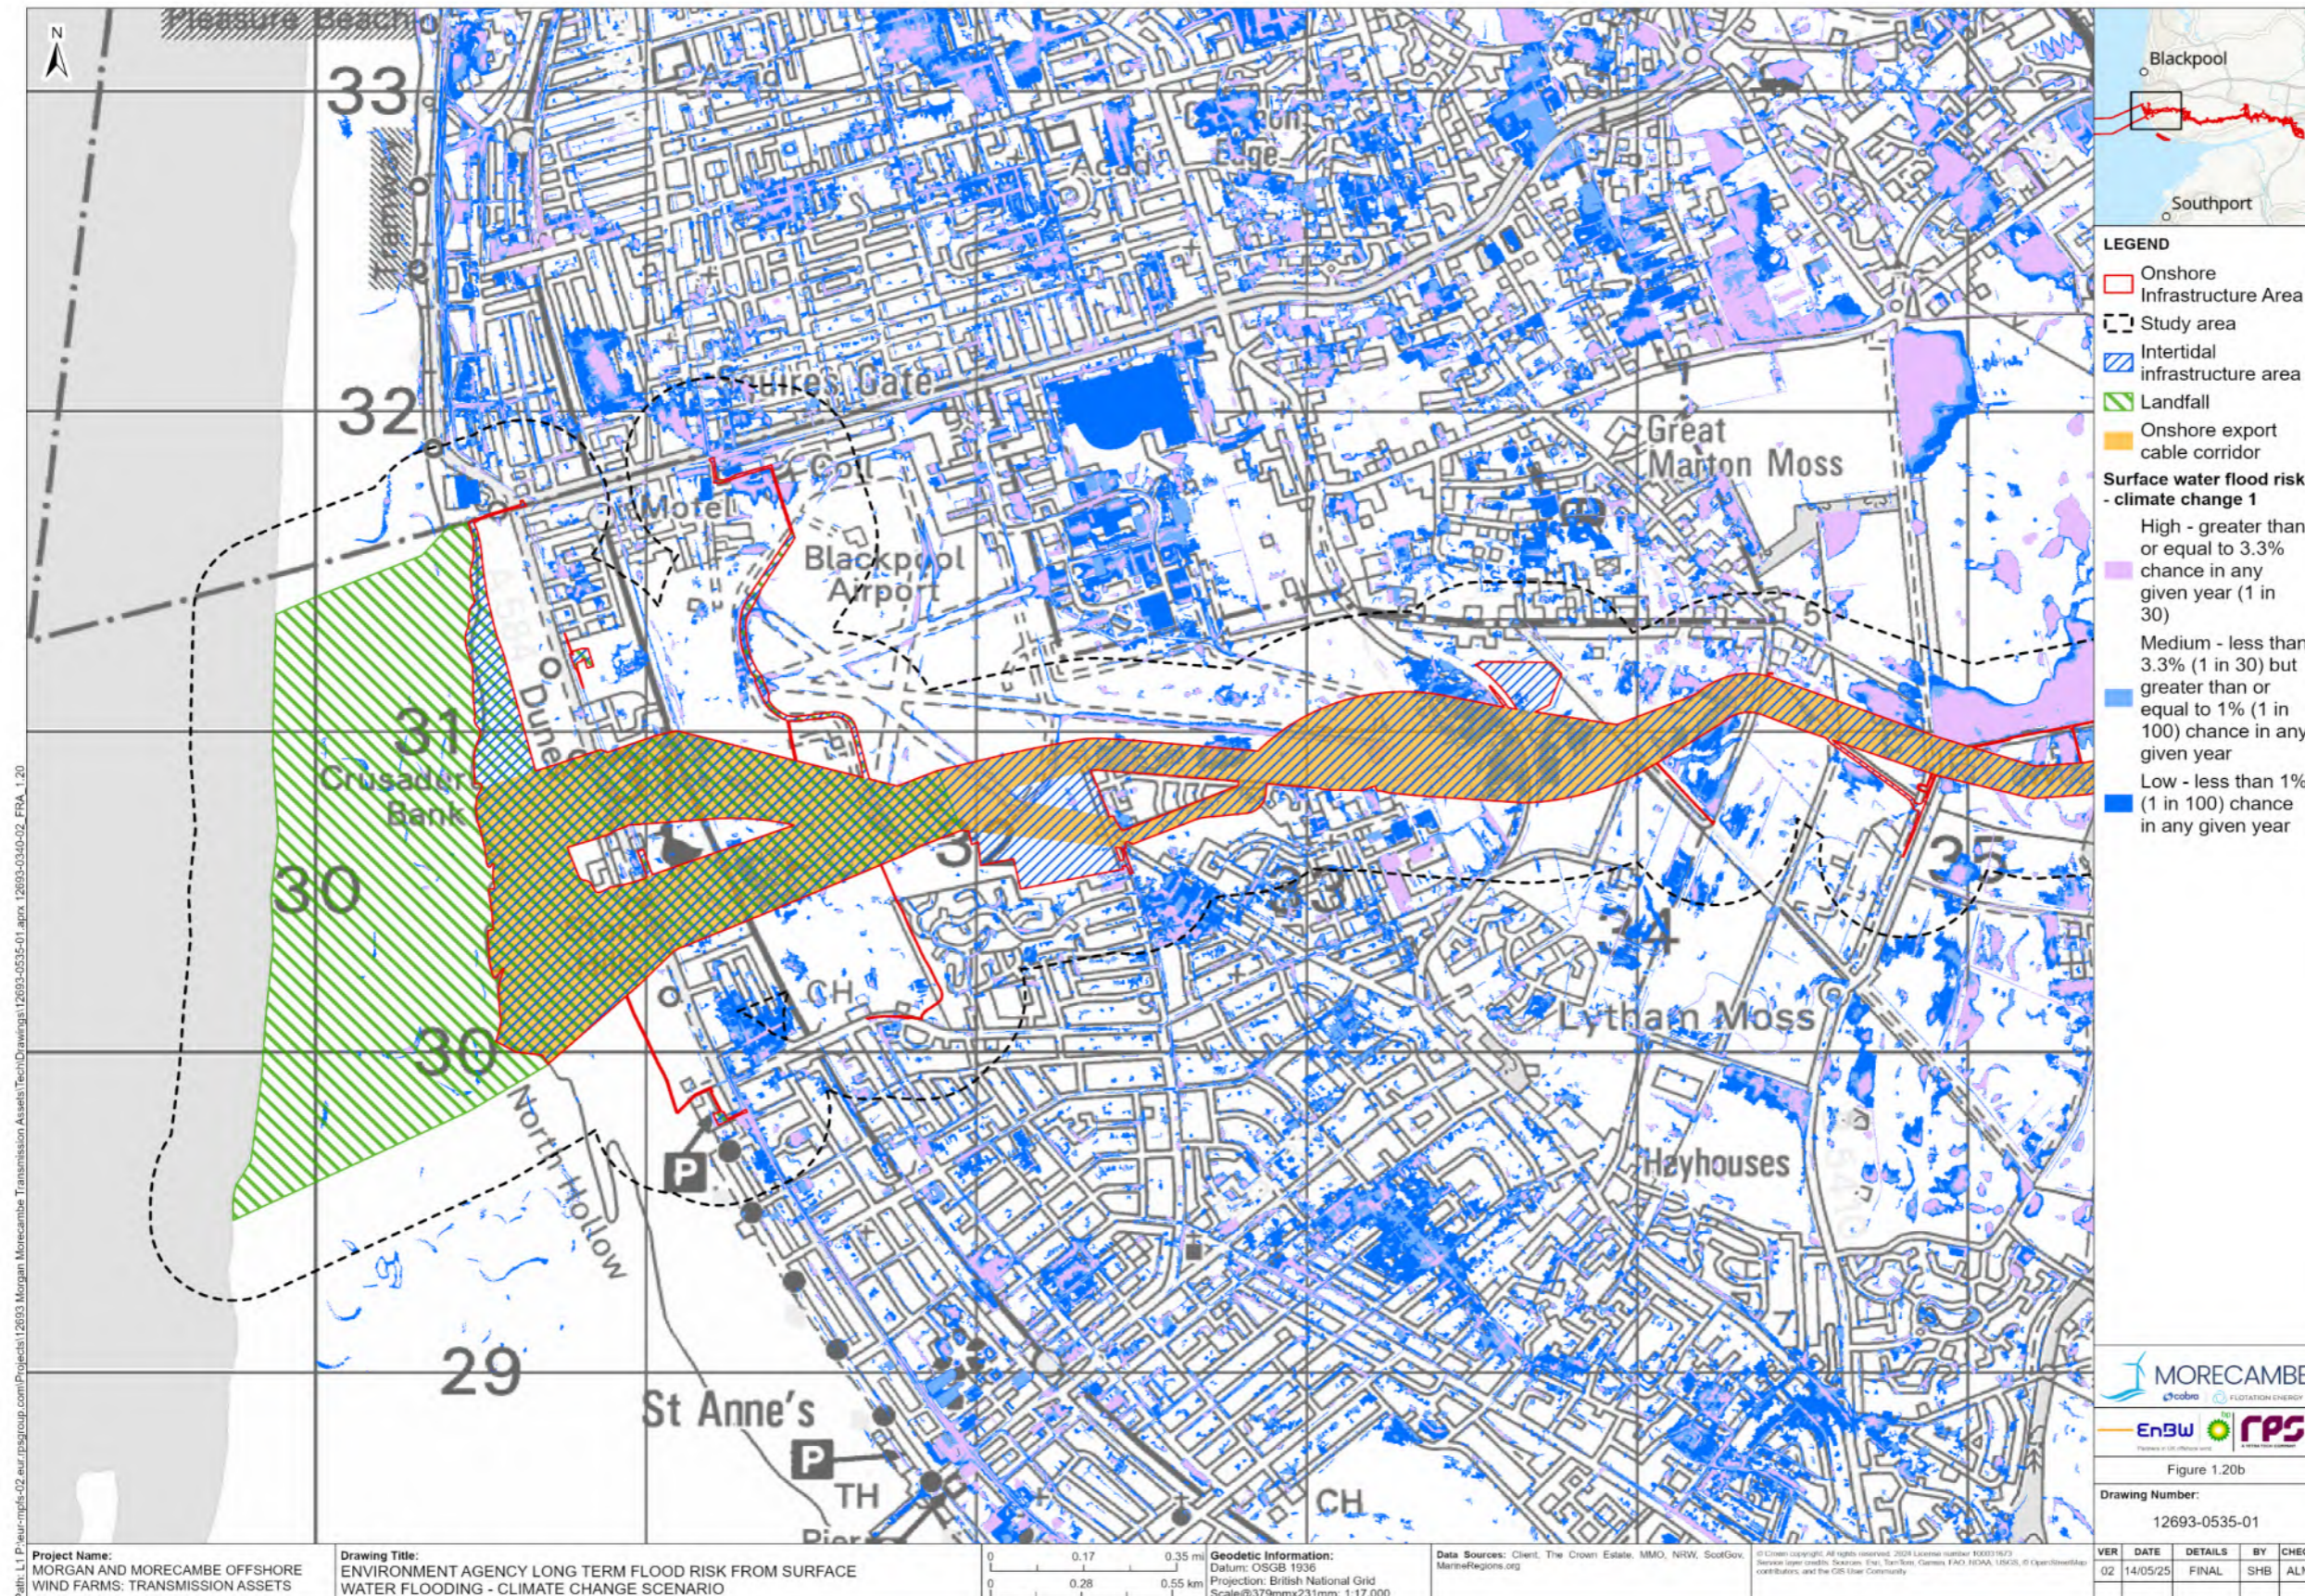
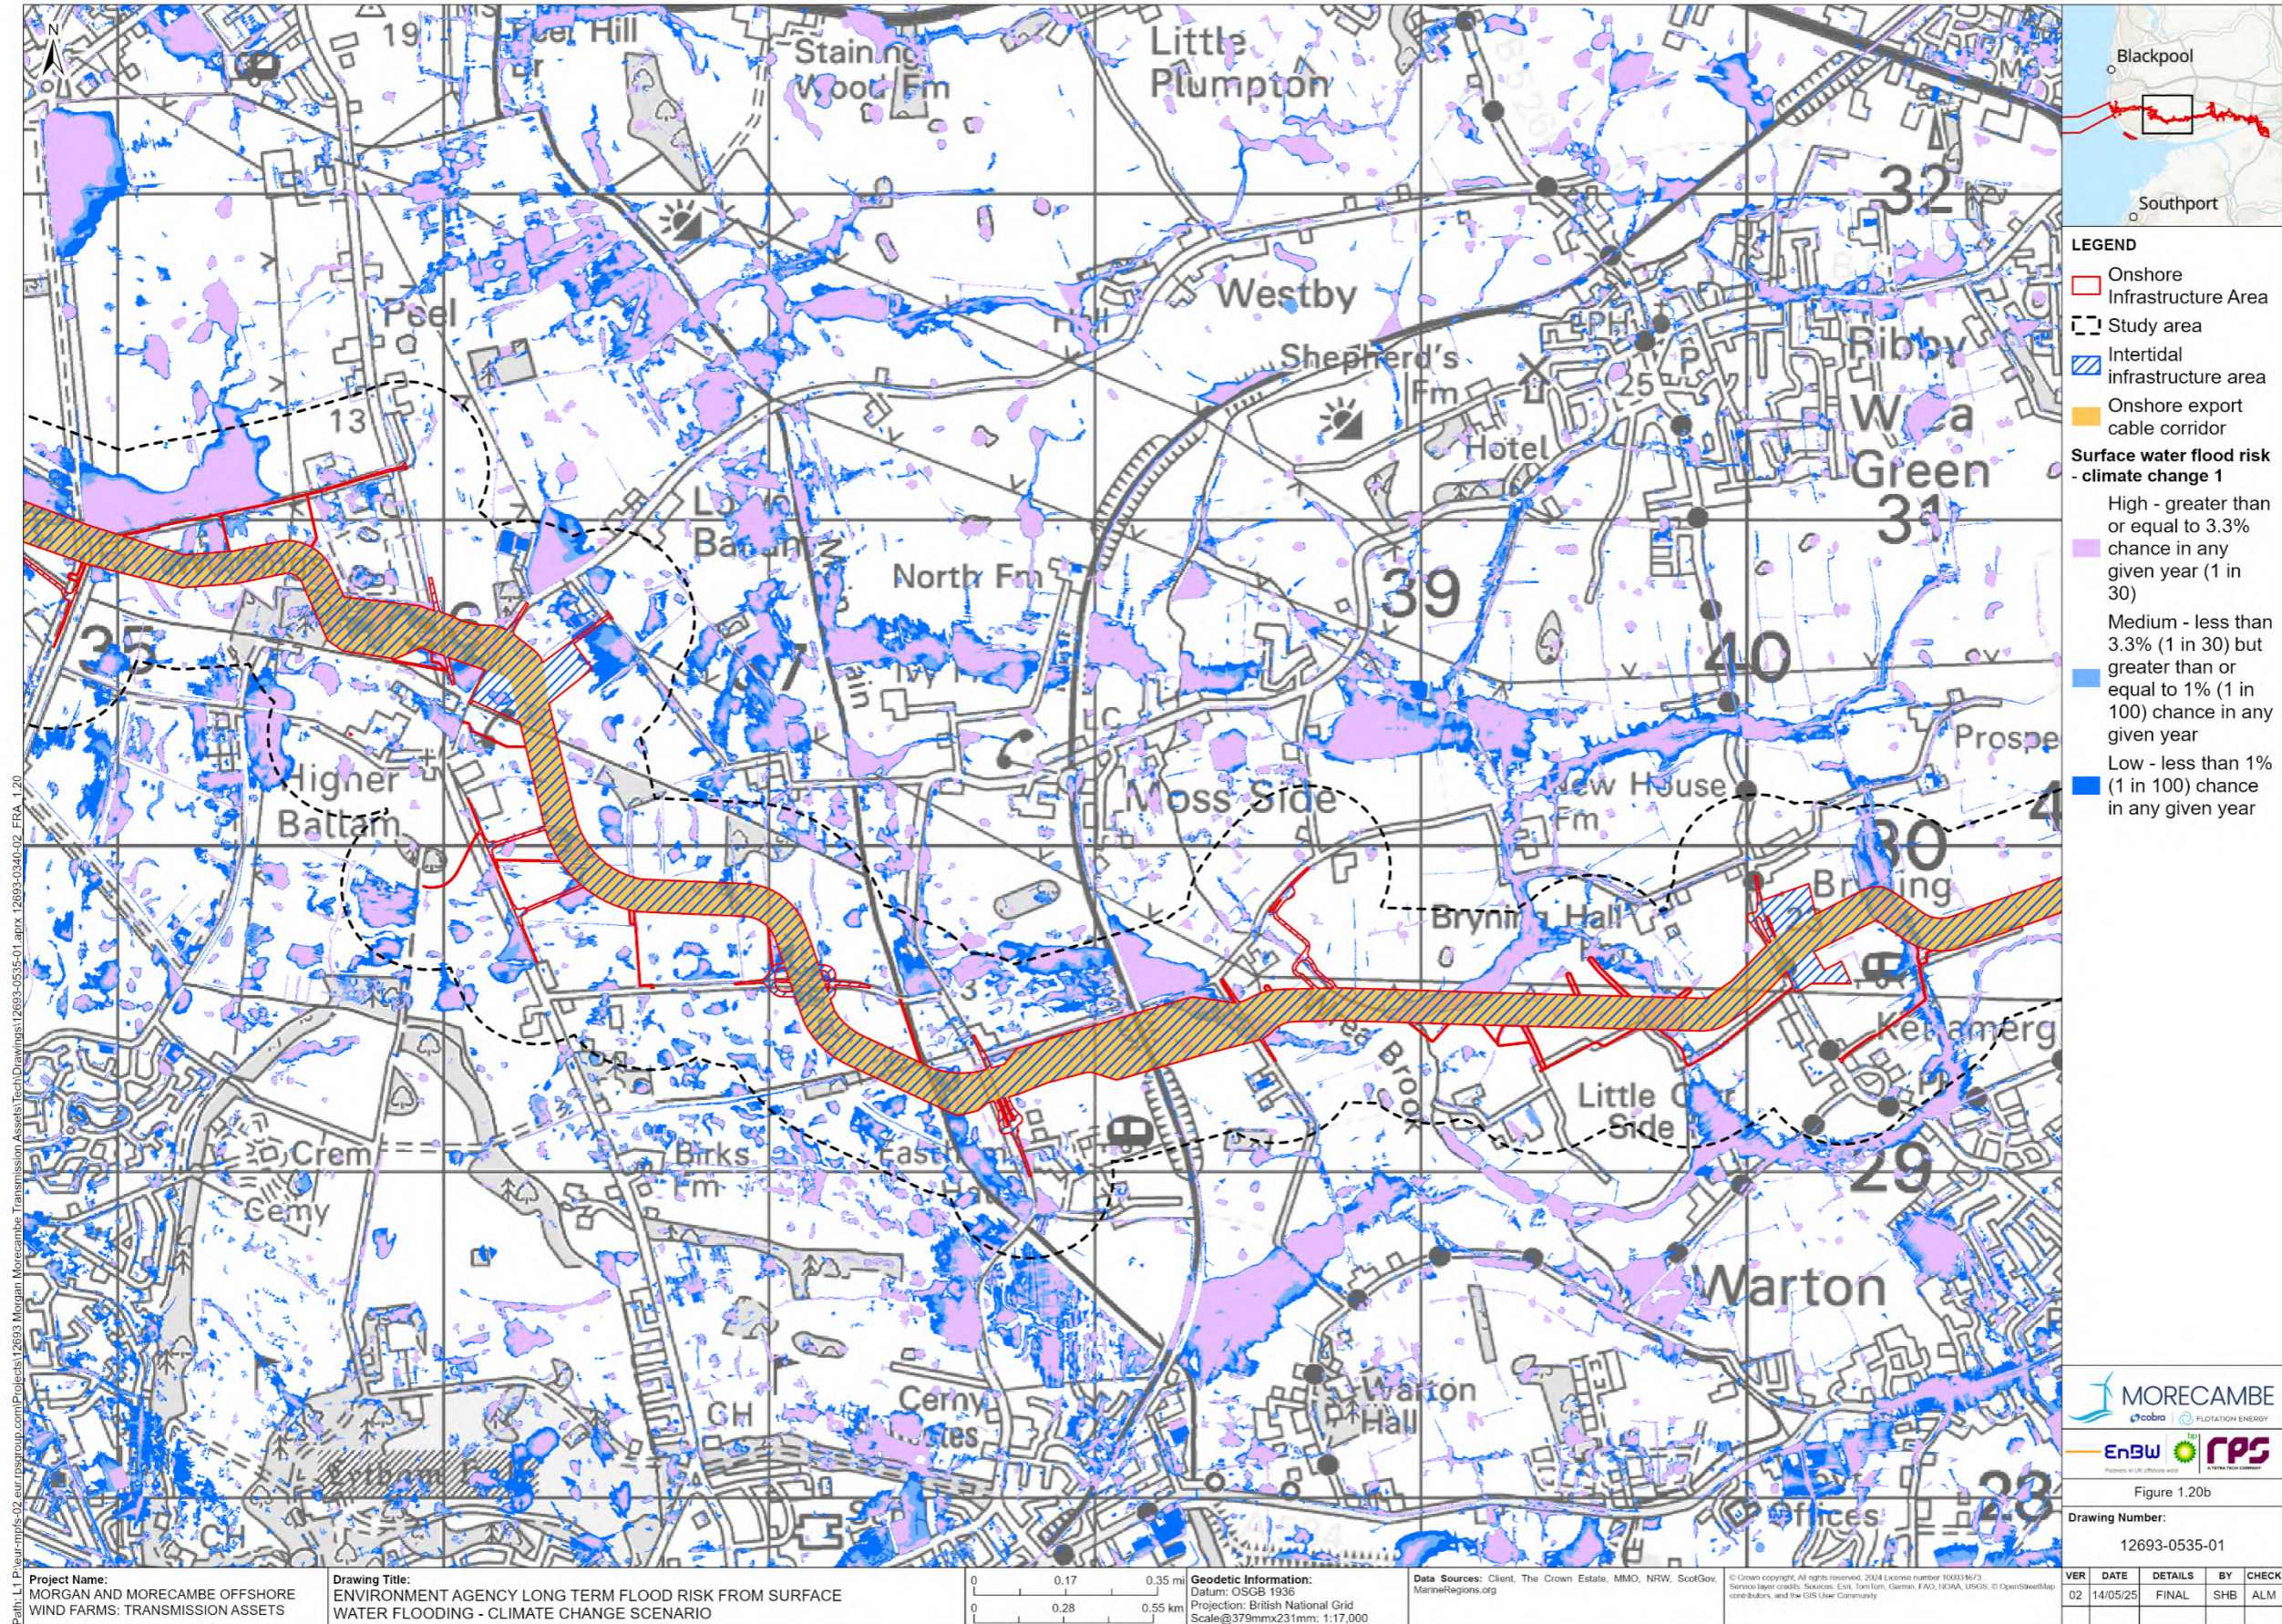


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding – climate change scenario



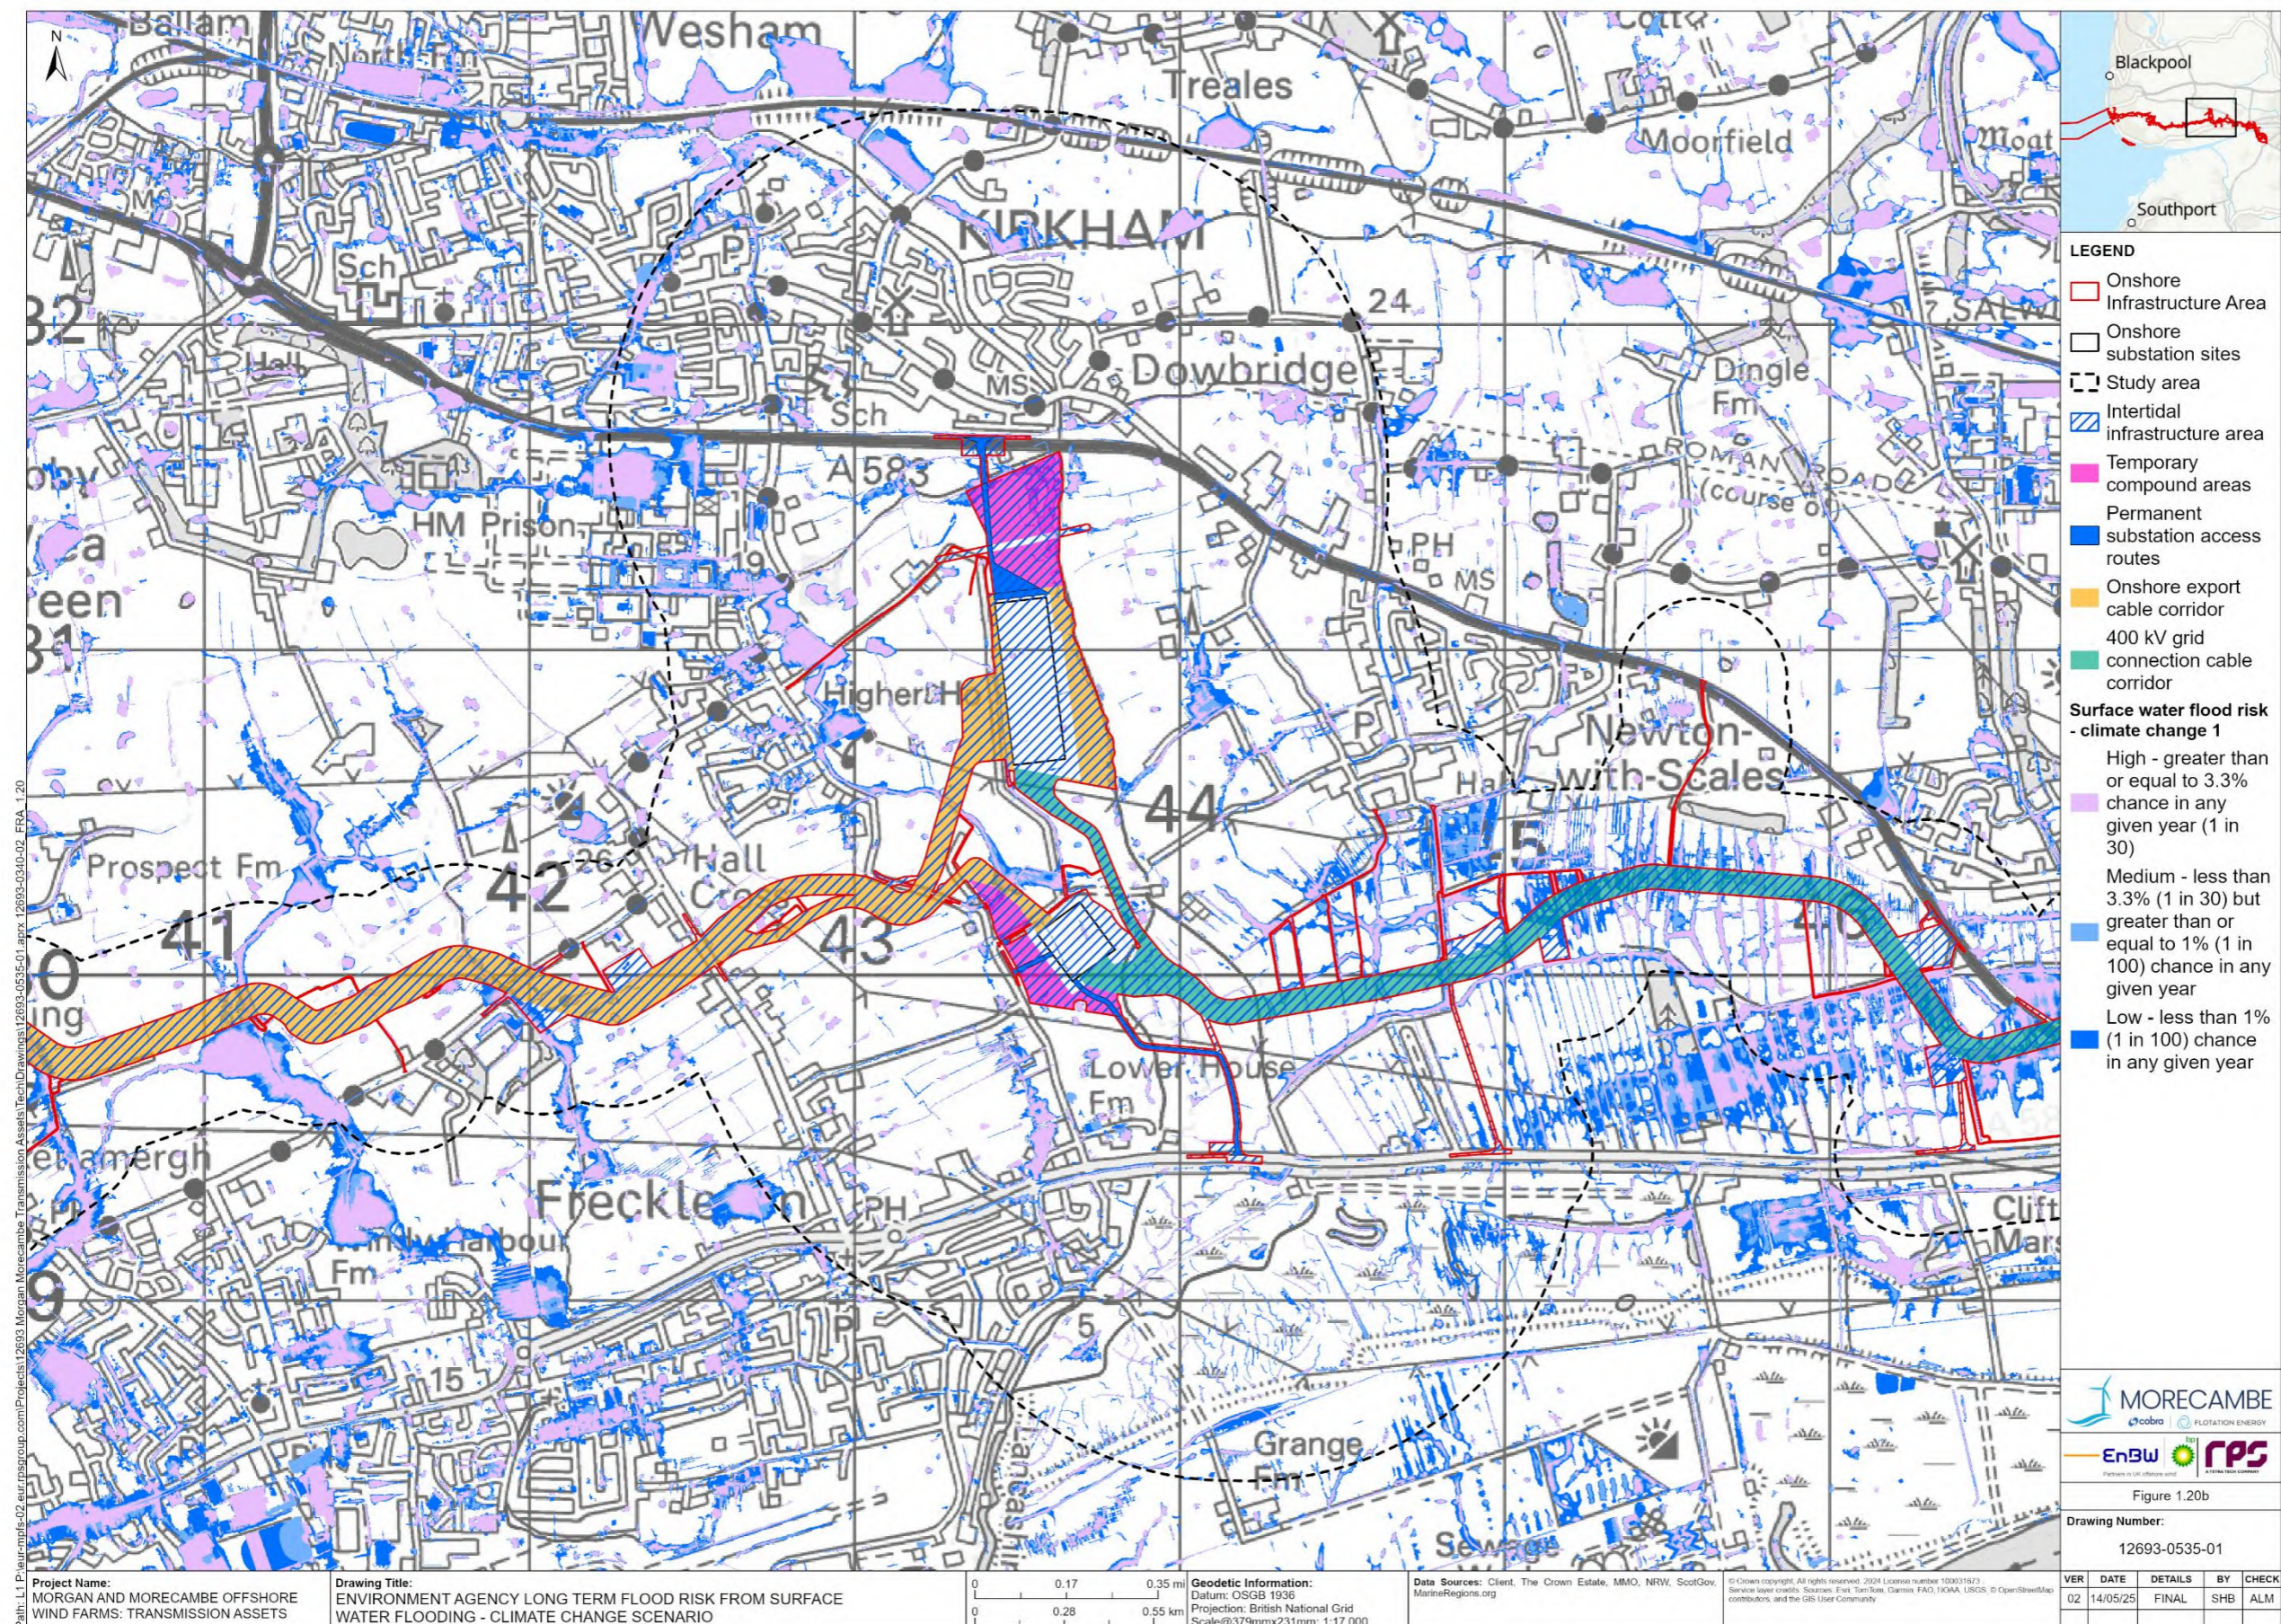


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding – climate change scenario

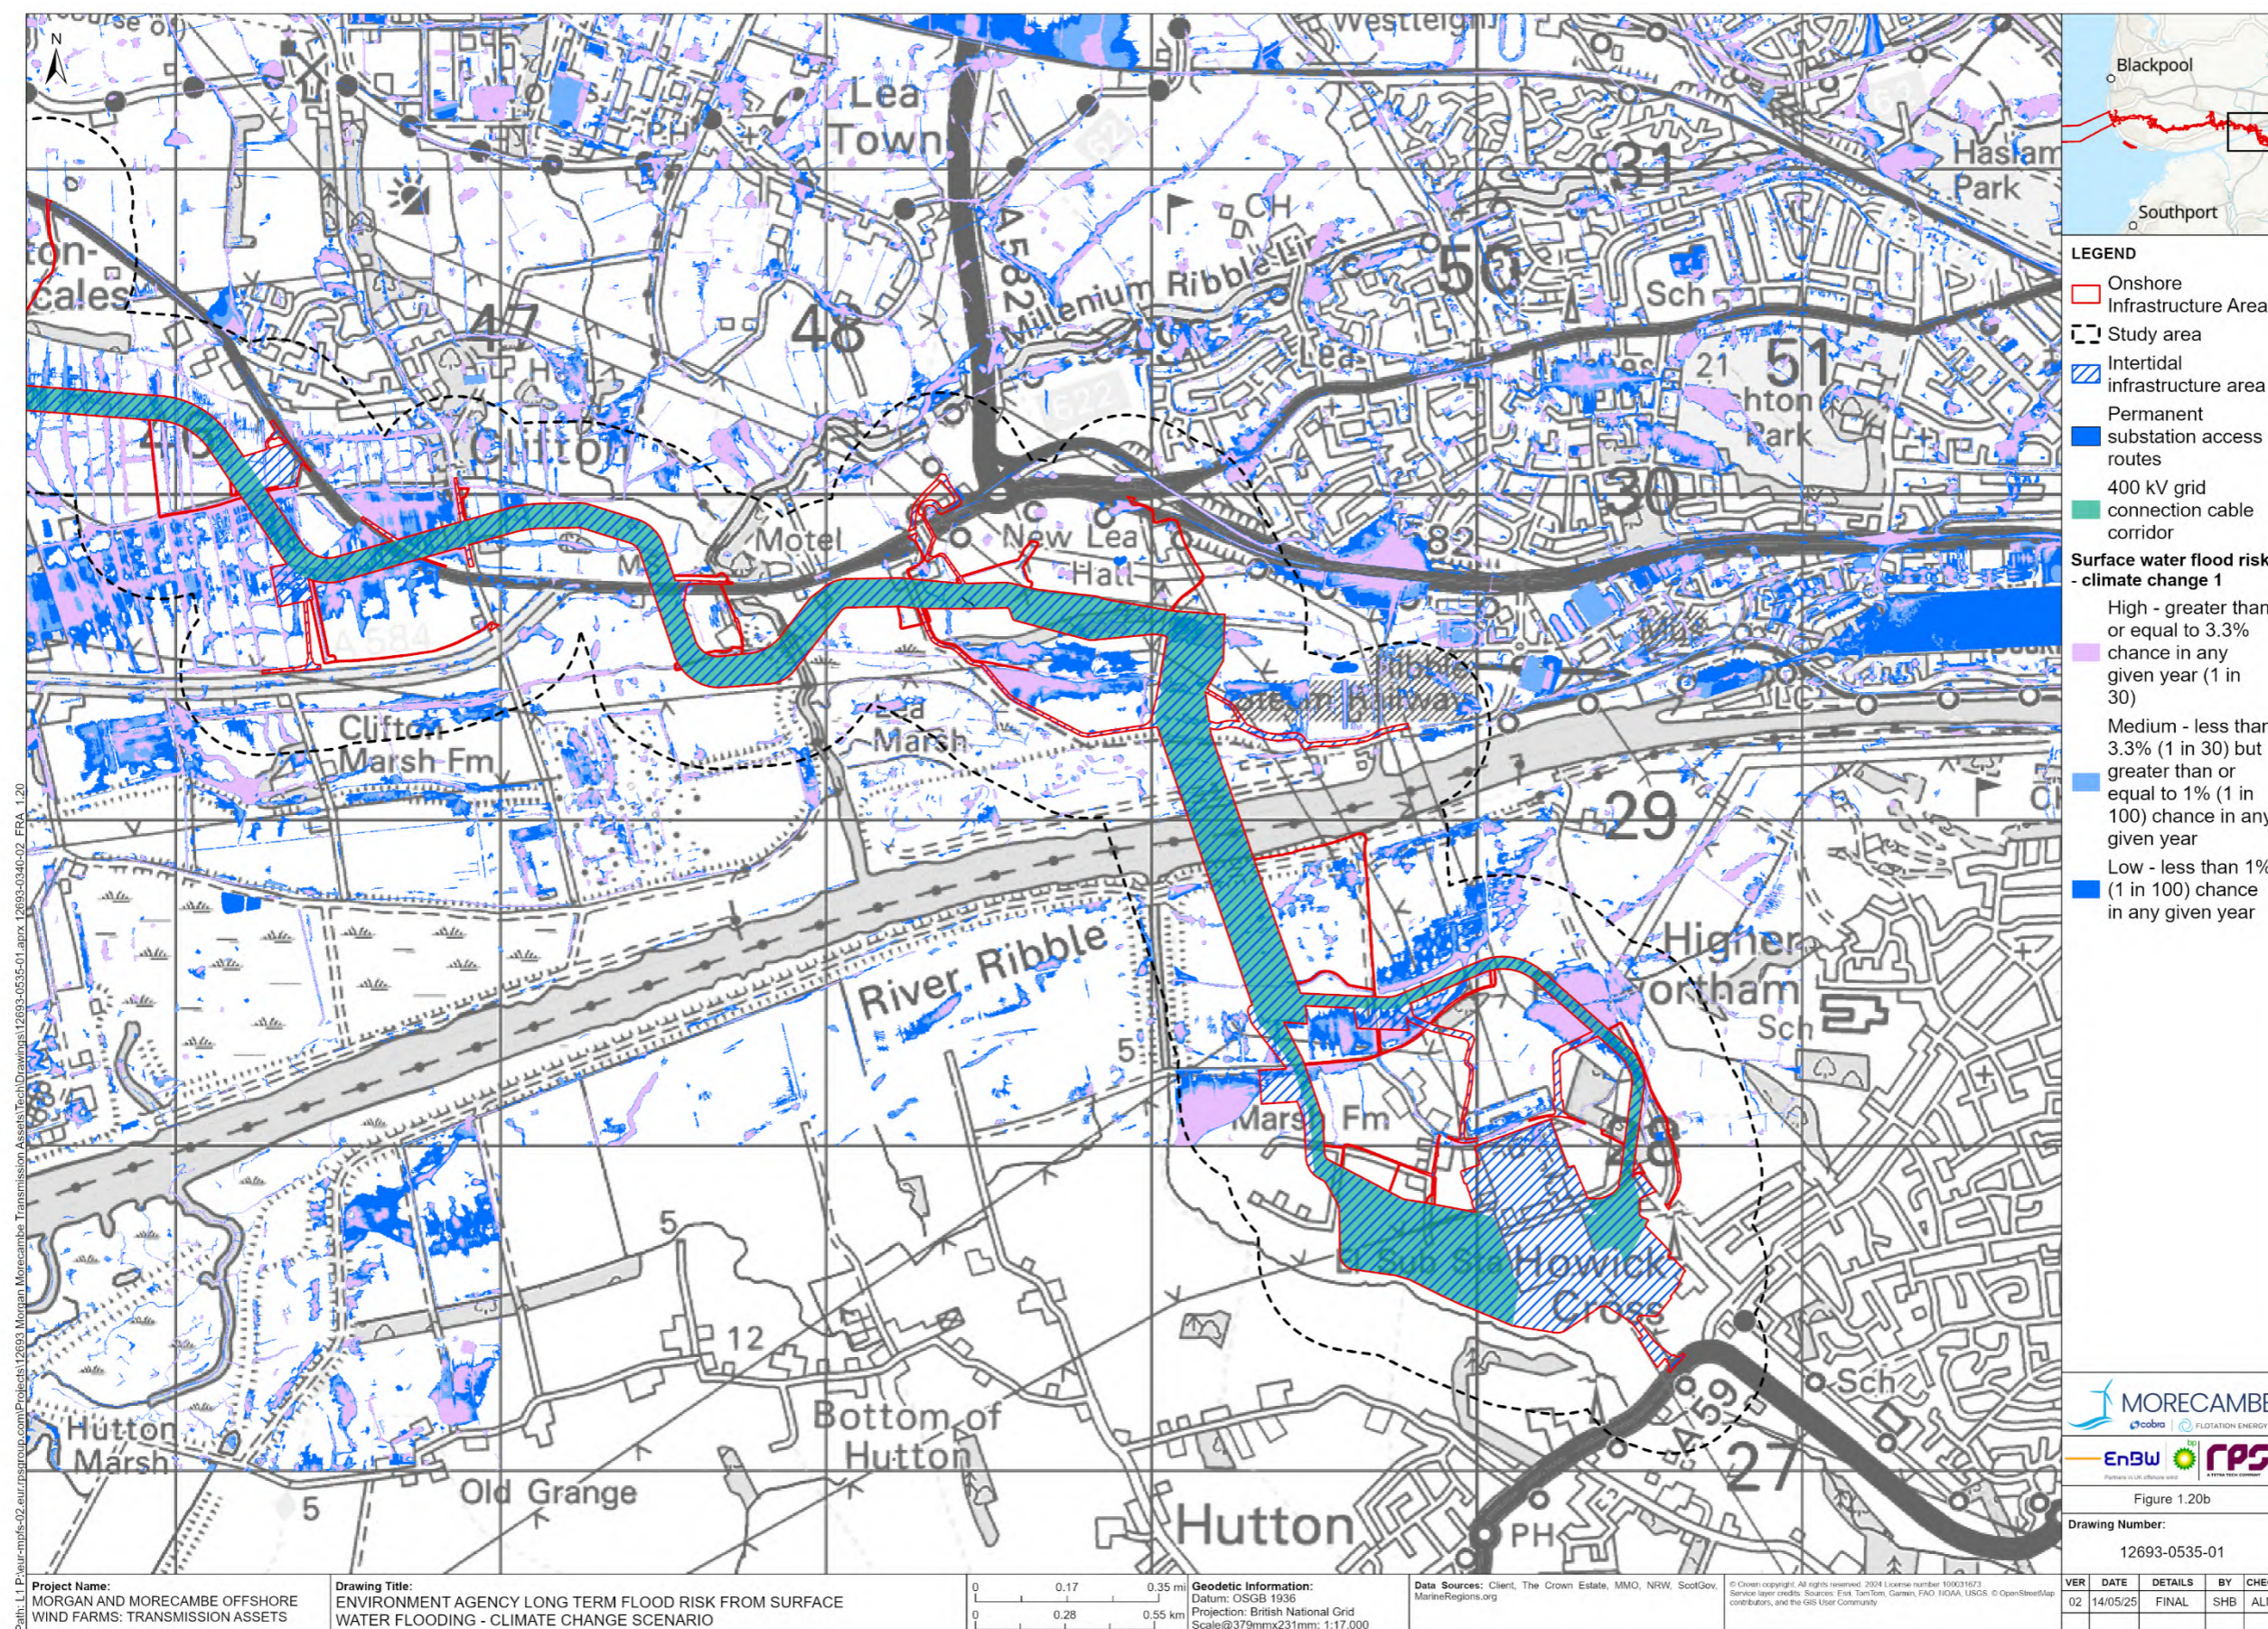


Figure 1.20a: Environment Agency Long term flood risk from surface water flooding– climate change scenario

1.7.8 Flood risk from sewer and water main failure

1.7.8.1 United Utilities operate public sewer assets and water supplies in the study area. Flooding from sewerage failure occurs when a rainfall event exceeds the maximum capacity of the surrounding network. The most common causes of flooding from sewers are inadequate flow capacity, blockages, pumping station failures, burst water mains, water inflow from rivers or the sea, tide locking, siltation, fats/greases, and sewer collapse. Should any of these events occur there is a risk of flooding within the vicinity of the sewer by surcharge where the flood is in excess of the sewer capacity (usually 1 in 30-year event or greater).

1.7.8.2 As per **section 3.16.8** of Volume 1, Chapter 3: Project description of the ES, to ensure damage to sewers and water pipelines and thus flooding from this source is prevented during the construction phase, prior to the commencement of works, any construction activities will need to be undertaken in accordance with the water authorities design standards prior to gaining approval. This includes providing evidence to confirm the presence/lack of presence of any water authority assets (e.g. sewers and water mains) and if they are present, how final design and construction methods will be implemented to divert their assets (which will need additional approval) or avoid their assets.

Strategic Flood Risk Assessment

The Fylde Coast Authorities Strategic Flood Risk Assessment (2024)

1.7.8.3 Relevant information regarding flood risk from sewers from the FCA SFRA to the landfall, onshore export cables and 400 kV grid connection cables has been extracted and included as follows.

- Within the Blackpool Council area, the main postal districts covering Blackpool are FY1 - FY4. Across these postal districts a total of 328 sewer flooding incidents have been recorded by United Utilities in data provided from 2009 to October 2023. Almost half of these incidences occur within the FY2 postcode area which covers the urban area in the north, incorporating Bispham, Greenlands, Knowle, and Warbreck.

~~1.7.8.2~~ • Within the Fylde Council area, The main postal districts covering Fylde are FY4, FY6, FY8 and PR4. Across these postal districts a total of 521 sewer flooding incidents have been recorded by United Utilities in data provided from 2009 to October 2023. Over half of these incidences occurred within the FY6 postcode area which covers the northern part of the area at Singleton but also the large urban area of Poulton-le-Fylde within Wyre district.

Mitigation measures (commitments)

~~1.7.8.3~~1.7.8.4 Mitigation measures (commitments) presented below within **Table 1.41** are proposed to manage flood risk and vulnerability to site workers during the construction and decommissioning phase. No commitments relating to groundwater flooding are required during the operation and maintenance phase. Commitments are also presented

within **Section 1.81.8, Table 1.44**. Commitments are to be secured through requirements of the DCO.

Table 1.41: Summary of CoT for flood risk from sewers for landfall, the onshore export corridor and 400 kV grid connection cable corridor

CoT	Summary	Reason	How CoT is to be secured
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	To implement construction phase drainage to control runoff during this phase of the Transmission Assets.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT35	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP will include measures to maintain and address: <ul style="list-style-type: none"> [...] flood protection and control measures; -water environment and drainage; and pollution prevention [...] 	To implement control measures in regards to fluvial and tidal flooding, including: <ul style="list-style-type: none"> Measures to prevent a reduction in the capacity of the fluvial floodplain which can increase flood risk downstream; Measures regarding dewatering; Measures regarding restricting the placement of stockpiling, storage of fuels and chemicals and refuelling to Flood Zone 1 (where practical) and at least 8 m from ordinary watercourses and Main Rivers and 16m from tidal Main Rivers to reduce vulnerability to flood risk; 	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT36	Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the	To manage flood risk during decommissioning	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)

CoT	Summary	Reason	How CoT is to be secured
	latest relevant available guidance.		

Summary

~~1.7.8.4~~ 1.7.8.5 With implementation of commitments listed within **Table 1.41**, flood risk from sewers is therefore assessed to be very low.

1.7.9 Flood risk from artificial sources

1.7.9.1 Field drainage is expected to be present within agricultural land within the study area and could pose localised sources of flooding if impacted during construction. Due to the nature of development associated with landfall, onshore export cable corridor and 400 kV grid connection cable corridor, which is predominantly to be buried below ground, development will not be impacted by or cause any adverse effect on field drainage following installation.

Mitigation measures (commitments)

1.7.9.2 Mitigation measures (commitments) presented below within **Table 1.42** are proposed to manage flood risk and vulnerability to site workers during the construction and decommissioning phase. No commitments relating to flooding from artificial sources are required during the operation and maintenance phase. Commitments are also presented within **Section 1.8**, **Table 1.44**. Commitments are to be secured through requirements of the DCO.

Table 1.42: Summary of CoT for flood risk from artificial sources for landfall, the onshore export corridor and 400 kV grid connection cable corridor

CoT	Summary	Reason	How CoT is to be secured
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	To implement construction phase drainage to control runoff during this phase of the Transmission Assets.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT35	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP will include measures to maintain and address: <ul style="list-style-type: none"> [...] flood protection and control measures; 	To implement control measures in regards to fluvial and tidal flooding, including: <ul style="list-style-type: none"> Measures to prevent a reduction in the capacity of the fluvial floodplain which can increase flood risk downstream; Measures regarding dewatering; 	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

CoT	Summary	Reason	How CoT is to be secured
	<ul style="list-style-type: none"> -water environment and drainage; and pollution prevention [...] 	Measures regarding restricting the placement of stockpiling, storage of fuels and chemicals and refuelling to Flood Zone 1 (where practical) and at least 8 m from ordinary watercourses and Main Rivers and 16m from tidal Main Rivers to reduce vulnerability to flood risk;	
CoT36	Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the latest relevant available guidance.	To manage flood risk during decommissioning	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)
CoT84	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. In order to manage impacts to field drainage, the Outline CoCP stipulates field drainage plans will be developed in consultation with the relevant landowners. If required, additional field drainage will be installed to ensure the existing drainage of the land is maintained during and after construction.	To prevent flooding from field drainage	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

Summary

1.7.9.3 With implementation of commitments listed within **Table 1.42**, flood risk from artificial sources is therefore assessed to be very low.

1.7.10 Historic flooding

1.7.10.1 The Environment Agency Historic Flood Map is presented within **Figure 1.11** and records historical flooding has occurred within the study area on the land north of the River Ribble, and around Savick Brook. Extents are approximately 95.4 ha. [Additional details include:](#)

- [November 1977, flooding resulted from spring tide sequences and gale force south west, to north west winds. Massive surge experienced on the Fylde and Morecambe Bay. It is noted that flood defences have been updated since 1978.](#)
- [February 1990, an 80 metre long breach in the earth embankment caused flooding of 500 acres of agricultural land and Grange Farm. The major sewage works was also flooded.](#)

[Strategic Flood Risk Assessment](#)

[The Fylde Coast Authorities Strategic Flood Risk Assessment \(2024\)](#)

[1.7.10.2](#) [Relevant information to historical flood events from the FCA SFRA relevant to the landfall, onshore export cables and 400 kV grid connection cables has been extracted and included as follows.](#)

- [February and March 2020, overtopping of sea defences led to flooding of roads and properties within Blackpool.](#)

[Strategic Flood Risk Assessment Data](#)

[Strategic Flood Risk Assessment \(Fylde Borough Council, 2011\)](#)

~~1.7.10.1~~ [1.7.10.3](#) [Relevant information from the Fylde Council SFRA has been extracted and included as follows.](#)

- Fylde Borough Council do not hold any records of historical flooding.

1.7.11 Summary of flood risk

1.7.11.1 A summary of assessed flood risk is presented below within **Table 1.43**.

Table 1.43: Morecambe onshore substation flood risk summary

Source of flooding	Assessed risk to Morecambe onshore substation	Commitment measures to be adopted
Fluvial and tidal	Low	CoT02 CoT06, CoT08, CoT09 CoT10, CoT12, CoT14 CoT27 CoT35, CoT36, CoT95 and CoT97
Groundwater	Very low	CoT09 CoT35 CoT36, CoT41
Surface water	Low	CoT08, CoT09, CoT24, CoT27, CoT35, CoT36
Reservoir	Very low	None
Sewer	Very low	CoT09 CoT35 CoT36,
Artificial Sources	Very low	CoT09 CoT35 CoT36 CoT84

1.8 Flood Risk Management

1.8.1 Measures adopted as part of the Transmission Assets (Commitments)

- 1.8.1.1 Embedded and secondary measures relevant to flood risk of the Transmission Assets that will form part of the final design (and/or are established legislative requirements/good practice) have been taken into account as part of the flood risk assessment presented in **section 1.5.4** and below within **Table 1.44**.

Table 1.44: Mitigation measures and commitments

Commitment number	Mitigation measure	How will this commitment be secured?
Embedded measures		
CoT02	<p>The following features will be crossed by trenchless techniques, as set out in the Onshore Crossing Schedule submitted as part of the application for development consent:</p> <ul style="list-style-type: none"> • A, B and Classified unnumbered roads (known as C roads) (including the Preston Western Distributor Road, A582 South Ribble Western Distributor Upgrade and M55 Heyhouses Link Road; excluding Leech Lane); • All Environment Agency Main Rivers, including: Moss Sluice, east of Midgeland Road along Pegs Lane; Savick Brook, south of A583; Wrea Brook southeast of Cartmell Lane; Dow Brook east of Lower Lane between the A584 and the A583; Middle Pool north of Lund Way; and • All Network Rail crossings, including along the line which runs between Blackpool North and Preston, south of Cartmell Lane; and at the Network Rail crossing along the line which runs to Blackpool North, south east of Squires Gate, parallel to the A584. 	<p>DCO Schedules 2A & 2B, Requirement 5(2) (Detailed design parameters onshore);</p> <p>DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)"</p>
CoT06	<p>The construction area associated with onshore export cable corridor will be 100 m working width and the 400 kV grid connection cable corridor will be working width 76 m to minimise the construction footprint, except at complex trenchless technique crossings, including, but not limited to:</p> <ul style="list-style-type: none"> • Network Railway Crossings; • A, B and Classified unnumbered roads (known as C roads), including B5261 (Queensway); • the approach to landfall; • river and water course crossings; and • sensitive utility assets (e.g. high pressure gas pipelines). <p>The widths of both the onshore export cable corridor and 400 kV grid connection cable corridor also increases up to 270 m in width, on the access and egress to the onshore substations, to facilitate consideration of trenchless crossings as well as being subject to detailed design. These increased widths and crossing methodologies are set out in the Onshore Crossing Schedule and Works Plans-Onshore and Intertidal.</p>	<p>DCO Schedules 2A & 2B, Requirement 5 (Detailed design parameters onshore);</p> <p>Works Plans - Onshore and Intertidal</p>
CoT08	<p>Post-construction, the working area will be reinstated to pre-existing condition as far as reasonably practical in line with the DEFRA Construction Code of Practice for the Sustainable Use of Soils on Construction Sites (PB13298), Institute of Quarrying (IQ) Good Practice Guide for Handling Soils in</p>	<p>DCO Schedules 2A & 2B, Requirement 18 (Restoration</p>

Commitment number	Mitigation measure	How will this commitment be secured?
	Mineral Workings (IQ, 2021) and British Society of Soil Science (BSSS) Working with Soil Guidance Note on Benefitting from Soil Management in Development and Construction (BSSS, 2022).	of land temporarily used for construction); DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT09	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the outline CoCP. The Outline CoCP includes information about drainage during construction.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT10	Where trenchless techniques are proposed for Environment Agency Main Rivers, the following distances will be used: <ul style="list-style-type: none"> • 8 m from the bank of the Environment Agency Main River or landward toe of any associated flood defence structure; • 16 m from tidal Environment Agency Main Rivers or the landward toe of any flood defences, where the Main River is a sea defence structure; and • a minimum of 2 m vertical clearance will be maintained below the hard bed of all Environment Agency Main Rivers, including the landward toe of any associated flood defences. Final vertical clearance depths beneath Environment Agency Main Rivers will be identified during detailed design stage, in consultation with the Environment Agency, to ensure the export cables remain buried for the operational lifetime of the project.	DCO Schedules 2A and 2B, Requirement 8 (Code of Construction Practice)
CoT11	An Outline Operational Drainage Management Plan for the substation sites has been prepared and submitted with the application for development consent. The Plan will include measures to ensure that existing land drainage is reinstated and/or maintained. This will include measures to limit discharge rates and attenuate flows to maintain greenfield runoff rates at the onshore substations. It will also include measures to control surface water runoff, including measures to prevent flooding of the working areas or offsite and to ensure any runoff is treated appropriately. Detailed Operational Drainage Management Plan(s) will be developed in accordance with the Outline Operational Drainage Management Plan and in line with the latest relevant drainage guidance notes in consultation with the Environment Agency and the Lead Local Flood Authority (Lancashire County Council).	DCO Schedules 2A & 2B, Requirement 20 (Outline Operational Drainage Management Plan)
CoT12	The onshore export cables and the 400 kV grid connection cables will be completely buried underground for the entire length. No overhead pylons will be installed as part of the Transmission Assets.	DCO Schedule 1, Part 1, Authorised Development

Commitment number	Mitigation measure	How will this commitment be secured?
CoT14	Joint bays will be completely buried, with the land above reinstated. An inspection cover will be provided on the surface for link boxes for access during operation and maintenance phase.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT24	Where practicable, during construction, access routes within the onshore export cable corridor and 400 kV grid connection corridor (i.e. for example, the use of haul roads) will be used, to minimise potential impacts to the local road network.	DCO Schedules 2A & 2B, Requirement 9 (Traffic and Transport) Access to Works Plan
CoT27	All temporary compounds will be removed and sites will be reinstated when construction has been completed.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice) DCO Schedules 2A & 2B, Requirement 16 (Restoration of land used temporarily for construction)
CoT35	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. The Outline CoCP includes measures to maintain and address: <ul style="list-style-type: none"> • [...]flood protection and control measures; • water environment and drainage[...] 	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT36	Onshore Decommissioning Plan(s) will be developed prior to decommissioning. The Onshore Decommissioning Plan(s) will include provisions for the removal of all onshore above ground infrastructure and the decommissioning of below ground infrastructure (if and where relevant and practicable), and details relevant to flood risk, pollution prevention and avoidance of ground disturbance. The Onshore Decommissioning Plan(s) will be in line with the latest relevant available guidance.	DCO Schedules 2A & 2B, Requirement 22 (Onshore decommissioning)
CoT39	Fences, walls, ditches and drainage outfalls will be retained at the landfall and along the onshore export cable corridor and 400 kV grid connection cable corridor, where possible. Where it is not reasonably practicable to retain them, any damage will be repaired and reinstated as soon as reasonably practical. The Environment Agency must be notified if damage occurs to any Environment Agency main river or related flood infrastructure.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

Commitment number	Mitigation measure	How will this commitment be secured?
CoT44	The Project Description (Volume 1, Chapter 3 of the Environmental Statement) sets out that the installation of the offshore export cables under Lytham St Annes SSSI and the St Annes Old Links Golf Course will be undertaken by direct pipe trenchless installation technique. The exit pits associated with the direct pipe installation will be at least 100 m seaward of the western boundary of the SSSI.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT82	Where trenchless techniques are proposed for crossing ordinary watercourses, the entry and exit pits will be set back a minimum of 8 m from the bank of the watercourse. These crossings are detailed in the Onshore Crossing Schedule. Where required, geomorphological surveys will be undertaken on ordinary watercourses that may be crossed by trenched techniques. These will be used to inform detailed designs prior to construction.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice); DCO Schedule 10
CoT84	An Outline Code of Construction Practice (CoCP) has been prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. In order to manage impacts to field drainage, the Outline CoCP stipulates field drainage plans will be developed in consultation with the relevant landowners. If required, additional field drainage will be installed to ensure the existing drainage of the land is maintained during and after construction.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT86	An Outline Code of Construction Practice (CoCP) will be prepared and submitted with the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. Where required, trenched techniques may be used for minor ditches or smaller watercourses that are frequently dry. In these cases, measures will be implemented to protect water quality and flow and these will be detailed within the Outline CoCP.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT90	The Project Description (Volume 1, Chapter 3 of the Environmental Statement) sets out that the installation of the 400 kV Grid Connection Cable Corridor beneath the River Ribble will be undertaken by direct pipe or micro tunnel trenchless installation techniques.	DCO Schedules 2A & 2B, Requirement 5(3)(Detailed design parameters onshore); and Requirement 8 (Code of Construction Practice)"

Commitment number	Mitigation measure	How will this commitment be secured?
CoT95	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. The Outline CoCP includes that during the construction phase the Principal Contractor(s) will sign up to the Flood Warning Service and will be alerted by a phone call or text when a Flood Warning becomes active. The flood warning will be applied to the entire Onshore Infrastructure Area located within Flood Zones 2 and 3 to enable site personnel to be evacuated from the site in a timely manner prior to a flood event occurring, if appropriate.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
CoT97	The Outline Code of Construction Practice (CoCP) has been submitted as part of the application for development consent. Detailed CoCP(s) will be developed in accordance with the Outline CoCP. The Detailed CoCPs detail that where necessary at the compounds located within the landfall area, construction measures will be adopted to maintain the existing level of flood protection during construction. These measures will be discussed with the Environment Agency. If applicable, these measures could include scheduling work windows against tide times and briefing site personnel regarding weather conditions, tide times and heights. If a Flood Warning/Flood Alert is issued for the 'Lancashire coastline at Lytham St. Annes, along the coast from Squires Gate to Warton Bank' Flood Warning Area (reference 012FWCTL13A) and the 'Coast at Lytham St Annes' Flood Alert area (reference 012WACLS) works within the relevant areas within the landfall area would also be stopped whilst the Flood Warning/Flood Alert is active.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)
Secondary measures		
CoT41	Where the onshore export cable corridor or 400 kV grid connection cable corridor crosses sites of particular sensitivity (e.g. embanked Environment Agency surface watercourses, Sites of Special Scientific Interest or groundwater inner Source Protection Zones) hydrogeological risk assessment(s) will be undertaken to inform a site-specific crossing method statement(s) where required. These will be agreed with the relevant stakeholders prior to construction.	DCO Schedules 2A & 2B, Requirement 8 (Code of Construction Practice)

1.9 Sequential test and exception test

1.9.1 Site Vulnerability

- 1.9.1.1 In accordance with the Development Vulnerability Categories within Annex 3: The Transmission Assets are classified as 'essential infrastructure'.
- 1.9.1.2 The NPS and NPPF requires the Local Authority to apply the Sequential and Exception Test in consideration of new development. The aim of the test is to steer new development to areas at the lowest probability of flooding.
- 1.9.1.3 According to Annex 3: Flood risk vulnerability classification of the NPPF, the Morecambe onshore substation is classified as 'Essential Infrastructure' and as such is acceptable within Flood Zones 1 and 2. The exception test is required if development is proposed within Flood Zone 3.

1.9.2 Sequential test

Morgan onshore substation

- 1.9.2.1 The site selection process for the onshore substations is detailed within Volume 1, Annex 4.3: Selection and Refinement of Onshore Infrastructure of the ES. A sequential approach has been applied to Morgan onshore substation whereby the onshore substation development platform plus ~~associated access/egress and~~ surface water attenuation is located within Flood Zone 1 and has a low risk of flooding from all assessed sources. In relation to the Morgan onshore substation development platform ~~and associated access/egress~~, the sequential test is considered to be passed.
- 1.9.2.2 During the initial route selection process the Morgan onshore substation access track was located on land assessed as Flood Zone 1, and at low risk of other forms of flooding (surface water, reservoir etc.). Following the publication of the updated Environment Agency's Flood Map for Planning in March 2025, a section of the Morgan onshore substation temporary and permanent access tracks is now located in an area of Flood Zone 3a and 3b. The updated Flood Zone is associated with out of bank flooding from a tributary of Dow Brook. The access track provides the most direct route to the Morgan onshore substation, which has itself been sited to avoid areas of higher flood risk and is wholly located within Flood Zone 1. Alternative routes would be longer in length (requiring additional land take) and would still require a crossing of the aforementioned flood zone.
- 1.9.2.3 Due to existing development bounding the west and the Dow Brook located adjacent to the east, there are no other reasonable available sites which the temporary and permanent access tracks can be located to provide access between the onshore substation and public highway network. The access track being located in an area of Flood Zone 3a and 3b does not change the outcomes and as such, these elements of the Morgan onshore substation are considered to pass the sequential test.
- ~~1.9.2.2~~ 1.9.2.4 The temporary construction compounds are located Flood Zone 1, 2 and 3a and are required to enable construction of the onshore substation. The temporary compounds will be decommissioned prior

to ~~2032~~2036 when the Morgan Offshore Wind Project and the Morecambe Offshore Windfarm intend to be fully operational. Due to the nature of temporary construction compounds, there are no other reasonable available sites which provide access to the construction activities. As such, this aspect of enabling works is considered to pass the sequential test.

Morecambe onshore substation

~~1.9.2.3~~1.9.2.5 The site selection process for the onshore substations is detailed within Volume 1, Annex 4.3: Selection and Refinement of Onshore Infrastructure of the ES. A sequential approach has been applied to Morecambe onshore substation whereby the onshore substation development platform, associated surface water attenuation and temporary construction compounds are located within Flood Zone 1 and have a low risk of flooding from all other sources. The sequential test is considered to be passed for these elements of the Morecambe onshore substation.

~~1.9.2.4~~1.9.2.6 The Morecambe onshore substation temporary and permanent access tracks are routed across Flood Zone 3a and 3b. The permanent use would be for heavy goods vehicle and abnormal loads deliveries only and therefore operational use would be rare. Due to existing development bounding the south, west and north and the Dow Brook located adjacent to the east, there are no other reasonable available sites which the temporary and permanent access tracks can be located to provide access between the onshore substation and public highway network. As such, these elements of the Morecambe onshore substation are considered to pass the sequential test.

Landfall, onshore cable corridor and 400 kV export cable corridor

~~1.9.2.5~~1.9.2.7 The site selection process for the onshore substations is detailed within Volume 1, Annex 4.3: Selection and Refinement of Onshore Infrastructure of the ES. Existing development including infrastructure, industry, commercial and residential buildings are located throughout the wider area and due to the linear nature of the project, the site selection process has been sequentially steered away from these areas to prevent disruption to infrastructure, services and occupants of the wider area. The landfall and National Grid substation at Penwortham are required to be connected by the onshore export cable corridor and 400 kV grid connection cable corridor and there are no reasonably available routes available in which cables can traverse without crossing areas of Flood Zone 3 (Flood Zones 3a and 3b).

~~1.9.2.6~~1.9.2.8 Furthermore, no permanent above ground development will occur as a result of construction activities associated with landfall, the onshore export cable corridor and 400 kV grid connection cable corridor and flood risk will only be temporarily increased until ~~2032~~2036 when the construction phase ends. The sequential test for the landfall, onshore export cable corridor and 400 kV are therefore considered passed.

1.9.3 Exception test

- 1.9.3.1 According to Table 3: Flood risk vulnerability and flood zone compatibility of the NPPF, 'essential infrastructure' is acceptable within Flood Zones 1 and 2. The exception test is required if development is proposed within Flood Zone 3.
- 1.9.3.2 the onshore substation development platform plus associated access/egress and surface water attenuation is located within Flood Zone 1 and has a low risk of flooding from all other sources and as such the application of the exception test is not required for this aspect of development.
- 1.9.3.3 The PPG advises that 'essential infrastructure' development can be considered appropriate in Flood Zone 3a and 3b, following satisfactory application of the exception test. The Exception test aims to ensure that more vulnerable property types are not allocated to areas at high risk of flooding. For the exception test to be passed the following must be met.
- It must be demonstrated that the development provides wider sustainability benefits to the community that outweigh flood risk, informed by a SFRA where one has been prepared.
 - A site-specific flood risk assessment must demonstrate that the development will be safe for its lifetime taking account of the vulnerability of its users, without increasing flood risk elsewhere, and, where possible, will reduce flood risk overall.
- 1.9.3.4 With reference to point (a), the Transmission Assets are required to connect two nationally significant offshore wind farms to the national grid and will contribute towards meeting the UK Government's targets for generating energy from a renewable energy source; please see Section 3.3 of Volume 1, Chapter 3: Project description of the ES.
- 1.9.3.5 Furthermore, the Transmission Assets will contribute towards meeting the UK Government's targets for generating energy from a renewable energy source; they will generate increased employment opportunities and supply chain demand during its construction phase and operation and maintenance phase. For more information, please see Volume 4, Chapter 2: Socio-economics of the ES. Therefore, point (a) of the exception test is considered to be satisfied.
- 1.9.3.6 Point (b) is discussed within the substations below.

Morgan onshore substation

- 1.9.3.7 With reference to point (b), the [temporary and permanent access track and temporary construction compounds](#) to enable the construction of the Morgan onshore substation are located within Flood Zone 1, 2, [3a and 3b](#).
- 1.9.3.8 Flood risk is fluvial in nature from the Dow Brook. To ensure the fluvial floodplain capacity is maintained and flow conveyance is unaffected by development, no profiling of ground levels within the Environment Agency Flood Map for Planning Flood Zone 3 ([further assessed as Flood Zone 3a and 3b](#)) in association with temporary construction compounds [and temporary and permanent access tracks](#). Additional commitments to be implemented during the construction phase are referenced within **Table 1.18** and set out in Outline Code of Construction Practice (document reference J1) that will be submitted

to the LPAs for approval with consultation with the Environment Agency and LLFA prior to the commencement of works.

Morecambe onshore substation

- 1.9.3.9 With reference to point (b), the temporary and permanent Morecambe onshore substation access and egress is located within Flood Zone 1, 2, ~~and 3a and 3b~~. An egress to the existing highways network is required to enable access to the Morecambe onshore substation by HGVs. The permanent and temporary access tracks are therefore unable to be routed between the Morecambe onshore substation and Preston New Road (A584) without crossing areas within Flood Zone 3a and 3b.
- 1.9.3.10 Flood risk is both fluvial and tidal. To ensure the fluvial floodplain capacity is maintained and flow conveyance is unaffected by development, no profiling of ground levels within the Environment Agency Flood Map for Planning Flood Zone 3 is proposed in association with temporary and permanent access tracks.
- 1.9.3.11 The permanent and temporary access track via Preston New Road is located within Flood Zones 1, 2, ~~and 3a and 3b~~ and is to serve as access to the Morecambe onshore substation for HGVs. During construction, If a Flood Warning/Flood Alert is issued for the 'Lancashire coastline at Lytham St. Annes, along the coast from Squires Gate to Warton Bank' Flood Warning Area (reference 012FWCTL13A) and the 'Coast at Lytham St Annes' Flood Alert area (reference 012WACLS) works within the relevant areas within the landfall area would also be stopped whilst the Flood Warning/Flood Alert is active (CoT97). The permanent use would be for heavy goods vehicle and abnormal loads deliveries only and therefore operational use would be rare and an outline operational drainage management plan (document reference J10) has been submitted with the application.
- 1.9.3.12 Additional commitments are referenced within **Table 1.27** and set out in Outline Code of Construction Practice (document reference J1) that will be submitted to the LPAs for approval with consultation with the Environment Agency and LLFA prior to the commencement of works.

Landfall, onshore export cable corridor and 400 kV grid connection cable corridor

- ~~1.9.3.13~~ With reference to point (b) (in **paragraph 1.9.3.3**), the development is to connect the offshore wind farms to the national grid and therefore is unable to be routed without crossing areas within Flood Zone 3a and 3b. The following components ~~are located partially within Flood Zone 3a:~~
- 1.9.3.13 located within Flood Zone 3 have been further assessed to be partially located within Flood Zone 3b:
- The onshore export cable corridor;
 - The 400kv grid connection cable corridor;
 - Areas of temporary construction, and operational access tracks;
 - Temporary construction compounds;

~~The onshore export cable corridor;~~

~~Areas of the 400kv grid connection cable corridor;~~

~~Areas of temporary construction, and operational access tracks;~~

~~Temporary construction compounds;~~

~~The following components are located within Flood Zone 3b:~~

~~A small extent of the 400kv grid connection cable corridor in proximity to the River Ribble and Savick Brook;~~

~~An operational access track located to the south of the River Ribble;~~

~~Portions of two 400kv grid connection temporary construction access tracks; and~~

~~Two temporary construction compounds located to the south of the River Ribble.~~

- 1.9.3.14 The installation of below ground cables will be undertaken during the construction stage, with no permanent above ground structures proposed. The majority of the construction works are within agricultural land however, there will be no changes to existing land use once cables are installed, as per CoT14. Once installed, the landfall and onshore cable corridors do not increase flood risk to the surrounding area and has negligible risk of flooding to and from the development.
- 1.9.3.15 Any alterations in the existing surface water drainage regime associated with the installation of the below ground cables are expected to be only during the construction stage and thus temporary in nature. Any increase in runoff from the onshore cable corridors during construction will be managed through commitments listed within **Table 1.44** and set out in Outline Code of Construction Practice (document reference J1) that will be submitted to the LPAs for approval with consultation with the Environment Agency and LLFA prior to the commencement of works.
- 1.9.3.16 Site workers will be present within areas of the landfall, onshore export cable corridor and 400 kV grid connection cable corridor at risk of fluvial and tidal flooding (Flood Zone 2 and ~~3a and 3b~~) during the construction phase of the development. Occasional operation and maintenance activities are also expected to take place at the landfall, onshore export cable corridor and 400 kV grid connection cable corridor. As outline in the outline operational drainage management plan (document reference J10), the onshore export cables and 400 kV grid connection cables will be installed below ground, and the existing land cover will be reinstated at surface level, in line with best practice, during the construction phase. On this basis it is not considered necessary to provide permanent surface water management measures for the onshore cable route.
- 1.9.3.17 Additional commitments are referenced within **Table 1.27** and set out in Outline Code of Construction Practice (document reference J1) that will be submitted to the LPAs for approval with consultation with the Environment Agency and LLFA prior to the commencement of works.

Exception test part (b)– conclusion

- 1.9.3.18 This FRA and the mitigation measures proposed demonstrates that the development will be safe, without increasing flood risk elsewhere. Therefore, point (b) of the exception test for the temporary construction compounds is considered to be satisfied.

1.10 Summary and conclusions

1.10.1 Summary

1.10.1.1 A site-specific FRA in accordance with NPS EN-1, the NPPF and associated PPG has been undertaken for the study area which incorporates the following aspects of the Transmission Assets.

- The area of land to be temporarily or permanently occupied during the construction, operation and maintenance and decommissioning phases of the Transmission Assets.
- Flood risk receptors located within 250 m of the following elements located within the intertidal infrastructure area and onshore infrastructure area:
 - Landfall, including up to six TJBs and two associated compounds and four compounds to the west of TJBs to MLWS;
 - onshore export cable corridor: these cables will link the landfall via TJBs and the onshore substations;
 - 400 kV grid connection cables: these 400 kV cables will connect the onshore substations to the existing National Grid Penwortham substation; and
 - Associated temporary construction compounds and construction access tracks
- Flood risk receptors located within 1 km of the Morgan and Morecambe onshore substations which are also are located within the onshore infrastructure area, plus:
 - access/egress, temporary construction compounds and construction access tracks associated with the onshore substations.

1.10.1.2 In accordance with the guidance on development and flood risk (PPG Flood risk and coastal change), this FRA demonstrates the following.

1.10.2 Fluvial and tidal flood risk

1.10.2.1 ~~Environment Agency flood model data indicates that a~~ [The updated Flood Map for Planning shows a](#) proportion of the development is located within Flood Zone 1 (low risk). However, partial extents of the development are located within Flood Zone 2 (medium risk) and Flood Zone 3 (including Flood Zones 3a and 3b) (high risk). Areas of risk are associated with tidal flooding from the Ribble Estuary causing flooding to main rivers and ordinary watercourses that run through the onshore infrastructure area. Within the intertidal infrastructure area, the Irish Sea poses flood risk via tidal flooding along the coastline.

1.10.2.2 The majority of main rivers are bounded by Environment Agency flood defences which provide varying levels of protection to the development.

1.10.2.3 Phasing between the Transmission Assets and Penwortham Flood Defence Scheme have been confirmed to be different, minimising the chance of interaction between the schemes.

1.10.2.4 In summary:

- the landfall is assessed to partially be at risk of tidal flooding during construction;
- the onshore export cable corridor is at risk of tidal flooding during construction,
- the [access tracks serving](#) Morgan onshore substation is assessed to partially be at risk of fluvial flooding during [the](#) construction [and operation and maintenance phases](#);
- [the access tracks serving](#) ~~the~~ Morecambe onshore substation is assessed at to partially be at risk of fluvial and tidal flooding during the [construction and](#) operation and maintenance phases; and
- 400 kV grid connection cable corridor are at risk from tidal and fluvial flooding during construction.

1.10.2.5 However, with mitigation measures CoT02 CoT06, CoT08, CoT09 CoT10, CoT12, CoT14 CoT27 CoT35, CoT36, CoT95 and CoT97 (as presented within **Section 1.8, Table 1.44** and to be secured through requirements of the DCO) fluvial and/or tidal risk to the Transmission Assets is considered to be low.

1.10.3 Groundwater flood risk

1.10.3.1 Groundwater flood risk mapping included within the Groundsure Enviro and Geo Insight report shows the western extent of the study area has a 'low' risk of groundwater flooding. The eastern extent of the Transmission Assets has a 'moderate' to 'high' risk of groundwater flooding, associated with the water table being located closer to the surface within proximity to the Ribble Estuary.

1.10.3.2 Considering the implementation of commitments CoT09, CoT35, CoT36 and CoT41 (as presented within **Section 1.8, Table 1.44** and to be secured through requirements of the DCO) the overall risk of flooding from groundwater has been assessed to be low for the onshore substation sites and very low for the landfall, onshore export cable corridor and 400 kV grid connection cable corridor.

1.10.4 Surface water flood risk

1.10.4.1 As shown within the Environment Agency Long Term Flood Risk mapping, areas within the study area have been identified as being at low to high risk of surface water flooding. These areas are associated with out-of-bank flows from ordinary watercourses and surface water ponding.

1.10.4.2 During the construction phase of the onshore export cable corridor and 400 kV grid connection cable corridor, CoT08, CoT09, CoT24, CoT27, CoT35 and CoT36 (as presented within **Section 1.8, Table 1.44** and to be secured through requirements of the DCO) will ensure surface water will not be adversely affected. As such, flood risk from surface water sources is considered to be low.

1.10.5 Reservoir flood risk

- 1.10.5.1 Environment Agency reservoir mapping shows that during a wet scenario, a significant portion of the study area is expected to become inundated. Water is shown to extend north and south from the River Ribble and encompass approximately 460 ha of land. There are additional small portions of land around the Main Drain in the west of the study area that are also shown to be affected during the wet scenario.
- 1.10.5.2 Due to the regular inspection and maintenance regime in place on large reservoirs, the likelihood of catastrophic failure and therefore risk of flooding to the site from this source is unlikely to occur. For this reason, risk of flooding from reservoirs is considered to be very low.

1.10.6 Flood risk from sewers and water main failure

- 1.10.6.1 United Utilities operate public sewer assets and water supplies in the study area. However, the majority of the cable corridor is predominantly located within agricultural land. With the implementation of CoT09, CoT35 and CoT36 (as presented within **Section 1.8, Table 1.44** and to be secured through requirements of the DCO), flood risk from this source is assessed to be very low.

1.10.7 Flood risk from artificial sources

- 1.10.7.1 Field drainage is expected to be present within agricultural land within the study area and could pose localised sources of flooding if impacted during construction. CoT09, CoT35, CoT36 and CoT84 (as presented within **Section 1.8, Table 1.44** and to be secured through requirements of the DCO) are expected to prevent impacts to field drainage. The landfall and onshore cable corridor will not be impacted by or cause any adverse effect on field drainage following installation. As such, the risk of flooding from artificial sources is assessed to be very low.

1.10.8 Sequential and exception tests

- 1.10.8.1 The Transmission Assets are defined as 'essential infrastructure' in Table 2 of Planning Practice Guidance ID7 and is suitable for the present Flood Zone and the zone including climate change, subject to an exception test.
- 1.10.8.2 The Morgan onshore substation [temporary and permanent access tracks and](#) temporary construction compounds are partially located within Flood Zone 3a and 3b. There are no other reasonable available sites which the temporary construction compounds can be located to provide access to the construction activities. As such, these elements of the Morgan onshore substation are considered to pass the sequential test.
- 1.10.8.3 The exception test has been undertaken and based on sustainability grounds and demonstration that the temporary construction compounds will not increase flood risk elsewhere during construction activities, and appropriate mitigation measures are implemented, the exception test is deemed to be passed.

- 1.10.8.4 The Morecambe onshore substation temporary and permanent access tracks are routed across Flood Zone 3a and 3b. The permanent use would be for heavy goods vehicle and abnormal loads deliveries only and therefore operational use would be rare. There are no other reasonable available sites which the temporary and permanent access tracks can be located to provide access between the onshore substation and public highway network. As such, these elements of the Morecambe onshore substation are considered to pass the sequential test.
- 1.10.8.5 The exception test has been undertaken and based on sustainability ground and demonstration that the temporary and permanent access tracks will not increase flood risk elsewhere for the lifetime of development, and appropriate mitigation measures are implemented, the exception test is deemed to be passed.
- 1.10.8.6 The Transmission Assets onshore export cable corridor and 400 kV grid connection cable corridor will connect the offshore wind farms from landfall to the National Grid Penwortham substation and therefore are unable to be routed without crossing areas within Flood Zone 3a and 3b. This does not increase flood risk to the surrounding area and has negligible risk of flooding on the development. On this basis, the sequential test and exception test are determined to be passed.

1.10.9 Surface water drainage

- 1.10.9.1 The drainage strategies for the onshore substations are presented within the Outline Operational Drainage Management Plan (document reference J10) and are to be secured through requirements of the DCO.

1.10.10 Conclusion

- 1.10.10.1 Proposed mitigation measures will reduce any adverse impacts caused by the construction of the Transmission Assets. As a result, these aspects of the Transmission Assets have a low to very low risk of flooding, and flood risk will not be increased as a result of development.
- 1.10.10.2 The FRA and supporting documentation demonstrate that the Onshore Infrastructure Area study area meets the requirements of the NPS EN-1, the NPPF and the associated PPG.

1.11 References

Blackburn with Darwen Council, Blackpool Council, Lancashire County Council (2021) Local Flood Risk Management Strategy for Lancashire 2021-2027. Available online: <https://www.lancashire.gov.uk/media/928565/lancashire-flood-risk-management-strategy-2021-2027-final-v2.pdf> Accessed on 29 August 2024

Blackpool Council (2014) Strategic Flood Risk Assessment. Available online: <https://www.blackpool.gov.uk/Residents/Planning-environment-and-community/Documents/EB027-SFRA.pdf> Accessed on 29 August 2024

British Geological Survey (2023) Geoindex Onshore Mapping. Available online: [\[Redacted URL\]](#) Accessed on 29 August 2024

CIRIA (2001) Report C532 Control of water pollution from construction sites. London, CIRIA.

CIRIA (2015a) Report C753 The SuDS manual. London, CIRIA.

CIRIA (2015b) Report C741 Environmental good practice on site guide. 4th ed. London, CIRIA.

Defra (2011) National Standards for sustainable drainage systems. Designing, constructing, operating and maintaining drainage for surface runoff. London, Department for Environment Food and Rural Affairs.

Defra (2015) Sustainable Drainage Systems: Non-statutory technical standards for sustainable drainage systems. Available online:
https://www.gov.uk/government/uploads/system/uploads/attachment_data/file/415773/sustainable-drainagetechnical-standards.pdf Accessed on 29 August 2024

Department for Business, Energy and Industrial Strategy (2021a) Draft Overarching National Policy Statement for Energy (NPS EN-1). Available online:
https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment_data/file/1015233/en-1-draft-for-consultation.pdf Accessed on 29 August 2024

Department for Business, Energy and Industrial Strategy (2021b) Draft National Policy Statement for Renewable Energy Infrastructure (NPS EN-3). Available online:
https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment_data/file/1015236/en-3-draft-for-consultation.pdf Accessed on 29 August 2024

Department for Energy Security and Net Zero (2024a) Overarching National Policy Statement for Energy (NPS EN-1). Available online:
<https://www.gov.uk/government/publications/overarching-national-policy-statement-for-energy-en-1> Accessed on 29 August 2024

Department for Energy Security and Net Zero (2024b) National Policy Statement for renewable energy infrastructure (NPS EN-3). Available online:
<https://www.gov.uk/government/publications/national-policy-statement-for-renewable-energy-infrastructure-en-3> Accessed on 29 August 2024

Department for Energy Security and Net Zero (2024c) National Policy Statements for Electricity Networks Infrastructure (NPS EN-5). Available online:
<https://www.gov.uk/government/publications/national-policy-statement-for-electricity-networks-infrastructure-en-5> Accessed on 29 August 2024

Department for Levelling Up, Housing and Communities (2023) National Planning Policy Framework. Available online: <https://www.gov.uk/guidance/national-planning-policy-framework> Accessed on 29 August 2024

Department for Levelling Up, Housing and Communities and Ministry of Housing, Communities and Local Government (2014) Flood risk and coastal change. Available online: <https://www.gov.uk/guidance/flood-risk-and-coastal-change> Accessed on 29 August 2024.

Department for Levelling Up, Housing and Communities and Ministry of Housing, Communities and Local Government (2021) Planning Practice Guidance.
<https://www.gov.uk/government/collections/planning-practice-guidance>

Environment Agency (2024a) Catchment Data Explorer. Available online:
<https://environment.data.gov.uk/catchment-planning> Accessed on 29 August 2024

Environment Agency (2024b) Climate change allowances for peak rainfall in England. Available online: <https://environment.data.gov.uk/hydrology/climate-change-allowances/rainfall> Accessed on 29 August 2024

Environment Agency (2024c) Climate change allowances for peak river flow in England. Available online: <https://environment.data.gov.uk/hydrology/climate-change-allowances/river-flow> Accessed on 29 August 2024

Environment Agency (2024d) Flood Map for Planning. Available online: <https://flood-map-for-planning.service.gov.uk/> Accessed on 29 August 2024

Environment Agency (2024e) Long Term Flood Risk Map. Available online: <https://check-long-term-flood-risk.service.gov.uk/map> Accessed on 29 August 2024

[Environment Agency \(2024d\) Find a Shoreline Management Plan. Available online: https://environment.data.gov.uk/shoreline-planning](https://environment.data.gov.uk/shoreline-planning) Accessed on 29 August 2024

[Environment Agency \(2024d2025\) Flood Map for Planning. Available online: https://flood-map-for-planning.service.gov.uk/](https://flood-map-for-planning.service.gov.uk/) Accessed on 29 07 August May 20254

[Environment Agency \(2024e2025\) Long Term Flood Risk Map. Available online: https://check-long-term-flood-risk.service.gov.uk/map](https://check-long-term-flood-risk.service.gov.uk/map) Accessed on 29 07 August May 20254

~~Environment Agency (2024f) Find a Shoreline Management Plan. Available online: https://environment.data.gov.uk/shoreline-planning~~ Accessed on 29 August 2024

Flood Estimation Handbook Web Service (2023) Catchment mapping. Available online: [k/GB/map](#) Accessed on 29 August 2024

Fylde Borough Council (2018) Coastal Strategy. Available online: <https://new.fylde.gov.uk/wp-content/uploads/2018/10/Coastal-Strategy-2015-FINAL.pdf> Accessed on 29 August 2024

[Fylde Borough Council \(2011\) Strategic Flood Risk Assessment Level 1 https://new.fylde.gov.uk/wp-content/uploads/2025/01/1.-LHI-JBAU-XX-XX-RP-HM-0001-A1-C03-L1SFRA_MainReport.pdf](https://new.fylde.gov.uk/wp-content/uploads/2025/01/1.-LHI-JBAU-XX-XX-RP-HM-0001-A1-C03-L1SFRA_MainReport.pdf) Accessed on 07 May 2025

~~Fylde Borough Council (2011) Strategic Flood Risk Assessment. Available online: https://new.fylde.gov.uk/wp-content/uploads/2019/11/SFRA-2011.pdf~~ Accessed on 29 August 2024.

Fylde Borough Council (2021) Fylde Local Plan to 2032 (incorporating Partial Review) Available online: <https://new.fylde.gov.uk/wp-content/uploads/2021/12/Fylde-Local-Plan-to-2032-incorporating-Partial-Review-adopted.pdf> Accessed on 29 August 2024

Groundsure (2022) Enviro-Geo Insight reports. Brighton, Nile House.

Internal Drainage Board (2024) Internal Drainage Boards Map. Available online: [k/GB/map](#) Accessed May 2024

Lancashire County Council (2024) Flood risk asset register. Available online: <https://www.lancashire.gov.uk/council/strategies-policies-plans/environmental/flood-risk-asset-register/>. Accessed on 29 August 2024

Lancashire County Council (2024) Regulating Ordinary Watercourses in Lancashire. Available online: <https://www.lancashire.gov.uk/flooding/ordinary-watercourse-regulation/> Accessed on 29 August 2024

North West England and North Wales Coastal Group (2011) North West England and North Wales Shoreline Management Plan SMP2. Available at: [https://k/GB/map](#) -

f Accessed on 29 August 2024

Ordnance Survey (2024) 1:25 000 mapping. Available online: <http://bing.com/maps>
Accessed on 29 August 2024

Preston City Council, South Ribble Borough Council and Chorley Borough Council (2012) Central Lancashire Adopted Core Strategy. Available online:
<https://new.fylde.gov.uk/resident/planning/planning-policy-local-plan/adopted-fylde-local-plan-to-2032-incorporating-partial-review/> Accessed on 29 August 2024

Planning Inspectorate (2024) Nationally Significant Infrastructure Projects: Advice on the Water Framework Directive. Available online: <https://www.gov.uk/guidance/nationally-significant-infrastructure-projects-advice-on-the-water-framework-directive>. Accessed 23 September 2024.

Scott Wilson Group PLC on behalf of Preston City Council, South Ribble Borough Council and Chorley Borough Council (2007) Central Lancashire Strategic Flood Risk Assessment Level 1 Final Report. Available online: https://www.southribble.gov.uk/media/758/SRE042a-Central-Lancashire-Strategic-Flood-Risk-Assessment-2007/pdf/SRE042a_-_Central_Lancashire_Strategic_Flood_Risk_Assessment_-_2007.pdf?m=637479597051430000 Accessed on 29 August 2024

The National Soils Research Institute (2024) Soilscales viewer. Available online: